



Report

ENERGY FROM WASTE FACILITY – AIR QUALITY AND GREENHOUSE GAS ASSESSMENT

THE NEXT GENERATION

Job ID. 21292C

31 October 2016

PROJECT NAME: Energy from Waste Facility – Air Quality and Greenhouse Gas Assessment
JOB ID: 21292C
DOCUMENT CONTROL NUMBER: AQU-NS-001-21292C
PREPARED FOR: The Next Generation
APPROVED FOR RELEASE BY: D. Roddis
DISCLAIMER & COPYRIGHT: This report is subject to the copyright statement located at www.pacific-environment.com © Pacific Environment Operations Pty Ltd ABN 86 127 101 642

DOCUMENT CONTROL			
VERSION	DATE	PREPARED BY	REVIEWED BY
Final	08.09.2014	J. Firth	J. Barnett
Revision 1	03.03.2015	J. Firth	D. Roddis
Revision 2	26.03.2015	J. Firth	D. Roddis
Revision 3	30.09.2016	J. Firth, A. Rouggos	D. Roddis
Revision 4	27.10.2016	J. Firth, A. Rouggos	D. Roddis
Revision 5	31.10.2016	J. Firth	D. Roddis

Pacific Environment Operations Pty Ltd: ABN 86 127 101 642

BRISBANE

Level 1, 59 Melbourne Street, South Brisbane Qld 4101
 PO Box 3306, South Brisbane Qld 4101
 Ph: +61 7 3004 6400
 Fax: +61 7 3844 5858

Unit 1, 22 Varley Street
 Yeerongpilly, Qld 4105
 Ph: +61 7 3004 6460

ADELAIDE

35 Edward Street, Norwood SA 5067
 PO Box 3187, Norwood SA 5067
 Ph: +61 8 8332 0960
 Fax: +61 7 3844 5858

SYDNEY

Suite 1, Level 1, 146 Arthur Street
 North Sydney, NSW 2060
 Ph: +61 2 9870 0900
 Fax: +61 2 9870 0999

MELBOURNE

Level 10, 224 Queen Street
 Melbourne Vic 3000
 Ph: +61 3 9036 2637
 Fax: +61 2 9870 0999

PERTH

Level 1, Suite 3
 34 Queen Street, Perth WA 6000
 Ph: +61 8 9481 4961
 Fax: +61 2 9870 0999

EXECUTIVE SUMMARY

The Next Generation NSW Pty Ltd (TNG NSW) proposes to construct and operate an Energy from Waste (EfW) facility on land adjacent to the Genesis Xero Waste facility in Eastern Creek. This development site is part of a proposal to construct and operate NSW's largest EfW facility using residual waste as fuel which would otherwise be landfilled, to allow for a "green" electricity generation facility. The facility, fuelled by non-recyclable combustible waste material and will have a design capacity to process up to 1,350,000 tonnes of residual waste material per annum. Pacific Environment has been engaged by TNG NSW to prepare an Air Quality and Greenhouse Gas Assessment for the facility. Air quality impacts are assessed at the closest sensitive receptors, including locations such as schools and hospitals, located within the closest residential suburbs of Minchinbury and Erskine Park. Also included are the potential future receptors within the adjacent industrial estate.

The primary emissions from the EfW facility, as defined by emission limits for waste incineration set by the European Union (EU) Industrial Emissions Directive (IED; Directive 2010/75/EU), are anticipated to be as follows:

- Particulate matter (PM), assumed to be emitted as PM₁₀ and PM_{2.5}^a.
- Hydrogen Chloride (HCl).
- Hydrogen Fluoride (HF).
- Carbon Monoxide (CO).
- Sulfur Dioxide (SO₂)
- Oxides of nitrogen (NO_x) (expressed as Nitrogen Dioxide (NO₂)).
- Heavy metals (including Mercury (Hg), Cadmium (Cd), Arsenic (As) and Chromium (Cr).
- Gaseous and vaporous organic substances (expressed as total organic carbon (TOC)).
- Dioxins and furans.

In addition to the atmospheric emissions identified in the IED, other potential emissions that have been addressed include:

- Hydrogen sulfide (H₂S).
- Chlorine (Cl₂).
- Ammonia (NH₃).
- Polycyclic aromatic hydrocarbons (PAHs).

In March 2014 the NSW Environment Protection Authority (EPA) published its Energy from Waste Policy Statement ("the EfW Policy Statement"). The EfW Policy Statement requires that any facility proposing to recover energy from waste will need to meet current international best practice. The policy also requires that emissions from EfW facilities must satisfy, as a minimum, current emission limits prescribed by the POEO (Clean Air) Regulations.

The proposed technology for the EfW facility is based on existing facilities in the United Kingdom and Europe and will incorporate best available technology (BAT) for flue gas treatment. The flue gas treatment is designed to meet the in-stack concentrations limits for waste incineration set by the EU IED, which are generally more stringent than those prescribed within the POEO (Clean Air) Regulations. The flue gas treatment system includes:

- Selective Non-Catalytic Reduction (SNCR) for reducing emissions of oxides of nitrogen (NO_x).
- Dry lime scrubbing for reducing emissions of acid gases, including hydrogen chloride (HCl) and sulfur dioxide (SO₂).
- Activated carbon injection for reducing emissions of dioxins and mercury (Hg).

^a Particulate matter with an aerodynamic diameter of less than 10 and 2.5 micrometres respectively.

- Fabric filters for reducing emissions of particle matter (PM) and metals.
- Following flue gas treatment, emissions will be dispersed via a 100m stack.

A review of existing EfW facilities shows that the facility meets current international best practice and can satisfy the emission limit requirements of the IED.

The AERMOD atmospheric dispersion model was selected as a suitable dispersion model due to the source type, location of nearest receiver and nature of local topography.

Modelling predictions at sensitive receptors have been made and the results under normal operating conditions show:

- The maximum predicted 1-hour NO₂ is 21% of the impact assessment criterion, even when adopting the conservative assumption of 100% conversion from NO_x to NO₂
- The maximum predicted annual NO₂ is 5% of the impact assessment criterion.
- The maximum predicted 10-minute SO₂ is 1.5% of the impact assessment criterion, for 1-hour 1.3%, for 24-hour SO₂, 0.7% and for annual, 0.8%.
- The maximum predicted 24-hour PM is 0.1% of the impact assessment criterion for PM₁₀ and 0.2% of that for PM_{2.5}.
- The maximum predicted annual PM is less than 0.1% of the impact assessment criterion for PM₁₀ and 0.2% of that for PM_{2.5}.
- The maximum predicted CO for the 15-minute, 1-hour and 8-hour averaging periods are 0.1% or less than the relevant impact assessment criterion.
- The maximum predicted 24-hour HF is 9% of the impact assessment criterion, for 7-day 10%, for 30-day HF, 13% and for 90-day, 18%.

Modelling predictions for air toxics are assessed against the 99.9th percentile prediction, at and beyond the site boundary. The ambient concentration of H₂S is assessed against the 99th percentile prediction.

In summary, the modelling results show:

- The 99.9th percentile predicted HCl is 2% of the impact assessment criterion.
- The 99.9th percentile predicted cadmium (Cd) is 11% of the impact assessment criterion.
- The 99.9th percentile predicted mercury (Hg) is 0.5% of the impact assessment criterion.
- The 99.9th percentile predicted dioxins and furans are 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted total organic carbon (TOC; as benzene) is 0.01% of the impact assessment criterion.
- The 99.9th percentile predicted NH₃ is 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted PAH (as benzo(a)pyrene) is 0.4% of the impact assessment criterion.
- The 99th percentile predicted H₂S is 70% of the impact assessment criterion.

Cumulative predictions are also presented. There are no exceedances of the EPA criteria when the EfW contribution is added to maximum background concentrations under normal operating conditions.

The results of the modelling during upset conditions indicate that, under worst-case dispersion conditions, NO₂ and cadmium are predicted to exceed the NSW impact assessment criteria. A probabilistic approach has then been adopted, with results indicating that the probability of the above pollutants resulting in adverse impacts (i.e. the potential for upset conditions to coincide with worst-case dispersion conditions) would be less than 0.01%.

Additional modelling of a Regulatory Scenario indicates that application of the POEO emission limits within the Environmental Protection Licence for the facility would be sufficiently protective of health and environmental impacts while providing the facility with some operational flexibility.

The exception to this is cadmium, where an alternative in-stack concentration limit is provided.

Odour emissions from the EfW facility have been addressed in a stand-alone quantitative assessment (Pacific Environment, 2015a). The results of this assessment show that worst-case odour concentrations would be below the impact assessment criterion of 2 ou at nearest sensitive receptors.

A screening assessment of construction phase impacts identified no human receptors within 350 m of the boundary of the site. The screening assessment concluded no detailed assessment of construction phase **impact is required and routinely employed 'good practice' mitigation measures** for construction sites would be sufficient to control dust impacts to acceptable levels.

The operation of the facility would have a net positive GHG impact, potentially eliminating 3 million tonnes of carbon dioxide equivalents (CO₂-e) per annum. The emission intensity for electricity generated from the facility is lower than other non-renewable energy generators in NSW.

CONTENTS

1	INTRODUCTION	1
1.1	Background and Context	1
1.2	Assessment Requirements	1
2	TECHNICAL DESCRIPTION OF THE FACILITY	4
2.1	EfW Facility Overview	4
2.2	Flue Gas Treatment	5
2.3	Fuels	5
2.3.1	Design Fuel	6
2.3.2	Fuel Source Availability	6
2.4	Start-up / Shut-down Conditions	7
2.5	Upset Conditions	7
2.6	Emergency Conditions	7
3	LOCAL SETTING	10
4	LEGISLATIVE SETTING	12
4.1	Introduction	12
4.2	NSW EPA Energy from Waste Policy Statement	12
4.3	Emission Limits	14
4.4	Ambient Air Quality Criteria	16
4.5	Load Based Licensing	17
4.5.1	Hydrogen Sulfide	18
5	DISPERSION METEOROLOGY	19
5.1	Wind Speed and Wind Direction	19
5.2	Meteorological File for Modelling	20
5.3	Atmospheric Stability	23
6	EXISTING AIR QUALITY	26
6.1	Particulate Matter (PM ₁₀)	26
6.1.1	NSW OEH Monitoring at St Marys	26
6.1.2	NSW OEH Monitoring at Prospect	27
6.1.1	Industry Monitoring at Minchinbury	27
6.2	Particulate Matter (PM _{2.5})	28
6.3	Nitrogen Dioxide (NO ₂)	29
6.3.1	NSW EPA Monitoring at St Marys	29
6.3.2	NSW EPA Monitoring at Prospect	30
6.4	Sulfur Dioxide (SO ₂)	30
6.4.1	NSW EPA Monitoring at Prospect	30
6.5	Carbon Monoxide (CO)	30
6.5.1	NSW EPA Monitoring at Prospect	30
7	EMISSIONS TO AIR	31
7.1	Best Available Techniques	31
7.1.1	General	31
7.1.2	Flue Gas Treatment	32
7.2	Emissions Performance	35
7.3	Emissions during Normal Operations	35
7.4	Emissions during Start-up / Shut-down Conditions	37
7.5	Emissions during Upset Conditions	37
7.6	Emissions during operation of emergency diesel generators	38
7.7	NSW Clean Air Regulation in-stack Concentration Limits	39
7.8	Stack Parameters	40
7.9	Release of Dioxins/Furans	40
7.10	Treatment of Emissions of Oxides of Nitrogen (NO _x)	41

7.11 Treatment of dust deposition	41
7.12 Odour	41
7.13 Fugitive Dust Emissions	42
7.14 Emissions from Trucks Entering the Site	42
7.15 Construction	42
7.15.1 Construction Activities	43
7.15.2 Assessment Procedure	43
7.15.3 Step 1: Screening	44
8 MODELLING APPROACH	46
8.1 Modelling System	46
8.2 Building Wake Effects	46
8.3 Sub-hourly Predictions	47
9 LOCAL AIR QUALITY ASSESSMENT	48
9.1 Incremental Ground Level Concentrations	48
9.1.1 Normal Operations	48
9.1.2 Upset Conditions	65
9.1.3 Operation of Emergency Diesel Generators	66
9.1.4 POEO Emission Limits (Regulatory Scenario)	67
9.2 Cumulative Assessment	69
9.2.1 Normal Operations	69
9.2.2 Upset Conditions	70
9.2.3 POEO Emission Limits (Regulatory Scenario)	70
9.3 NO _x Load to Air Shed	72
9.3.1 Impacts on Regional Air Quality	72
9.3.2 Load Based Licensing	72
10 GREENHOUSE GAS ASSESSMENT	73
10.1 Introduction	73
10.2 Reporting Guidelines	73
10.3 Emission Estimates	74
10.3.1 Scope 1 GHG emissions from Waste Incineration	74
10.3.2 Scope 1 GHG Emissions (substitution of grid electricity)	74
10.3.3 Scope 1 GHG Emissions Diverted from Landfilling	75
10.3.4 Scope 3 GHG Emissions	76
10.3.5 Net GHG Emissions for EfW Facility	76
10.4 Benchmarking GHG intensity	76
11 CONCLUSION	79
12 REFERENCES	81
APPENDIX A GENERAL ARRANGEMENT OF EFW FACILITY	A-1
APPENDIX B ASSUMPTIONS	B-1
B.1 Assumptions	B-2
APPENDIX C RAMBOLL TECHNICAL MEMORANDA	C-1
APPENDIX D FUEL COMPOSITION	D-1
D.1 RAMBOLL Memo – Design Fuel Mix	D-4
APPENDIX E SENSITIVE RECEPTORS	E-1
APPENDIX F FIVE YEAR ANALYSIS OF METEOROLOGY	F-1
APPENDIX G SUMMARY OF IN-STACK CONCENTRATION ESTIMATES	G-1
APPENDIX H PERFORMANCE SPECIFICATIONS FOR EMERGENCY DIESEL GENERATORS	H-1
APPENDIX I SUMMARY OF EMISSIONS PERFORMANCE	I-1
I.1 Summary of Emissions Performance reported in WSP (2000)	I-2
I.2 Cadmium and metals emissions Performance in HZI Plants	I-3

I.3 Sample CEMS report from Riverside	I-4
APPENDIX J DETAILED MODELLING PREDICTIONS	J-1
J.1.1 Normal Operations	J-3
J.1.2 Upset Conditions	J-18
J.1.3 POEO Emission Limits	J-33

LIST OF FIGURES

Figure 2-1: Emergency diesel generator (QSK78)	9
Figure 3-1: Local setting and representative sensitive receptor locations	11
Figure 5-1: Wind roses for St Marys (2009)	21
Figure 5-2: Wind roses for St Marys (2013)	22
Figure 5-3: Annual statistics of 1/L by hour of the day	24
Figure 5-4: Annual distribution of stability type by hour of the day	24
Figure 6-1: 24 hour average PM ₁₀ concentrations – St Marys (2013)	27
Figure 6-2: 24-Hour PM ₁₀ monitoring at Minchinbury	28
Figure 6-3: 1-hour NO ₂ concentrations – St Marys (2013)	29
Figure 7-1: Steps in an assessment of construction dust (IAQM, 2014)	44
Figure 8-1: Visualisation of the Incorporation of EfW Building Dimensions within the Model	47
Figure 9-1: Maximum predicted Ground Level PM ₁₀ Concentration – µg/m ³	51
Figure 9-2: Maximum Predicted Ground Level PM _{2.5} Concentration – µg/m ³	52
Figure 9-3: Maximum Predicted Ground Level NO ₂ Concentration – µg/m ³	53
Figure 9-4: Maximum Predicted Ground Level SO ₂ Concentration – µg/m ³	54
Figure 9-5: Maximum Predicted Ground Level SO ₂ Concentration – µg/m ³	55
Figure 9-6: Maximum Predicted Ground Level CO Concentration – mg/m ³	56
Figure 9-7: Maximum Predicted Ground Level CO Concentration – mg/m ³	57
Figure 9-8: Maximum Predicted Ground Level HF Concentration	58
Figure 9-9: Maximum Predicted Ground Level HF Concentration	59
Figure 9-10: 99.9 th Percentile Predicted Ground Level Metals Concentration – mg/m ³	60
Figure 9-11: 99.9 th Percentile Predicted HCl and Dioxin/Furan Ground Level Concentration – mg/m ³	61
Figure 9-12: 99.9 th Percentile Predicted Ammonia Ground Level Concentration	62
Figure 9-13: 99.9 th Percentile Predicted PAH and VOC Ground Level Concentration	63
Figure 9-14: 99 th Percentile Predicted Hydrogen Sulfide Ground Level Concentration	64
Figure 9-15: Predicted cumulative PM ₁₀ at most affected sensitive receptor adopting POEO Emission Limits	71
Figure 10-1: Overview of Scopes and Emissions across a Value Chain	73
Figure 10-2: Projected NSW electricity consumption (AEMO, 2014)	77
Figure 10-3: Emission intensity comparison for existing / committed NSW generators	77
Figure 10-4: Net greenhouse gas emission estimates for the EfW facility on an annual basis	78
Figure J-1: Receptor locations shown in result tables	J-2

LIST OF TABLES

Table 1-1: Agency requirements	2
Table 4-1: Technical criteria as outlined in EfW Policy Statement	13
Table 4-2: POEO Clean Air Regulation Standards of Concentration	14
Table 4-3: IED Air Emission Limit Values	15
Table 4-4: EPA ambient impact assessment criteria	16
Table 4-5: PM _{2.5} advisory reporting standards	17
Table 4-6: Threshold limits for energy recovery from waste	17
Table 4-7: Odour performance criteria for the assessment of hydrogen sulfide	18
Table 5-1: Inverse of the Monin-Obukhov length L with respect to Atmospheric stability	23
Table 6-1: Annual average and maximum 24 hour average PM ₁₀ concentrations – St Marys (µg/m ³)	26
Table 6-2: Annual average and maximum 24 hour average PM ₁₀ concentrations (µg/m ³)	27
Table 6-3: Annual average and maximum 24 hour average PM _{2.5} concentrations (µg/m ³)	28
Table 6-4: Annual average and maximum 1 hour average NO ₂ concentrations – St Marys (µg/m ³)	29
Table 6-5: Annual average and maximum 1 hour average NO ₂ concentrations (µg/m ³)	30
Table 6-6: Annual average and maximum 1 hour average SO ₂ concentrations (µg/m ³)	30
Table 6-7: Maximum 8-hour average CO concentrations (mg/m ³)	30
Table 7-1: General good practice procedures / process control	31
Table 7-2: Best Available Techniques for EfW flue gas treatment (FGT)	33
Table 7-3: Flue Gas Treatment for existing EfW facilities	34
Table 7-4: Emission rates per stack during normal operations	37
Table 7-5: Emissions per stack during upset conditions	38
Table 7-6: Pollutant mass emission rates for each emergency diesel generator	39
Table 7-7: POEO (Clean Air) Regulation Emission Limits	39
Table 7-8: Stack parameters for modelling	40
Table 7-9: EfW facility construction timeframes	43
Table 9-1: Summary of predicted ground level concentrations during normal operations	49
Table 9-2: Summary of predicted ground level concentrations during upset conditions	65
Table 9-3: Conservative estimation of ground level concentrations during operation of emergency diesel generators	66
Table 9-4: Summary of predicted ground level concentrations at POEO emission limits	67
Table 9-5: Cumulative assessment for criteria pollutants during normal operations	69
Table 9-6: Cumulative assessment for criteria pollutants	70
Table 9-7: Cumulative assessment for criteria pollutants while at POEO Emission Limits	71
Table 10-1: Method 1 estimation of GHG emissions from waste incineration	74
Table 10-2: Estimation of GHG emissions (substitution of grid electricity)	75
Table 10-3: Method 1 estimation of methane emissions from landfill	76
Table 10-4: Estimation of net GHG emissions	76

1 INTRODUCTION

The Next Generation NSW Pty Ltd (TNG NSW) proposes to construct and operate an Energy from Waste (EfW) facility on land adjacent to the Genesis Xero Waste facility, located at Honeycomb Drive, Eastern Creek, approximately 36 km west of the Sydney CBD.

Pacific Environment has been engaged by TNG NSW to prepare an Air Quality and Greenhouse Gas Assessment as part of an Environmental Impact Statement (EIS), required under State Significant Development (SSD) provision in Schedule 1 of the State Environmental Planning Policy (State and Regional Development) 2011.

This assessment has followed the procedures outlined in the NSW Environment Protection Authority (EPA) document titled "Approved Methods and Guidance for the Modelling and Assessment of Air Pollutants in NSW" ("The Approved Methods", NSW DEC, 2005).

1.1 Background and Context

The proposed EfW facility has been designed to comply with the NSW Environment Protection Authority (EPA) *Energy from Waste Policy Statement* ("the EfW Policy Statement"; EPA, 2014).

The development involves the construction and operation of an electricity generation plant, which will allow for unsalvageable and uneconomic residue waste from the Genesis Xero Material Processing Centre (MPC) and external Waste Transfer Station (WTS) to be used for generation of electrical power. The EfW facility is proposed to be located on Lots 2 and 3, DP 1145808.

This development site is part of a proposal to construct and operate NSW's largest EfW facility using residual waste as fuel which would otherwise be landfilled, to allow for a "green" electricity generation facility. The facility, fuelled by non-recyclable combustible waste material and will have a design capacity to process up to 1,350,000 tonnes of residual waste material per annum. The proposed works will, in addition to the EfW facility, include the adoption of a plan of subdivision and the following ancillary works:

- Subdivision of the land
- Pedestrian footpaths and routes
- Internal roadways and weighbridges (x 2)
- Direct underpass connection (Precast Arch and Conveyor Culvert) between the proposed Facility and the Genesis MPC
- Staff car parking for 40 vehicles (including 3 visitor parking spaces and 2 disabled parking spaces)
- Water detention and treatment basin and
- Services (Sewerage, Water Supply, Communications, Power Supply)
- Signage
- CCTV and other security measures
- External lighting
- Hard and soft landscaping and biodiversity measures.

1.2 Assessment Requirements

The Air Quality and Greenhouse Gas Assessment is guided by the Director-General's Requirements (DGRs) and Agency requirements, as outlined in Table 1-1.

Table 1-1: Agency requirements

Government Agency	Requirement	Relevant Section
DP&I	Air Quality and Human Health - including:	
	- a quantitative assessment of the potential air quality and odour impacts for the development on surrounding landowners and sensitive receptors under the relevant Environment Protection Authority guidelines;	Section 9
	- a description of construction and operational impacts, including air emissions from the transport of materials;	Section 7 and 9
	- a human health risk assessment covering the inhalation of criteria pollutants and exposure (from all pathways i.e., inhalation, ingestion and dermal) to specific air toxics;	Standalone report - note ^b
	- details of any pollution control equipment and other impact mitigation measures for fugitive and point source emissions;	Section 7
	- a demonstration of how the waste to energy facility would be operated in accordance with best practice measures to manage toxic air emissions with consideration of the European Union's <i>Waste Incineration Directive 2000</i> and the Environment Protection Authority's draft policy statement <i>NSW Energy from Waste</i> ;	Section 7
	- an examination of best practice management measures for the mitigation of toxic air emissions;	Section 7
	- details of the proposed technology and a demonstration that it is technically fit for purpose.	Section 2
	Greenhouse Gas - including:	
- a full greenhouse gas assessment (including an assessment of the potential scope 1, 2 and 3 greenhouse gas emissions of the project, and an assessment of the potential impacts of these emissions on the environment	Section 10	
- a detailed description of the measures that would be implemented on site to ensure that the project is energy efficient.	Section 10.3	
EPA	Assess the risk associated with potential discharges of fugitive and point source emissions.	Section 9
	Assessment of risk relates to environmental harm, risk to human health and amenity. Justify the level of assessment undertaken on the basis of risk factors, including but not limited to: a. proposal location; b. characteristics of the receiving environment; and c. type and quantity of pollutants emitted.	Section 3, 4, 7 and 9
	Describe the receiving environment in detail. The Proposal must be contextualised within the receiving environment (local, regional and inter-regional as appropriate). The description must include but need not be limited to: a. meteorology and climate;	Section 6

^b A Human Health Risk Assessment has been prepared as a standalone assessment as part of the EIS.

<p>b. topography; c. surrounding land-use; receptors; and d. ambient air quality. e. Include a detailed description of the Proposal.</p>	
<p>All processes that could result in air emissions (including odour) must be identified and described. Sufficient detail to accurately communicate the characteristics and quantity of all emissions must be provided.</p>	Section 7
<p>Demonstrate that the proposed facility complies with the requirements of the NSW Energy from Waste <i>Draft Policy Statement</i> (2013). In particular: a. An international best practice techniques demonstration with respect to process design and control, emission control equipment design and control and emission monitoring with real time feedback to the controls of the process; and b. Energy Recovery Facility Technical Criteria.</p>	Section 4, 7, 9
<p>Include a detailed emissions inventory for the Proposal. All point and fugitive sources are to be included in the inventory together with estimates of emission concentration and rate of all air pollutants emitted.</p>	Section 7
<p>Any nominated controls must be explicitly linked to calculated emission reductions adopted in the air quality impact assessment emissions inventory, with all assumptions documented and justified.</p>	Section 7
<p>Include a consideration of 'worst case' emission scenarios and impacts at proposed emission limits.</p>	Section 9
<p>Account for cumulative impacts associated with existing emission sources as well as any currently approved developments linked to the receiving environment.</p>	Section 9
<p>Include air dispersion modelling where there is a risk of adverse air quality impacts, or where there is sufficient uncertainty to warrant a rigorous numerical impact assessment? Air dispersion modelling must be conducted in accordance with the Approved Methods or the Modelling.</p>	Section 8, 9
<p>An odour impact assessment must additionally have regard to the technical Framework and Notes for the assessment and Management of odour from discretionary sources in NSW (2006).</p>	Section 7.11
<p>Include a quantitative photochemical smog assessment in accordance with the Approved Methods for the Modelling and Assessment of Air Pollutants in NSW (2005).</p>	Standalone report – note ^c
<p>ODOUR A quantitative assessment of the potential odour impacts from the construction and operation of the plant on surrounding landowners and sensitive receptors.</p>	Section 7.11

^c An ozone impact assessment / photochemical smog assessment has been prepared as a standalone assessment, submitted as part of the EIS.

2 TECHNICAL DESCRIPTION OF THE FACILITY

2.1 EfW Facility Overview

The EfW facility will operate a well-established technology known as a moving grate system with water and air cooled grate bars. Residual waste fuel is gravity fed onto the incinerator grate. The grate is continually moving thus promoting continuous mixing of the residual waste fuel with the combustion air, extracted from the tipping hall and introduced from beneath the grate into the heart of the fire. Further air is injected just above the fire to promote mixing and complete combustion of the gases.

The turbine exhaust cooling system for the EfW facility is an Air Cooled Condenser (ACC) that does not require water and does not generate an effluent discharge. Furthermore there is no visual plume impact through the ACC, as there would be for an evaporative cooling tower.

Diesel generators are installed for start-up and to maintain the furnace temperature, if required. However, during normal operation no support fuel is required to maintain a minimum combustion temperature of 850°C.

Ash from the grate is discharged into a water filled quench bath from where it is moved by conveyor to the enclosed ash storage bunkers prior to being transported off site.

Hot gases from the combustion of the residual waste fuel pass through a heat recovery boiler. The temperature of the gases is reduced from over 850°C to around 150°C. The energy from the hot gases is transferred to the boiler to produce high pressure steam. This steam is fed to the steam turbine driven generator capable of generating around 137.3 MW, which, after supplying the site electrical load is exported to the National Grid.

The technology will have a design capacity to process up to 1,350,000 tonnes of residual waste material per annum. TNG NSW's proposed implementation will be to process up to 1,105,000 tonnes per annum, using a two phased approach:

- Phase 1 (lines 1 and 2) which will require 552,500 tpa as waste.
- Phase 2 (lines 1, 2, 3 and 4) which will require 1,105,000 tpa as waste.

The first phase will include the complete construction of the Tipping Hall and Waste Bunker and combustion Lines 1 and 2 comprising of two independent boilers, Flue Gas Treatment (FGT) systems, stack as well as one turbine and one Air Cooled Condenser (ACC) and all other auxiliary equipment. The second phase will comprise of installation of combustion lines 3 and 4 with again two independent boilers, FGT systems, stack as well as one turbine and one ACC and all other auxiliary equipment. This assessment addresses the EfW facility when all four lines are operational. Some wastes would be delivered directly to the facility (by truck) with the remaining transferred from the existing Genesis Facility either via a covered electrically powered conveyor or by truck.

Without any changes to the main process, the EfW facility will be configured so that it will be possible to export heat to nearby consumers.

Operation of the EfW facility will generate three types of solid waste by-products, while producing no excess effluent during operation:

- Bottom ash
- boiler ash
- flue gas treatment residues (APC residues).

The operational parameters of waste flow, combustion air and temperatures will be automatically controlled by the Distributed Control System based on the incoming waste parameters. This will provide the necessary combustion conditions and maintain the necessary temperature and residence time in the secondary combustion chamber. As part of the operational requirements, appropriate waste sorting

procedures will be refined to incorporate any Conditions of Consent issued by the Department of Planning and Environment.

The EfW facility will operate 24 hours a day, seven days a week, with occasional offline periods for maintenance. Over the entire year, it is assumed that the EfW facility would be operational for 8,000 hours as an annual average. Some residual waste fuels would be delivered directly to the EfW facility (by B-double) with the remaining transferred from the existing Genesis Xero Waste facility either via a covered electrically powered conveyor or by truck. It is anticipated that as a result of the EfW facility operations the site would receive a maximum of 252 trucks per day, comprising:

- 168 truck movements associated with the waste material
- 4 truck movements for miscellaneous deliveries such as hydrated lime or activated carbon
- 80 trucks movements for ash removal for worst case fuel.

All roads will be sealed to reduce potential for wheel generated dust emissions.

A general arrangement for the EfW facility is shown in Appendix A. A list of all adopted assumptions in this assessment is provided in Appendix B.

2.2 Flue Gas Treatment

The proposed technology for the EfW facility is based on existing facilities in the United Kingdom (UK) and rest of Europe and will incorporate best available technology (BAT) for flue gas treatment. The flue gas treatment is designed to meet the in-stack concentration limits for waste incineration set by the European Union (EU) Industrial Emissions Directive (IED; Directive 2010/75/EU).

The flue gas treatment system is designed to achieve the emission limits as required by the Industrial Emissions Directive (IED) (further discussed in Section 4.3). The flue gas treatment system includes:

- Selective Non-Catalytic Reduction (SNCR) for reducing emissions of oxides of nitrogen (NO_x).
- Dry lime scrubbing for reducing emissions of acid gases, including hydrogen chloride (HCl) and Sulfur Dioxide (SO₂).
- Activated carbon injection for reducing emissions of dioxins and mercury (Hg).
- Fabric filters for reducing emissions of particulate matter (PM) and metals.

Following flue gas treatment, emissions will be dispersed via a 100m stack. Further details of the flue gas treatment are discussed in Section 7.

The owner's engineer, Ramboll, has produced a memorandum presented in Appendix C noting that waste is ignited and burnt on the grate in the furnace at temperatures around 1,100° C and the temperature of the flue gases is thereafter kept above 850 °C for at least 2 seconds in the afterburning chamber.

The flue gas treatment stage consists of a reactor with injection of lime and activated carbon followed by a bag house filter for PM removal, including the activated carbon. In this manner, the flue gas treatment system is designed to ensure that the stack emissions comply with in-stack emission limits regardless the content in the raw, untreated flue gas within any realistic operational range.

2.3 Fuels

The following residual waste fuel types have been identified as the main sources of fuel for the EfW facility:

- Chute Residual Waste (CRW) from the Genesis MPC;
- Commercial and Industrial (C&I);
- Construction and Demolition(C&D);
- Floc waste from car and metal shredding;
- Paper pulp;

- Glass Recovery;
- Garden Organics (GO);
- Alternative Waste Treatment (AWT); and
- Material Recovery Facility waste (MRF waste) residual

As the net calorific value (NCV) of waste fuels vary depending on type, the EfW facility will operate within a range of NCVs to support operational flexibility.

2.3.1 Design Fuel

Based upon the fuel types listed above, a design fuel composition has been developed and is provided in Appendix D. This is based on typical values for each of the proposed fuels and an estimated fuel mix. Input fuel will be mixed as part of the normal operational process to produce as homogenous an input as possible. Further, technical memoranda outlining the waste composition anticipated for the EfW facility are presented in Appendix C.

It is acknowledged that fuel will comprise some fractions containing PVC and their chlorine content will be slightly above 1%, nevertheless the waste in total and as an average will not contain more than 1% chlorine (Ramboll, 2016).

This will be achieved through the extensive mixing of waste before feeding it to the combustion process. As described in Ramboll (2016), the mixing and homogenisation of the different waste streams is a very important aspect of the operation of a waste-to-energy plant and therefore it is given a very high importance. When the waste is tipped in to the bunker it has to be picked up by the crane grab so as to keep the delivery area free and allow further waste deliveries. During times with low delivery it is the duty of the crane driver (or in the case of an automatic crane or the automation system) to thoroughly mix the waste by picking it up and dropping it in a different place of the storage area in the bunker. This ensures a thorough mixing of the different waste fractions. To be fed to the combustion system the waste is again picked up by the crane grab. Further discussion is provided in Section 4.2.

2.3.2 Fuel Source Availability

The availability of waste as fuel source is a commercial issue. Despite this, EIS and the Waste Management Report have investigated the availability of waste as a fuel source which has been discussed in the EIS and Waste Management Report. As discussed in Section 2.1, the EfW facility will be developed in two stages:

- Phase 1 (lines 1 and 2) which will require 552,500 tpa as waste.
- Phase 2 (lines 1, 2, 3 and 4) which will require 1,105,000 tpa as waste.

The eligible tonnes received currently across DADI's waste asset portfolio exceed the tonnes required for lines 1 and 2 (552,500 tpa).

In relation to identifying waste for energy for Phase 2 of the project, DADI commissioned an assessment for the availability of waste to landfill in metropolitan Sydney which is summarised in Section 2 of the Waste Management Report. Table 3 of the Waste Management Report illustrates waste available for disposal in metropolitan Sydney as of 2008/2009:

- 1,854,500 tpa of C&I waste for disposal.
- 1,075,000 tpa of C&D waste for disposal.

It is noted that recycling percentages have increased over time however, population increases have meant that waste generation overall has increased to counter increases in recycling. From the study and DADI's working knowledge of the waste markets, confidence can be placed on the availability of waste as a fuel source to meet the tonnes per annum requirements to run all four lines.

Importantly, DADI plans to commission the plant in two phases to give time to make contract arrangements with waste collectors in order to assure there is sufficient waste fuel to open lines 3 and 4. Without approval and an operating plant it is unrealistic to have these contracts in place.

It should be noted that under the current NSW waste levy it is more profitable for DADI to recycle waste as opposed to using the waste for a fuel source in the TNG Facility. Therefore, it will be the preference and aim of DADI's Genesis Xero Waste Facility to recycle as far as reasonably practicable and not divert any recycling opportunities in favour of use at the TNG Facility.

2.4 Start-up / Shut-down Conditions

The EfW facility is designed to operate continuously, therefore start-up and shutdown are infrequent events and anticipated to be required during the EfW facility's annual maintenance program. However, any required start/stop operations will be completed automatically, under the supervision of trained operators, in a controlled and safe manner.

The EfW facility will be started using fuel oil to reach safe combustion temperatures before any solid fuels are added. The flue gas cleaning system and emissions monitoring will be in operation before any solid fuel is added.

When required, the EfW facility is turned off in a controlled manner through reversing the start-up process. The solid fuel feeding is stopped, with the EfW facility then operating to ensure that all material is burnt and flue gases are cleaned out of the process. Finally, the air flows are left on to allow the boiler unit to cool before the EfW facility can be fully shut off (Ramboll, 2016).

2.5 Upset Conditions

Upset operating conditions at the EfW facility could occur for a number of reasons (Ramboll, 2016). It should be noted that during upset conditions, not all air quality parameters will simultaneously increase, but rather individual parameters may increase by an approximate factor of 10 under specific upset conditions, for example:

- Reduced efficiency of:
 - Selective Non-Catalytic Reduction (SNCR) system as a result of blockages or failure
 - particulate filtration system due to bag failure and inadequate isolation, leading to elevated particulate emissions and metals in the particulate phase.
 - lime injection system such as through blockages or failure of fans leading to elevated acid gas emissions.
- Complete failure of:
 - lime injection system leading to unabated emissions of HCl. (Note: this would require the plant to have complete failure of the bag filter system. As a plant of modern design, the plant would have shut down before reaching these operating conditions).
 - the activated carbon injection system and loss of temperature control leading to elevated concentrations of metals, organics and dioxin reformation and their unabated release.

Under any of the above circumstances, the operator will reduce or shut-down operations as soon as practicable until normal operations can be restored. In accordance with the a design to the requirements of the EU IED, such events shall under no circumstance occur for more than four hours uninterrupted where the emission values exceed the limits and no more than 60 hours per year.

2.6 Emergency Conditions

In the event of a breakdown of the steam turbine generator, the power for the site parasitic load will be supplied from the grid. It is anticipated that the steam turbine will be capable of operating in island

mode. In the event of a loss of grid connection, this would allow the EfW facility to continue processing fuel with the auxiliary load supplied from the turbine generator.

Emergency diesel generators will also be available for safe shut down of the EfW facility in the event of a loss of grid connection and failure of the steam turbine to transfer to island mode operation.

To facilitate this safe shutdown and black start^d there will be two emergency diesel generators with one dedicated to each purpose. Each diesel generator (OSK78) will have a capacity of 2.4 MW that will provide sufficient power for the four incineration lines. A photograph of the proposed diesel generators is shown in Figure 2-1.

The emergency generators will not be used during normal operation of the EfW facility. This includes during planned (scheduled) or forced (unscheduled) outages. Circumstances where the emergency generators may be used include:

- Routine maintenance and specific testing; units will operate for one hour a month.
- In the event of a fire, to provide power supply for emergency lighting and fire-fighting pumps.
- In the simultaneous event of:
 - High Voltage electric grid blackout in the Eastern Creek area or in the whole of Sydney requiring island mode operation of the EfW plant an extremely hot day in the summer time with ambient air temperatures above 35°C (depends on the final sizing of the ACC and on the steam turbine manufacturer) causing an excessively high back pressure in the ACC, in turn initiating a turbine trip and necessitating a shutdown of the whole EfW plant..

This latter event is considered to have a low probability of occurrence, with a worst case frequency estimated to be once every ten years for the two events combined (HZI, 2015).

In the event of requiring safe shutdown/black start, it is anticipated that the diesel generators would be required to run for approximately two hours, with a maximum of six hours for black start required if the plant shutdown is over a longer period of time.

^d Black start is the process of restoring power station operation without relying on the external electric power transmission network.



Figure 2-1: Emergency diesel generator (QSK78)

3 LOCAL SETTING

The proposed EfW facility is located at Eastern Creek, approximately 36 km west of the Sydney CBD and surrounded by the residential areas of Minchinbury, Mt Druitt and Rooty Hill to the north, Erskine Park to the east and Colyton to the northwest (shown in Figure 3-1).

The site which is accessed off Honeycomb Drive at Eastern Creek is surrounded by land owned by the Corporate Group Alexandria Landfill Pty Ltd, ThaQuarry Pty Ltd, Australand, Hanson, Jacfin, the Department of Planning and Infrastructure and Sargents.

The site and surrounding land is identified as part of the '*State Environmental Planning Policy (Western Sydney Employment Area) 2009 (WSEA SEPP)*' to be redeveloped for higher end industrial and employment uses over the next decade. The site has a total area of approximately 56 hectares including the Riparian Corridor, with a specific development area circa 9 hectares.

A sensitive receptor is defined as a location where people are likely to work or reside; and may include a dwelling, school, hospital office or public recreational area in addition to known or likely future locations (NSW DEC, 2005).

Air quality impacts are assessed at the closest residential areas as shown, including particularly sensitive receptors such as schools and hospitals, as well as isolated semi-rural residential receptors off Burley Road to the southeast. Included in this assessment are the potential future receptors that may be located within the adjacent industrial estate. Listed in Appendix E are the particularly sensitive receptors (schools, childcare centres), located within the residential suburbs of Minchinbury and Erskine Park (also shown in Figure 3-1).

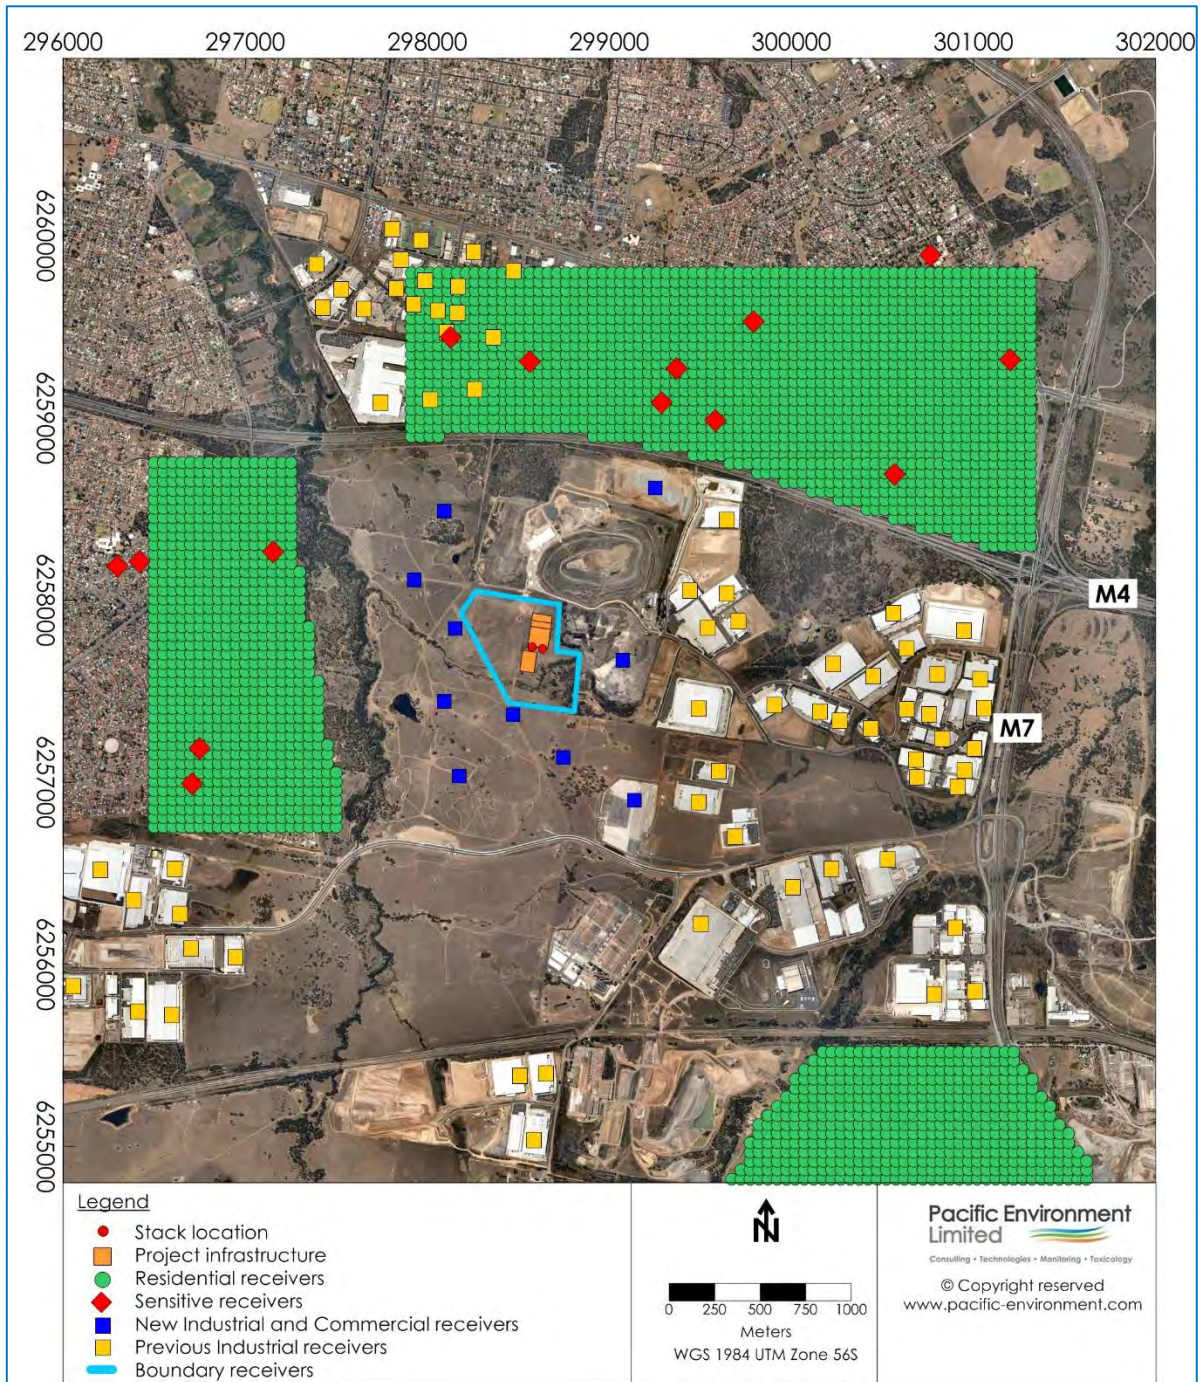


Figure 3-1: Local setting and representative sensitive receptor locations

4 LEGISLATIVE SETTING

4.1 Introduction

The EfW facility design has been developed to align with the relevant environmental, operational and safety requirements of Australian and NSW regulatory frameworks. Key performance requirements have been used to inform the development of the design and operation of the EfW facility.

The starting point for the environmental performance of the EfW facility has been the compliance with legislative standards which are required of Waste-to-Energy plants in Europe. The European Industrial Emissions Directive IED 2010/75 EC (EU IED) has also been used as the basis for the development of the NSW Energy from Waste Policy, which is the legislative framework for the proposed EfW facility.

The primary emissions from the EfW facility, as defined by emission limits for waste incineration set by the EU IED, are as follows:

- Particulate matter (PM), assumed to be emitted as PM₁₀ and PM_{2.5}^e.
- Hydrogen Chloride (HCl).
- Hydrogen Fluoride (HF).
- Carbon Monoxide (CO).
- Sulfur Dioxide (SO₂)
- Oxides of nitrogen (NO_x) (expressed as Nitrogen Dioxide (NO₂)).
- Heavy metals (including Mercury (Hg), Cadmium (Cd), Arsenic (As), Chromium (Cr).
- Gaseous and vaporous organic substances (expressed as total organic carbon (TOC)).
- Dioxins and furans.

In addition to the emission identified in the EU IED, potential emissions also include:

- Hydrogen sulfide (H₂S).
- Chlorine (Cl₂).
- Ammonia (NH₃).
- Poly-aromatic hydrocarbons (PAHs).

The EfW facility will incorporate best available technology (BAT) for flue gas treatment designed to meet the most stringent in-stack concentrations limits and ambient air quality criteria applicable for NSW. An overview of the applicable limits and criteria are provided below.

4.2 NSW EPA Energy from Waste Policy Statement

In March 2014 the NSW Environment Protection Authority (EPA) published its Energy from Waste Policy Statement ("the EfW Policy Statement"; EPA, 2014). The EfW Policy Statement sets out the policy framework and overarching criteria that apply to facilities in NSW proposing to thermally treat waste or waste-derived materials for the recovery of energy. Thermal treatment is defined as combustion, thermal oxidation, thermal or plasma gasification, pyrolysis and torrefaction.

Facilities proposing to thermally treat wastes that are not listed as an eligible waste fuel (such as this EfW facility) must meet the requirements of an energy recovery facility, that is must meet international best practice with respect to:

- Process design and control
- Emission control equipment
- Emission monitoring with real time feedback to process controls
- Arrangements for receipt of waste

^e Particulate matter with an aerodynamic diameter of less than 10 and 2.5 micrometres respectively.

➤ Management of residues

The EfW Policy Statement notes that meeting international best practice will ensure that air toxics and particulate emissions are below levels that may pose a risk of harm to the community or environment. The EfW Policy Statement also specifies technical criteria which must be met, as outlined in Table 4-1.

Table 4-1: Technical criteria as outlined in EfW Policy Statement

Technical Criteria	
1	Combustion chamber minimum temperature of 850°C for at least 2 seconds, after the last injection of air.
2	Where waste contains >1% halogenated organic substances (expressed as chlorine), the combustion chamber temperature should be raised to 1100°C for at least 2 seconds, after the last injection of air.
3	The air emissions must satisfy, as a minimum, the Group 6 emission standards prescribed by the Protection of the Environment Operations (Clean Air) Regulation, 2010.
4	There must be continuous measurement of NO _x , CO, particles (total), total organic compounds, HCl, HF and SO ₂ .
5	There must be continuous measurement of temperature in the combustion chamber.
6	There must be continuous measurement of temperature, oxygen, pressure in the stack and water vapour in the exhaust gases.
7	Proof of performance trials must be conducted to demonstrate compliance with the emission standards. At least two measurements per year are required for heavy metals, PAHs and dioxins and furans (quarterly for the first year).
8	The total organic carbon (TOC) or loss on ignition (LOI) content of the slag and ash residue must be not greater than 3% and 5% respectively of the dry weight material.
9	Waste interlocks are required to prevent waste being fed before the requirement combustion temperature has been reached.
10	The net energy produced must be positive with at least 25% thermal efficiency (25% of thermal energy capture as electricity).

With regard to the second technical criterion, it is understood that the >1% chlorine trigger for waste has been incorporated because EfW Policy Statement references the original EU Waste Incineration Directive. However, the EfW Policy Statement refers simply to "waste" with > 1% chlorine, whereas the EU Waste Incineration Directive refers to "hazardous waste with halogenated organic substances >1%".

The main contribution to the chlorine content of the waste is PVC. PVC (C₂H₃Cl) itself contains approximately 57% chlorine by weight. In municipal waste typically approximately 50 % of the chlorine within the waste stream comes from PVC, in C&I waste the contribution of PVC to the overall chlorine content is expected to be even higher (Ramboll, 2016).

The European EfW experience has shown that EfW facilities typically have to handle concentrations of PVC of around 1% (MSW) with around 0.4% residual (i.e. non-PVC) chlorine contents. Residual fractions from recycling, C&D and C&I can also reportedly reach up to nearly 10%.

It is highlighted that PVC is not classified as a hazardous waste in either the EU or NSW jurisdictions.

The waste in total and as an average will not contain more than 1% chlorine (Ramboll, 2016). This will be achieved through the extensive mixing of waste before feeding it to the combustion process. Ramboll (2016) conducted a sensitivity analysis of how a changing percentage of the different fractions influences the final chlorine content of the fuel. The analysis showed that the fractions with higher chlorine content can increase by a factor of at least 5 without the resulting fuel exceeding the 1% limit specified. Such a change is highly unlikely and therefore the fuel mix is expected to remain below a composition of 1% chlorine.

Current technology (from all EfW providers) does not allow efficient energy recovery at the higher temperature of 1,100°C referenced in Point 2 in Table 4-1.

TNG NSW have expressed that the current wording of the NSW EfW Policy Statement should be amended to reflect the wording within the EU legislation that it was based upon. Within the context of the current assessment, it is understood that, while flue gas treatment is able to abate significantly greater peaks in chlorine concentration of the residual waste fuel, the waste in total and as an average will not contain more than 1% chlorine (Ramboll, 2016) and therefore subject to an 850°C combustion temperature (Appendix C). Equally, the EfW facility would not be handling any 'hazardous' waste (with or without halogenated organic substances) as referenced in the EU legislation. As such, the technical criteria around the use of higher combustion temperatures referenced within the EU legislation would not require to be invoked in any event.

4.3 Emission Limits

Under the EfW Policy Statement the stack emissions from the facility are required, as a minimum, to meet the Group 6 standards of concentration set out in the *Protection of the Environment Operations (Clean Air) Regulation 2010* ("the Clean Air Regulation"). The Clean Air Regulation sets standards for various activities and those that are applicable to an EfW facility are outlined in Table 4-2.

However, the proposed flue gas treatment will be designed to employ Best Available Technology (BAT) and achieve the emission limits specified by the EU IED^f. The IED emissions limits (refer Table 4-3) are generally more stringent than the Clean Air Regulation limits. The proposed technology is based on existing facilities operated throughout Europe, which are designed to meet the IED limits.

Table 4-2: POEO Clean Air Regulation Standards of Concentration

Pollutant	Standard (mg/Nm ³)	Source	Activity
Solid Particles (Total)	50	Electricity generation	Any activity of plant using liquid or solid standard fuel or non-standard fuel
HCl	100	General standards	Any activity or plant
HF	50	Electricity generation	Any activity of plant using liquid or solid standard fuel or non-standard fuel
SO ₂	No applicable standard		
NO ₂	500	Electricity generation	Any boiler operating on a fuel other than gas, including a boiler used in connection with an electricity generator that forms part of an electricity generating system with a capacity of 30 MW or more
Type 1 & 2 substances (in aggregate)	1	Electricity generation	Any activity of plant using non-standard fuel
Cd or Hg (individually)	0.2	Electricity generation	Any activity of plant using non-standard fuel
Dioxins or furans	1x10 ⁻⁷ (0.1 ng/m ³)	Electricity generation	Any activity of plant using non-standard fuel that contains precursors of dioxin or furan formation
VOC	40 (VOC) or 125 (CO)	Electricity generation	Any activity of plant using non-standard fuel
Cl ₂	200	General standards	Any activity or plant
H ₂ S	5	General standards	Any activity or plant

Reference conditions defined as dry, 273.15 K, 101.3 kPa and 7% O₂ for all air impurities when burning a solid fuel, with the exception of dioxins and furans where the required O₂ concentration is 11% for waste incineration.

^f The IED replaces the EU Waste Incineration Directive (2000/76/EC)

Table 4-3: IED Air Emission Limit Values

Pollutant	Daily Average (mg/Nm ³)	Half Hourly Average(mg/Nm ³)	
		100%	97%
Total Dust	10	30	10
Total Organic Carbon (TOC)	10	20	10
HCl	10	60	10
HF	1	4	2
SO ₂	50	200	50
NO ₂	200	400	200
Cd	0.05	N/A	
Thallium (Tl)	0.05		
Hg	0.05		
Type 1 and 2	0.5		
Dioxins	1E-07 (0.1 ng/m ³)		
CO	50		

Reference conditions defined as dry, 273.15 K, 101.3 kPa and 11% O₂.

No emission limits are prescribed for NH₃ or PAHs under the Australian or European legislative framework. Notwithstanding, these are important emissions that have been addressed within this assessment.

In accordance with clauses 56 of the Clean Air Regulation, power station emissions during start-up and shut-down periods are exempt from the in-stack concentration limits specified in Table 4-2. In addition, clause 57A of the Clean Air Regulation states that emergency generators are also exempt if the generators are used no more than 200 hours per year.

4.4 Ambient Air Quality Criteria

The emissions from the EfW facility are also required to comply with the ground level concentrations criteria outlined in the Approved Methods (NSW DEC, 2005). Table 4-4 summarises the ambient impact assessment criteria applicable to this assessment.

Impact assessment criteria for NO₂, SO₂, PM₁₀, CO and HF are applied at the nearest existing or likely future off-site sensitive receptor and are reported as the 100th percentile (i.e. maximum) of the dispersion modelling prediction. For the assessment of impact, background concentrations for these pollutants needs to be considered.

Impact assessment criteria for 'air toxics' (HCl, Hg, Cd, dioxins, NH₃ and PAHs) are applied beyond the site boundary and reported as the 99.9th percentile of the dispersion modelling prediction. Only incremental impacts for these pollutants need be reported.

Table 4-4: EPA ambient impact assessment criteria

Pollutant	Criterion	Averaging Period
NO ₂	246 µg/m ³	1-hour average
	62 µg/m ³	Annual average
SO ₂	712 µg/m ³	10-minute average
	570 µg/m ³	1-hour average
	228 µg/m ³	24-hour average
	60 µg/m ³	Annual average
PM < 10 µm (PM ₁₀)	50 µg/m ³	24-hour average
	30 µg/m ³	Annual average
CO	100 mg/m ³	15-minute average
	30 mg/m ³	1-hour average
	10 mg/m ³	8-hour average
HF ^(a)	2.9 µg/m ³	24-hour average
	1.7 µg/m ³	7 days
	0.84 µg/m ³	30 days
	0.5 µg/m ³	90 days
HCl	0.114 mg/m ³	1-hour
Hg (inorganic)	0.0018 mg/m ³	1-hour
Cd	0.000018 mg/m ³	1-hour
Dioxins and furans	2.0 x 10 ⁻⁹ mg/m ³	1-hour
TOC (as benzene) ^(b)	0.029 mg/m ³	1-hour
NH ₃	0.33 mg/m ³	1-hour
Cl ₂	0.05 mg/m ³	1-hour
PAHs (as benzo(a)pyrene)	0.0004 mg/m ³	1-hour

Notes: a. Applies to general land use other than areas with vegetation sensitive to fluoride e.g. grape vines and stone fruit.

b. Benzene has been adopted as it has the most stringent impact assessment criterion of the BTEX (benzene, toluene, ethylbenzene and xylene) organic compounds.

The criteria in Table 4-5 are consistent with applicable standards in the *National Environment Protection Measure for Ambient Air Quality* (referred to as the Ambient Air-NEPM) (NEPC, 1998a). In May 2003, the NEPC released a variation to the Ambient Air-NEPM (NEPC, 2003) to include advisory reporting standards for fine particulate matter with an equivalent aerodynamic diameter of 2.5 µm or less (PM_{2.5}). The purpose of the variation was to gather sufficient data nationally to facilitate the review of the Ambient Air-NEPM, which is currently underway.

Table 4-5: PM_{2.5} advisory reporting standards

Pollutant	Advisory Reporting Standard	Averaging Period
PM < 2.5 µm (PM _{2.5})	25 µg/m ³	24-hour average
	8 µg/m ³	Annual average

4.5 Load Based Licensing

The load-based licensing (LBL) scheme, sets limits on the pollutant loads emitted by holders of environment protection licences and links licence fees to pollutant emissions.

Schedule 1 of the *Protection of the Environment Operations (General) Regulation 2009* sets out the licence fee system and lists assessable pollutants for energy recovery from waste and hazardous waste. The threshold limits for energy recovery are listed in Table 4-6.

Table 4-6: Threshold limits for energy recovery from waste

Air quality parameter	Threshold factor (tonnes)
Arsenic	0.00005
Benzene	0.0000011
Benzo(a)pyrene	0.00002
Fine particulates	0.7
Lead	0.035
Mercury	0.003
Nitrogen oxides and nitrogen oxides (summer)	2.5
Sulfur oxides	0.07

It is acknowledged that the EfW facility will likely be liable under the LBL scheme for a number of air quality parameters.

4.5.1 Hydrogen Sulfide

The Approved Methods also include ground-level concentration (glc) criteria for individual odorous air pollutants such as H₂S, taking account of population density in a given area. Table 4-7 lists the H₂S criteria to be exceeded not more than 1% of the time, for different population densities.

The differences between odour criteria are based on considerations of risk of odour impact rather than differences in odour acceptability between urban and rural areas. For a given odour level there will be a wide range of responses in the exposed population. In a densely populated area there will therefore be a greater risk that some individuals within the community will find the odour unacceptable than in a sparsely populated area.

An H₂S criterion of 1.38µg/m³ would apply to the built up areas around the EfW facility in any further detailed assessment of proposed operations.

Table 4-7: Odour performance criteria for the assessment of hydrogen sulfide

Population of affected community	Criterion for H ₂ S 99 th percentile (µg/m ³)
≤ ~2	1.38
~10	2.07
~30	2.76
~125	3.45
~500	4.14
Urban (2000) and/or schools and hospitals	4.83

5 DISPERSION METEOROLOGY

5.1 Wind Speed and Wind Direction

Air quality impacts are influenced by meteorological conditions, primarily in the form of gradient wind flow regimes, and by local conditions generally driven by topographical features and interactions with coastal influences, such as the sea breeze. The local dispersion meteorology for the site, in relation to wind speed and direction, has been reviewed based on the data available at nearby meteorological stations.

The Bureau of Meteorology (BoM) collects climatic information at the Horsley Park Equestrian Centre Automatic Weather Station (AWS), located approximately 6 km southeast of the site. The NSW Office of Environment and Heritage (OEH) operate a meteorological station at St Marys, located approximately 5 km west and at Prospect, located approximately 6 km east of the EfW.

The closest site and most representative location in terms of land use and surface roughness is the OEH monitoring site at St Marys. Annual and seasonal wind roses for 2009 and 2013 at St Marys are shown in Figure 5-1 and Figure 5-2, respectively. During both years the dominant annual winds are from the south and south-southwest with a significant portion also from the north-northwest. This pattern is similar in all seasons with summer also showing a proportion of winds from the southeast. The percentage calms (defined as wind speeds less than 0.5 m/s) are 26.2% and 30.9% for the respective years.

Sensitivity analysis was completed using the alternative Horsley Park data for 2013. The results demonstrated that use of the St Marys meteorological data provided a more conservative assessment for almost all of the investigated pollutants. The exception being the 1-hour 99th percentile H₂S results, with predictions being 7% higher than when using the St Marys dataset. For the remaining pollutants there was no change or a decrease of between 2% and 64%.

As specified in the Approved Methods, five years of data are required to be reviewed so that a representative year of meteorological conditions can be selected. Appendix F provides an analysis of the five years of meteorological data from the Horsley Park Equestrian Centre that can also be compared with the St Marys weather data. The Horsley Park meteorological data was selected for the analysis as it is a readily available and cost-effective data set to access. The review identified 2013 as a representative year for dispersion modelling with no anomalous wind patterns compared to the other years examined and is therefore considered a representative year for dispersion modelling. The prevalence of calm conditions in the western Sydney area is shown to be a common feature of the meteorology in the vicinity of the EfW facility. The percentage of calms measured at the Horsley Park Equestrian Centre ranged between 14.2% and 24.5%. However, wind measurements are made at 10m above ground level. The emission from the Project would be occurring at 100m above ground level where wind speeds are significantly higher and calm conditions far less frequent. These calm conditions are most common during autumn and winter and are often a function of temperature inversions that also occur during these cooler months. Thus, the prevalence of calm conditions in the western Sydney area is shown to be a common feature of the meteorology in the vicinity of the EfW facility. These calm conditions are most common during autumn and winter and are often a function of temperature inversions that also occur during these cooler months. Calm conditions are also associated with poor dispersion conditions.

In view of the high percentage of calm conditions for 2013 measured at St Marys, using these data for dispersion modelling will provide an additional level of conservatism in the prediction of ground level pollutant concentrations.

It is highlighted that the AERMOD modelling system allows for wind speed and direction variation in the vertical, through reference to a 'surface' meteorological input file, and a 'profile' input file. The profile input file contains information on the (logarithmic) increase in wind speed with height. Thus, it is noted that the wind speeds interacting with the stack exit (100m aloft) will not reflect any calm observation occurring within the surface input file.

As a general note, the AERMOD dispersion model is anticipated to be the most widely used dispersion model internationally, and has been the subject of many validation exercises to confirm its satisfactory performance for both calm conditions and tall stack applications using standard model validation data sets.

5.2 Meteorological File for Modelling

The compilation of the meteorological file followed Pacific Environment's quality assurance procedures that form part of an ISO 9001:2000 certified quality system.

A complete year of hourly meteorological data, collected at the St Marys station was used as input within the dispersion modelling. The meteorological data set for modelling is 98% complete (>90% data retrieval is a requirement of the Approved Methods) and was demonstrated to be a representative year.

The AERMOD dispersion model also requires cloud cover and cloud height as input and the closest meteorological station recording these parameters is Bureau of Meteorology (BoM) Bankstown Airport AWS, located approximately 19 km southeast of the EfW facility. Another option would be to use the cloud data from Richmond RAAF Base AWS. Given that both sites are located inland and with Bankstown Airport AWS being the closest to the Project it was considered the most suitable.

For AERMET the use of the Upper Air Estimator was used as it has the advantage of having no issues surrounding consistency between surface and upper air data, which is often the case when synthetic (prognostic) upper air data is referenced.

It is acknowledged that upper air profiles are available in the Sydney area. However, these profiles comprise twice daily measurements collected at Sydney Airport and therefore require interpolation for the remaining 22 hours of the day. Furthermore, Sydney Airport is located on the coastline 37 km south east of the Project with the two locations subject to very different influences on the boundary layer meteorology. For example, the height of the mixed layer in coastal areas is very different to those experienced at inland area, such as where the Project is located. These inland influences are characterised by the frequency of calm wind speeds (<0.5 m/s) associated with night time drainage flows and inversion conditions.

For the operation of AERMET, a full morning upper air sounding (RAWINSONDE) is required for winds, temperature, and dew point. Wind data are used by AERMET to produce the profile data file, and temperature is used for mixing height calculations.

Critically, there are no temperature and dew point temperature data for nearly all upper air sounding data taken in Australia. Further, there are a lot missing days and hours such that there are not a sufficient number of soundings to be useful within AERMET.

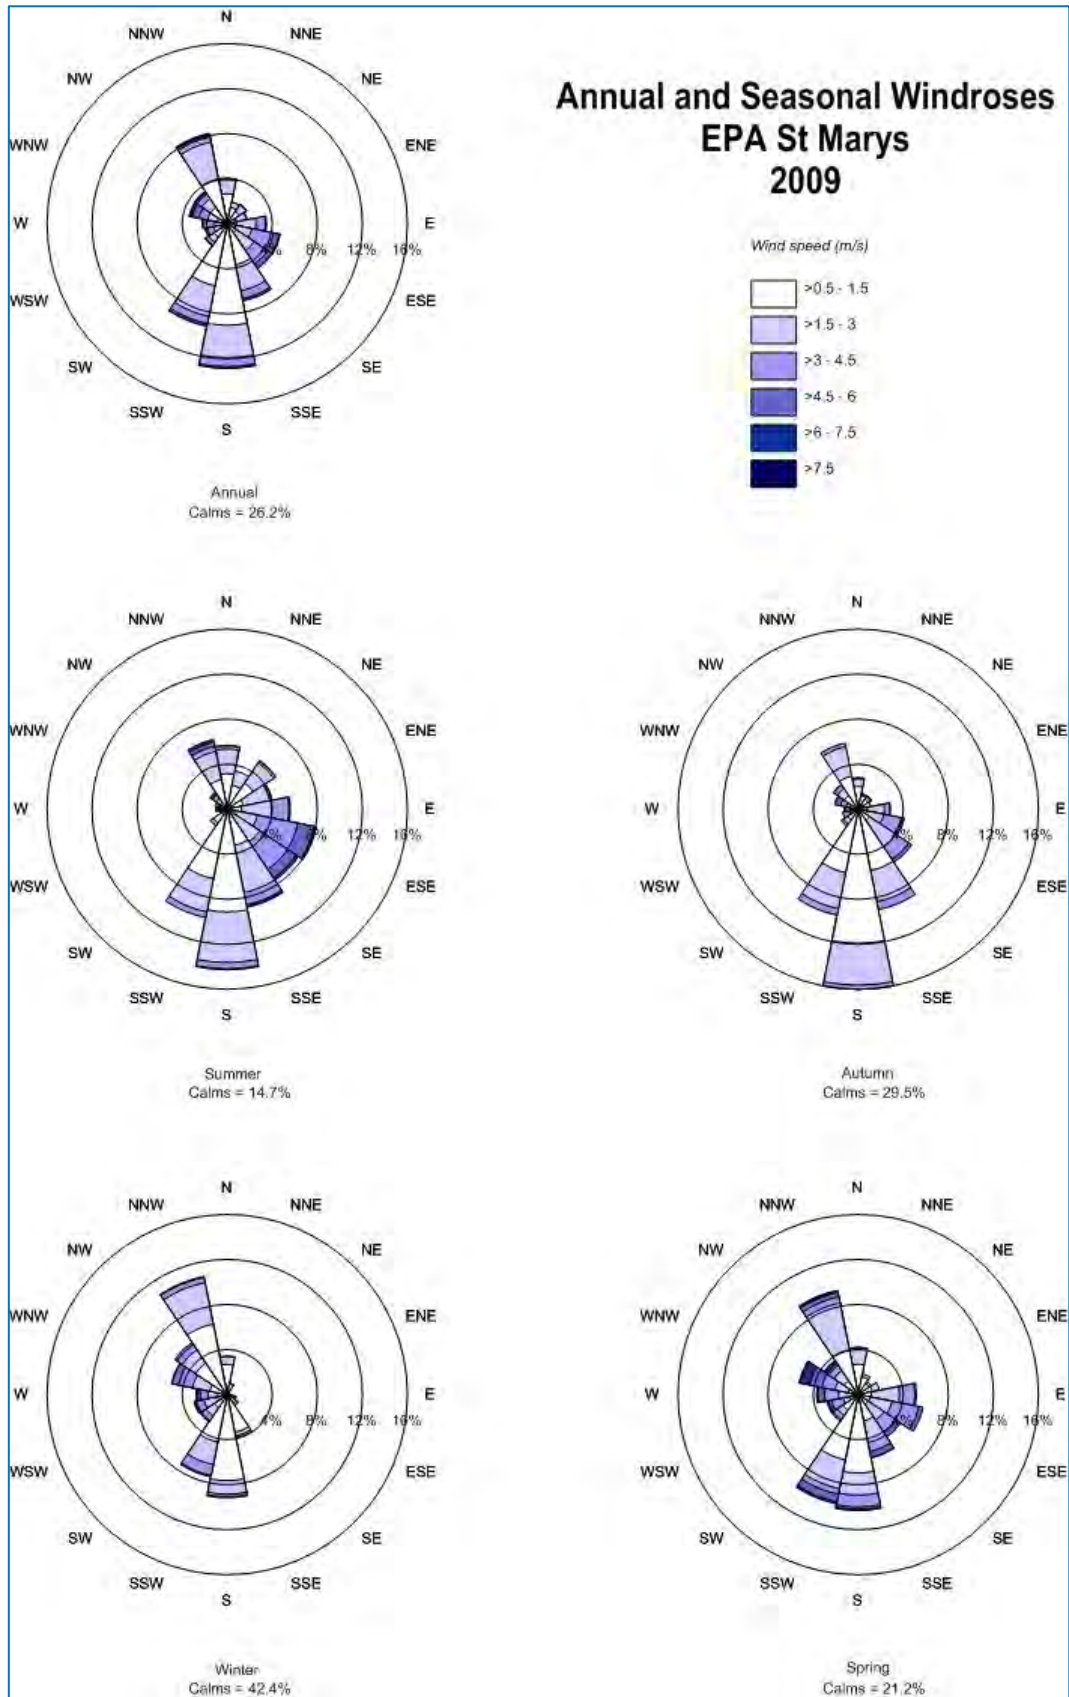


Figure 5-1: Wind roses for St Marys (2009)

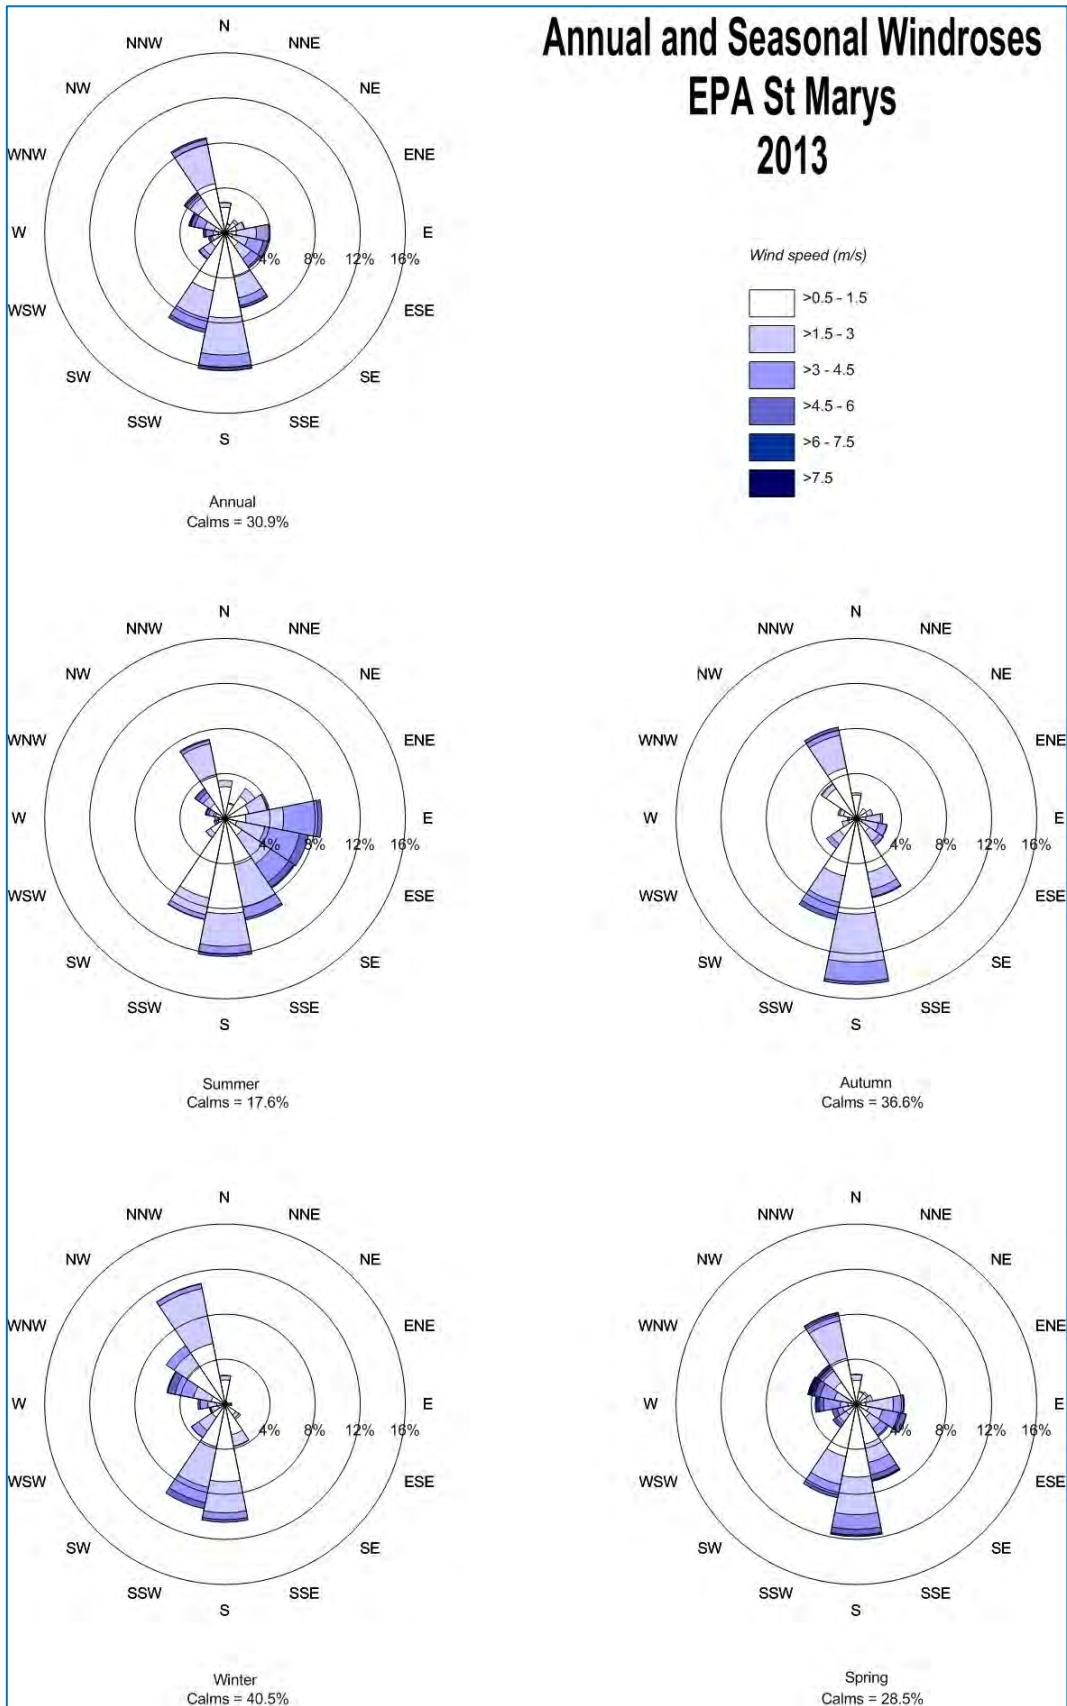


Figure 5-2: Wind roses for St Marys (2013)

5.3 Atmospheric Stability

An important aspect of pollutant dispersion is the level of turbulence in the lowest 1 km or so of the atmosphere, known as the planetary boundary layer (PBL). Turbulence controls how effectively a plume is dispersed into the surrounding air and hence diluted. It acts by increasing the cross-sectional area of the plume due to random motions. With stronger turbulence, the rate of plume dispersion increases. Weak turbulence limits dispersion and contributes to high plume concentrations downwind of a source.

Turbulence is generated by both thermal and mechanical effects to varying degrees. Thermally driven turbulence occurs when the surface is being heated, in turn transferring heat to the air above by convection. Mechanical turbulence is caused by the frictional effects of wind moving over the earth's surface, and depends on the roughness of the surface as well as the flow characteristics.

Turbulence in the boundary layer is influenced by the vertical temperature gradient, which is one of several indicators of stability. Plume models use indicators of atmospheric stability in conjunction with other meteorological data to estimate the dispersion conditions in the atmosphere.

Stability can be described across a spectrum ranging from highly unstable through neutral to highly stable. A highly unstable boundary layer is characterised by strong surface heating and relatively light winds, leading to intense convective turbulence and enhanced plume dispersion. At the other extreme, very stable conditions are often associated with strong temperature inversions and light winds, which commonly occur under clear skies at night and in the early morning. Under these conditions plumes can remain relatively undiluted for considerable distances downwind. Neutral conditions are linked to windy and/or cloudy weather, and short periods around sunset and sunrise, when surface rates of heating or cooling are very low.

The stability of the atmosphere plays a large role in determining the dispersion of a plume and it is important to have it correctly represented in dispersion models. Current air quality dispersion models (such as AERMOD and CALPUFF) use the Monin-Obukhov Similarity Theory (MOST) to characterise turbulence and other processes in the PBL. One of the measures of the PBL is the Monin-Obukhov length (L), which approximates the height at which turbulence is generated equally by thermal and mechanical effects (Seinfeld and Pandis 2006). It is a measure of the relative importance of mechanical and thermal forcing on atmospheric turbulence.

Because values of L diverge to + and - infinity as stability approaches neutral from the stable and unstable sides, respectively, it is often more convenient to use the inverse of L (i.e., 1/L) when describing stability.

Figure 5-3 shows the hourly averaged 1/L for the Project site computed from all data in the AERMET surface file. Based on Table 5-1, this plot indicates that the PBL is stable overnight and becomes unstable as radiation from the sun heats the surface layer of the atmosphere and drives convection. The changes from positive to negative occur at the shifts between day and night. This indicates that the diurnal patterns of stability are realistic.

Table 5-1: Inverse of the Monin-Obukhov length L with respect to Atmospheric stability

1/L	Atmospheric Stability
Negative	Unstable
Zero	Neutral
Positive	Stable

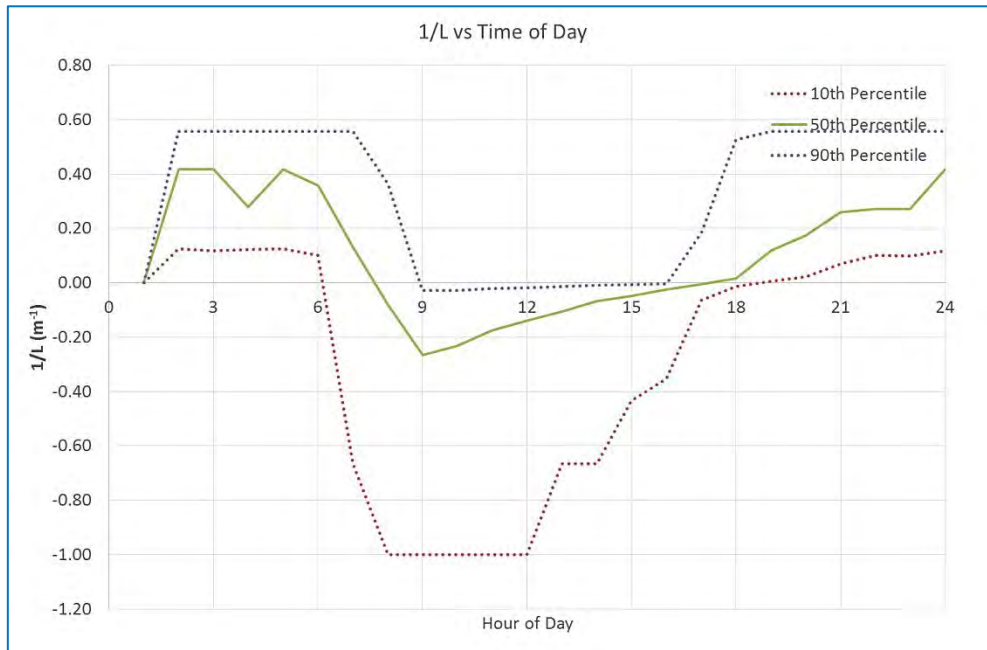


Figure 5-3: Annual statistics of 1/L by hour of the day

Figure 5-4 shows the variations in stability over the year by hour of the day, with reference to the widely known Pasquill-Gifford classes of stability. The relationship between L and stability classes is based on values derived by Golder (1972) set out in NSW DEC (2005). Note that the reference to stability categories here is only for convenience in describing stability. The model uses calculated values of L across a continuum.

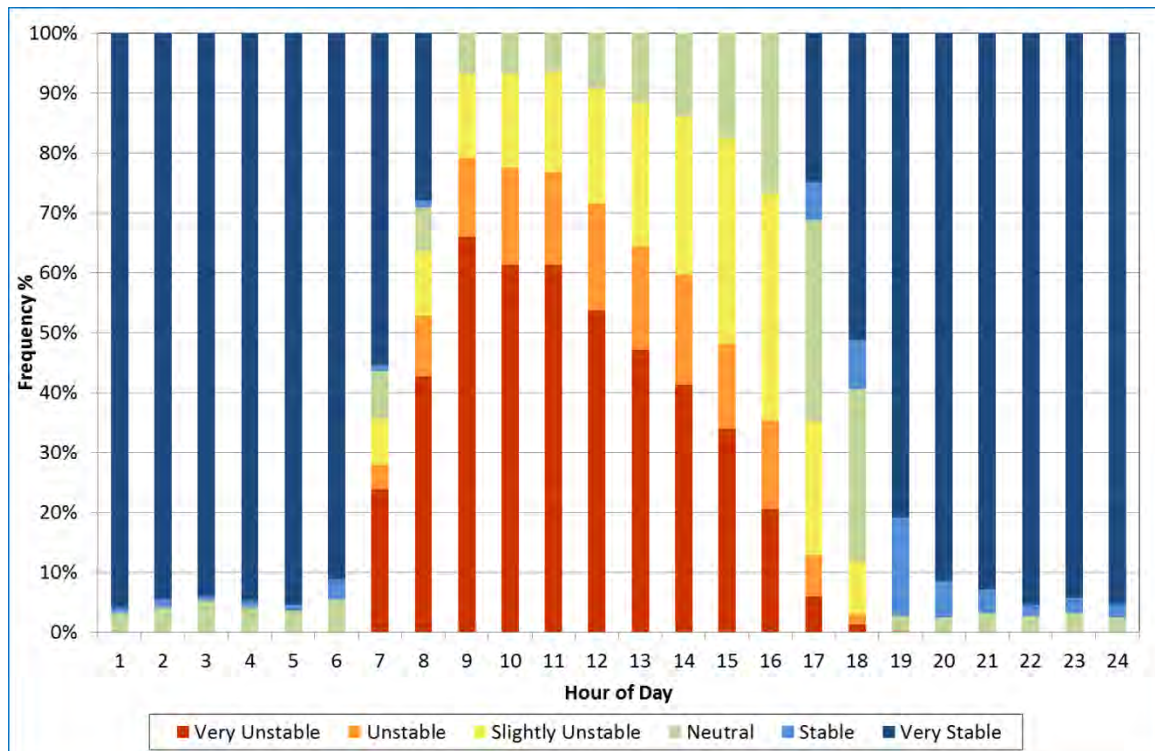


Figure 5-4: Annual distribution of stability type by hour of the day

Figure 5-4 shows that stable and very stable conditions occur for about 50% of the time, which is typical for inland locations that regularly experience temperature inversions at night. Atmospheric instability increases during the day and reaches a peak around noon as solar-driven convective energy peaks. A stable atmosphere is prevalent during the night. These profiles indicate that pollutant dispersion is most effective during the daytime and least effective at night.

Values of surface roughness, albedo and Bowen ratio were determined based on a review of aerial photography for a radius of 3 km centred on the EPA St Marys station. Default values for cultivated land and urban areas were chosen over two sectors across this area. The default values for these three surface characteristics required for AERMET are as follows:

- Surface roughness, which is the height at which the mean horizontal wind speed approaches zero, based on a logarithmic profile. Values adopted = 1.0 (urban) and 0.07 (cultivated land)
- Albedo, which is an indicator of reflectivity of the surface. Values adopted = 0.2075 (urban) and 0.28 (cultivated land)
- Bowen ratio, which is an indicator of surface moisture. Values adopted = 1.625 (urban) and 0.75 (cultivated land)
-

6 EXISTING AIR QUALITY

To assess potential impacts against the relevant air quality standards and criteria (see Section 4.4) it is necessary to have information or estimates on existing concentrations for the area in which the EFW facility would contribute to these levels.

The OEH monitoring station at St Marys collects air quality data for pollutants including PM₁₀, NO_x and O₃. The OEH monitoring station at Prospect collects air quality data for other pollutants not monitored at St Marys, including SO₂ and CO.

In addition, the adjacent Genesis facility operates a continuous PM₁₀ monitor (BAM) at a residence in the suburb of Minchinbury, as a requirement of their Environmental Protection Licence (EPL).

A summary of the available air quality data is provided in the subsequent sections. Generally, air quality for the local area can be described as good, with the exception of isolated high pollution days or extreme events such as dust storms and bushfires.

6.1 Particulate Matter (PM₁₀)

6.1.1 NSW OEH Monitoring at St Marys

A summary of the annual average and maximum 24-hour PM₁₀ concentrations measured between January 2009 and December 2013 at St Marys are presented in Table 6-1. There were several exceedances of the 24-hour average PM₁₀ criterion at St Marys in the last 5 years. During 2009 there were a number of elevated dust events including one of eastern Australia's most significant dust storms events, occurring on 23 September 2009 and recording a maximum 24 hour average concentration of 1,680µg/m³.

Table 6-1: Annual average and maximum 24 hour average PM₁₀ concentrations – St Marys (µg/m³)

Year	Maximum 24-hour average (µg/m ³)	Annual average (µg/m ³)
<i>EPA Criterion</i>	50	30
2009	1661	23
2010	52	15
2011	74	15
2012	34	14
2013	93	16

A time-series of the 24-hour average PM₁₀ concentration for 2013 (the year chosen for modelling) is presented in Figure 6-1. The data indicates that concentrations above the EPA criterion of 50µg/m³ were experienced on two days. It should be noted that the national air quality goal prescribed under the Ambient Air-NEPM (2008) provide for up to five exceedances of the goal per year.

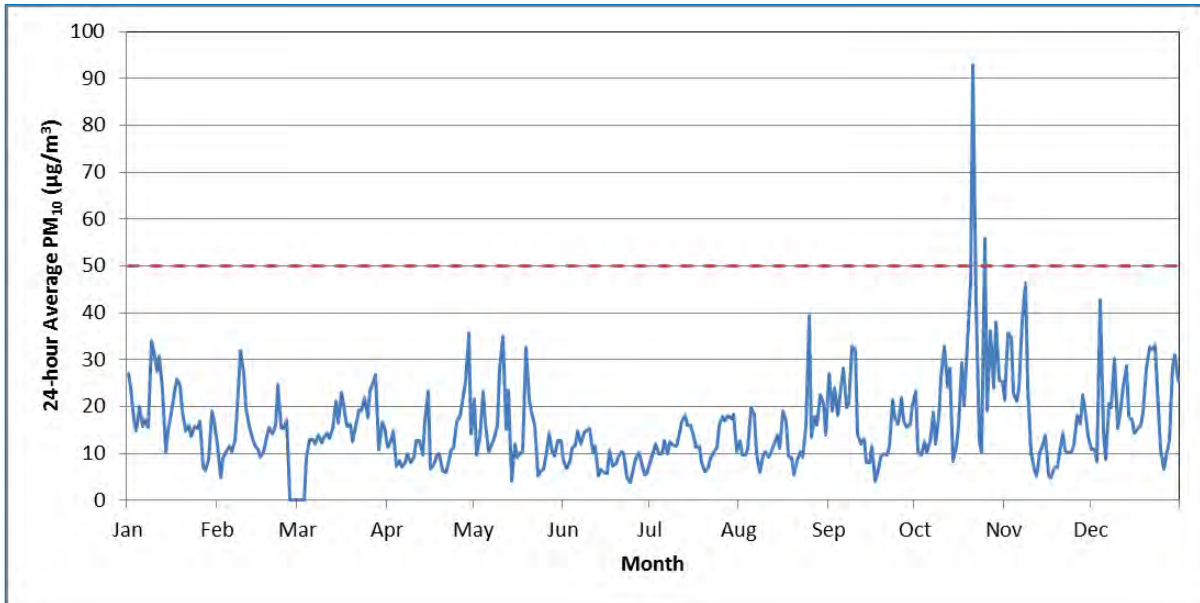


Figure 6-1: 24 hour average PM₁₀ concentrations – St Marys (2013)

6.1.2 NSW OEH Monitoring at Prospect

A summary of the annual average and maximum 24-hour average PM₁₀ concentration measured between January 2009 and December 2013 at Prospect are presented in Table 6-2. The annual average PM₁₀ concentration at Prospect appears to display an upward trend in the past 4 years which is not reflected in the data recorded at St Marys.

Table 6-2: Annual average and maximum 24 hour average PM₁₀ concentrations (µg/m³)

Year	Maximum 24-hour average (µg/m ³)	Annual average (µg/m ³)
<i>EPA Criteria</i>	50	30
2009	1,680	26
2010	40	15
2011	42	16
2012	39	17
2013	82	19

6.1.1 Industry Monitoring at Minchinbury

The adjacent Genesis facility operates a BAM PM₁₀ monitor at Minchinbury, which has been operational since mid-2012. The 2013 annual average at Minchinbury is the same as Prospect (19µg/m³) and the maximum 24-hour average for the year is also similar (77µg/m³). A plot of the 24-hour PM₁₀ concentration collected between July 2012 and February 2014 is presented in Figure 6-2.

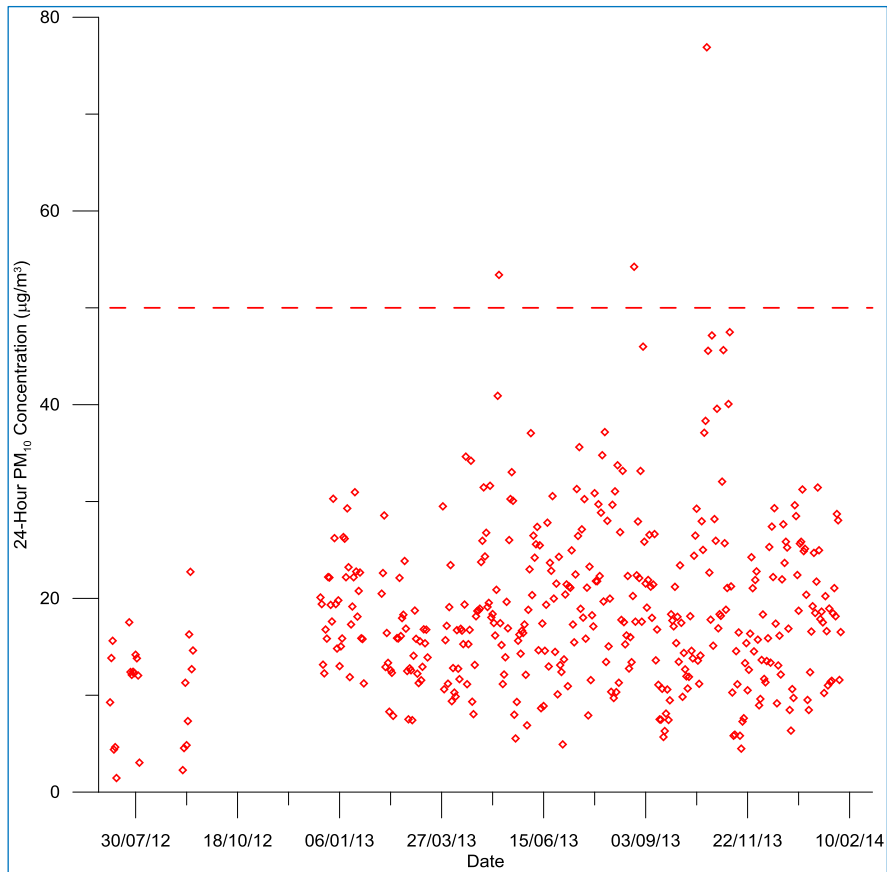


Figure 6-2: 24-Hour PM₁₀ monitoring at Minchinbury

6.2 Particulate Matter (PM_{2.5})

The two closest OEH monitoring stations do not currently measure PM_{2.5}. Rather than adopt PM_{2.5} data from further afield, a PM_{2.5}:PM₁₀ ratio (0.35:1) has been applied to the PM₁₀ data measured at St Marys and Prospect. The ratio is based on PM measurements from Richmond and Liverpool between 2009 and 2013.

A summary of the calculated annual average and maximum 24-hour average PM_{2.5} concentrations measured between January 2009 and December 2013 at fro St Marys are presented in Table 6-3.

Table 6-3: Annual average and maximum 24 hour average PM_{2.5} concentrations (µg/m³)

Year	St Marys		Prospect	
	Maximum 24-hour average (µg/m ³)	Annual average (µg/m ³)	Maximum 24-hour average (µg/m ³)	Annual average (µg/m ³)
<i>EPA Criteria</i>	25	8	25	8
2009	587	8	594	9
2010	18	5	14	5
2011	26	5	15	6
2012	12	5	14	6
2013	33	6	29	7

6.3 Nitrogen Dioxide (NO₂)

6.3.1 NSW EPA Monitoring at St Marys

A summary of the NO₂ annual and 1 hour maximum data from 2009 to 2013 at St Marys is presented in Table 6-4. During this period there were no exceedances of the 1-hour maximum criterion of 246µg/m³ or the annual average criterion of 62 µg/m³.

A time-series of the 1-hour average NO₂ concentrations recorded at St Marys during 2013 (modelling year) is presented in Figure 6-3. The results indicated that hourly NO₂ concentrations are well below the EPA criterion of 246µg/m³. The maximum recorded 1-hour average concentration in 2013 was 76µg/m³.

Table 6-4: Annual average and maximum 1 hour average NO₂ concentrations – St Marys (µg/m³)

Year	Maximum 1-hour average (µg/m ³)	Annual average (µg/m ³)
<i>EPA Criteria</i>	246	62
2009	72	12
2010	74	12
2011	74	12
2012	88	10
2013	76	10

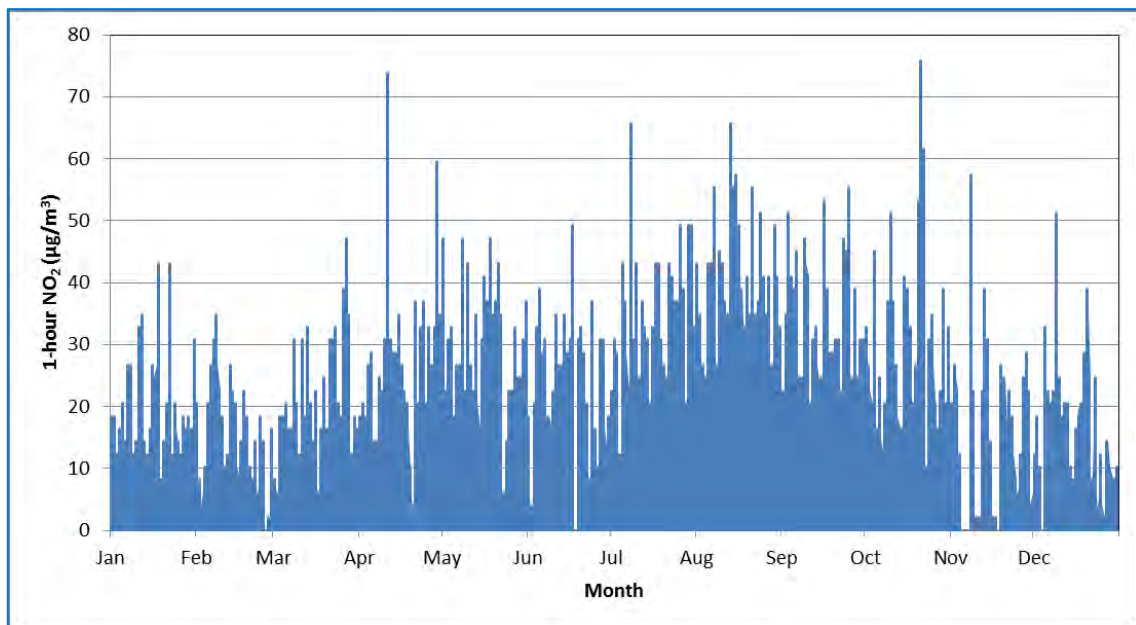


Figure 6-3: 1-hour NO₂ concentrations – St Marys (2013)

6.3.2 NSW EPA Monitoring at Prospect

A summary of the NO₂ annual and 1 hour maximum data from 2009 to 2013 at Prospect is presented in Table 6-5. During this period there were no exceedances of the 1-hour maximum criterion of 246µg/m³ or the annual average criterion of 62 µg/m³. The maximum 1-hour and annual average concentrations are generally higher than at St Marys.

Table 6-5: Annual average and maximum 1 hour average NO₂ concentrations (µg/m³)

Year	Maximum 1-hour average (µg/m ³)	Annual average (µg/m ³)
<i>EPA Criteria</i>	246	62
2009	105	23
2010	88	25
2011	80	21
2012	103	21
2013	100	23

6.4 Sulfur Dioxide (SO₂)

6.4.1 NSW EPA Monitoring at Prospect

A summary of the annual average and 1-hour maximum data for the 2009 to 2013 period at Prospect is presented in Table 6-6. During this period there were no exceedances of the 1-hour maximum criterion of 570µg/m³ or the annual average criterion of 60 µg/m³.

Table 6-6: Annual average and maximum 1 hour average SO₂ concentrations (µg/m³)

Year	Maximum 1-hour average (µg/m ³)	Annual average (µg/m ³)
<i>EPA Criteria</i>	570	60
2009	49	N/A
2010	52	3
2011	40	3
2012	34	3
2013	57	3

6.5 Carbon Monoxide (CO)

6.5.1 NSW EPA Monitoring at Prospect

A summary of the CO monitoring data from the Prospect station for the 2008 to 2012 period at Prospect is presented in Table 6-7. During this period there were no exceedances of the 1 hour maximum criterion of 30µg/m³ or the 8-hour criterion of 10 µg/m³.

Table 6-7: Maximum 8-hour average CO concentrations (mg/m³)

Year	Maximum 8-hour average (mg/m ³)
<i>EPA Criteria</i>	10
2009	3
2010	2
2011	2
2012	2
2013	2

7 EMISSIONS TO AIR

As noted in Section 4.2, the EfW Policy Statement indicates that any facility proposing to recover energy from waste will need to meet current international best practice. The EfW Policy Statement also requires that emissions from EfW facilities must satisfy, as a minimum, emission limits prescribed by the Clean Air Regulations.

The proposed technology for the EfW facility is based on existing facilities in Europe and will incorporate best available technology (BAT) for flue gas treatment. The flue gas treatment is designed to meet the in-stack concentrations limits for waste incineration set by the EU IED. The IED emissions limits (Table 4-3) are generally more stringent than the Clean Air Regulation limits (Table 4-2).

7.1 Best Available Techniques

A summary of the technologies used to control emissions from waste incineration at existing EfW facilities is presented to examine what constitutes current international best practice. The purpose of the review is to demonstrate that existing technology can satisfy the emission limit requirements of the EU IED, and therefore is appropriate for the EfW facility.

7.1.1 General

In 2006 the European Commission published a reference document for best available techniques for waste incineration (EC, 2006). The Best Available Techniques Reference Documents (BREF) are made under the European directive on Integrated Pollution Prevention and Control (IPPC) (Council Directive 96/61/EC).

The BREF defines five sectors for waste incineration (mixed municipal, pre-treated municipal, hazardous, sewage sludge, chemical waste) and covers three types of thermal treatment (pyrolysis, gasification, incineration). The focus of the BAT review within the BREF is for flue gas treatment, however process control is also important and Table 7-1 presents good practice process control proposed for the EfW facility.

Table 7-1: General good practice procedures / process control

Process	Details
Types of waste received	The technology has been chosen having regard to the characteristics of waste received, which are well known from the operation of the existing Genesis facility, and based on a minimum calorific value of 12.34 MJ/kg.
	A quality control process will be established for waste received at the EfW facility.
Maintenance	Regular maintenance will ensure equipment remains in good working order
Combustion	The furnace and boiler technology is designed for optimal combustion performance
	Proposed use of automated combustion control system, including control and optimisation of oxygen supply, temperature, residence time.
	Air injection
	Minimising uncontrolled ingress of air into combustion chamber during loading.
	Minimise start up / shut downs
	Preheating the combustion chamber for lower calorific wastes.
Monitoring	The EfW facility will employ a Continuous Emissions Monitoring System (CEMS).

7.1.2 Flue Gas Treatment

A range of pollution control equipment are available for the pollutants generated at EfW facilities and an overview of existing BAT for flue gas treatment is provided below and summarised in Table 7-2.

Fabric filters (bag houses) are used in the majority of existing EfW facilities as they have high particle removal efficiency and also work in combination with scrubbing systems (i.e. activated carbon injection). Electrostatic Precipitators (ESPs) have been used in conjunction with fabric filters to provide additional level of control where needed.

Scrubbing systems are used to remove acid gases and can be wet, dry or semi-dry. Scrubbers work by adsorption, bringing flue gas into contact with a scrubbing material such as lime, sodium hydroxide or sodium carbonate. Dry/semi dry scrubbers work well in conjunction with activated carbon injection, which is typically used to remove volatile heavy metals (e.g. Hg, Pb, Cd) and dioxins and furans. The used carbon and lime, along with the adsorbed pollutants, are collected on the fabric filter.

NO_x is produced in the combustion process (combining the nitrogen and oxygen present in air) and also from the nitrogen contained within the residual waste fuel. Thermal NO_x is typically controlled with good practice combustion and flue gas recirculation (FGR). FGR lowers the excess air rate, thereby increasing the thermal efficiency and reducing the available nitrogen for NO_x formation.

The NO_x removal system comprises Selective Non-Catalytic Reduction (SNCR). With an SNCR system, ammonia water is injected into the first pass of the boiler at a temperature of approximately 900°C. Here the chemical reaction takes place, converting NO_x to nitrogen and water. With an SNCR system the requirement of an in-stack concentration of 200 mg/Nm³ NO_x can be comfortably reached.

The SNCR technology can be optimised to reach 120 mg/Nm³ for a sophisticated SNCR (as a daily average). The increased efficiency comes with a modest increase of CAPEX and additional consumption of ammonia.

Ammonia slippage from an SNCR system (i.e. surplus NH₃ going to atmosphere) normally constitutes in-stack concentrations of between 1 mg/Nm³ and 10 mg/Nm³, with an average of 4 mg of NH₃/Nm³ (EC, 2006). The effects of ammonia slip have been conservatively factored into the upset conditions emissions scenario, which assumes in-stack concentrations of ammonia of 20 mg/Nm³.

Table 7-2: Best Available Techniques for EfW flue gas treatment (FGT)

Substance	BAT	Comments
Particles	Fabric filters / bag filters Cyclones Electrostatic precipitators	Fabric filters are generally sufficient to meet the emissions limits than prescribed by the EU Waste Incineration Directive and typically employed at existing EfW facilities.
Hydrogen chloride (HCl)	Waste control	Wet FGT results in lowest emissions; however Dry FGT has the co-benefit of removing PCDD/F and mercury (with addition of activated carbon injection). Dry/semi dry most commonly employed at existing EfW facilities.
Hydrogen Fluoride (HF)	Wet scrubbers	
Sulfur Dioxide (SO ₂)	Dry and semi dry scrubbers	
Oxides of Nitrogen (NO _x)	Reduction of thermal NO _x through combustion control and Flue Gas Recirculation Selective Catalytic Reduction (SCR) Selective Non Catalytic Reduction (SNCR)	Waste and combustion control with SNCR/SCR can generally result in emissions within limits prescribed by the EU Waste Incineration Directive. SNCR typically employed at existing EfW facilities.
Carbon Monoxide	Combustion control	Activated carbon injection may provide additional benefit of VOC control.
Gaseous and various organic substance (TOC)		
Mercury	Wet scrubbing with injection Activated carbon injection Condensing scrubbers Resin filters	Adsorption using carbon based reagents generally needed to meet limits prescribed by the EU Waste Incineration Directive. Activated carbon injection typically employed at existing EfW facilities.
Metals	Activated carbon injection Fabric filters	Techniques that control dust will also control metal emissions and fabric filters commonly used. Activated carbon injection additionally controls volatile metals (Hg).
Dioxins and Furans (PCDD/F)	Primary (combustion control) techniques, flue gas recirculation Selective Catalytic Reduction (SCR) Catalytic filter bags Adsorption by activated carbon injection / static beds Wet scrubbing with carbon injection / carbon slurries	Secondary abatement generally needed in combination with primary (combustion control) to meet limits prescribed by the EU Waste Incineration Directive.

A review of existing EfW facilities (mostly in the UK and Europe) indicates that these BAT are routinely implemented at EfW facilities. Table 7-3 summarises the flue gas treatment that will be installed on commissioning of the TNG EfW facility (in addition to combustion and other process control).

The owner's engineer, Ramboll, has produced a technical memorandum as to 'real world' in-stack concentrations of a comprehensive list of air quality metrics, referenced from existing EfW facilities internationally. This memorandum is provided in full as Appendix C. This memorandum provides publicly available emission data from plants fired by C&I and C&D waste and / or semi dry APC system, as proposed for the TNG project. These facilities include:

- Hurth-Knapsack (Germany) – 2 x 150,000 tpa
- Heringen (Germany) – 2 x 148,500 tpa
- Premnitz (Germany) – 1 x 150,000 tpa
- Grossraschen (Germany) – 1 x 276,250 tpa
- TIRME Mallorca (Spain) – 2 x 208,000 tpa
- Riverside (UK) – 3 x 195,000 tpa.

It is acknowledged that the proposed TNG EfW Facility will process up to 1,105,000 tpa and that above examples do not process the volume of waste that is proposed.

A further technical memorandum as to 'real world' in-stack concentrations of a comprehensive list of air quality metrics, referenced from existing EfW facilities internationally is provided in Appendix C.

Table 7-3: Flue Gas Treatment for existing EfW facilities

Facility	Flue Gas Treatment	Fuel Type
Lakeside, London, UK	SNCR for NOx control Semi-dry scrubbing using lime Activated carbon injection Fabric filter 75m stack	Household and municipal waste
Issy Les Moulineaux, Paris, France	Fabric filter plus ESP Dry scrubbing using sodium bicarbonate Activated carbon injection SCR low temperature deNOx system Gas exit temperature of 200°C and velocity of 30m/s (due to short stack)	Municipal solid waste
Riverside, London, UK	Semi-dry scrubber with lime and activated carbon injection Fabric filter 85m stack	Municipal solid waste
Mainz, Germany	SNCR for NOx control High dust catalytic converter to remove surplus ammonia Spray absorption using lime milk Activated coke injection Fabric filter 95m stack	Household waste, bulky waste and commercial waste.
AEB, Amsterdam, The Netherland (1,370,000 tpa)	SNCR for NOx control ESP plus fabric filter with activated carbon/coke injection Packed bed scrubber for HCl, lime milk injection for SO2 Fabric filter Polishing scrubber	Municipal and industrial waste
Spittleu, Vienna, Austria	SCR for NOx control ESP Wet scrubber for acid gases, lime slurry for HCl, NaOH for SO2	Municipal solid waste
Kwinana Facility, Western Australia	SNCR for NOx control Spray dryer (lime) / high temperature lime scrubbing Activated carbon injection Fabric filter	Combustion of Municipal Solid Waste (MSW) in twelve Ultra High Temperature Combustors (UHTC's)

Greatmore Facility, Buckinghamshire, UK	Ammonia injection to reduce NO _x Lime injection Injection of activated carbon Bag filter 95m stack	Municipal solid waste (MSW) using Steam condensation by the means of air-cooled vacuum condenser.
Newhaven Facility, UK	Ammonia injection Lime injection Activated carbon Fabric filter 65m stack	Mixed municipal waste.
Worcestershire EfW facility, UK	Activated carbon injection Dry lime scrubbing Selective Non-Catalytic Reduction (SNCR) Fabric filter 75m stack	Household and municipal waste
Montgomery County, Maryland, USA	Thermal deNO _x using aqueous ammonia Hydrated lime injection and spray dryer adsorper Carbon injection Baghouse 84m stack	Municipal solid waste

Source: Mercier EnviRecover (2010); SLR (2010); WA EPA (2000); Veolia (2013); WSP (2013)

7.2 Emissions Performance

The emission performance of a number of case studies is summarised in WSP (2013), including some of the facilities presented in Table 7-3. A number of the case studies presented use the technology provider for the proposed EfW facility (i.e. Issy Les Moulineaux, Paris, and Riverside, London) and most apply the same flue gas treatment as the proposed EfW facility.

The data reviewed in the case studies demonstrates that emissions consistently meet the IED limits. Appendix F presents some of this data from WSP (2013).

CEMS reports for the Riverside EfW facility have also been reviewed. Riverside employs similar technology (Hitachi Zosen Inova (HZI)) and flue gas treatment to the proposed EfW facility. The CEMS reports (2011 – 2014) demonstrate that the EfW facility consistently meets the EU IED limits for the pollutants monitored by CEMS and in most cases are significantly lower.

The Riverside EfW CEMS reports are publicly available on the internet (<http://www.coryenvironmental.co.uk/page/rrremissions2012.htm>). A sample report is presented in Appendix F.

HZI has also provided a summary of heavy metals emissions from a number of reference plants in the UK which employ semi-dry FGT (as is proposed for the EfW facility). These results show that emissions of Hg and Cd are an order of magnitude below the EU IED limits. A summary of the data is provided in Appendix F.

7.3 Emissions during Normal Operations

Emission rates for modelling are estimated based on the EfW facility meeting the more stringent limits prescribed in the IED, as outlined in Table 4-3. In October 2015, Ramboll, the owner's engineers, updated the in-stack concentration estimates for all air quality parameters. These updated concentration

estimates are based on stack testing data for existing reference facilities. More information is provided in the technical memorandum provided by Ramboll in Appendix C.

The emission rates (g/s) adopted for modelling of each stack presented in Table 7-4 are derived from the in-stack concentrations provided by Ramboll in Appendix G and the flue gas flow rate per stack (Nm³/s) shown in Table 7-8. A summary of the in-stack concentration estimates adopted is additionally documented within Appendix G.

Table 7-4: Emission rates per stack during normal operations

Emission Parameter	In-stack concentration during normal operations (mg/m ³) ^(a)	Mass emission rate used to model normal operations (g/s)
Oxides of Nitrogen (NO _x expressed as NO ₂)	188	24
SO ₂	27	3.4
CO	23	2.9
PM	1.0	0.1
HCl	9.0	1.1
HF	4.0	0.5
Cd	0.009	0.001
Hg	0.004	0.001
Dioxins and furans	0.000000010	0.000000001
TOC (as benzene)	0.015	0.002
NH ₃	2.0	0.3
H ₂ S	5.0	0.6
PAH (as benzo(a)pyrene)	0.0005	0.00006
C ₁₂	9.0	1.1

Notes: (a) Reference conditions defined as dry, 273.15 K, 101.3 kPa and 7% O₂ for all air impurities when burning a solid fuel.

7.4 Emissions during Start-up / Shut-down Conditions

As discussed in Section 2.3 a clean auxiliary support fuel will be used in the incinerator to regulate the temperature. It is understood that the fuel would comprise diesel, with all emissions released from the 100m stack. As the nature of the emissions from the combustion of diesel fuel would burn significantly cleaner than the residual waste fuel, and in consideration of the infrequent occurrence of start-up and shut down, emissions during such conditions have not been further assessed.

7.5 Emissions during Upset Conditions

As per the normal operations, in-stack concentrations for 'upset conditions' were provided by Ramboll (2016), shown in Appendix G. The emissions modelled are presented in Table 7-5.

Table 7-5: Emissions per stack during upset conditions

Emission parameter	In-stack concentration during upset conditions (mg/m ³) ^(a)	Mass emission rate used to model upset conditions (g/s)
Oxides of Nitrogen (NO _x expressed as NO ₂)	1880	238.8
SO ₂	270	34.3
CO	230	29.2
PM	150	19.1
HCl	90	11.4
HF	40	5.1
Cd	0.09	0.011
Hg	0.013	0.002
TOC (as benzene)	0.15	0.019
NH ₃	20	2.5

Notes: (a) Reference conditions defined as dry, 273.15 K, 101.3 kPa and 7% O₂ for all air impurities when burning a solid fuel.

When considering upset operating conditions it is always a matter of balance between stated upset emission level, the probability of occurrence, and the duration of emission at such elevated rates. Very high emission rates would occur rarely and for short time because plant shutdown would likely be an imminent consequence, whereas slightly elevated levels could occur occasionally and for some length of time until the necessary actions are put into force.

In the event of upset conditions strict management measures should be followed to ensure that elevated emissions are minimised.

7.6 Emissions during operation of emergency diesel generators

Two emergency diesel generators will operate as part of the Project. Dispersion modelling has been used to assess the ground level concentrations during the operation of the diesel generators during emergency conditions. The adopted mass emission rates and stack parameters are provided in Table 7-6.

To reiterate that already outlined in Section 2.6, the diesel generators are only required in case of an emergency when there is a black out of the power grid and the plant fails to run in "island mode" (island mode is the generation of power by the turbine/generator of the plant for internal use without any connection to the power grid). The generators will then ensure a safe shutdown of the plant. The operation time of these generators is therefore maximum a few hours per event. Further, the generators are not used to maintain the furnace temperature.

A manufacturer's guarantee has been provided by Cummins (2015) that the emergency diesel generators will operate within the POEO Regulation emission limits. A copy of the emission performance specifications for the emergency diesel generators is provided as Appendix H.

The owner's engineers have confirmed (Pers. Comm. Martin Brunner, Ramboll) that benzene composition within the emergency diesel generator exhaust is anticipated to be well below 1%, and this assumption has been adopted for modelling purposes. It is anticipated that this can be confirmed during the commissioning stack testing. If not the case, generators can be retrofitted with catalysts to further reduce in-stack benzene concentrations, as required.

Table 7-6: Pollutant mass emission rates for each emergency diesel generator

Parameters	Input
Stack coordinates (UTM)	298536 mE, 6257776 mN 298683 mE, 6257757 mN
Stack height	3.2 m
Stack diameter	0.5 m
Exit velocity	39 m/s
Exit temperature	736 K
NOx mass emission rate	3.10 g/s
CO mass emission rate	1.41 g/s
PM mass emission rate	0.20 g/s
VOCs mass emission rate	3.10 g/s

7.7 NSW Clean Air Regulation in-stack Concentration Limits

The POEO Regulation in-stack concentration criteria relevant to this assessment are presented in Table 7-7. To inform future Environmental Protection Licensing of the EfW facility, in addition to the normal and upset conditions, ground level concentrations resulting from a Regulatory scenario (in-stack concentrations at the POEO emission limits) have also been presented in Section 9.

Table 7-7: POEO (Clean Air) Regulation Emission Limits

Emission parameter	POEO Regulation limit (mg/m ³)
Oxides of Nitrogen (NOx expressed as NO ₂)	500
SO ₂	n/a
CO	125
PM	50
HCl	n/a
HF	n/a
Cd	0.20
Hg	0.20
Dioxins and furans	1.0x10 ⁻⁷
TOC	40
NH ₃	n/a
H ₂ S	5
PAH (as benzo(a)pyrene)	n/a

Reference conditions defined as dry, 273.15 K, 101.3 kPa and 7% O₂ for all air impurities when burning a solid fuel, with the exception of dioxins and furans where the required O₂ concentration is 11% for waste incineration.

There are no provisions in NSW legislation or policy documents that prescribe the allowable number of hours emission limits can be exceeded. The Proponent acknowledges the requirements to comply with the Clean Air Regulation and EPL limits at all times.

In the event that the emission limit does not satisfy the ground level concentration criterion then a more stringent in-stack emission limit would be proposed.

7.8 Stack Parameters

The EfW facility will be designed in two phases (TNG1 and TNG2), with a dedicated stack servicing each phase. Each stack will comprise two waste lines. For the purposes of this assessment, the emissions associated with the two waste lines reporting to each stack have been combined. The modelled stack parameters for each of stack are provided in Table 7-8.

Ramboll produced a technical memorandum in which they document flue gas flow rates and exit parameters that have been derived during the detailed design process. The exit parameters advised by the owner's engineers are provided within their technical memorandum included as Appendix C

Table 7-8: Stack parameters for modelling

Parameter	Original Air Quality Assessment	Revised (Current) Modelling
Stack Location (m, MGA, Zone 56)	298632.9 (E) 6257733.5 (N)	
	298574.6 (E) 6257741.3 (N)	
Base Elevation (m, AHD)	~65	
Stack Height (m)	100	
Stack Diameter (m)	2.5	2.2
Temperature (°C)	120	
Flue Gas Flow (Nm ³ /s)	139.3	127.0
Gas Exit Flow Rate (Am ³ /s)	175.8	165.2
Gas Exit Velocity (m/s)	35.8	21.7

Nm³/s = reference gas flow, dry at 11% O₂. Am³/s = actual gas flow, wet, corrected for temperature

7.9 Release of Dioxins/Furans

Ramboll have provided a dedicated memorandum on the subject of dioxin control within Appendix C, which speaks directly to emission performance and implications under the Stockholm Convention. The following aspects are highlighted:

- The flue gas treatment stage consists of a reactor with injection of lime and activated carbon for dioxin adsorption followed by a bag house filter for dust separation, including the activated carbon particles with dioxin adsorbed.
- The flue gas treatment system ensures that the stack emissions comply with the emission requirement of 0.1 ng/m³ (at reference conditions; EC, 2010) regardless the content in the raw, untreated flue gas within any realistic operational range.
- This technology is compliant with provisions of the EU Best Available Techniques as described in the BAT reference note (EC, 2006).
- The dioxin content of the incoming waste is anticipated to grossly exceed the sum of the outputs such that the TNG EfW facility is a net destructor of dioxin (atmospheric emissions of dioxin are expected to comprise less than 1% of the content of the incoming waste).
- The total dioxin emission from the TNG EfW facility is estimated to be around 0.02% of the Australian inventory, and 0.05% of the contribution from Australian backyard incineration activities.

Appendix E.1 directly addresses the TNG EfW facility's emission performance and associated implications under the Stockholm Convention. The following aspects of this memorandum are highlighted:

- When waste is directed to the TNG EfW facility, less waste will be available for open and other uncontrolled burning of waste, including unintended landfill fires. This is anticipated to have a

large beneficial impact on the control of persistent organic pollutants (POPs) from waste management because emissions from uncontrolled burning of waste are several orders of magnitude higher than from a modern EfW facility.

- The Stockholm Convention specifically mentions the following to be considered in determining **best available techniques for dioxin control**; *"Use of improved methods for flue-gas cleaning such as thermal or catalytic oxidation, dust precipitation, or adsorption"*.
- The TNG EfW facility will be constructed using the Best Available Techniques (BAT) as described in the convention. It uses dust precipitation and adsorption in the flue gas treatment system.
- All residues from the process (bottom ash and flue gas treatment residue, including fly ash) are **expected to be well below the "low POP content" threshold for wastes**. This means that the Stockholm Convention does not require further treatment of the residues prior to disposal when it comes to the dioxin content.

The presence of ultra-fine and sub-micron particulate in the environment is acknowledged. It is highlighted that the particulate generated by the EfW facility is expected to be less than 2.5 micrometres in aerodynamic diameter (PM_{2.5}) with particle size distributions similar to conventional combustion sources.

Related to this topic, it is noted that deposition data has been requested as input to the revised Health Risk Assessment (AECOM, 2015). Given that particulate matter less than 2.5 micrometres are not readily affected by gravitational settling, to generate a non-zero outcome, deposition modelling has been completed based on a 10 micrometre (PM₁₀) size fraction. This is considered conservative for deposition purposes, and in reality the PM₁₀ size fraction is anticipated to be equivalent to (i.e. lie within) the PM_{2.5} size fraction.

7.10 Treatment of Emissions of Oxides of Nitrogen (NO_x)

Nitrogen oxides (NO_x) emitted from combustion are comprised mainly of nitric oxide (NO) and nitrogen dioxide (NO₂). Typically, at the point of emission, NO_x would consist of approximately 90-95% of NO and 5-10% of NO₂. The dominant mechanism for short-term conversion of NO to NO₂ is through oxidation with atmospheric ozone (O₃) as an exhaust plume travels from source. Therefore, to predict the ground-level concentration of NO₂ (regulated oxide of nitrogen) it is important to account for the transformation of NO_x to NO₂. Ultimately, all NO emitted into the atmosphere will be oxidised to NO₂ and to other higher oxides of nitrogen. The rate at which this oxidation takes place depends on prevailing atmospheric conditions including temperature, humidity and the presence of other substances in the atmosphere such as O₃. It can vary from a few minutes to many hours. If the dispersion is sufficient to have diluted the plume to the point where the concentration is very low, it is unimportant that the oxidation has taken place. However, if the oxidation is rapid then high concentrations of NO₂ can occur when inadequate dispersion / dilution conditions exist. For this report we have conservatively assumed 100% conversion of NO_x to NO₂.

7.11 Treatment of dust deposition

The Human Health Risk Assessment requires the deposition of particulate-phase pollutants (dioxins/furans, PAHs and all metals) to be calculated. Given that particulate matter less than 2.5 micrometres (PM_{2.5}) are not readily affected by gravitational settling, to generate a non-zero outcome, deposition modelling has been completed based on a 10 micrometre (PM₁₀) size fraction. This is considered conservative for deposition purposes, and in reality the PM₁₀ size fraction is anticipated to be equivalent to (i.e. lie within) the PM_{2.5} size fraction.

7.12 Odour

Residual waste fuel will arrive to the EfW facility in covered trucks or via an enclosed conveyor from the Genesis facility. The EfW facility will employ high speed roller doors for truck access to ensure fugitive odour emissions are minimal. All residual waste fuel storage and unloading will take place within the tipping hall building, which is kept at negative pressure with air extracted from the building will be used

as excess air in the boiler. Odour emissions from the EfW facility have been addressed in a stand-alone quantitative assessment (Pacific Environment, 2016a). The results of this assessment show that the odour concentrations would be below the impact assessment criterion of 2 ou.

7.13 Fugitive Dust Emissions

As discussed in Section 2, residual waste fuel would be transported onsite via sealed roads. The use of sealed roads is considered an effective management strategy in the reduction of fugitive dust emissions, specifically those related to wheel generated dust emissions.

As already discussed, the tipping hall building will also operate under negative pressure whereby air within the building will be used as excess air for the boilers, limiting the release fugitive dust emissions generated within the shed to the ambient environment (as this will subsequently pass through the FGT's bag house).

On the basis of the above, the EfW facility is considered to have minimal potential for the generation of fugitive dust emissions provided good dust management practices are adhered to. Therefore this aspect has not been addressed further.

7.14 Emissions from Trucks Entering the Site

As discussed in Section 2.1, a maximum of 252 trucks would enter the site per day, resulting in localised diesel vehicle emissions with the air quality metrics of interest being NO_x, CO, PM_{2.5}, SO_x and VOCs. These additional emission sources are anticipated to be negligible in view of the location of the Project abutting the M4 and M7 motorways (see Figure 3-1).

For example, the average daily traffic count for 2016 on the M4 at Homebush is 88,700 vehicles and at near Penrith (north of Loftus Street) is 59,600 vehicles per day (RMS, 2016) (no traffic data were available for Eastern Creek or for the M7 Motorway). The additional truck movements associated with the Project equates to a 0.3% to 0.4% increase of vehicles per day. Such a small change in vehicle numbers is anticipated to make a non-discernible difference in local air quality.

Furthermore, not only are some of the closest residential residences situated in much closer proximity to the respective motorways, but the motorways also are located between the Project and the majority of these receptors.

7.15 Construction

The main air pollution and amenity issues at construction sites are:

- Annoyance due to dust deposition (soiling of surfaces) and visible dust plumes.
- Elevated PM₁₀ concentrations due to dust-generating activities.
- Exhaust emissions from diesel-powered construction equipment.

Exhaust emissions from on-site plant and site traffic are unlikely to have a significant impact on local air quality, and in the majority of cases they will not need to be quantitatively assessed (IAQM, 2014). Very high levels of soiling can also damage plants and affect the health and diversity of ecosystems.

Dust emissions can occur during the preparation of the land (e.g. demolition and earth moving) and during construction itself, and can vary substantially from day to day depending on the level of activity, the specific operations being undertaken, and the weather conditions. A significant portion of the emissions results from site plant and road vehicles moving over temporary roads and open ground. If mud is allowed to get onto local public roads, dust emissions can occur at some distance from the construction site (IAQM, 2014).

The risk of dust impacts from a demolition/construction site causing loss of amenity and/or health or ecological impacts is related to the following (IAQM, 2014):

- The nature of the activities being undertaken.
- The duration of the activities.
- The size of the site.
- The meteorological conditions (wind speed, direction and rainfall). Adverse impacts are more likely to occur downwind of the site and during drier periods.
- The proximity of receptors to the activities.
- The sensitivity of the receptors to dust.
- The adequacy of the mitigation measures applied to reduce or eliminate dust.

It is difficult to quantify dust emissions from construction activities. Due to the variability of the weather it is impossible to predict what the weather conditions would be when specific construction activities are undertaken. Any effects of construction on airborne particle concentrations would also generally be temporary and relatively short-lived. Moreover, mitigation should be straightforward, as most of the necessary measures are routinely employed as 'good practice' on construction sites.

Construction dust impacts are typically assessed as a qualitative assessment. The impacts of construction have not been modelled; rather a risk based approach is used based on a method outlined in IAQM (2014). The IAQM guidance is designed primarily for use in the UK, although it may be applied elsewhere.

7.15.1 Construction Activities

Activities on construction sites can be divided into three types to reflect their different potential impacts, and the potential for dust emissions is assessed for each activity that is likely to take place. It is noted that there will be no demolition and therefore demolition works is not assessed.

The activities considered are:

- Earthworks. This covers the processes of soil stripping, ground levelling, excavation and landscaping. Earthworks will primarily involve excavating material, haulage, tipping and stockpiling.
- Construction. Construction is any activity that involves the provision of new structures, modification or refurbishment. A structure will include a residential dwelling, office building, retail outlet, road, etc.
- Track-out. This involves the transport of dust and dirt by HDVs from the construction/demolition site onto the public road network, where it may be deposited and then re-suspended by vehicles using the network.

The construction works will follow a staged approach as summarised in Table 7-9.

Table 7-9: EFW facility construction timeframes

Stage		Timeframe
Stage 1	Site establishment and clearance	2 weeks
Stage 2	Excavation/Services Lead-in	6-10 months
Stage 3	Structure	5 months
Stage 4	Technology provider plant Installation Structural Steel Works	16-18months 4-6 months
Stage 5	Façade/Roofing	4 months
Stage 6	Fit out/Landscaping	5 months

7.15.2 Assessment Procedure

The IAQM assessment procedure for assessing risk is shown in Figure 7-1. The assessment is used to define appropriate mitigation measures to ensure that there will be no significant effect.

The assessment methodology considers three separate dust impacts:

- Annoyance due to dust soiling.
- The risk of health effects due to an increase in exposure to PM₁₀.
- Harm to ecological receptors.

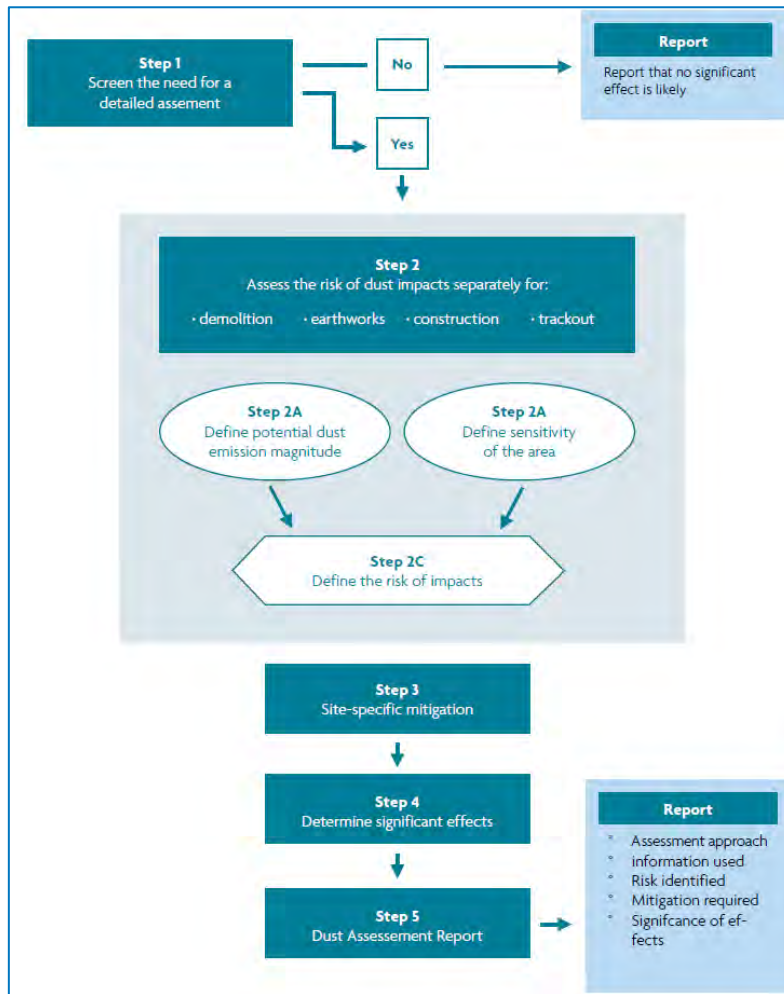


Figure 7-1: Steps in an assessment of construction dust (IAQM, 2014)

7.15.3 Step 1: Screening

Step 1 is a screening assessment to determine if detailed assessment is required. A construction dust assessment will normally be required where:

- There are human receptors within 350 m of the boundary of the site and/or within 50 m of the route(s) used by construction vehicles on the public highway, up to 500 m from the site entrance(s).
- There are ecological receptors within 50 m of the boundary of the site and/or within 50 m of the route(s) used by construction vehicles on the public highway, up to 500 m from the site entrance(s).

A 'human receptor', refers to any location where a person or property may experience the adverse effects of airborne dust or dust soiling, or exposure to PM₁₀ over a time period relevant to air quality standards and goals. In terms of annoyance effects, this will most commonly relate to dwellings, but may also refer to other premises such as buildings housing cultural heritage collections (e.g. museums and galleries), vehicle showrooms, food manufacturers, electronics manufacturers, amenity areas and horticultural operations (e.g. salad or soft-fruit production). An 'ecological receptor' refers to any sensitive

habitat affected by dust soiling. This includes the direct impacts on vegetation or aquatic ecosystems of dust deposition, and the indirect impacts on fauna (e.g. on foraging habitats) (IAQM, 2014).

In the context of the site, the nearest human receptors are works at the Genesis Xero MPC and the adjacent Hanson site. In the case of Genesis Xero MPC, the site is likely already exposed to dust arising from proximity to the former quarry and the operation of waste processing facility. In the case of the Hanson, it is noted that the site is currently vacant. Residential receptors are located at some distance, 1 km to the west and north well beyond the 350m buffer.

As the proposal involves the removal of existing vegetation from the site (and vegetation on the adjacent Hanson site has been approved for removal) there is limited potential to affect ecological receptors. The Ropes Creek Tributary to the south, despite its degraded state would be considered an ecological receptor.

Nevertheless, the context of the area is not considered to be sensitive to dust associated with construction works, owing to the nature of the existing land uses and therefore no quantitative assessment of construction phase impact has been completed.

It is assumed that routinely employed 'good practice' mitigation measures for construction sites would be sufficient to control dust impacts to acceptable levels. Such methods would include, but not be limited to the use of water sprays to suppress dust, stockpile management and planting of native cooch grass at the lay down pads as soon as practicable following completion of works. These mitigation measures would be detailed within the Construction Environmental Management Plan for the site.

Furthermore, Brookfield Multiplex and AT&L have considered the potential soil migration from the site as a consequence of the proposed construction works and each has identified a range of management and mitigation options that may be implemented to avoid and mitigate impacts on the receiving environment.

8 MODELLING APPROACH

The overall approach to the assessment has followed the Approved Methods using the Level 2 assessment methodology. The Approved Methods specify how assessments based on the use of air dispersion models should be completed. They include guidelines for the preparation of meteorological data to be used in dispersion models and the relevant air quality criteria for assessing the significance of predicted concentration and deposition rates from the EfW facility. The approach taken in this assessment has followed as closely as possible the approaches provided within the Approved Methods.

8.1 Modelling System

AERMOD was chosen as a suitable dispersion model due to the source type, location of nearest receiver and nature of local topography. AERMOD is the US EPA's recommended steady-state plume dispersion model for regulatory purposes. AERMOD replaced the Industrial Source Complex (ISC) model for regulatory purposes in the US in December 2006. Ausplume, a steady state Gaussian plume dispersion model developed by the Victorian EPA and frequently used in Australia for simple near-field applications is based on ISC, which has now been replaced by AERMOD. While AERMOD has not been explicitly listed as an approved model by the EPA in the Approved Methods, AERMOD has been used for a number of assessments that have been approved by NSW EPA (Pacific Environment 2013a; 2013b).

A significant feature of AERMOD is the Pasquill-Gifford stability based dispersion is replaced with a turbulence-based approach that uses the Monin-Obukhov length scale to account for the effects of atmospheric turbulence based dispersion.

The AERMOD system includes AERMET, used for the preparation of meteorological input files and AERMAP, used for the preparation of terrain data. Ground level concentrations were modelled across a 10km by 10km domain at 100m resolution. The size of the modelling domain is considered adequate to capture the maximum predicted ground level concentrations associated with the Project's activities, including emissions from the proposed 100m stacks.

Terrain data was sourced from NASA's Shuttle Radar Topography Mission Data (3 arc second [-90m] resolution) and processed to create the necessary input files.

AERMET requires surface and upper air meteorological data as input. Wind speed, wind direction, temperature, relative humidity and sea level pressure were source from the EPA St Marys meteorological station. Cloud cover and cloud height were sourced from the BoM Bankstown Airport AWS. In the absence of upper air sounding data for the area, upper air parameters were calculated using the upper air estimator within the Lakes Environment AERMODview software package.

Appropriate values for three surface characteristics are required for AERMET as follows:

- Surface roughness, which is the height at which the mean horizontal wind speed approaches zero, based on a logarithmic profile.
- Albedo, which is an indicator of reflectivity of the surface.
- Bowen ratio, which is an indicator of surface moisture.

Values of surface roughness, albedo and bowen ratio were determined based on a review of aerial photography for a radius of 3 km centred on the EPA St Marys station. Default values for cultivated land and urban areas were chosen over two sectors across this area.

8.2 Building Wake Effects

Wind flow is often disrupted in the immediate vicinity of buildings. Plumes emitted nearby are assumed to be unaffected by building wakes if they manage to reach building height plus 1.5 times the lesser of building height or projected building width. If this is not the case, pollutants can be brought to ground within a highly turbulent, generally recirculating cavity region in the immediate lee of the building and/or

be subject to plume downwash and enhanced dispersion in a turbulent region which extends further downwind behind the building.

A simplified building geometry was incorporated for simulation of building wake effects, modelled using BPIP-PRIME model, as shown in Figure 8-1. BPIP-PRIME uses heights and corner locations of buildings in the vicinity of the plume to simulate the effective height and width of the structures. The downwash algorithm calculates effective building dimensions relative to the plume, resolved down to ten degree intervals. AERMOD then calculates the impact of these buildings on plume dispersion and consequently on GLCs.

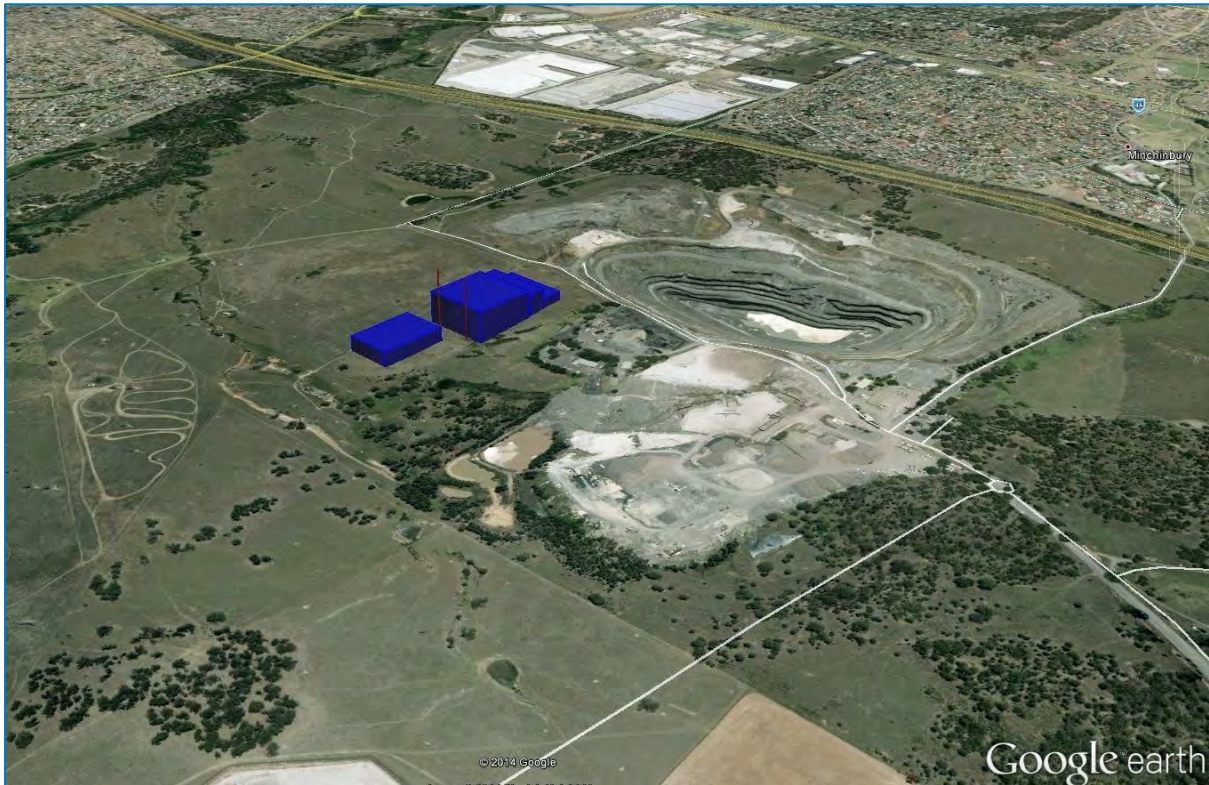


Figure 8-1: Visualisation of the Incorporation of EfW Building Dimensions within the Model

8.3 Sub-hourly Predictions

The AERMOD model outputs ground level concentration predictions for averaging periods of 1-hour and greater. For sub-hourly averaging periods, such as for CO and SO₂, predictions were based on the power-law formula from Borgas (2000) to estimate short-term peak values referencing longer-term average concentrations. For example, to determine a 10-minute peak value from a one-hour value the formula is:

$$C_{10} = C_{60} \times (60/10)^{0.35}$$

C₁₀ is the estimated peak value and C₆₀ is the average one-hour value.

9 LOCAL AIR QUALITY ASSESSMENT

The concentrations of the air quality parameters assessed in this study were determined for boundary, residential, industrial (including potential future industrial/commercial) and community receptors located in the local area (see Section 3).

Contour plots have also been prepared to show the spatial distribution of the assessed pollutants, and these are provided in Section 9.1. Contour plots of pollutant concentrations show the areas that are predicted to be affected by the EfW Project under worst-case dispersion conditions. It is important to note that the contour figures are presented to provide a visual representation of the predicted (worst-case) impacts spatially. To produce the contours it is necessary to make interpolations, and as a result the contours will not always match exactly with predicted impacts at any specific location. The actual predicted pollutant concentrations at nearby receivers are presented in tabular form.

Note that 1-hour ground level concentrations of particulate matter (PM) size fractions have been modelled (Appendix J). The results are provided as an input to the Health Risk Assessment for the project (AECOM, 2016). Given that there are no air quality criteria relevant to 1-hour PM, these results are not discussed in detail within this document.

9.1 Incremental Ground Level Concentrations

9.1.1 Normal Operations

A summary of the predicted ground level concentration (GLC) for each pollutant is presented in Table 9-1. GLCs are presented at and beyond the site boundary, as well as the maximum prediction at sensitive receptors.

Contour plots of predicted GLCs are presented Figure 9-1 to Figure 9-14.

Table 9-1: Summary of predicted ground level concentrations during normal operations

Pollutant	Averaging period	Units	Criteria	Highest prediction at and beyond site boundary	Highest prediction at sensitive receptor
NO ₂ ^(a)	1 hour	µg/m ³	246	77.1	51.5
	Annual	µg/ m ³	62	3.4	3.1
SO ₂	10-minute	µg/ m ³	712	15.9	10.6
	1 hour	µg/ m ³	570	11.1	7.4
	24 hours	µg/ m ³	228	1.9	1.7
	Annual	µg/ m ³	60	0.49	0.45
CO	15-minute	mg/ m ³	100	0.01	0.008
	1 hour	mg/ m ³	30	0.009	0.006
	8 hours	mg/ m ³	10	0.007	0.006
PM ₁₀	24 hours	µg/ m ³	50	0.07	0.06
	Annual	µg/ m ³	30	0.018	0.017
PM _{2.5}	24 hours	µg/ m ³	25	0.07	0.06
	Annual	µg/ m ³	8	0.018	0.017
HCl	1 hour	mg/ m ³	0.14	0.004	0.003
HF	24 hours	µg/ m ³	2.9	0.28	0.26
	7 days	µg/ m ³	1.7	0.21	0.17
	30 days	µg/ m ³	0.84	0.15	0.11
	90 days	µg/ m ³	0.5	0.1	0.09
Cd ^(b)	1 hour	mg/ m ³	0.000018	0.0000037	0.000002
Hg ^(b)	1 hour	mg/ m ³	0.00018	0.0000015	0.00000087
Dioxins and furans ^(b)	1 hour	mg/ m ³	2.00 x 10 ⁻⁹	3.7 x 10 ⁻¹²	2.2 x 10 ⁻¹²
TOC (as benzene) ^(b)	1 hour	mg/ m ³	N/A	5.6 x 10 ⁻⁶	3.3 x 10 ⁻⁶
NH ₃ ^(b)	1 hour	mg/ m ³	0.33	0.0007	0.0004
H ₂ S ^(c)	1 hour	µg/ m ³	1.38	1.2	0.96
PAH (as benzo(a)pyrene) ^(b)	1 hour	mg/ m ³	0.0004	0.0000020	0.0000014

Note: (a) based on the assumption of 100% conversion from NO_x to NO₂.⁹
 (b) expressed as the 99.9th percentile of the dispersion modelling prediction
 (c) expressed as the 99th percentile of the dispersion modelling prediction

Modelling predictions at selected closest residences in the suburbs of Minchinbury and Erskine Park are presented in Appendix J to further inform the Health Risk Assessment.

Modelling results for criteria pollutants are assessed against the maximum prediction at sensitive receptors. In summary, the modelling results show:

- The maximum predicted 1-hour NO₂ is 21% of the impact assessment criterion, even assuming 100% conversion from NO_x to NO₂

⁹ As discussed, we have conservatively assumed 100% conversion of NO_x to NO₂.

- The maximum predicted annual NO₂ is 5% of the impact assessment criterion.
- The maximum predicted 10-minute SO₂ is 1.5% of the impact assessment criterion, for 1-hour 1.3%, for 24-hour SO₂, 0.7% and for annual, 0.8%.
- The maximum predicted 24-hour PM is 0.1% of the impact assessment criterion for PM₁₀ and 0.2% of the advisory reporting standard for PM_{2.5}.
- The maximum predicted annual PM is less than 0.1% of the impact assessment criterion for PM₁₀ and 0.2% of the advisory reporting standard for PM_{2.5}.
- The maximum predicted CO 15-minute, 1-hour and 8-hour averaging periods are 0.1% or less than the relevant impact assessment criterion.
- The maximum predicted 24-hour HF is 9% of the impact assessment criterion, for 7-day 10%, for 30-day HF, 13% and for 90-day, 18%.

For the pollutants above it is also important to consider cumulative impacts due to existing “background” air quality, and other sources of pollution in the area. The cumulative predictions are presented in Section 9.2.1.

Modelling predictions for air toxics are assessed against the 99.9th percentile prediction, at and beyond the site boundary. The individual odour compound H₂S is assessed against the 99th percentile prediction.

In summary, the modelling results show:

- The 99.9th percentile predicted HCl is 2% of the impact assessment criterion.
- The 99.9th percentile predicted cadmium is 11% of the impact assessment criterion.
- The 99.9th percentile predicted mercury is 0.5% of the impact assessment criterion.
- The 99.9th percentile predicted dioxins and furans are 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted TOC (as benzene) is 0.01% of the impact assessment criterion.
- The 99.9th percentile predicted NH₃ is 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted PAH (as benzo(a)pyrene) is 0.4% of the impact assessment criterion.
- The 99th percentile predicted H₂S is 70% of the impact assessment criterion.

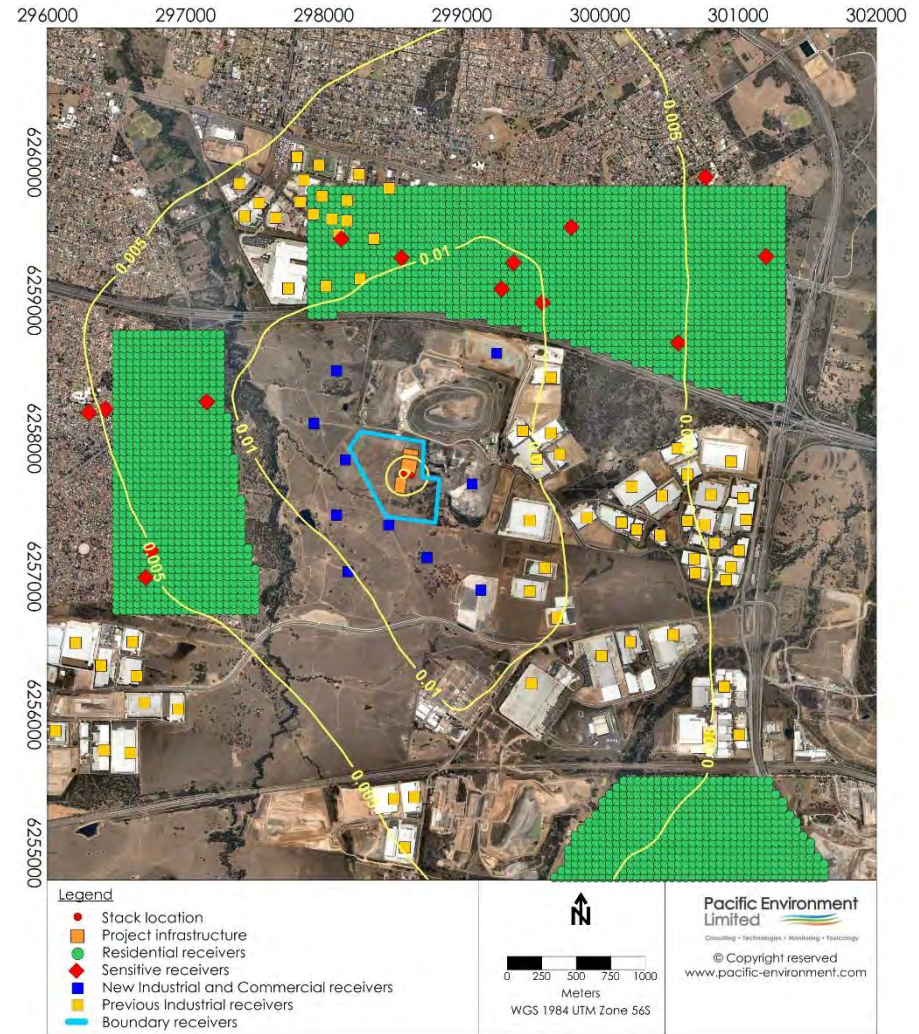
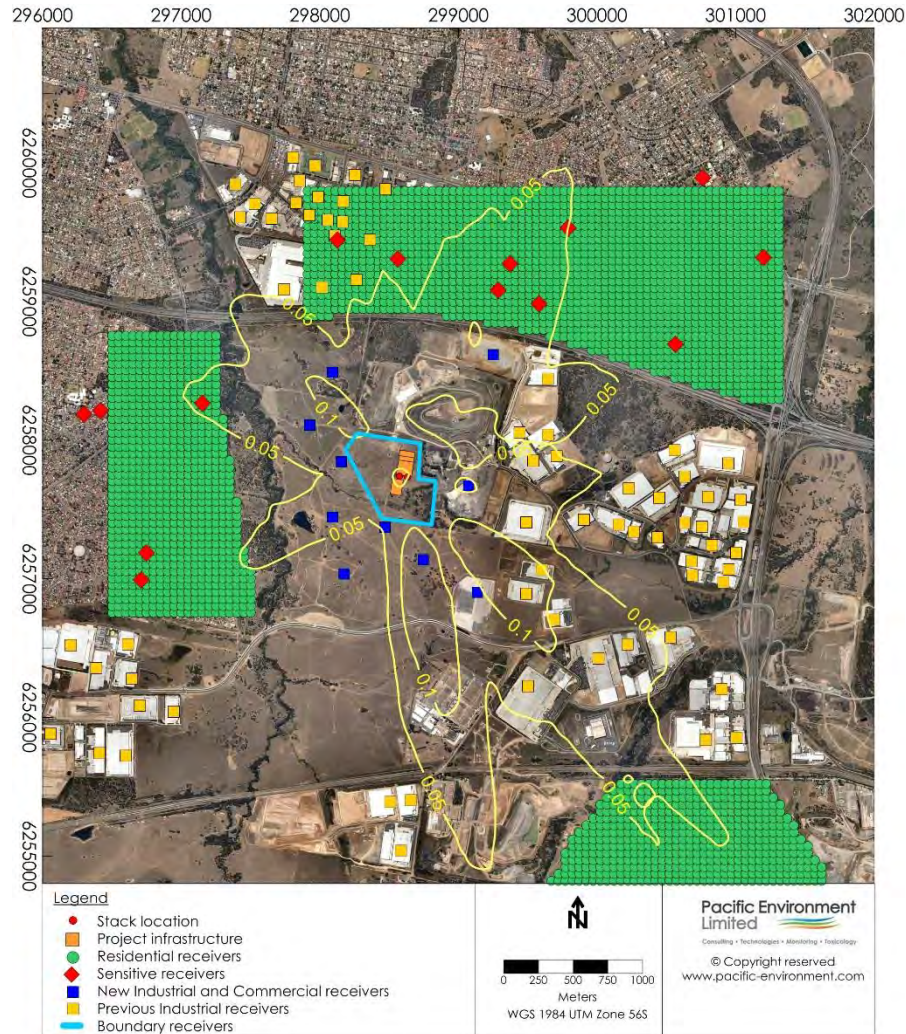


Figure 9-1: Maximum predicted Ground Level PM₁₀ Concentration – µg/m³

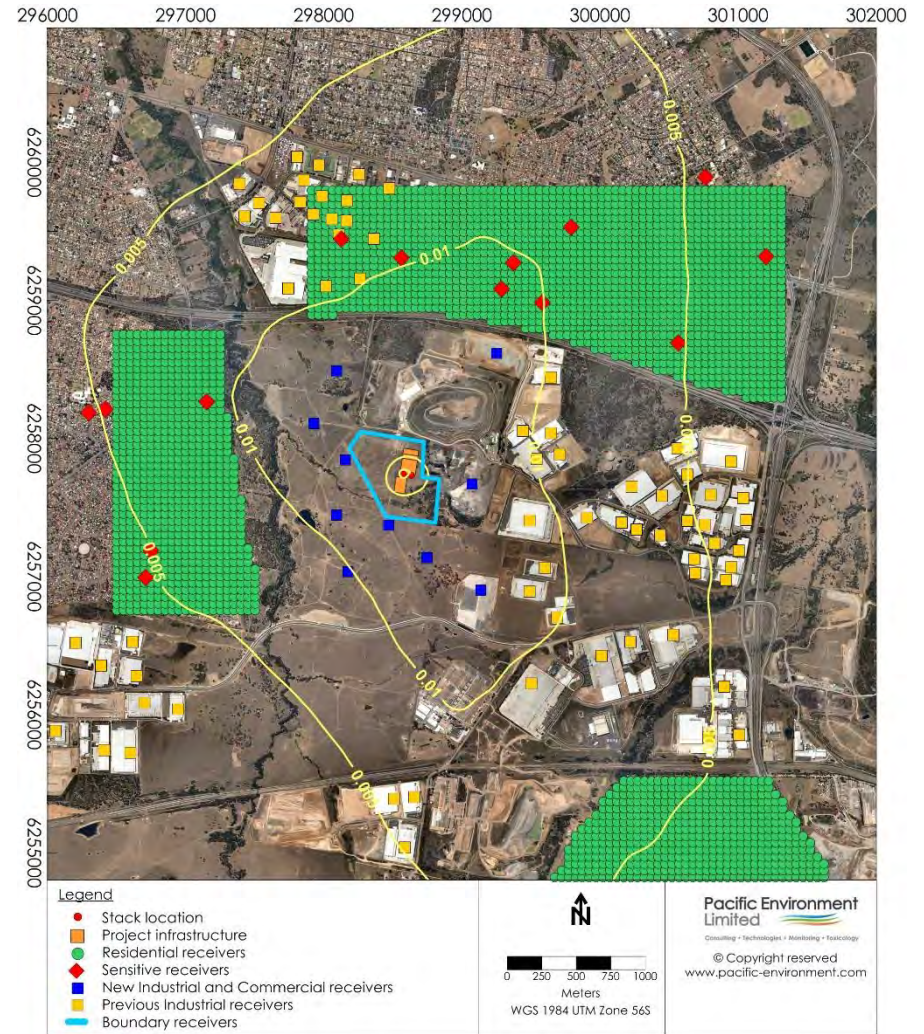
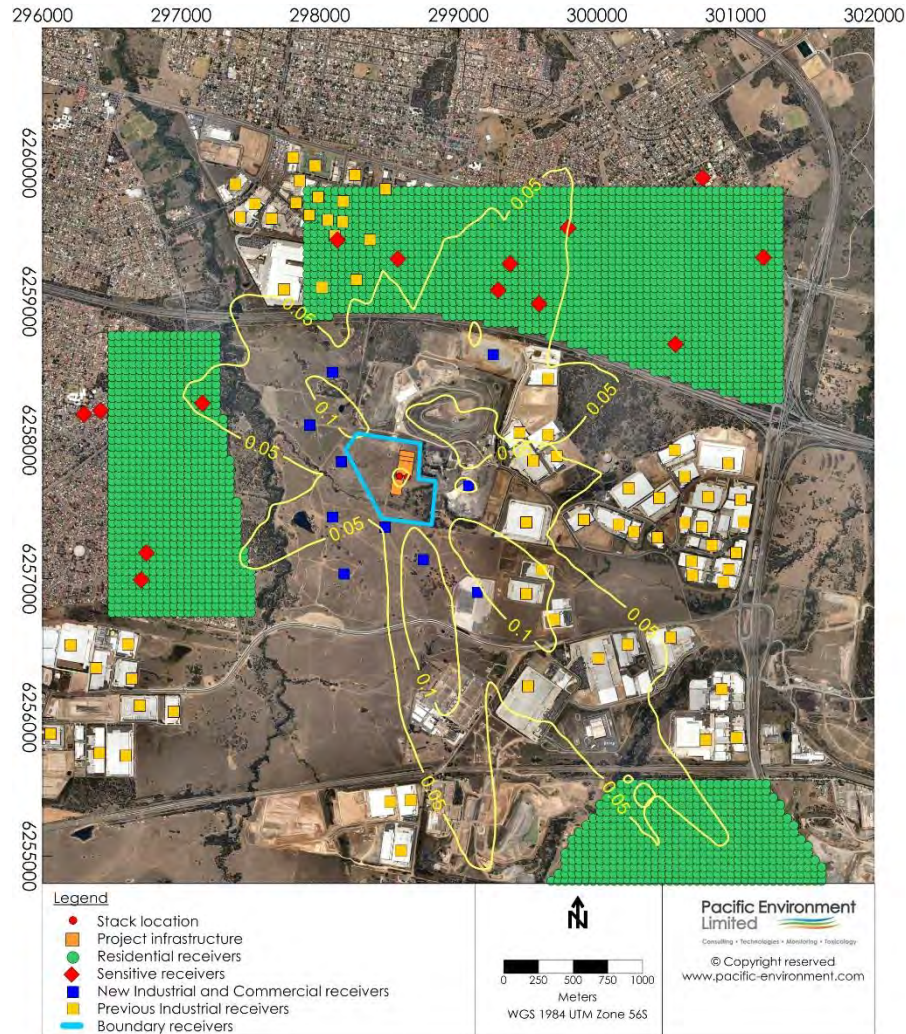


Figure 9-2: Maximum Predicted Ground Level PM_{2.5} Concentration – µg/m³




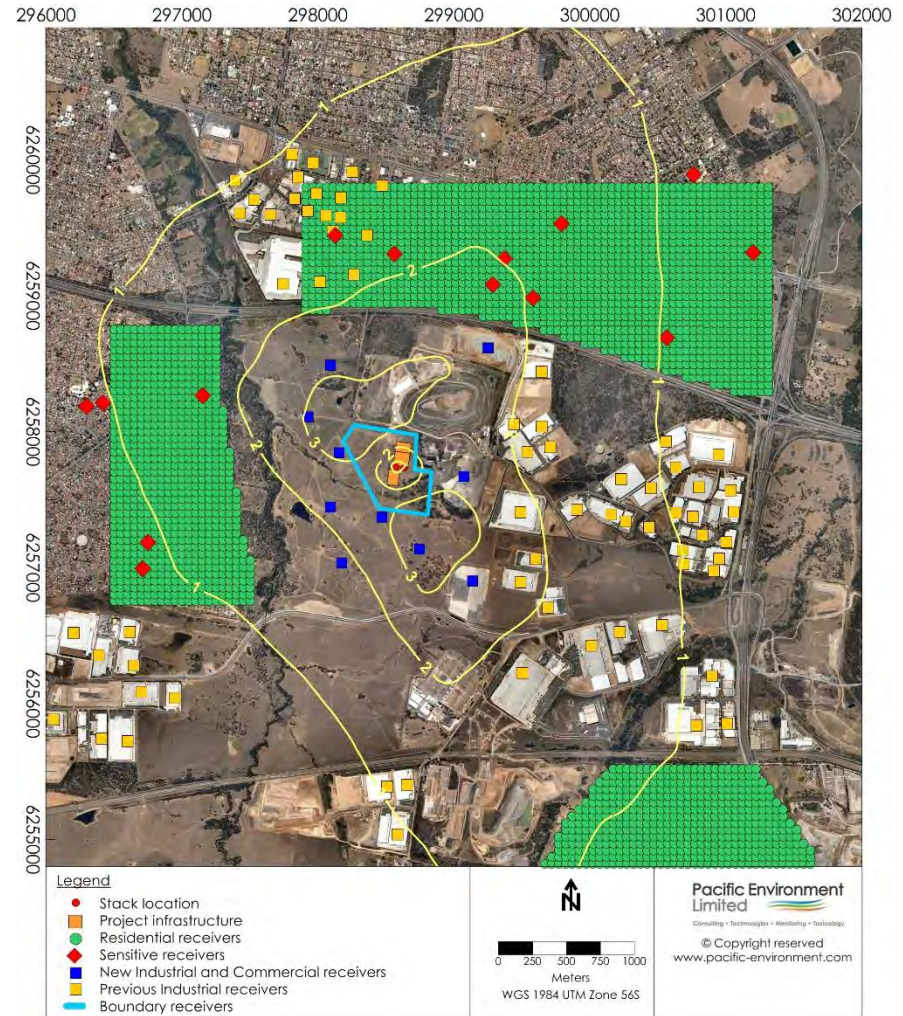


Figure 9-3: Maximum Predicted Ground Level NO₂ Concentration – µg/m³

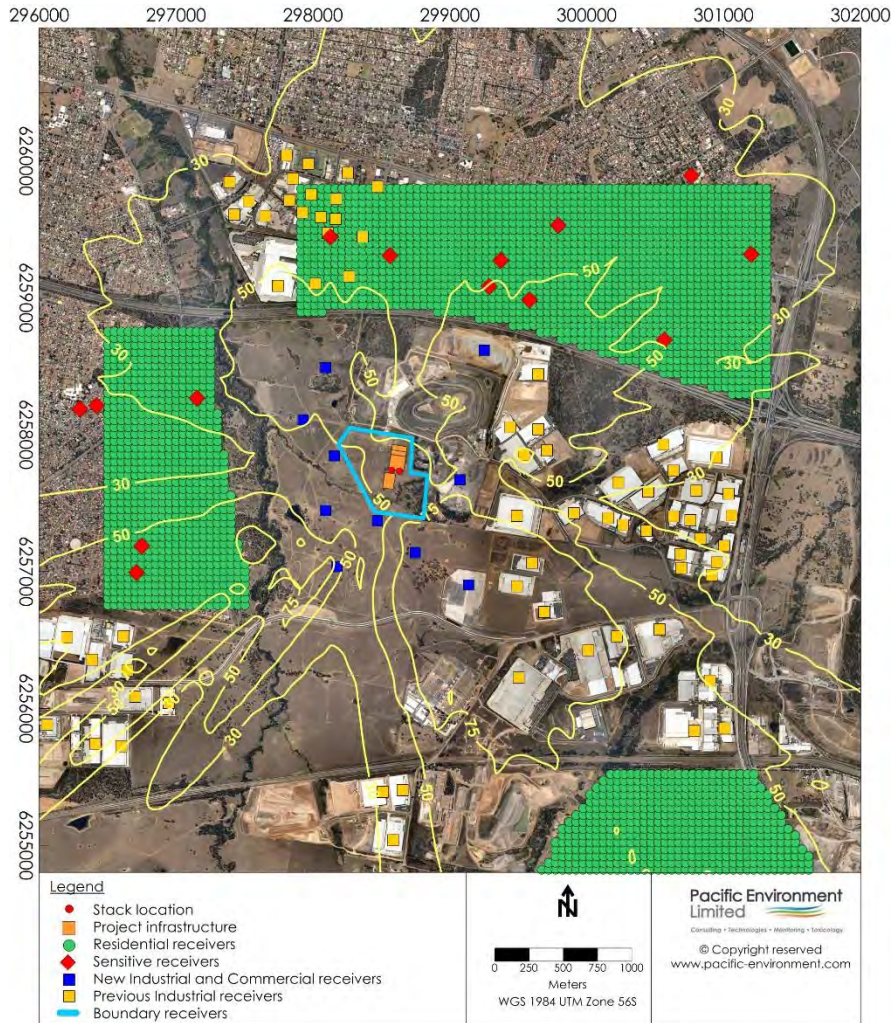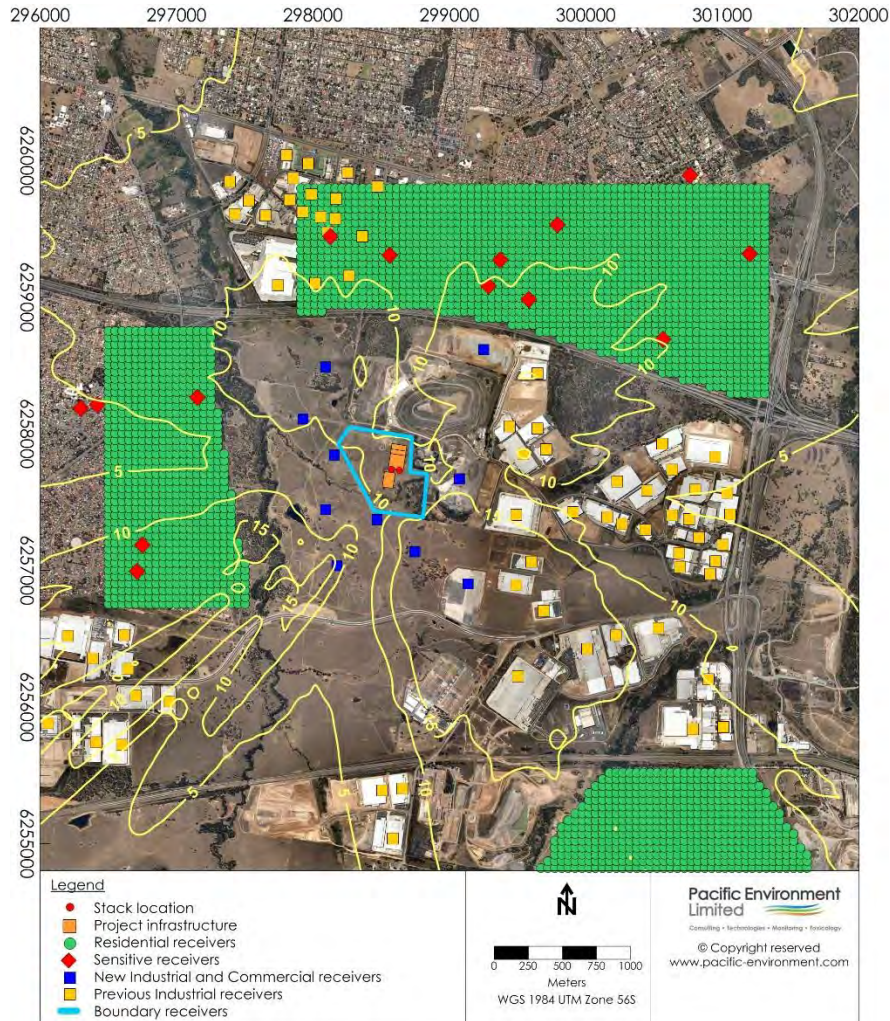


Maximum 10-Minute SO₂ (goal = 712 µg/m³)

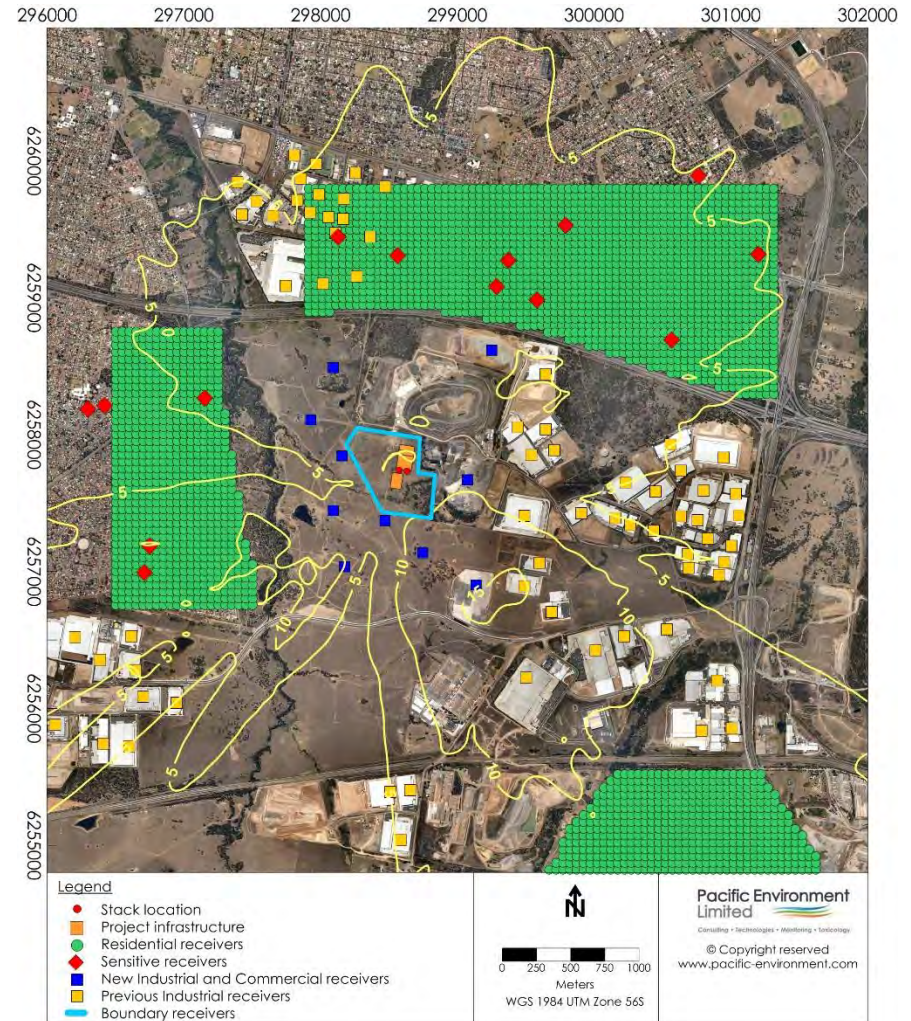

Maximum 1-Hour SO₂ (goal = 570 µg/m³)

Figure 9-4: Maximum Predicted Ground Level SO₂ Concentration – µg/m³

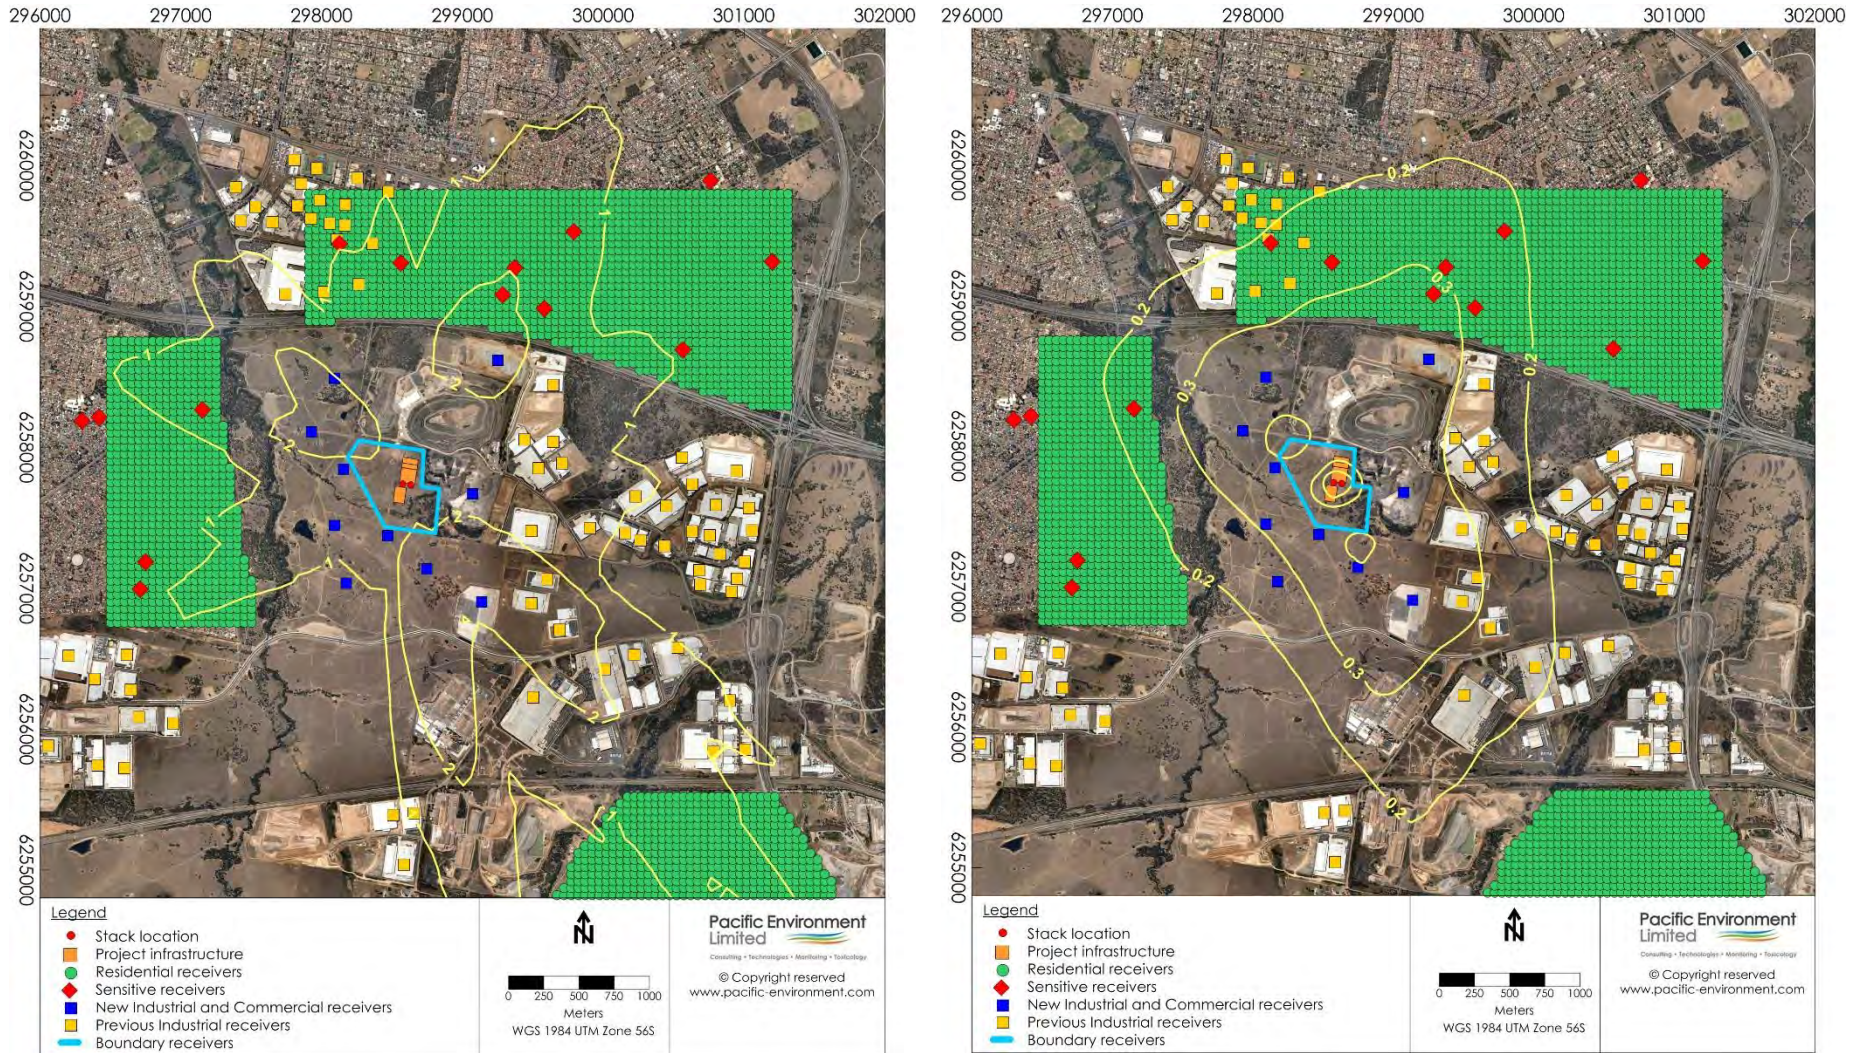

Maximum 24-Hour SO₂ (goal = 228 µg/m³)

Annual Average SO₂ (goal = 60 µg/m³)

Figure 9-5: Maximum Predicted Ground Level SO₂ Concentration – µg/m³



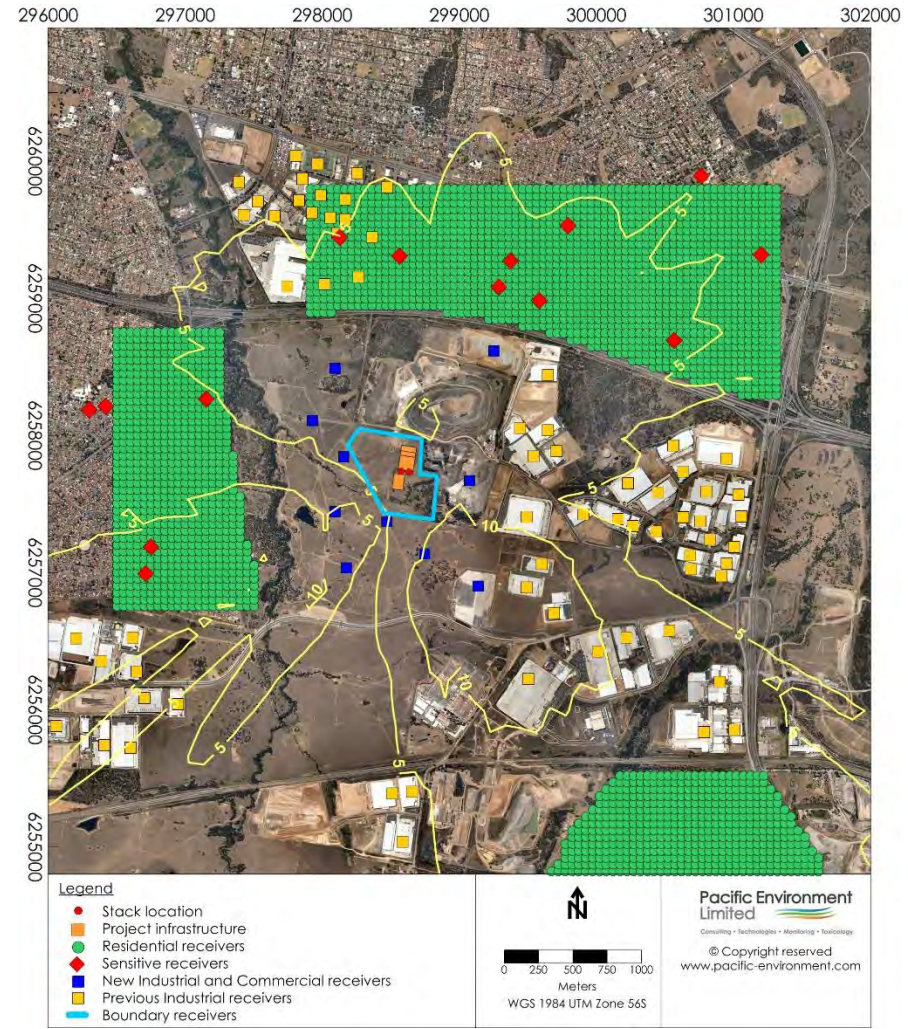


Figure 9-6: Maximum Predicted Ground Level CO Concentration – mg/m³

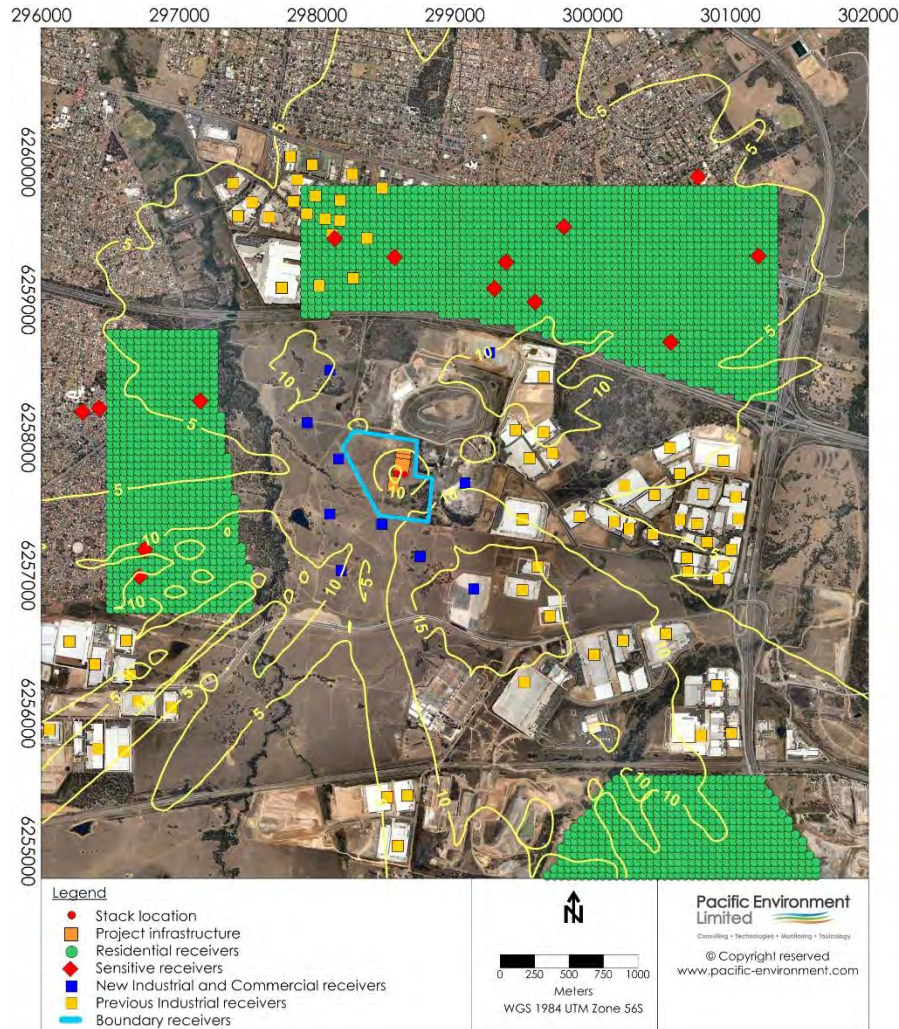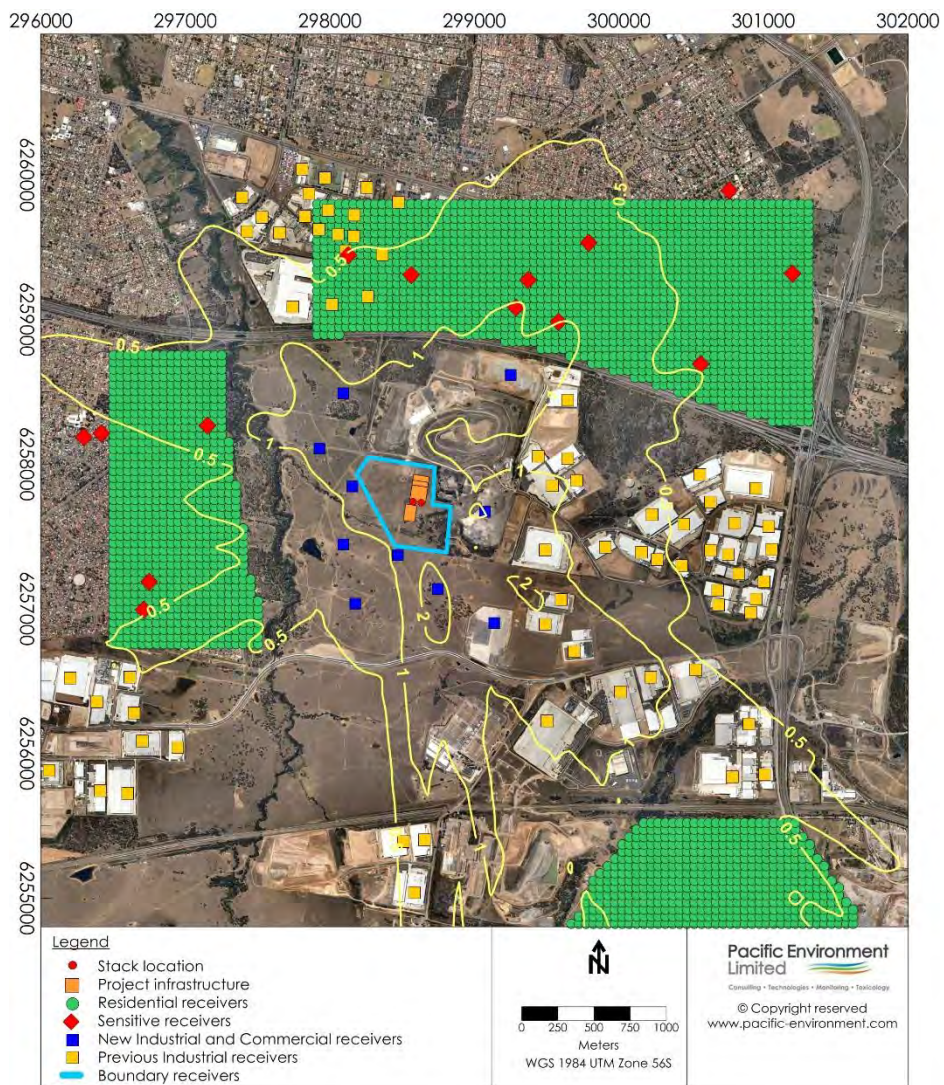

Maximum 8-Hour CO (goal = 10 mg/m³)

Figure 9-7: Maximum Predicted Ground Level CO Concentration – mg/m³



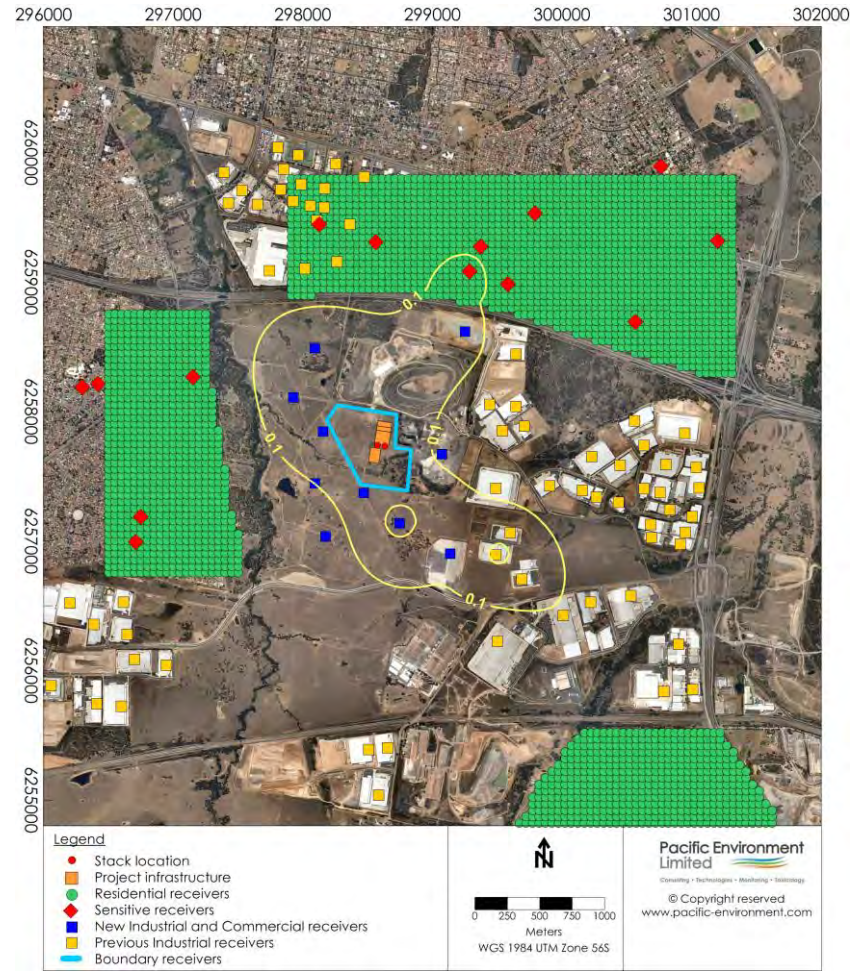


Figure 9-8: Maximum Predicted Ground Level HF Concentration

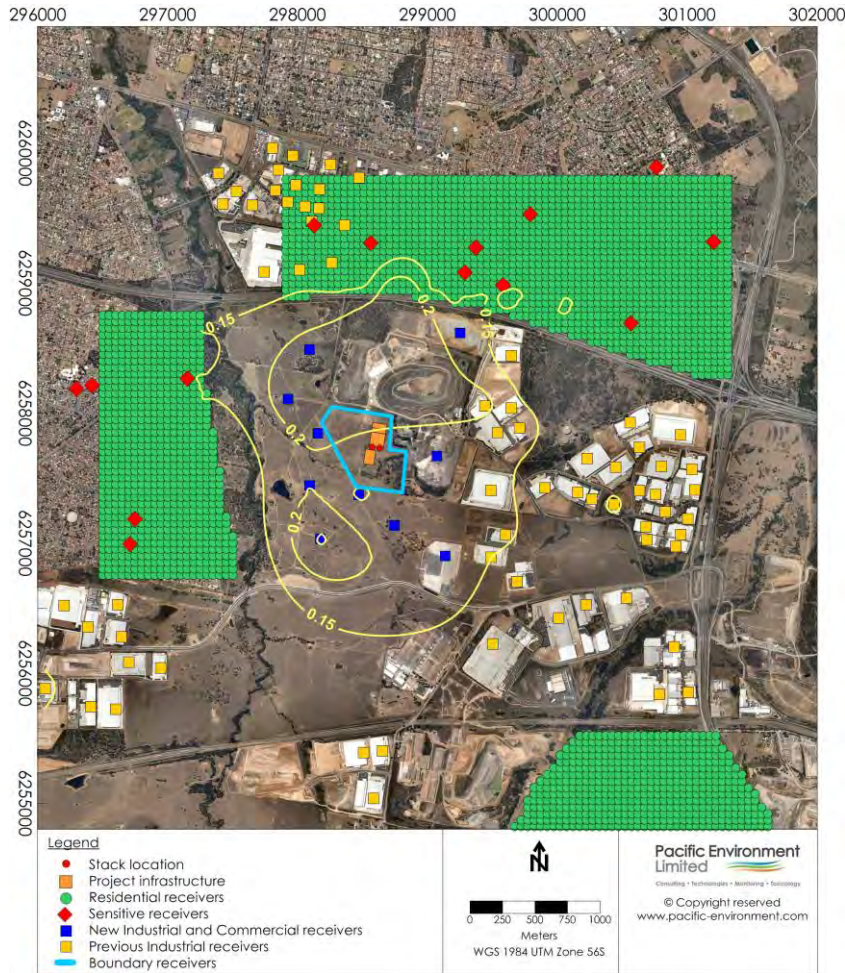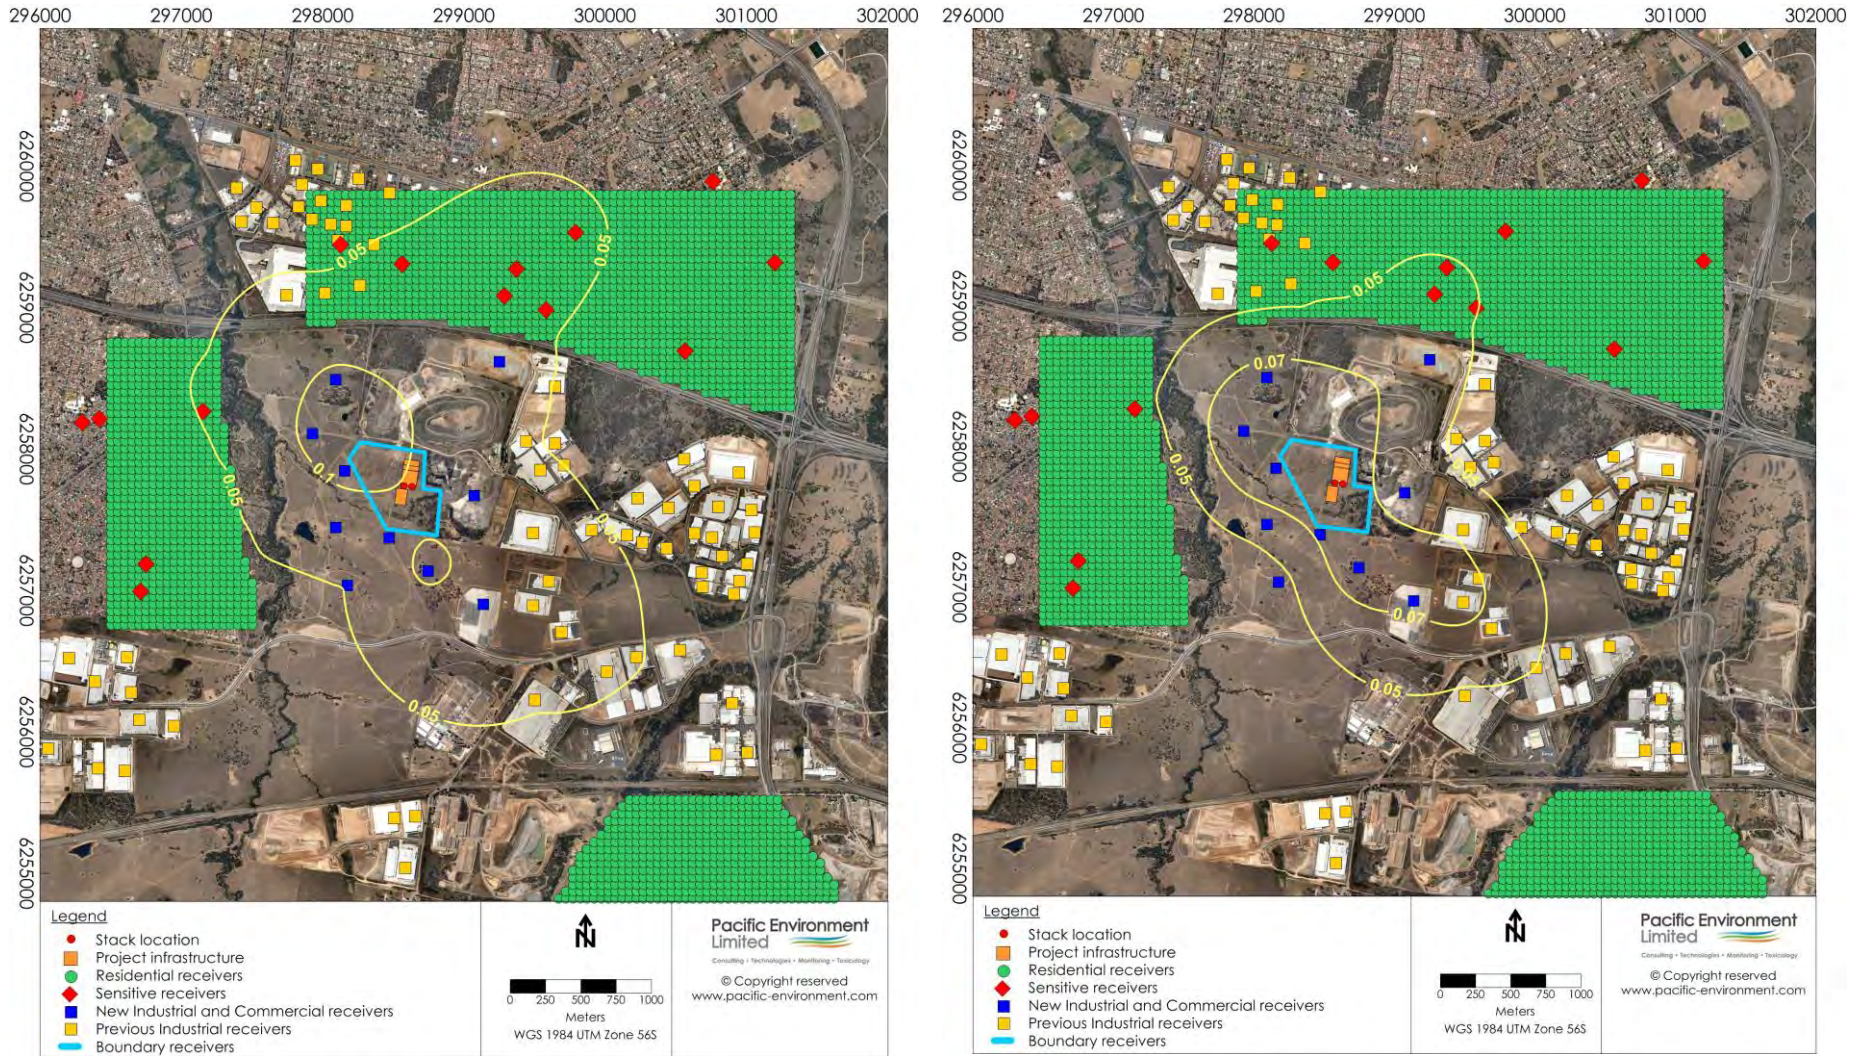

Maximum 30 day HF ($\mu\text{g}/\text{m}^3$) (goal = $0.84 \mu\text{g}/\text{m}^3$)

Maximum 90 day HF (goal = $0.5 \text{ mg}/\text{m}^3$)

Figure 9-9: Maximum Predicted Ground Level HF Concentration

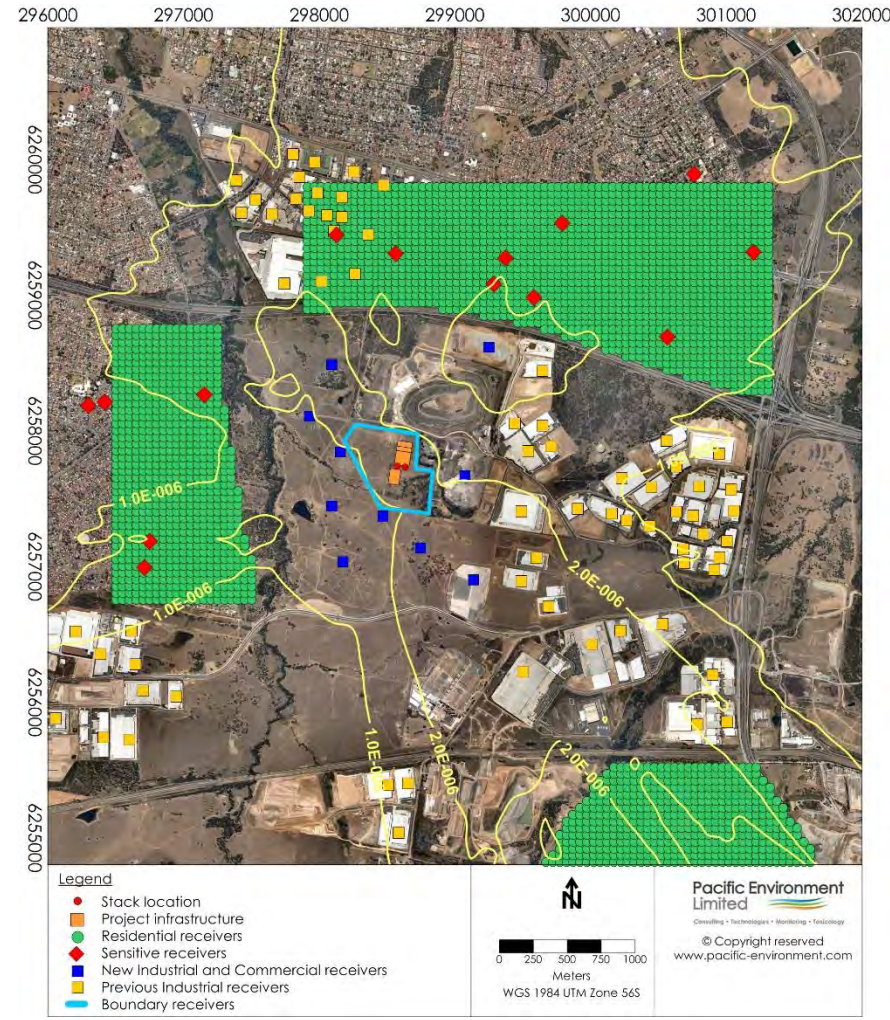
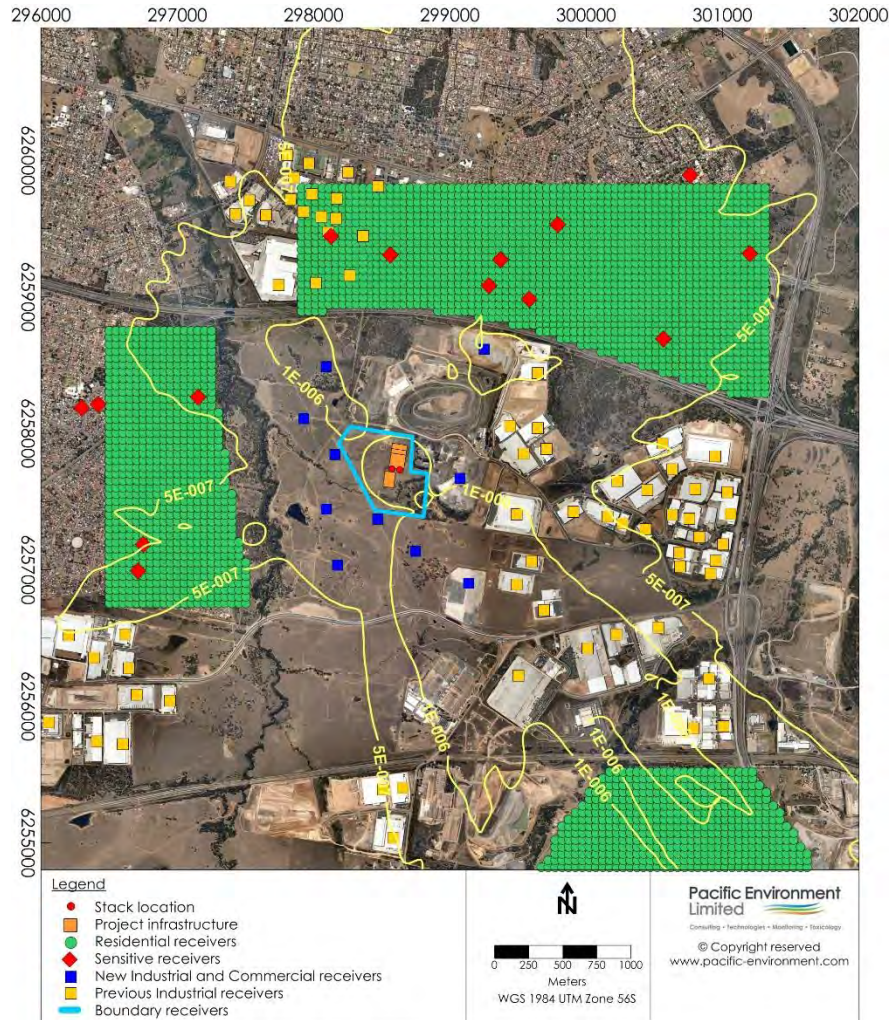


Figure 9-10: 99.9th Percentile Predicted Ground Level Metals Concentration – mg/m³



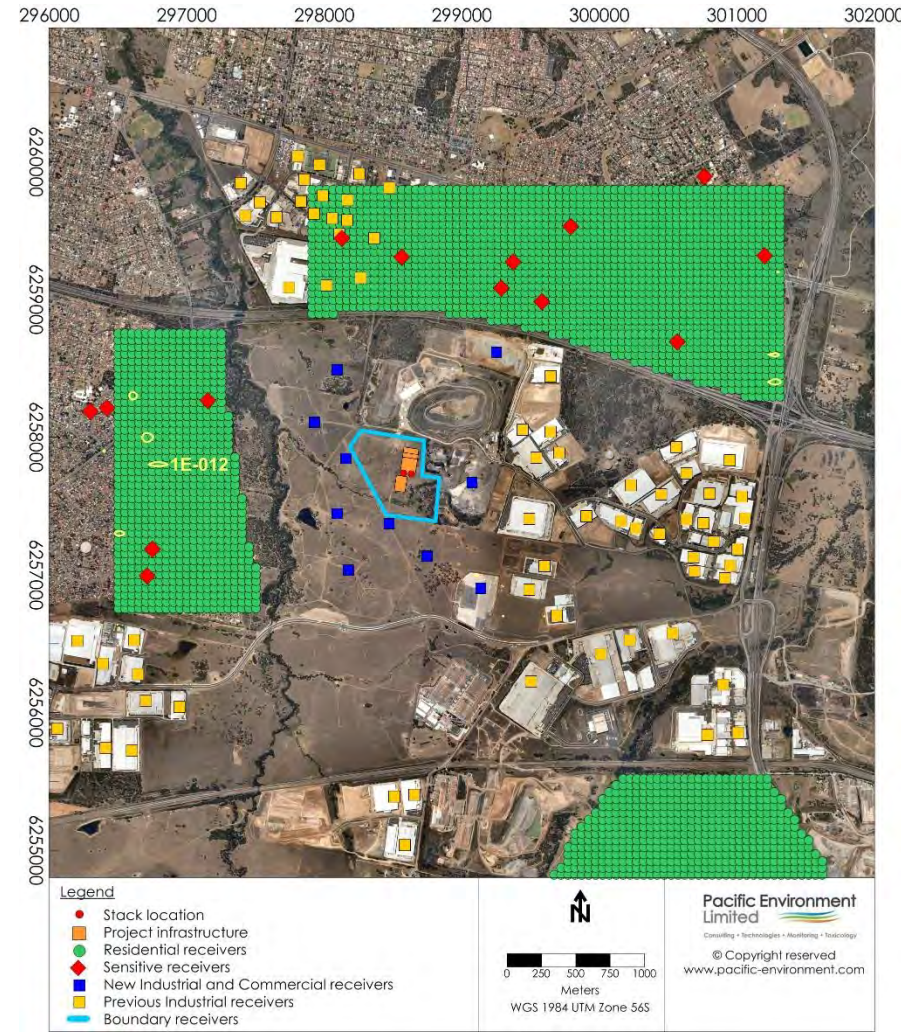


Figure 9-11: 99.9th Percentile Predicted HCl and Dioxin/Furan Ground Level Concentration – mg/m³

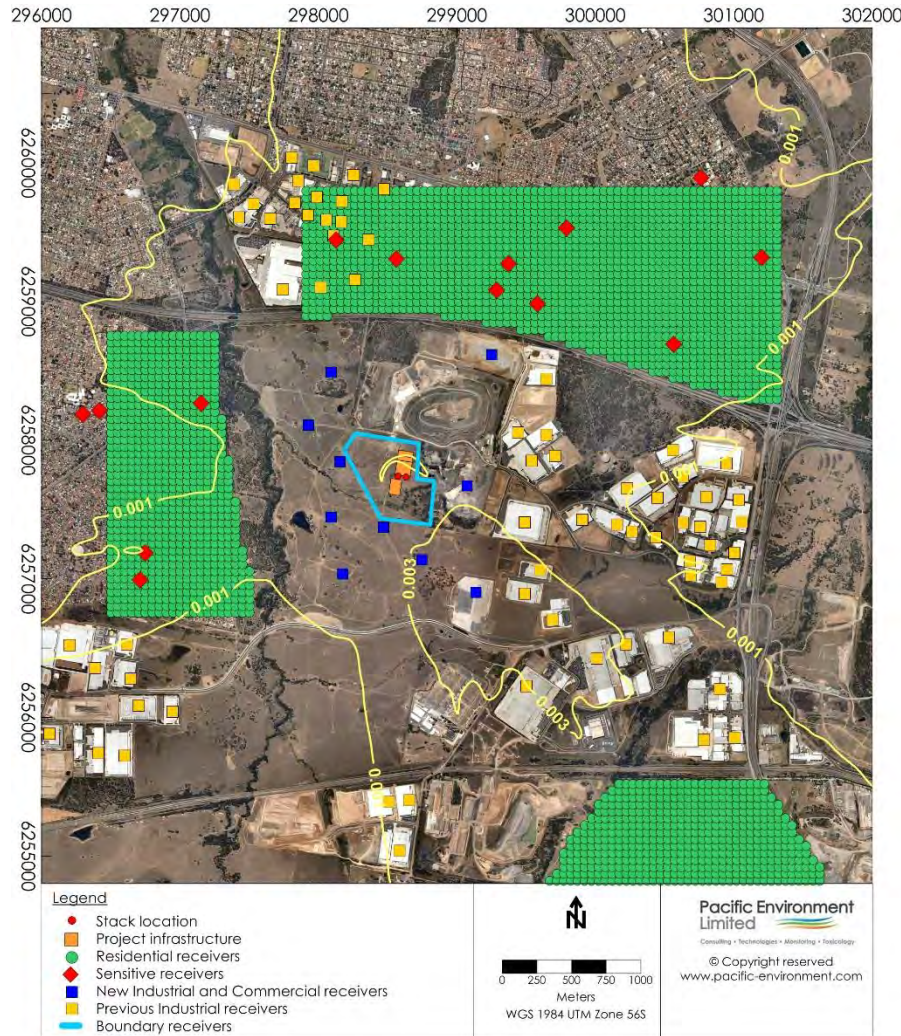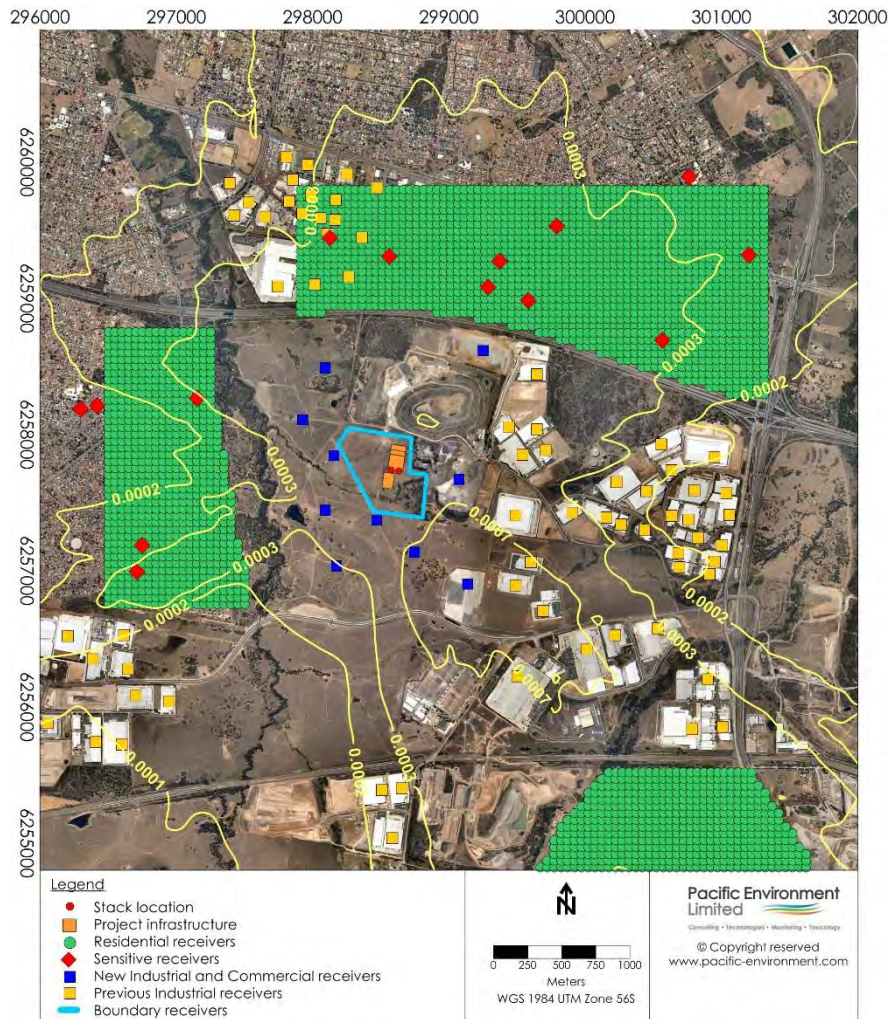

99.9th percentile 1-Hour NH₃ (goal = 0.33mg/m³)

Figure 9-12: 99.9th Percentile Predicted Ammonia Ground Level Concentration



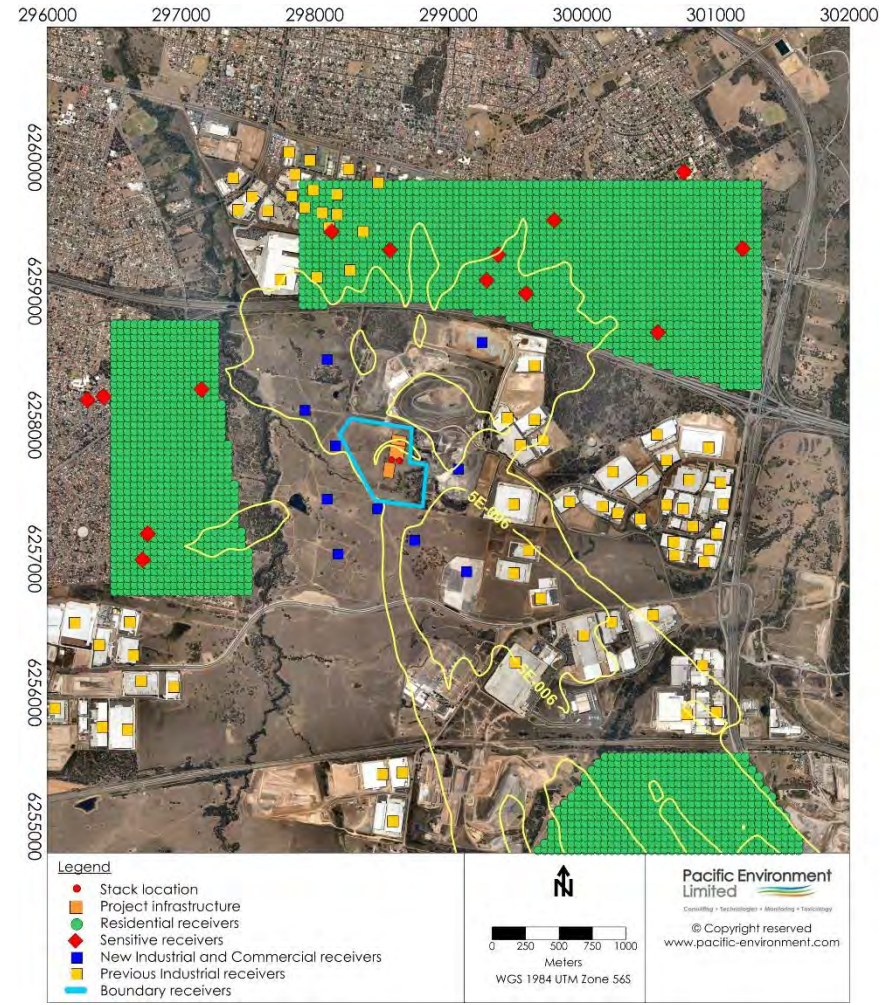


Figure 9-13: 99.9th Percentile Predicted PAH and VOC Ground Level Concentration

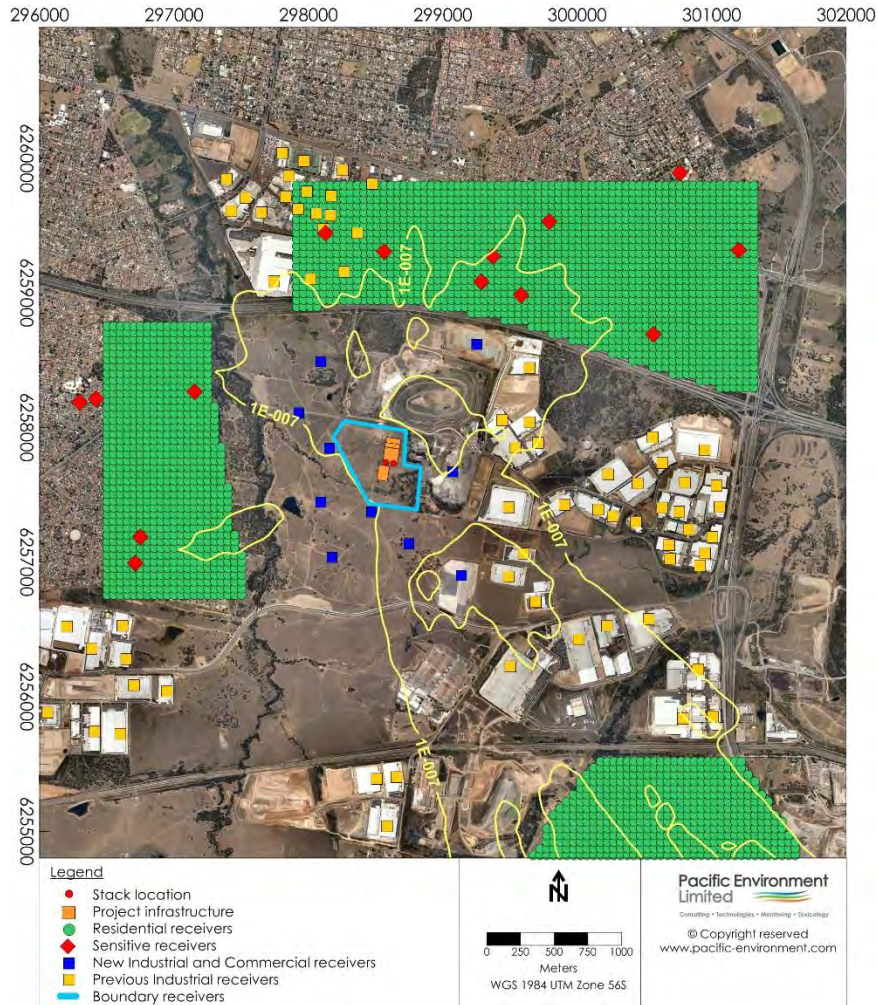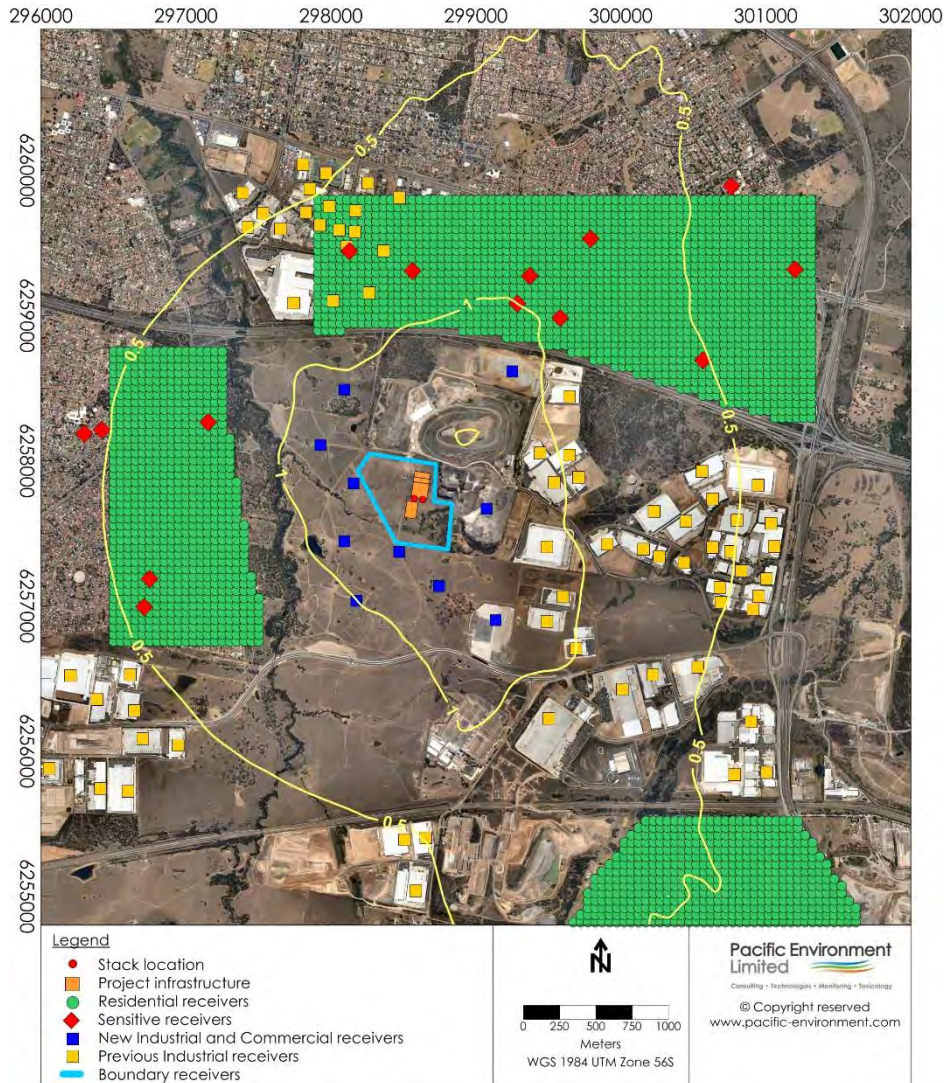

99th percentile 1-Hour H₂S (goal = 1.38µg/m³)

Figure 9-14: 99th Percentile Predicted Hydrogen Sulfide Ground Level Concentration

9.1.2 Upset Conditions

A summary of the predicted maximum ground level concentrations (GLCs) for each pollutant is presented in Table 9-2. GLCs are presented at and beyond the site boundary, as well as the maximum prediction at sensitive receptors. Predictions above the relevant NSW impact assessment criterion are shown in bold.

Long term averaging periods (annual, 90 day, 30 day, 7 day and 1 day) have not been included. This is because the any upset emission scenario is anticipated to last a maximum of a matter of hours (likely less). Therefore prediction over longer averaging periods is not relevant for this scenario.

Table 9-2: Summary of predicted ground level concentrations during upset conditions

Pollutant	Averaging period	Units	Criterion	Highest prediction at and beyond site boundary	Highest prediction at sensitive receptor
NO ₂ ^(a)	1 hour	µg/m ³	246	771	515
SO ₂	10-minute	µg/ m ³	712	159	106
	1 hour	µg/ m ³	570	111	74
CO	15-minute	mg/ m ³	100	0.1	0.1
	1 hour	mg/ m ³	30	0.09	0.06
HCl	1 hour	mg/ m ³	0.14	0.04	0.03
Cd ^(b)	1 hour	mg/ m ³	0.000018	0.000034	0.00002
Hg ^(b)	1 hour	mg/ m ³	0.00018	0.000005	0.000003
Dioxins and furans ^(b)	1 hour	mg/ m ³	2.00 x 10 ⁻⁹	1.9 x 10 ⁻¹⁰	1.1 x 10 ⁻¹⁰
TOC (as benzene) ^(b)	1 hour	mg/ m ³	N/A	0.00006	0.00003
NH ₃ ^(b)	1 hour	mg/ m ³	0.33	0.008	0.004

Note: (a) based on the assumption of 100% conversion from NO_x to NO₂^h
(b) expressed as the 99.9th percentile of the dispersion modelling prediction

Modelling results for criteria pollutants are assessed against the maximum prediction at sensitive receptors. In summary, the modelling results show that during upset conditions:

- The maximum predicted 1-hour NO₂ is 209% of the impact assessment criterion, assuming 100% conversion from NO_x to NO₂.
- The maximum predicted 10-minute SO₂ is 15% of the impact assessment criterion, and for 1-hour 13%.
- The maximum predicted CO 15-minute, and 1-hour averaging periods are 0.3% or less than the relevant impact assessment criterion.

For the pollutants above it is also important to consider cumulative impacts due to existing “background” air quality, and other sources of pollution in the area. The cumulative predictions are presented in Section 9.1.2.

Modelling predictions for air toxics are assessed against the 99.9th percentile prediction, at and beyond the site boundary and indicate under upset conditions:

- The 99.9th percentile predicted HCl is 21% of the impact assessment criterion.
- The 99.9th percentile predicted cadmium is 111% of the impact assessment criterion.

^h As discussed, we have conservatively assumed 100% conversion of NO_x to NO₂.

- The 99.9th percentile predicted mercury is 2% of the impact assessment criterion.
- The 99.9th percentile predicted dioxins and furans are 6% of the impact assessment criterion.
- The 99.9th percentile predicted TOC (as benzene) is 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted NH₃ is 1.3% of the impact assessment criterion.

As shown in Table 9-2 and noted above, there are two pollutants that are predicted to exceed the NSW impact assessment criteria and include NO₂ and Cd.

To assess these exceedances during upset conditions, a probabilistic approach has been adopted. As already discussed in Section 2.5, adopting a design to the requirements of the EU IED entails that such events shall under no circumstance occur for more than four hours uninterrupted where the emission values exceed the limits and no more than 60 hours per year. The probability that upset conditions will actually result in adverse air quality impacts at ground level is therefore a function of the maximum allowable hours of upset per year (60/8,760) multiplied by the predicted frequency of exceedance per annum for each pollutant. The resultant probabilities are therefore:

- NO₂ – 0.007% probability
- Cd – 0.002% probability
- Based on the above it can be inferred that in reality, the probability of the above pollutants resulting in adverse air quality impacts at ground level due to upset conditions would be extremely low.

9.1.3 Operation of Emergency Diesel Generators

As noted in Section 4.3, the diesel generators would not operate for more than 200 hours per year and for a few hours during any one event, therefore the predicted ground level concentrations from these sources have been compared against the short term assessment criteria only.

The atmospheric dispersion model results attributable to operation of the emergency diesel generators, concurrent with stack emissions are conservatively estimated in Table 9-3. The predicted ground level concentrations for the most impacted sensitive receptor at or beyond the site boundary for NO₂, CO, PM₁₀, PM_{2.5} and benzene have been provided.

In addition to worst-case predictions associated with operation of the emergency diesel generators, Table 9-3 also provides the predicted maximum ground level concentrations for the most impacted sensitive receptor during operation of the stacks at or beyond the site boundary for NO₂, CO, PM₁₀, PM_{2.5} and benzene. As shown, the predicted maximum concentration of the generators and stacks in aggregate results in a concentration that is less than the respective criteria for the assessed pollutants. Note that this is a highly conservative assessment as it is not anticipated that the maximum concentrations from these two distinct sources would occur at either the same time or location, given the substantial difference in exit parameters between the sources.

Table 9-3: Conservative estimation of ground level concentrations during operation of emergency diesel generators

Parameter	Averaging period	Units	Criteria	Predicted concentration at most affected sensitive receptor	Predicted concentration at most affected sensitive receptor	Maximum background
				(generator)	(stacks)	
NO ₂	1 hour	µg/m ³	246	160	77.1	N/A ¹
CO	15-minute	mg/m ³	100	0.23	0.012	7
	1 hour	mg/m ³	30	0.14	0.009	4
	8 hour	mg/m ³	10	0.07	0.007	2
PM ₁₀	24 hour	µg/m ³	50	0.9	0.07	49

PM _{2.5}	24 hour	µg/m ³	25	0.9	0.07	17
Benzene ³	1 hour	mg/m ³	29	3	6.9 x 10 ⁻⁷	N/A ²

Note 1: Nitrogen dioxide predictions have been made using the Ozone Limiting Method and as such, the values presented take account of contemporaneous background observations

Note 2: Consistent with Section 7.2.2 of NSW DEC, 2005, the predictions of benzene are compared against the ground level concentration criterion as increment only, at the 99.9th percentile.

Note 3: Benzene has been assumed to comprise 1% of the total VOC emission.

Table 9-3 indicates that predicted concentrations of all parameters are anticipated to be below the relevant NSW EPA ground level concentration criteria during operation of the emergency diesel generators.

9.1.4 POEO Emission Limits (Regulatory Scenario)

As noted in Section 7.7, to inform future Environmental Protection Licensing of the EfW facility, in addition to the normal and upset conditions, ground level concentrations resulting from a Regulatory scenario (in-stack concentrations at the POEO emission limits) have been presented.

A summary of the ground level concentrations (GLCs) for each pollutant when released at the POEO emission limits is presented in Table 9-4. GLCs are presented at and beyond the site boundary, as well as the maximum prediction at sensitive receptors. Predictions above the relevant NSW impact assessment criterion are shown in bold.

Table 9-4: Summary of predicted ground level concentrations at POEO emission limits

Pollutant	Averaging period	Units	Criteria	Highest prediction at and beyond site boundary	Highest prediction at sensitive receptor
NO ₂ ^(a)	1 hour	µg/m ³	246	205	137
	Annual	µg/ m ³	62	9	8
CO	15-minute	mg/ m ³	100	0.07	0.04
	1 hour	mg/ m ³	30	0.05	0.03
	8 hours	mg/ m ³	10	0.04	0.03
PM ₁₀	24 hours	µg/ m ³	50	2.6	2.3
	Annual	µg/ m ³	30	0.9	0.8
PM _{2.5}	24 hours	µg/ m ³	25	2.6	2.3
	Annual	µg/ m ³	8	0.9	0.8
Cd ^(b)	1 hour	mg/ m ³	0.000018	0.00008	0.00004
Hg ^(b)	1 hour	mg/ m ³	0.00018	0.00007	0.00004
Dioxins and furans ^(b)	1 hour	mg/ m ³	2.00 x 10 ⁻⁹	3.7 x 10 ⁻¹¹	2.2 x 10 ⁻¹¹
TOC ^(b)	1 hour	mg/ m ³	N/A	0.015	0.009
H ₂ S ^(c)	1 hour	µg/ m ³	1.38	1.2	0.96

Note: (a) based on the assumption of 100% conversion from NO_x to NO₂ⁱ

(b) expressed as the 99.9th percentile of the dispersion modelling prediction

Modelling results for criteria pollutants are assessed against the maximum prediction at sensitive receptors. In summary, the modelling results show that when emitting at the POEO emission limits:

ⁱ As discussed, we have conservatively assumed 100% conversion of NO_x to NO₂.

- The maximum predicted 1-hour NO₂ is 56% of the impact assessment criterion, even assuming 100% conversion from NO_x to NO₂
- The maximum predicted annual NO₂ is 13% of the impact assessment criterion.
- The maximum predicted 24-hour PM increment is 5% of the impact assessment criterion for PM₁₀ and 9% of the impact assessment criterion for PM_{2.5}.
- The maximum predicted annual PM is 3% of the impact assessment criterion for PM₁₀ and 10% of the impact assessment criterion for PM_{2.5}.
- The maximum predicted CO 15-minute, 1-hour and 8-hour averaging periods are 0.1% or less than the relevant impact assessment criterion.

For the pollutants above it is also important to consider cumulative impacts due to existing background air quality. The cumulative predictions relevant to the Regulatory Scenario are presented in Section 9.2.3.

Modelling predictions for air toxics are assessed against the 99.9th percentile prediction, at and beyond the site boundary and show that when emitting at the POEO emission limits:

- The 99.9th percentile predicted cadmium is approximately two times the impact assessment criterion.
- The 99.9th percentile predicted mercury is 22% of the impact assessment criterion.
- The 99.9th percentile predicted dioxins and furans are 1.1% of the impact assessment criterion.
- The 99.9th percentile predicted TOC (as benzene) is 31% of the impact assessment criterion.

As shown in Table 9-2 and noted above, there is one pollutant (Cd) that is predicted to exceed the NSW impact assessment criteria when the facility is operated under the POEO in-stack limits.

However, as noted in Section 9.1.1, under normal operations (assumed in-stack Cd concentration of 0.009 mg/Nm³), the maximum prediction of Cd at and beyond the site boundary is anticipated to be 3.7 x 10⁻⁶ mg/m³, or 21% of the relevant NSW EPA ground level concentration criterion.

Based on the linear relationship between in-stack concentration and maximum predictions for this parameter, it can be seen that a roughly four-fold increase in the in-stack concentration assumption for normal operations would still be anticipated to satisfy the NSW EPA ground level concentration criterion.

On the above basis, it is suggested that an in-stack concentration limit for Cd of 0.04 mg/Nm³ would be sufficiently protective of health and environmental impacts while providing the facility with some operational flexibility. This proposed emission limit would be captured within a statement of commitment for the Project.

9.2 Cumulative Assessment

To assess impacts against the relevant air quality criteria, it is necessary consider the existing background concentrations of the air quality metrics in question. The existing background air quality environment is described in Section 6.

9.2.1 Normal Operations

The maximum predicted GLCs for products of combustion from the EfW facility are combined with maximum background levels and presented in Table 9-5. This provides a conservative estimate of cumulative impact as the probability of a maximum observed value occurring at the time of a maximum predicted value is very small.

There are no exceedances of the EPA criteria when the EfW facility contribution is added to maximum background.

Table 9-5: Cumulative assessment for criteria pollutants during normal operations

Pollutant	Averaging period	Units	Criteria	Maximum GLC at sensitive receptor	Maximum background	Cumulative concentration
NO ₂ ^(a)	1 hour	µg/m ³	246	51.5	100	151.5
	Annual	µg/ m ³	62	3.1	23	26.1
SO ₂	10-minute	µg/ m ³	712	11	107	118
	1 hour	µg/ m ³	570	7.4	57	64.4
	24 hours	µg/ m ³	228	1.7	0.7	2.4
	Annual	µg/ m ³	60	0.45	3	3.45
CO	15-minute	mg/ m ³	100	0.01	14	14.01
	1 hour	mg/ m ³	30	0.006	7	7.006
	8 hours	mg/ m ³	10	0.006	2	2.006
PM ₁₀	24 hours	µg/ m ³	50	0.06	49	49.06
	Annual	µg/ m ³	30	0.017	19	19.017
PM _{2.5}	24 hours	µg/ m ³	25	0.06	17	17.06
	Annual	µg/ m ³	8	0.017	7	7.02

Note: (a) based on the assumption of 100% conversion from NO_x to NO₂^j

^j As discussed, we have conservatively assumed 100% conversion of NO_x to NO₂.

9.2.2 Upset Conditions

The maximum predicted GLCs for products of combustion from the EfW facility during upset conditions are combined with maximum background levels and presented in Table 9-6. This again provides a conservative estimate of cumulative impact as the probability of a maximum observed value occurring at the time of a maximum predicted value (under upset conditions – maximum 60 hours per annum) is extremely small.

Table 9-6: Cumulative assessment for criteria pollutants

Pollutant	Averaging period	Units	Criteria	Maximum GLC at sensitive receptor	Maximum background	Cumulative concentration
NO ₂ (a)	1 hour	µg/m ³	246	771	100	871
SO ₂	10-minute	µg/ m ³	712	158	107	309
	1 hour	µg/ m ³	570	111	57	165
CO	15-minute	mg/ m ³	100	0.1	14	7
	1 hour	mg/ m ³	30	0.1	7	4

Note: (a) based on the assumption of 100% conversion from NO_x to NO₂^k

9.2.3 POEO Emission Limits (Regulatory Scenario)

The maximum predicted GLCs for products of combustion from the EfW facility are combined with maximum background levels and presented in Table 9-7.

There are no exceedances of the EPA criteria when the EfW facility contribution is added to maximum background, with the exception of PM, which results in a cumulative concentration marginally above the 24-hour PM₁₀ criterion of 50 µg/m³. However, this occurs on a day when the background PM concentration is already high (at 49.2µg/m³) and the probability of the EfW facility resulting in additional exceedances of the impact assessment criterion is considered to be low.

This is demonstrated in Figure 9-15 which shows a time-series plot of the background 24-hour PM₁₀ concentration recorded at Prospect with the EfW facility increment (from the most impacted sensitive receptor) stacked on top. The EfW facility clearly adds a very small increment to the existing background, however is predicted to result in one additional exceedances of the air quality goal. Figure 9-15 indicates that these exceedances are a result of the high background PM₁₀ concentrations, rather than the incremental increase from the EfW facility. It is also noted that this assumes the facility operates at the POEO emission limit for PM continuously, which would not be an operational reality.

^k As discussed, we have conservatively assumed 100% conversion of NO_x to NO₂.

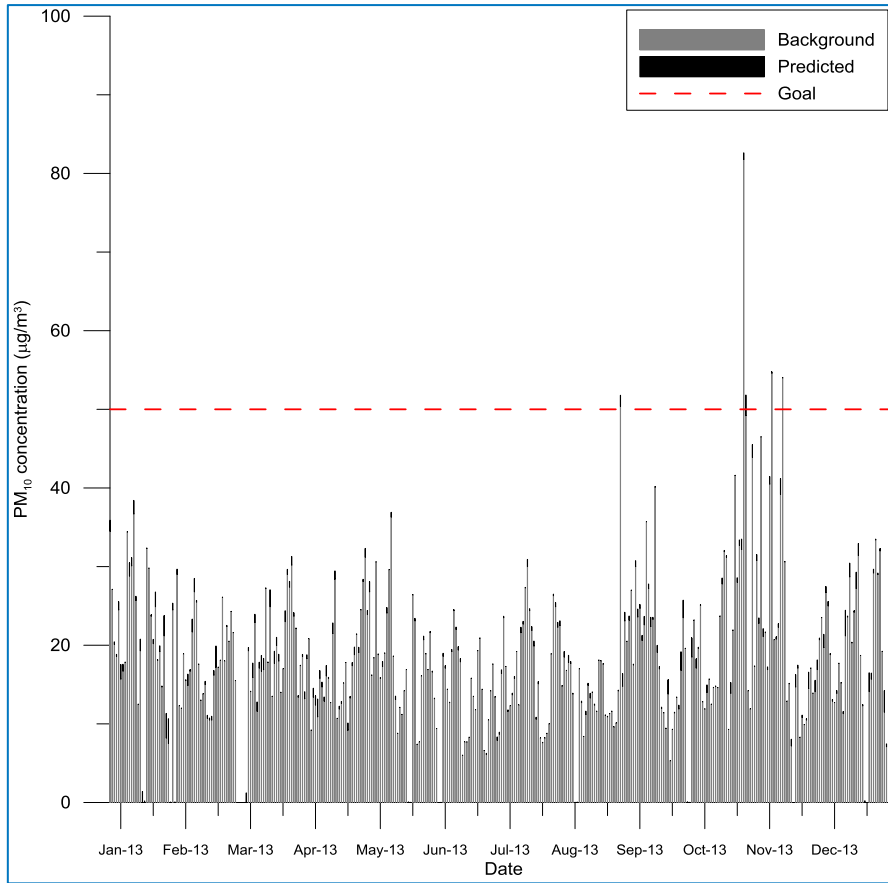


Figure 9-15: Predicted cumulative PM₁₀ at most affected sensitive receptor adopting POEO Emission Limits

Table 9-7: Cumulative assessment for criteria pollutants while at POEO Emission Limits

Pollutant	Averaging period	Units	Criteria	Maximum GLC at sensitive receptor	Maximum background	Cumulative concentration
NO ₂ ^(a)	1 hour	µg/m ³	246	137	100	237
	Annual	µg/ m ³	62	8	23	31
CO	15-minute	mg/ m ³	100	0.04	14	14.04
	1 hour	mg/ m ³	30	0.03	7	7.03
	8 hours	mg/ m ³	10	0.03	2	2.03
PM ₁₀	24 hours	µg/ m ³	50	2.3	49	51.3
	Annual	µg/ m ³	30	0.8	19	19.8
PM _{2.5}	24 hours	µg/ m ³	25	2.3	17	19.3
	Annual	µg/ m ³	8	0.8	7	7.8

Note: (a) based on the assumption of 100% conversion from NO_x to NO₂¹

¹ As discussed, we have conservatively assumed 100% conversion of NO_x to NO₂.

In summary, based on the information provided above and within Section 9.1.4, it is considered that application of the POEO emission limits within the Environmental Protection Licence for the facility would be sufficiently protective of health and environmental impacts while providing the facility with some operational flexibility.

The exception to this is cadmium, where an alternative in-stack concentration limit is provided within Section 9.1.4.

It is noted that the proposed technology for the EfW facility is based on existing facilities in Europe and will incorporate best available technology (BAT) for flue gas treatment. The flue gas treatment is designed to meet the in-stack concentrations limits for waste incineration set by the EU IED. The IED emissions limits (Table 4-3) are generally more stringent than the Clean Air Regulation limits (Table 4-2). On the above basis, environmental licencing based on the IED limits (or hourly extrapolations of these performance standards) would also be a suitable alternative regulatory approach.

9.3 NO_x Load to Air Shed

9.3.1 Impacts on Regional Air Quality

NO_x is a precursor to the formation of ozone and ozone concentrations in the Sydney region have exceeded the Ambient Air-NEPM ozone standards every year since 1994 (DECCW, 2010). The Sydney region is therefore considered an ozone non-attainment area and if the NO_x emission from a new facility exceeds a threshold of 90 tonnes/year, an ozone impact assessment may be required under the NSW EPA proposed ozone impact assessment framework (not yet released at the time of writing).

Assuming the EfW facility emits NO_x at the EU IED limit for 8,000 hours of the year, the annual NO_x load to the Sydney air shed would be approximately 800 tonnes/year, thereby triggering further assessment. The potential for regional photochemical smog / ozone impacts are investigated in a standalone study, submitted as part of the Environmental Assessment (Pacific Environment, 2016b). Based on the outcomes of the regional ozone modelling the annual NO_x load was revised so as to comply with the requirements of Environ (2011). The daily average NO_x emissions limit was revised down to be a daily average of 120 mg/m³ with a total annual NO_x load of ~440 tonnes per year (assuming continuous operation). Further detail of this is provided within Pacific Environment, 2016b.

9.3.2 Load Based Licensing

As discussed in Section 4.5 the NO_x load based licensing threshold is 2.5 tonnes/year. Based on the anticipated NO_x emissions of ~440 tonnes/year the EfW exceeds this threshold and it is therefore anticipated that the EfW facility will be subject to a load based licence limit on total NO_x emissions, as well as summertime NO_x emissions, prescribed by EPA on issuance of the EfW facility's EPL.

10 GREENHOUSE GAS ASSESSMENT

10.1 Introduction

The World Resources Institute / World Business Council for Sustainable Development Greenhouse Gas Protocol (the GHG Protocol) originally documented the different scopes for greenhouse gas (GHG) emission inventories. The GHG Protocol is the most widely used international accounting tool for government and business leaders to understand, quantify, and manage greenhouse gas emissions. This corporate accounting and reporting standard is endorsed by the Australian Department of Climate Change and Energy Efficiency.

The GHG Protocol defines three scopes for developing inventories leading to reporting of emissions. These scopes help to delineate direct and indirect emission sources, improve transparency, and provide a degree of flexibility for individual organisations to report based on their organisational structure, business activities and business goals.

Three scopes of emissions (also shown in Figure 10-1) are defined in the GHG Protocol:

- 'Scope 1' emissions: direct GHG emissions occurring from sources owned or controlled by the company – for example vehicle fleet and direct fuel combustion. Any negative emissions (sequestration), for example from a plantation owned by the entity, would also be included in Scope 1.
- 'Scope 2' emissions: indirect GHG emissions from purchasing electricity or heat from other parties; and
- 'Scope 3' emissions: indirect emissions which occur due to the company's business activities, but from sources not owned or controlled by the company - for example emissions from employee business-related air travel.

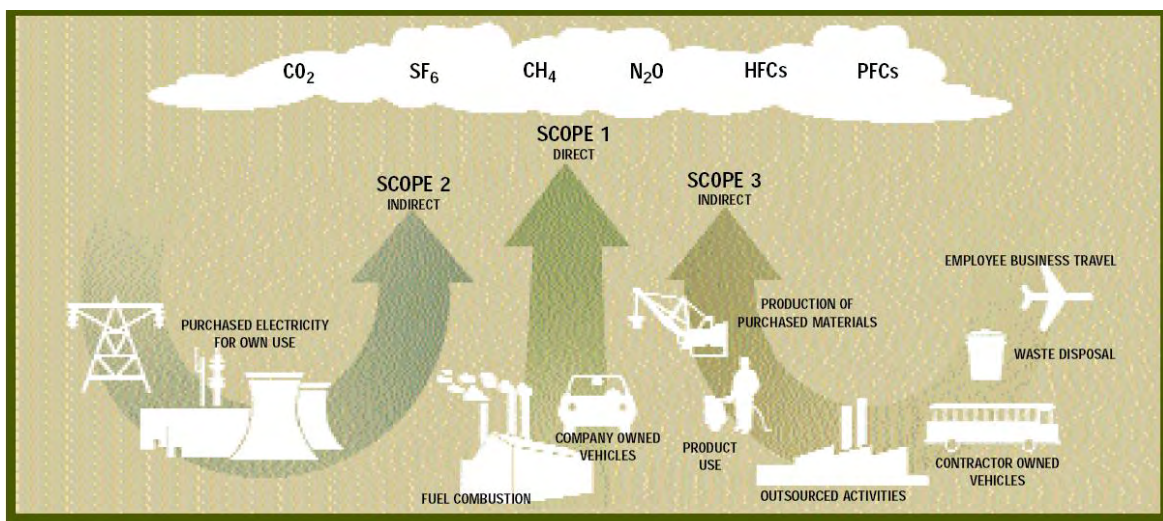


Figure 10-1: Overview of Scopes and Emissions across a Value Chain

10.2 Reporting Guidelines

The GHG assessment is guided by, and makes reference to the National Greenhouse and Energy Reporting (Measurement) Determination 2008 (the "NGER Measurement Determination") incorporating the National Greenhouse and Energy Reporting (Measurement) Amendment Determination 2012 (No. 1).

The National Greenhouse and Energy Reporting Regulations 2008 (the NGER Regulations) describe the detailed requirements for reporting under the NGER Act 2007. The National Greenhouse and Energy Reporting (Measurement) Technical Guidelines (the NGER Technical Guidelines) have been intended to support reporting under the NGER Act 2007. They have been designed to assist corporations in understanding and applying the NGER Measurement Determination.

The NGER Technical Guidelines outline calculation methods and criteria for determining GHG emissions, energy production, energy consumption and potential GHG emissions embodied in natural gas.

Under the NGER Act, Scope 1 and 2 emissions must be accounted for by the organisation. Reporting of Scope 3 is optional and has been addressed in this assessment qualitatively as the Scope 3 emissions would be minor. The EfW facility will have negligible Scope 2 emissions (of the site will be a net exporter of electricity) and the focus of this assessment is therefore on Scope 1 emissions.

10.3 Emission Estimates

10.3.1 Scope 1 GHG emissions from Waste Incineration

The calculation of GHG emissions for waste incineration is based on the maximum volume of material that will be combusted during any one year (see Section 2.1). The compositional data and chemical analysis used for these calculations are provided in Appendix D (Ramboll, 2016).

Combusted ash residue that is to be landfilled will not result in GHG emissions and therefore has not been considered. This is because the ash does not release methane as the available carbon has already been consumed during combustion (US EPA, 2014).

Part 5.5, Section 5.3 of the NGER Technical Guidelines outlines Method 1 for the calculation of carbon dioxide emissions from waste incineration, as follows:

$$E_i = Q_i \times CC_i \times FCC_i \times OF_i \times 3.664$$

where:

E_i is the emissions of CO₂ released from the incineration of waste type (i) measured in CO₂-e tonnes.

Q_i is the quantity of waste type (i) incinerated by the plant during the year, measured in tonnes.

CC_i is the carbon content of waste type (i).

FCC_i is the proportion of carbon in waste type (i) that is fossil origin (i.e. not biomass).

OF_i is the oxidation factor of waste type (i)

The estimated GHG emissions from waste incineration are presented in Table 10-1.

Table 10-1: Method 1 estimation of GHG emissions from waste incineration

Waste (tpa)	Carbon Content (%)	% carbon that is fossil origin ¹	Oxidation Factor	CO ₂ -e (tpa)
1,350,000	31.44%	33.14%	0.98*	505,069

Note: ¹ It is assumed that this includes plastic film, dense plastic, textiles, combustibles, hazardous and other combustibles of Appendix G.

* Not known, default of 1 applied.

10.3.2 Scope 1 GHG Emissions (substitution of grid electricity)

The facility is designed to have a total thermal input of 471.9 MW (117.98 MW for each combustion line) and an assumed net average annual electrical efficiency of 29.1%. Based on this information the EfW facility is designed to export 137.3 MWe (29.1% x 471.9 MW). As the auxiliary load for the EfW facility is 14.6 MW the EfW facility would therefore export to the main electricity grid, thus substituting a requirement for approximately 137.3 MW of more GHG emission intensive electricity generation.

An estimated of the GHG emissions that would be substituted from the grid is presented, based on an assumption that the EfW facility would operate for 8,000 hours per annum.

The GHG emissions from grid have been estimated as follows:

$$Y = Q \times \frac{EF}{1000}$$

where:

Y is the Scope 2 emissions measured in CO₂-e tonnes.

Q is the quantity of electricity diverted (kilowatt hours).

EF is the scope 2 emission factor for NSW (t).

GHG emissions which would be diverted from the main grid are presented in Table 10-2.

Table 10-2: Estimation of GHG emissions (substitution of grid electricity)

Net Output (MW)	Operational hours (per year)	Electricity diverted from grid (kWh per year)	Emission factor for grid electricity in NSW (kg CO ₂ -e/kWh)	CO ₂ -e diverted from main electricity grid (tpa)
137.3	8,000	1,098,400,000	0.86	944,624

10.3.3 Scope 1 GHG Emissions Diverted from Landfilling

By removing biomass waste from the landfill, emissions of methane^m from the decomposition of waste are eliminated. It is acknowledged that some landfills combust the methane via a flare or gas engine. However, this is not currently the case at the Genesis facility and would not form part of the future operations for the site (and has therefore not been considered).

Emissions of methane from disposal of waste to landfill are estimated based on the NGER Scheme Method 1 for emissions of methane from landfills. A simplified estimation is made based on the assumption that all methane is released in the same year that the solid waste is disposed and the accumulated or opening stock of degradable organic carbon is not considered.

The carbon content of the residual waste fuel is based on the information provided for the design fuel mix (Ramboll, 2016). For reference, the fuel composition data is provided in Appendix D.

Emissions are estimated as follows:

$$CO_2 - e \text{ (tonnes)} = DOC \times MCF \times F \times 1.336 \times 21$$

where:

DOC is the quantity of degradable organic carbon, estimated from % of carbon in the waste and a DOC fraction of 0.43 has been assumed for conservatismⁿ.

MCF is the methane correction factor (1)

F is the fraction of CH₄ in landfill gas (0.5)

1.336 convert C mass to CH₄ mass.

21 converts CH₄ to CO₂-e

^m Biomass emissions of CO₂ are considered to be climate neutral, and therefore not reported from either landfill or waste incineration. Emissions of methane are reported for landfilling and emissions of CO₂ for non-biomass (fossil origin) are reported for incineration.

ⁿ By using a DOC fraction for 'garden and green' (which is lower than other organic wastes) we have potentially underestimated GHG emissions from landfilling. This results in a conservatively low estimate of GHG emission diverted from landfill.

The estimated GHG emissions that would be diverted from landfilling activities (assuming 1,350,000 tonnes landfilled per annum under the Business As Usual scenario) are presented in Table 10-1.

Table 10-3: Method 1 estimation of methane emissions from landfill

Waste diverted from landfill (tpa)	Carbon Content (%)	DOC	CH ₄ (tpa)	CO ₂ -e (tpa)
1,350,000	31.44%	182,509	121,916	2,560,239

Note: * Not known, default of 1 applied.

10.3.4 Scope 3 GHG Emissions

The Greenhouse Gas Protocol allows optional reporting of scope 3 emissions. If an organisation believes that scope 3 emissions are a significant component of the total emissions inventory, these can be reported along with scope 1 and scope 2 emissions. However, the Greenhouse Gas Protocol notes that reporting scope 3 emissions can result in double counting of emissions and can also make comparisons between organisations and/or products difficult (because reporting is voluntary). Double counting needs to be avoided when compiling national (country) inventories under the Kyoto Protocol. The Greenhouse Gas Protocol also recognises that compliance regimes are more likely to focus on the “point of release” of emissions (i.e., direct emissions) and/or indirect emissions from the purchase of electricity. As already noted in Section 10.2, scope 3 emissions are anticipated to be minor. Nevertheless, we have identified the following scope 3 emissions that would likely be released as a result of the EfW facility's operations:

- Employees commuting to and from work.
- Employee business travel.
- Extraction, production and transport of purchased diesel fuel consumed.
- Fuel consumption transporting waste to the site.

10.3.5 Net GHG Emissions for EfW Facility

The emission intensity for electricity generated from waste incineration is lower than that derived from the NSW electricity grid (refer Section 10.4) and therefore a net reduction in GHG emissions is achieved when electricity from this source is exported to the NSW grid.

Similarly, by removing biodegradable wastes from the landfill, significant emissions of methane from the decomposition of that waste are also avoided.

A summary of the estimated net GHG emissions resulting from the EfW facility are shown in Table 10-4. The operation of the EfW facility would have a net positive GHG impact, potentially avoiding 3 million tonnes of CO₂-e per annum.

Table 10-4: Estimation of net GHG emissions

Tpa CO ₂ -e from waste incineration	Tpa CO ₂ -e alternative to grid	Tpa CO ₂ -e diverted from landfill	Net GHG emissions (tpa CO ₂ -e)
505,069	944,6242	2,560,239	-2,999,794

10.4 Benchmarking GHG intensity

Emissions intensity of electricity generation is expressed as the rate of emissions (tonnes or kg of CO₂-e) per net unit of electricity produced (MWh or kWh).

The estimated emissions intensity for the proposed EfW facility is 0.53 tonnes CO₂-e/MWh generated. For 2014, the emissions intensity for the NSW grid was 0.93 tonnes CO₂-e/MWh generated (AEMO, 2015). Over time it is anticipated that the emission intensity for NSW would decrease through the introduction of less carbon intensive sources of energy.

The projected electricity consumption over the next 10 years for NSW is shown in Figure 10-2, along with the portion of total consumption that would be generated by the EfW facility. This contribution of the EfW facility to NSW electricity supply is approximately 2% for each financial year.


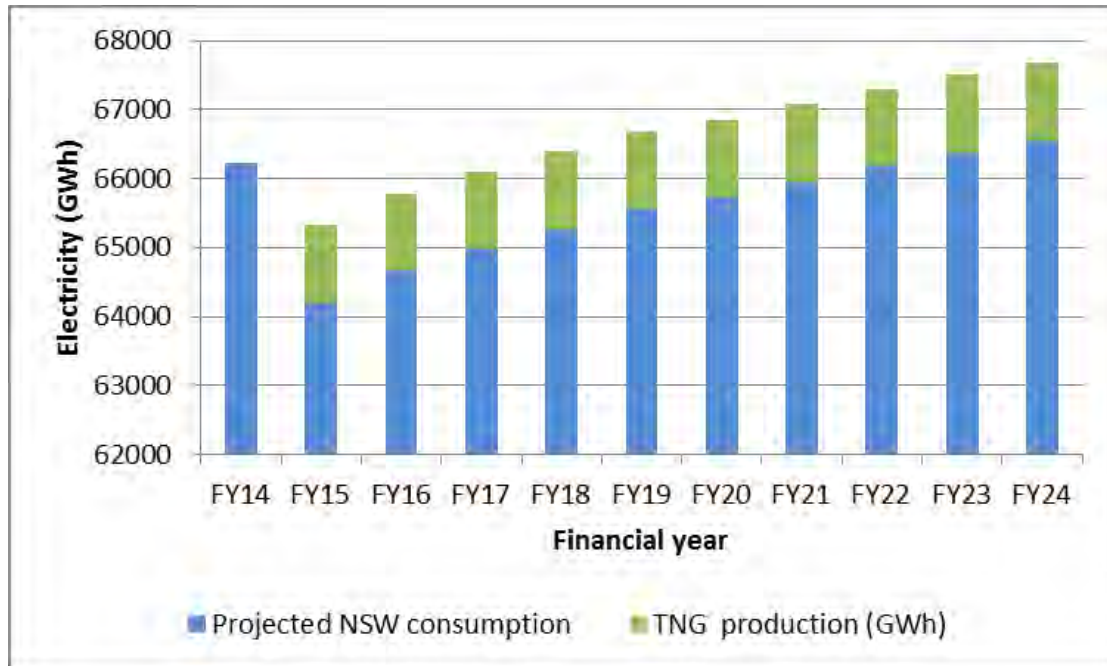


Figure 10-2: Projected NSW electricity consumption (AEMO, 2014)

A comparison has also been made with the emissions intensity measure of kg CO₂-e/MWh_{sent out} based on data presented for major NSW generators in the ACIL Tasman report on *Fuel resources, new entry and generation costs in the NEM* (Acil Tasman, 2009). The data presented in Figure 10-3 are based on Scope 1 emissions for fuel usage.

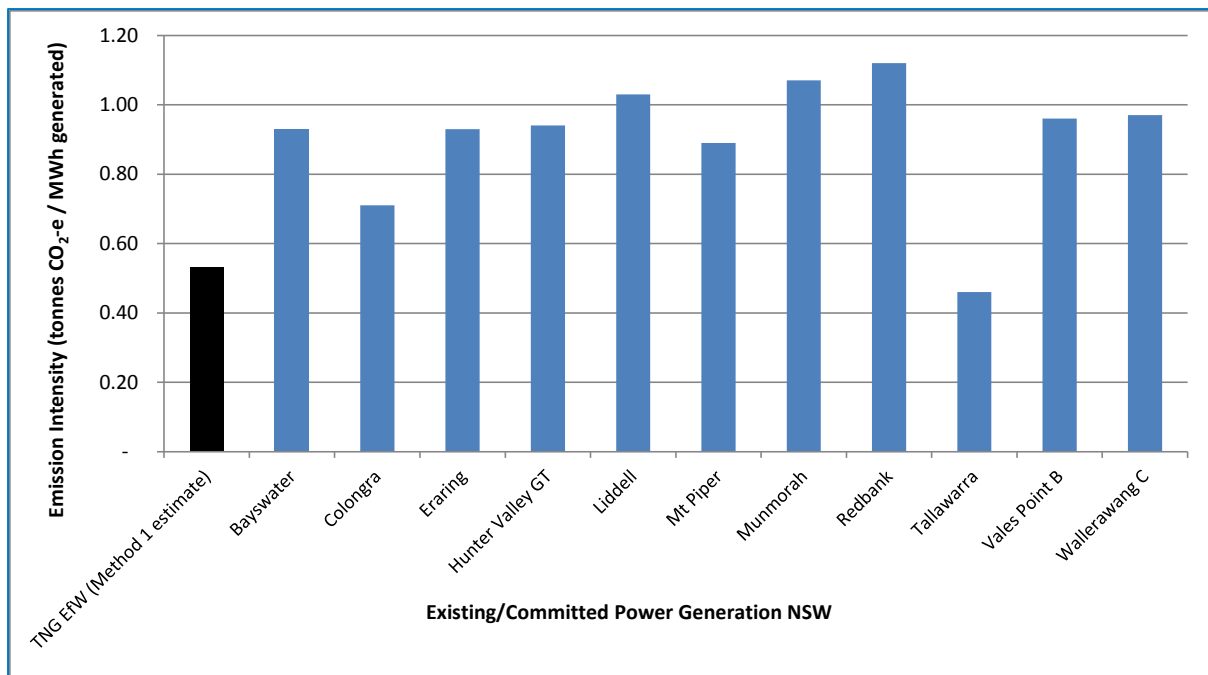

Data Source: ACIL Tasman, 2009

Figure 10-3: Emission intensity comparison for existing / committed NSW generators

Peak landfill methane production rates typically occur between five and seven years after waste has been landfilled (US EPA, 2000), with almost all gas is produced within 20 years after waste being placed in situ (ATSDR, 2001).

In view of the above, it can be inferred that the emission reduction associated with diverted landfill emissions would be realised gradually until they are fully realised by year six.

Figure 10-4 provides a representation of the net greenhouse gas emission (reduction) on an annual basis, assuming a 25 year facility life. The cumulative emission reduction over a 25 year period would thus be 68.5 Mt CO₂-e.

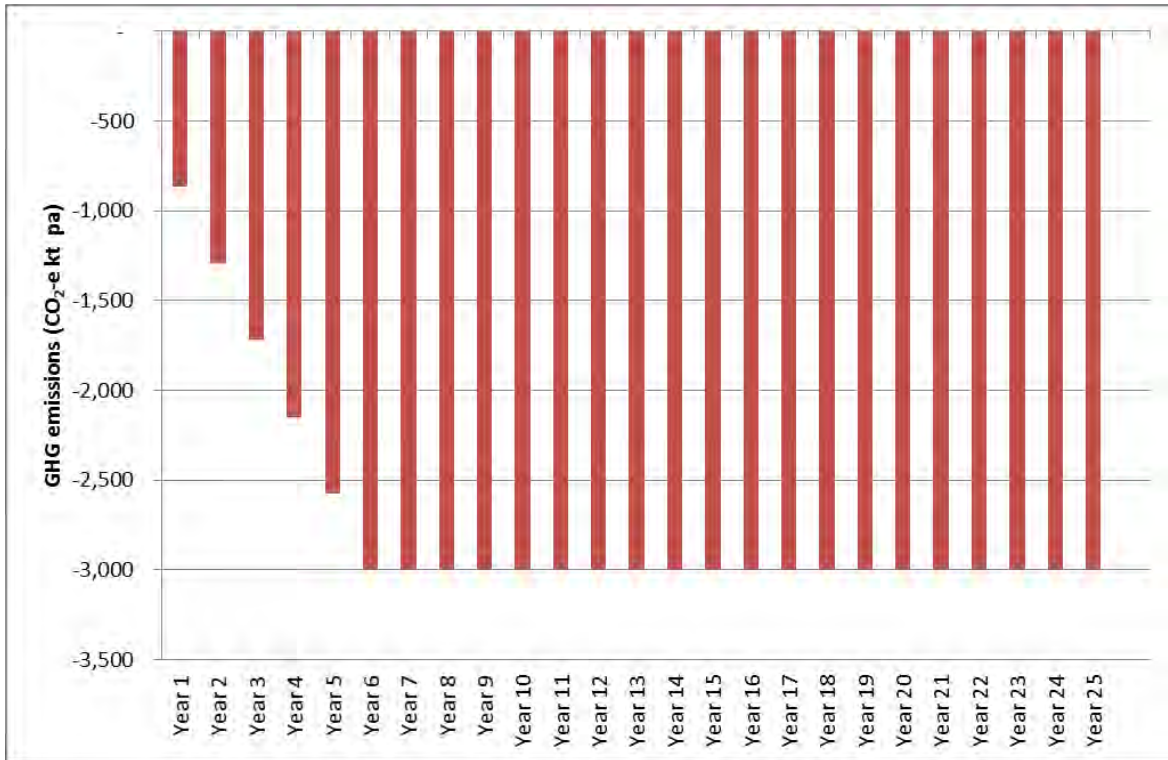


Figure 10-4: Net greenhouse gas emission estimates for the EfW facility on an annual basis

° It has been assumed that the ramp up to peak production is linear and occurs by Year 6.

11 CONCLUSION

Pacific Environment has been engaged by TNG NSW to prepare an Air Quality and Greenhouse Gas Assessment for the construction and operation of an Energy from Waste (EfW) facility. The proposed technology for the EfW facility is based on existing facilities in the UK and rest of Europe and will incorporate best available technology (BAT) for flue gas treatment, designed to meet the stringent in-stack concentrations limits for waste incineration set by the IEU Industrial Emissions Directive (IED).

Dispersion modelling predictions have been based on the above assumptions, and the results for normal operations show:

- The maximum predicted 1-hour NO₂ is 21% of the impact assessment criterion, even assuming 100% conversion from NO_x to NO₂
- The maximum predicted annual NO₂ is 5% of the impact assessment criterion.
- The maximum predicted 10-minute SO₂ is 1.5% of the impact assessment criterion, for 1-hour 1.3%, for 24-hour SO₂, 0.7% and for annual, 0.8%.
- The maximum predicted 24-hour PM is 0.1% of the impact assessment criterion for PM₁₀ and 0.2% of the advisory reporting standard for PM_{2.5}.
- The maximum predicted annual PM is less than 0.1% of the impact assessment criterion for PM₁₀ and 0.2% of the advisory reporting standard for PM_{2.5}.
- The maximum predicted CO 15-minute, 1-hour and 8-hour averaging periods are 0.1% or less than the relevant impact assessment criterion.
- The maximum predicted 24-hour HF is 9% of the impact assessment criterion, for 7-day 10%, for 30-day HF, 13% and for 90-day, 18%.

Modelling predictions for air toxics are assessed against the 99.9th percentile prediction, at and beyond the site boundary. The individual odour compound H₂S is assessed against the 99th percentile prediction.

In summary, the modelling results for these additional parameters show:

- The 99.9th percentile predicted HCl is 2% of the impact assessment criterion.
- The 99.9th percentile predicted cadmium is 11% of the impact assessment criterion.
- The 99.9th percentile predicted mercury is 0.5% of the impact assessment criterion.
- The 99.9th percentile predicted dioxins and furans are 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted TOC (as benzene) is 0.01% of the impact assessment criterion.
- The 99.9th percentile predicted NH₃ is 0.1% of the impact assessment criterion.
- The 99.9th percentile predicted PAH (as benzo(a)pyrene) is 0.4% of the impact assessment criterion.
- The 99th percentile predicted H₂S is 70% of the impact assessment criterion.

Cumulative predictions are also presented. There are no exceedances of the EPA criteria when the EfW contribution is added to maximum background concentration under normal operating conditions.

The results of the modelling during upset conditions indicate that, under worst-case dispersion conditions, NO₂ and Cadmium are predicted to exceed the NSW impact assessment criteria. A probabilistic approach has then been adopted, with results indicating that probability of the above pollutants resulting in adverse impacts (i.e. the potential for upset conditions to coincide with worst-case dispersion conditions) would be less than 0.01%.

Additional modelling of a Regulatory Scenario indicates that application of the POEO emission limits within the Environmental Protection Licence for the facility would be sufficiently protective of health and environmental impacts while providing the facility with some operational flexibility.

The exception to this is cadmium, where an alternative in-stack concentration limit is provided.

A semi-quantitative screening assessment of construction phase impacts identified no human receptors within 350 m of the boundary of the site. The screening assessment concluded no detailed assessment of construction phase impacts is **required and routinely employed** 'good practice' mitigation measures for construction sites would be sufficient to control dust impacts to acceptable levels.

The operation of the EfW facility would have a net positive GHG impact, potentially eliminating 3 million tonnes of CO₂-e per annum. The emission intensity for electricity generated from waste incineration is significantly lower than that derived from the current NSW electricity grid.

12 REFERENCES

ACIL Tasman, 2009 Fuel resources, new entry and generation costs in the NEM (April 2009)

AECOM, 2015 Energy From Waste Facility – Human Health Risk Assessment, Honeycomb Drive, Eastern Creek. AECOM Australia Pty Ltd, November 2015.

Australian Energy Market Operator (AEMO) (2015).

<http://www.aemo.com.au/Electricity/Settlements/Carbon-Dioxide-Equivalent-Intensity-Index>

Australian Energy Market Operator (AEMO) (2014). file:///L:/Ajobs%208500-8599/8526%20TNG%20EfW%20Facility%20Genesis%20Facility%20Eastern%20Creek/Reference%20Material/2014%20NEFR%20update.pdf

Agency for Toxic Substances and Disease Registry (2001) "Chapter 2: Landfill Gas Basics".

Borgas, M. S. (2000) "The mathematics of whiffs and pongs. Presented at Enviro2000 Odour Conference", Sydney, 9-13 April 2000: Clean Air Society of Australia and New Zealand Environment Australia (2001).

Cummins (2015). Technical specifications for QSK78 diesel generator.

DECCW (2010). Current Air Quality in New South Wales: A technical paper supporting the Clean Air Forum 2010, Department of Environment, Climate Change and Water NSW, Sydney [www.environment.nsw.gov.au/air/cpairqual.htm]

Directive 2000/76/EC of the European Parliament and of the Council of 4 December 2000 on the incineration of waste. Official Journal of the European Communities. 28.12.2000.

Directive 2010/75/EU of the European Parliament and of the Council of 24 November 2010 on industrial emissions (integrated pollution prevention and control) (recast). Official Journal of the European Communities. 17.12.2010.

EC (2000) Directive 2000/76/EC of the European Parliament and of the Council of 4 December 2000 on the incineration of waste. Official Journal of the European Communities. 28.12.2000.

EC (2006). "Integrated Pollution Prevention and Control Reference Document on the Best Available Techniques for Waste Incineration". European Commission. August 2006.

EC (2010) Directive 2010/75/EU of the European Parliament and of the Council of 24 November 2010 on industrial emissions (integrated pollution prevention and control) (recast). Official Journal of the European Communities. 17.12.2010.

EPA (2014). "NSW Energy from Waste: Policy Statement", published by the NSW Environment Protection Authority.

Golder, D., 1972, "Relations among Stability Parameters in the Surface Layer", Boundary-Layer Meteorology, 3: 47-58

HZI (2015) Client communications with HZI regarding emergency situations. 22 January 2015.

IAQM (2014). Guidance on the assessment of dust from demolition and construction. Institute of Air Quality Management, London. <http://iaqm.co.uk/guidance/>

Mercia EnviRecover (2010). "Proposed development of an energy from waste facility on land at Hartlebury Trading Estate, Hartlebury, Worcestershire". Environmental Statement, Volume 1, Main Report. April 2010.

NEPC (1998a). "National Environment Protection (Ambient Air Quality) Measure".

NEPC (2003). "Variation to the National Environment Protection (Ambient Air Quality) Measure"

NSW DEC (2005) "Approved Methods for the Modelling and Assessment of Air Pollutants in NSW", published August 2005

Pacific Environment (2013a). "Air Quality Assessment for Ethanol Storage Facility, Huntingwood, NSW". February 2013.

Pacific Environment (2013b). "Report in Response to Affidavits of Paul Ashton Mitchell and Scott Fishwick". Moorebank Recyclers Pty Ltd V Liverpool City Council & Anor: Land and Environment Court Proceedings 30141/13. May 2013.

Pacific Environment (2015a). "Energy from Waste Facility – Odour Assessment". February 2015.

Pacific Environment (2015b). "Energy from Waste Facility – Ozone Impact Assessment". March 2015.

Ramboll (2016). THE NEXT GENERATION NSW PTY LTD PROJECT DEFINITION BRIEF. May 2016

Roads and Maritime Services (2016). "Traffic Volume Viewer".

<http://www.rms.nsw.gov.au/about/corporate-publications/statistics/traffic-volumes/aadt-map/index.html#/?z=13&lat=->

[33.80552194287362&lon=150.85589526140743&q=Westlink%20M7,%20Eastern%20Creek,%20New%20South%20Wales,%20Australia&id=87006&tb=1](http://www.rms.nsw.gov.au/about/corporate-publications/statistics/traffic-volumes/aadt-map/index.html#/?z=13&lat=-33.80552194287362&lon=150.85589526140743&q=Westlink%20M7,%20Eastern%20Creek,%20New%20South%20Wales,%20Australia&id=87006&tb=1). Cited 25 August 2016.

Seinfeld, J. and S. Pandis (2006). "Atmospheric Chemistry and Physics: From Air Pollution to Climate Change." Hoboken, New Jersey, John Wiley & Sons, Inc.

SLR (2010) "Greatmoor Energy from Waste Facility, Buckinghamshire: Air Quality – Technical Appendix 6/A Atmospheric Dispersion Modelling", published July 2010. SLR Ref: 411.0197.0078

TNG NSW (2015) Minutes from TNG NSW's meeting with EPA on 12 February, 2015.

US EPA (2000) "Facts about landfill gas"

<http://www.dem.ri.gov/programs/benviron/waste/central/lfgfact.pdf>


US EPA (2014) Documentation for Greenhouse Gas Emission and Energy Factors Used in the Waste Reduction Model (WARM): Fly Ash <http://epa.gov/climatechange/wycd/waste/downloads/fly-ash-chapter10-28-10.pdf>

Veolia (2013). "Annual Performance Report 2012, Newhaven Energy Recovery Facility". Veolia ES Southdowns Ltd, January 2013.

WA EPA (2000). "Waste to Energy and Water Plant, Lot 15 Mason Road, Kwinana – Global Olivine Western Australia". Report and recommendation of the Environmental Protection Authority, December 2000

World Resources Institute/World Business Council for Sustainable Development (2004) "The Greenhouse Gas Protocol – A Corporate Accounting and Reporting Standard Revised Edition March 2004".

Appendix A GENERAL ARRANGEMENT OF EFW FACILITY

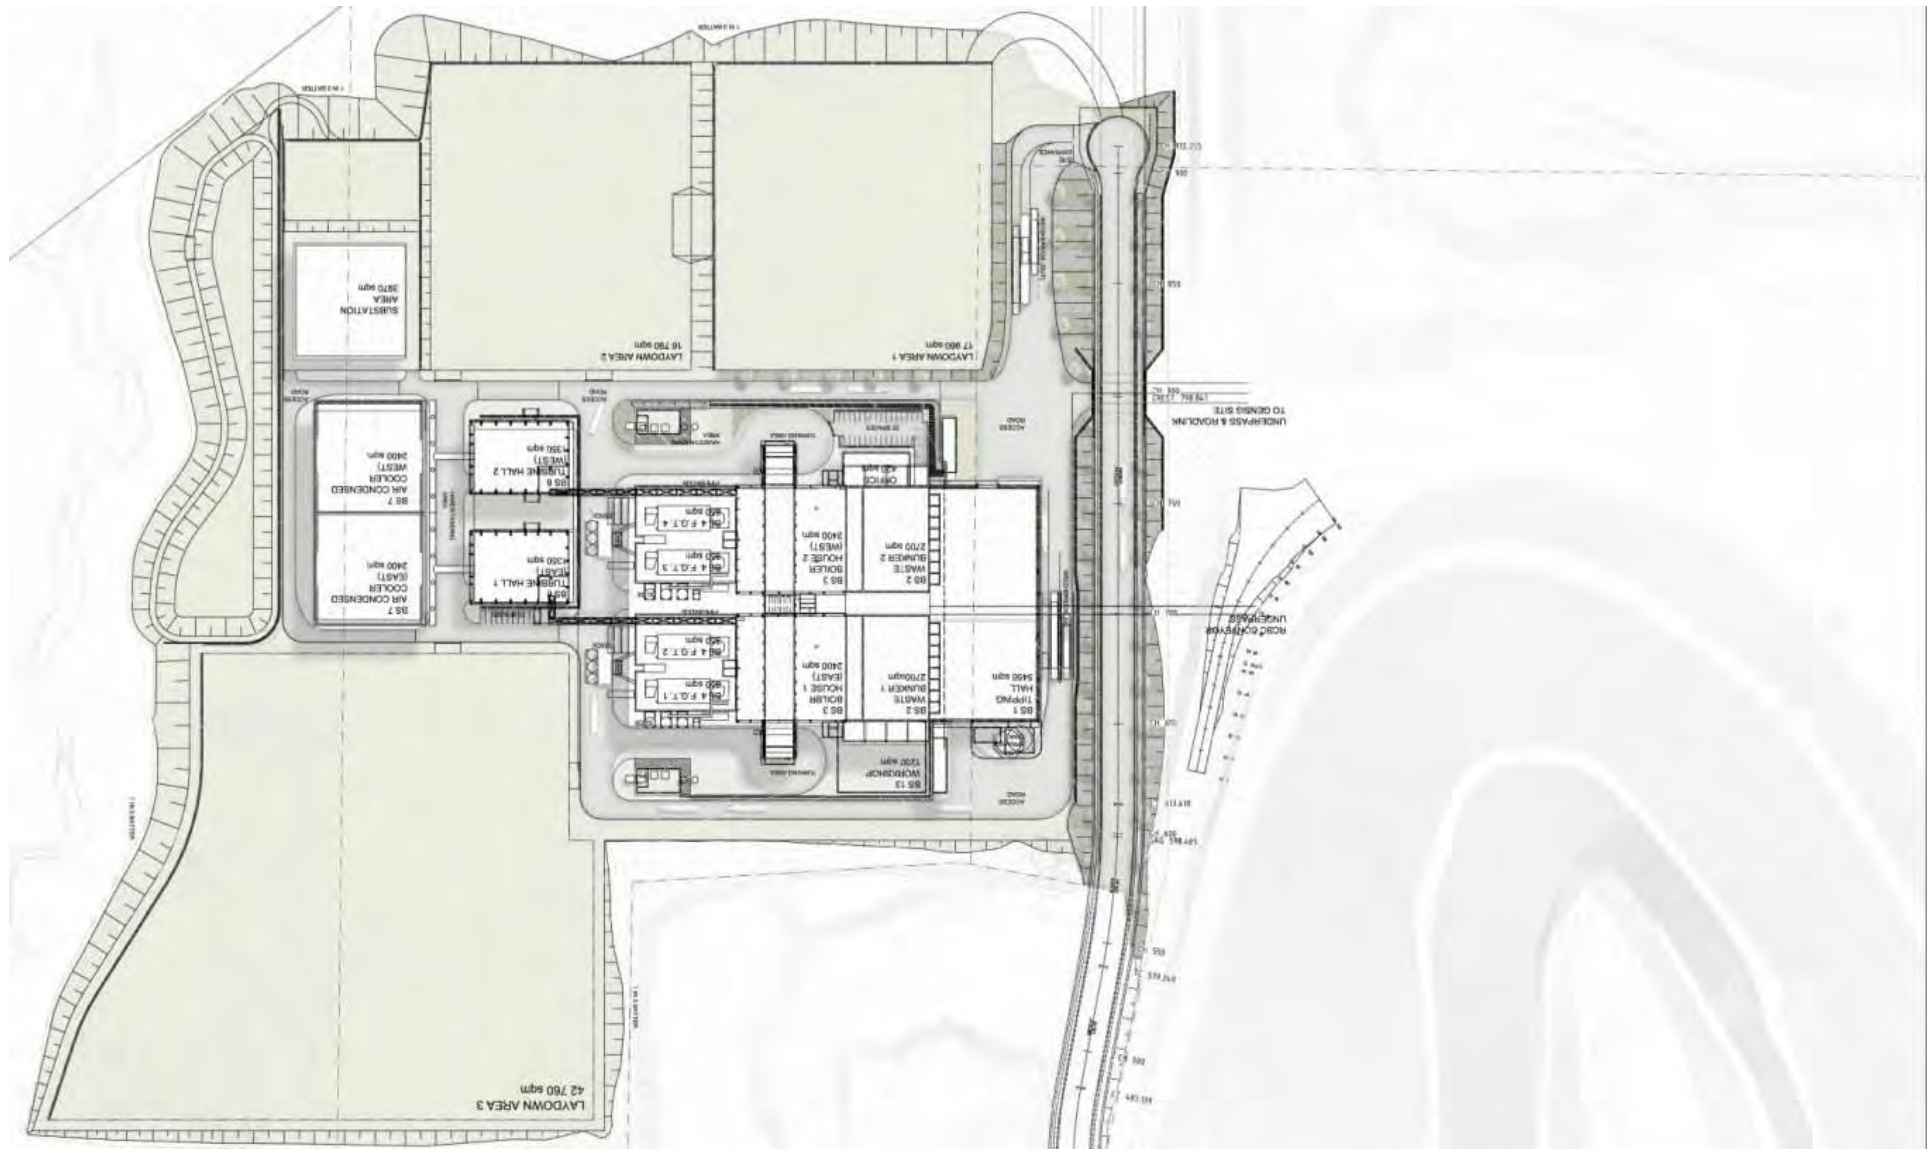

Appendix B ASSUMPTIONS

B.1 ASSUMPTIONS

General

The EfW facility will operate 24 hours a day, 7 days a week, with occasional offline periods for maintenance. Over the entire year, it is assumed that the EfW facility would be operational for 8,000 hours as an average.

The waste in total and as an average will not contain more than 1% chlorine (Ramboll, 2016). This is further discussed in Section 4.2.

The flue gas treatment system includes:

- Selective Non-Catalytic Reduction (SNCR) for reducing emissions of oxide of nitrogen.
- Dry lime scrubbing for reducing emissions of acid gases, including hydrogen chloride (HCl) and Sulfur Dioxide (SO₂).
- Activated carbon injection for reducing emissions of dioxins and mercury.
- Fabric filters for reducing emissions of particles and metals.
- Following flue gas treatment, emissions will be dispersed via a 100m stack. Further details of the flue gas treatment are discussed in Section 7.

The EfW facility is designed to operate continuously, therefore start-up and shutdown are infrequent events and anticipated to be required during the plants annual maintenance programme.

In accordance with the EU IED, such events shall under no circumstance occur for more than 4 hours uninterrupted where the emission values exceed the limits on no more than 60 hours per year.

To facilitate the safe shutdown and black start there will be two emergency diesel generators with one dedicated to each purpose. Each diesel generator (QSK78) will have a capacity of 2.4 MW that will provide sufficient power for the four waste lines. Routine maintenance and specific testing will occur for one hour, once a month.

Emissions

Air quality parameters anticipated to be released are as follows:

- Particulate matter (PM), assumed to be emitted as PM₁₀ and PM_{2.5}.
- Hydrogen Chloride (HCl).
- Hydrogen Fluoride (HF).
- Carbon Monoxide (CO).
- Sulfur Dioxide (SO₂).
- Oxides of nitrogen (NO_x) (expressed as Nitrogen Dioxide (NO₂)).
- Heavy metals (including Mercury (Hg), Cadmium (Cd), Arsenic (As), Chromium (Cr)).
- Organic substances (expressed as total organic compounds (TOC)).
- Dioxins and furans.
- Hydrogen sulfide (H₂S).
- Chlorine (Cl₂).
- Ammonia (NH₃).
- Poly-aromatic hydrocarbons (PAHs).

In the main, the 'normal' and 'upset' emission rates (g/s) adopted for modelling of each stack are derived from the in-stack concentrations provided by Ramboll in Appendix G and the flue gas flow rate per stack (Nm³/s) shown in Table 7-8. A summary of the in-stack concentration estimates adopted is additionally documented within Appendix G.

Ammonia slippage from an SNCR system normally ranges between 1 to 10 mg/Nm³, with an average of 4 mg of NH₃/Nm³ (European Commission, 2006). The effects of ammonia slip have been conservatively

factored into the upset conditions emissions scenario, which assumes in-stack concentrations of ammonia of 20 mg/Nm³.

Meteorology

The review identified 2013 as a representative year for dispersion modelling with no anomalous wind patterns compared to the other years examined and is therefore considered a representative year for dispersion modelling.

Background used for cumulative assessment

A PM_{2.5}:PM₁₀ ratio (0.35:1) has been applied to the PM₁₀ data measured at St Marys and Prospect for the PM_{2.5} background. The ratio is based on PM₁₀ measurements from Richmond and Liverpool between 2009 and 2013.

Pollutant	Averaging period	Units	Criteria	Maximum background
NO ₂	1 hour	µg/m ³	246	100
	Annual	µg/ m ³	62	23
SO ₂	10-minute	µg/ m ³	712	107 ^(a)
	1 hour	µg/ m ³	570	57
	24 hours	µg/ m ³	228	0.7
	Annual	µg/ m ³	60	3 ^(a)
CO	15-minute	mg/ m ³	100	14
	1 hour	mg/ m ³	30	7
	8 hours	mg/ m ³	10	2
PM ₁₀	24 hours	µg/ m ³	50	49 ^(a)
	Annual	µg/ m ³	30	19
PM _{2.5}	24 hours	µg/ m ³	25	17 ^(c)
	Annual	µg/ m ³	8	7 ^(b)

Note: (a) Excludes days already over the 50 µg/m³

(b) Calculated background. See Section 6.2.

Modelling

The stack temperature is taken from the technical specifications for a similar facility in the UK. A stack diameter of 2.2m is chosen to achieve an exit velocity of greater than 15 m/s, based on the provided volumetric flow rates (Ramboll, 2016).

A stack height of 100m has been adopted as compliance with the NSW impact assessment criteria was demonstrated at this height.

AERMOD was chosen as a suitable dispersion model due to the source type, location of nearest receiver and nature of local topography.

Terrain data was sourced from NASA's Shuttle Radar Topography Mission Data (3 arc second [~90m] resolution) and processed to create the necessary input files.

Values of surface roughness, albedo and bowen ratio were determined based on a review of aerial photography for a radius of 3 km centred on the EPA St Marys station. Default values for cultivated land and urban areas were chosen over two sectors across this area.

Building wake heights associated with the proposed on-site structures have been incorporated into the model.

For sub-hourly averaging periods, such as for CO and SO₂, predictions were based on the power-law formula from Borgas (2000) to estimate short-term peak values from longer-term average concentrations.

Results

GLCs for NO₂ were based on the assumption of 100% NO_x to NO₂ conversion.

Longer term averaging periods (24-hour, annual, 90 day, 30 day and 7 day) have not been included for the upset conditions modelling scenario. This is because the upset conditions would last for a period of no more than four hours.

Assuming the EfW facility emits NO_x at the EU IED limit for 8,000 hours of the year, the annual NO_x load to the Sydney air shed would be approximately 800 tonnes/year, thereby triggering further assessment. The potential for regional photochemical smog / ozone impacts are investigated in a standalone study, submitted as part of the Environmental Assessment (Pacific Environment, 2015b).

Greenhouse Gas Assessment

Scope 2 emissions (purchase of electricity) is not required to be quantified (the EfW facility is a net exporter of electricity) and the focus of this assessment is therefore on Scope 1 emissions. Scope 3 is optional and has been addressed in this assessment qualitatively as the Scope 3 emissions would be minor.

The maximum volume of material that will be combusted during any one year is assumed to be 1,350,000 tonnes.

The EfW facility is assumed to operate for 8,000 hours per year.

The EfW facility requires 7.5 MW of electricity to operate.

The carbon content of the residual waste fuel is based on the information provided for the design fuel mix (Ramboll, 2016).

DOC fraction for wood 'garden and green' (0.43) provides a conservatively low estimate of GHG emissions from landfilling. This results in a conservatively low estimate of GHG emissions diverted from landfill.

MEMORANDUM

To:	Damon Roddis	Organisation:	Pacific Environment
cc:	Skye Playfair Redman	Organisation:	Urbis
From:	Rosalind Flavell	Our Ref:	S1624-0010-0163RSF
Date:	29 January 2015	No. of Pages:	5
Subject:	Advice To Address EPA Comments		

Damon,

Please find enclosed a detailed description of how we would propose to assess the impact of the facility operating during periods of upset, start up and shut down. In addition we have provided some advice on likely emissions of ammonia.

1 PERIODS OF UPSET OPERATING CONDITIONS

1.1 Definition

Article 46(6) of the Industrial Emissions Directive (IED) (Directive 2010/75/EU) states that:

"... the waste incineration plant ... shall under no circumstances continue to incinerate waste for a period of more than 4 hours uninterrupted where emission limit values are exceeded.

The cumulative duration or operation in such conditions over 1 year shall not exceed 60 hours."

Article 47 continues with:

"In the case of a breakdown, the operator shall reduce or close down operations as soon as practicable until normal operations can be restored."

In addition Annex VI, Part 3, 2 states the emission limit values applicable in the circumstances described in Article 46(6) and Article 47:

"The total dust concentration in the emissions into the air of a waste incineration plant shall under no circumstances exceed 150 mg/Nm³ expressed as a half-hourly average. The air emission limit values for TOC and CO set out in points 1.2 and 1.5(b) shall not be exceeded."

The conditions detailed in Article 46(6) are considered to be "Upset Operating Conditions".

1.2 Reasons for occurrence

Upset operating conditions such as those defined may occur as a result of the following:

- reduced efficiency of the Selective Non-Catalytic Reduction (SNCR) system as a result of blockages or failure of the reagent injection system, leading to elevated oxides of nitrogen emissions;
- reduced efficiency of particulate filtration system due to bag failure and inadequate isolation, leading to elevated particulate emissions and metals in the particulate phase;
- reduced efficiency of lime injection system such as through blockages or failure of fans leading to elevated acid gas emissions;

FICHTNER

- complete failure of the lime injection system leading to unabated emissions of hydrogen chloride. (Note: this would require the plant to have complete failure of the bag filter system. As a plant of modern design, the plant would have shut down before reaching these operating conditions); or
- complete failure of the activated carbon injection system and loss of temperature control leading to elevated concentrations of metals and dioxin reformation and their unabated release.

1.3 Likely emission concentrations

There is no monitoring data available from existing facilities during 'upset operations'. In the absence of monitoring data plausible worst-case assumptions are used based on consultation with the UK Environment Agency based on their knowledge of plausible upset emissions. It will be worth consulting with HZI to ensure that they agree with the predicted NOx emissions under upset operating conditions.

No data on flow characteristics (flow rate, temperature etc) during these upset operating conditions is available and there is no reason to expect these parameters to change, so for the purposes of any assessment the design flow characteristics are applied.

Pollutant	Permitted Emission (mg/Nm ³ unless stated)		Plausible Upset Emission (mg/Nm ³ unless stated)	% Above Max Permitted Emission
	Daily Average	½ hourly max		
Oxides of nitrogen	200	400	550 ⁽¹⁾	38
Particulate matter (PM _{10S})	10	30	150 ⁽²⁾	400
Sulphur dioxide	50	200	450	125
Hydrogen chloride	10	60	900 ⁽³⁾	1,400
Hydrogen fluoride	1	4	90 ⁽⁴⁾	2,150
TOC (VOCs)	10	20	20 ⁽²⁾	0
CO	50	100	100 ⁽²⁾	0
Dioxins	0.1 ng/Nm ³		10 ng/Nm ³ ⁽⁴⁾	9,900
Group 1 Metals - Mercury	0.05		0.75	1400
Group 2 Metals - Cadmium etc	0.05		0.75	1400

Reference conditions for all emissions dry, 11% oxygen, 283K.

(1) To be confirmed with HZI.

(2) Taken from the Annex VI Part 3 of the IED.

(3) Based on information presented in an Environment Agency document.

(4) As requested by the Environment Agency.

It is assumed that all metals are in the particulate phase, therefore metal emissions during predicted upset operation will increase in proportion to the increase in particulate emissions. Reference monitoring methods for metals require periodic monitoring with emission concentrations expressed as an average over a sampling period of up to 8 hours. For the purpose of any assessment the ratio applied to the daily limit for particulates should be applied to the metals emissions. As such the predicted plausible upset emissions for each group of metals (Groups 1 and 2) should be calculated as 15 times the predicted emission concentration.

1.3.1 Plausible upset emissions of group 3 metals

For the purposes of assessing upset operating conditions a number of assumptions are usually made with regard to the plausible upset emissions of the group 3 metals.

- (1) The group 3 metals which have a short or long term EAL are considered (antimony, arsenic, chromium, copper, lead, manganese, nickel, vanadium).
- (2) The permitted emission concentrations for each group 3 metal is taken as the maximum monitored from "Environment Agency Guidance to Applicants on Metals Impact Assessment for Stack Emissions (September 2012, Version 3)".
- (3) The permitted emission concentration of chromium (VI) is based on the ratio of the effective chromium (VI) emission concentration to total metal emissions, as presented in the "Environment Agency Guidance to Applicants on Metals Impact Assessment for Stack Emissions (September 2012, Version 3)".
- (4) It is assumed that metals are in the particulate phase, therefore metal emissions during predicted upset operation will increase in proportion to the increase in particulate emissions. Reference monitoring methods for metals require periodic monitoring with emission concentrations expressed as an average over a sampling period of up to 8 hours. For the purpose of any assessment the ratio applied to the daily limit for particulates is applied to the group 3 metals. As such the predicted plausible upset emission for each group 3 metal is calculated as 15 times the predicted emission concentration.

The plausible upset emissions concentrations are presented in Table 2 for group 3 metals.

Pollutant	Permitted Emission based on Max Monitored Emission Concentrations (µg/Nm³)	Predicted Plausible Upset Emission (µg/Nm³)	% Above Max Permitted Emission
Antimony	11.5	172.5	1,400
Arsenic	3	45	1,400
Chromium	52.1	781.5	1,400
Chromium (VI)	0.01355	0.20319	1,400
Copper	16.3	244.5	1,400
Lead	36.8	552	1,400
Manganese	36.5	547.5	1,400
Nickel	136.2	2,043	1,400
Vanadium	1	15	1,400

Reference conditions for all emissions dry, 11% oxygen, 283K

1.4 How assessed

In the UK we assess the impact of the plant operating at the upset operating conditions against the relevant short term EALs. For instance an assessment is not made of the plant continually operating at the upset operating conditions for a continuous period of more than 4 hours.

To determine the impact for comparison with the long term objectives it is assumed that the plant operates at the plausible upset operating conditions for 60 hours and the remaining 8,700 hours at the daily limit. The impact is then assessed against the relevant long term EALs.

2 PLANT START-UP AND SHUTDOWN

Start-up of the facility from cold will be conducted with clean support fuel (low sulphur light fuel oil). During start-up waste will not be introduced onto the grate unless the temperature within the oxidation zone is above the 850°C as required by Article 50, paragraph 4(a) of the IED. During start-up, the flue gas treatment plant will be operational as will be the combustion control systems and emissions monitoring equipment.

The same is true during plant shutdown where waste will cease to be introduced to the grate. The waste remaining on the grate will be combusted, the temperature not being permitted to drop below 850°C through the combustion of clean support auxiliary fuel. During this period the flue gas treatment equipment is fully operational, as will be the control systems and monitoring equipment. After complete combustion of the waste, the auxiliary burners will be turned off and the plant will be allowed to cool.

Start-up and shutdown are infrequent events. The facility is designed to operate continuously, and ideally only shutdown for its annual maintenance programme.

In relation to the magnitude of dioxin emissions during plant start-up and shutdown, research has been undertaken by AEA Technology on behalf of the Environment Agency. Whilst elevated emissions of dioxins (within one order of magnitude) were found during shutdown and start-up phases where the waste was not fully established in the combustion chamber, the report concluded that:

"The mass of dioxin emitted during start-up and shutdown for a 4-5 day planned outage was similar to the emission which would have occurred during normal operation in the same period. The emission during the shutdown and restart is equivalent to less than 1 % of the estimated annual emission (if operating normally all year)."

There is therefore no reason why such start-up and shutdown operations will affect the long term impact of the facility.

3 AMMONIA SLIP

We have assumed that the facility will use Selective Non-Catalytic Reduction (SNCR) rather than Selective Catalytic Reduction (SCR). The IED NO_x limit is easily achieved using SNCR. SCR can achieve much lower NO_x levels but at a significant cost to the project.

The BREF states that ammonia slippage from a SNCR system normally range from 1 to 10 mg/Nm³, with an average of 4 mg of NH₃/Nm³. For the purpose of the permit and planning application in the UK we would normally assume the upper end of the range (i.e. 10 mg/Nm³) to allow for some flexibility. However, if local sites are highly sensitive to ammonia or nitrogen deposition a more stringent limit may be requested. It will be worth requesting the guarantee from HZI.

FICHTNER

If you have any questions please feel free to contact us.

Yours sincerely
FICHTNER Consulting Engineers Limited

Rosalind Flavell
Environmental Consultant

Stephen Othen
Technical Director

Appendix C RAMBOLL TECHNICAL MEMORANDA

MEMO

Job **Response to Submissions: SD_6236:
TNG Energy from Waste Facility, Eastern Creek,
Dioxin in Energy from Waste facilities**
Reference:
**Australand, Air quality and
Blacktown District Environment Group on Domestic Incineration
DADI**

Client
Memo no.
Date **10/08/2015**
To **Ian Malouf, DADI**
From **Tore Hulgaard**
Copy to **Geert Stryg
Martin Brunner**

Date 10/08/2015

1. Introduction

This memo is background memo elaborated with reference to "Consolidated Agency Submissions from 2015 Exhibition" (subsequently referred to as "2015 Exhibition") .

The memo describes general principles of dioxin destruction, formation and removal in Energy from Waste (EfW) facilities.

The dioxin emission and other dioxin containing outputs are described and put in perspective.

The dioxin related issues highlighted in the 2015-Exhibition are addressed, including the remarks of Australand under the heading of **Air quality and Ozone;** "

- The assumption that there will be no dioxins/furans leaving the primary secondary combustion chamber
- Absence of reference to, and compliance with, the Stockholm Convention

This memo also addresses dioxin emission from uncontrolled incineration, with reference to the note of the 2015-Exhibition under the heading Blacktown District Environmental Group, Domestic Incineration.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

2. What is Dioxin?

Dioxin is not just one chemical substance. It is a group of substances that share a range of similarities, and most are toxic but to varying degrees. Reference is usually made to the most toxic of them, the so-called Seveso dioxin or 2,3,7,8 TCDD (TCDD is tetrachlorodibenzo-para-dioxin).

Dioxins are of concern because they have been characterised as likely to be human carcinogens. Dioxins are solid substances at ambient temperatures and therefore deposit on land. Once deposited the destruction rate is low, why they are considered persistent.

Dioxin emissions and measurements in general are usually presented as toxicity equivalents (TEQ) of 2,3,7,8 TCDD which is a sum of around 20 selected dioxins and furans weighted according to their respective toxicities. Furans are dioxin like and therefore calculated together with dioxins.

In the EU Industrial Emissions Directive (IED) which is used as reference for the TNG EfW, 20 dioxins and furans are specified, and dioxin measurements according to IED are reported as international TEQ (I-TEQ)¹. For instance the emissions of TNG EfW is reported as I-TEQ with a limit value of 0.1 ng/m³ (at reference conditions).

Dioxins are mainly formed in the course of combustion processes including waste incineration, metal production, landfill fires and other uncontrolled combustion. Dioxins could also be generated as byproducts of chemical production.

3. The Stockholm Convention

The Stockholm Convention on Persistent Organic Pollutants² (POPs) was adopted on 22 May 2001 in Stockholm, Sweden. The Convention entered into force on 17 May 2004.

The Stockholm Convention on Persistent Organic Pollutants is a global treaty to protect human health and the environment from chemicals that remain intact in the environment for long periods, become widely distributed geographically, accumulate in the fatty tissue of humans and wildlife, and have harmful impacts on human health or on the environment.

The convention includes originally 12 pollutants. The list has been expanded over the years and now includes around 23 pollutants. They are grouped into three categories: one banning production and use, one restricting production and use and one being the result of unintentional production. Dioxins and furans emissions from waste incineration are in the latter group (Annex C of the convention).

¹ Different organisations and norms operate with different number of dioxin and furans and slightly different weighting factor, which may give slightly different TEQ values for the same emission.

² Stockholm Convention on Persistent Organic Pollutants (POPs) as amended in 2009, available from <http://chm.pops.int/Home/tabid/2121/Default.aspx>

3.1 Does the facility comply with the provisions of the Stockholm Convention?

Annex C (section A of part V) of the Convention includes general consideration including **“Improvements in waste management with the aim of the cessation of open and other uncontrolled burning of wastes, including the burning of landfill sites.”**

The high level consequence of constructing the facility is that when waste is directed to the EfW-facility, less waste shall be available for open and other uncontrolled burning of waste, including unintended landfill fires. This is in agreement with the Stockholm Convention and it shall have a large beneficial impact on the dioxin pollution from waste management because emissions (in nanograms per tonne) from uncontrolled burning of waste is several orders of magnitude higher than the air emission from an EfW facility.

When it comes to facilities that may produce dioxins as unintended by-products, as **described in Article 5, “Each Party” (meaning state that is bound by convention)** shall promote the use of Best Available Techniques and Best Environmental Practices.

On the matter of dioxin abatement at the facility, it is specifically mentioned in the Convention the following to be considered in determining best available techniques; **“Use of improved methods for flue-gas cleaning such as thermal or catalytic oxidation, dust precipitation, or adsorption”**.

The EfW facility will be constructed using the Best Available Techniques (BAT) as described in the convention. It uses dust precipitation and adsorption in the flue gas treatment system, two of the techniques mentioned in the Convention. As described in Concept Design Report, each unit would be fitted with a flue gas treatment system including the addition of activated carbon as adsorbent to minimise the emissions of dioxins, and a bag filter to remove particulates. This technology is furthermore in agreement with provisions of the EU Best Available Techniques as described in the BAT reference note³.

The technology ensures compliance with the EU air emission requirement of 0.1 ng/m³ (ref. standard temperature and pressure, dry flue gas at 11% O₂).

When it comes to the solid outputs they are also in agreement with the Convention, because the dioxin concentrations in each of the residues is below the threshold for **“low POP content”**.

As stated in article 6, paragraph 2 (c), of the Convention, cooperation between the Parties and Basel Convention shall work to establish, as appropriate, the concentration levels of the chemicals listed in order to define the low persistent organic pollutant content. Wastes consisting of, containing or contaminated with POPs above the low POP content should, in accordance with article 6, paragraph 1 (d) (ii), be disposed of in such a way that the POP content is destroyed or irreversibly transformed or otherwise disposed of in an environmentally sound manner when destruction or irreversible transformation does not represent the environmentally preferable option.”

³ EU Commission 2006, Integrated Pollution Prevention and Control, Reference Document on the Best Available Techniques for Waste Incineration.

The “low POP content” threshold of wastes has been set at 15 µg/kg for dioxin (TEQ PCDD/F) as a provisional value⁴. All residue being bottom ash and flue gas treatment residue (including fly ash) are expected to be well below the “low POP content” threshold. Bottom ash is expected at a dioxin content (TEQ) around 0.001-0.030 µg/kg, and flue gas treatment residue around 1 µg/kg. This means that the Convention does not require further treatment of the residues prior to disposal when it comes to the dioxin content.

In conclusion all relevant paragraphs of the Stockholm Convention are considered and complied by the EfW facility.

⁴ Basel Convention, Technical Guidelines for the Environmentally Sound Management (ESM) of Wastes Consisting of, Containing or Contaminated with Persistent Organic Pollutants (POPs), cf. <http://www.basel.int/Implementation/POPsWastes/TechnicalGuidelines/tabid/2381/Default.aspx>

4. Dioxin from EfW

An EfW facility may be illustrated as depicted in the figure below.

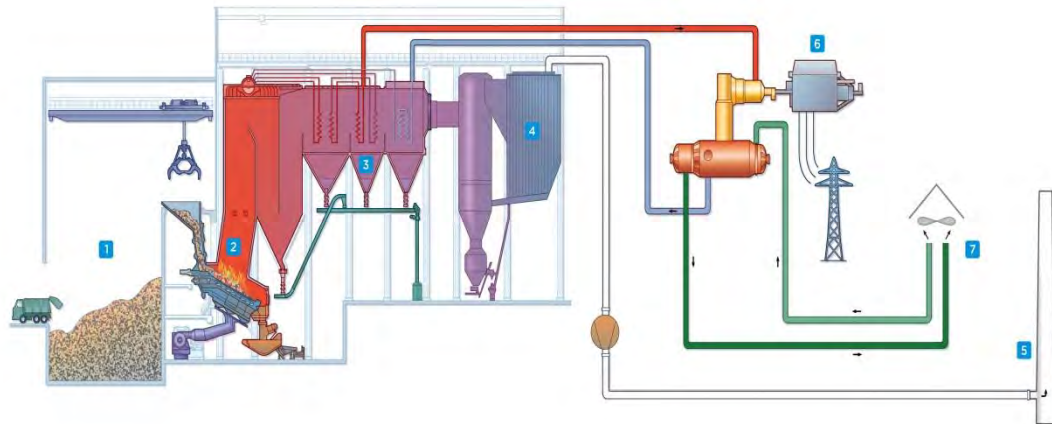


Figure 1 Typical Energy from Waste facility consisting of the main functions, 1) Waste bunker, 2) Furnace, 3) Energy recovery in a steam boiler, 4) Flue gas treatment, 5) stack, 6) electricity generation in turbine/generator set, 7) condensation of vapours in an air cooled condenser.

Waste is ignited and burnt on the grate in the furnace at temperatures around 1'100° C and the temperature of the flue gases is thereafter kept above 850 °C for at least 2 seconds in the afterburning chamber.

The flue gas treatment stage consists of a reactor with injection of lime and activated carbon for dioxin adsorption followed by a bag house filter for dust separation, including the activated carbon particles with dioxin adsorbed.

The flue gas treatment system ensures that the stack emissions comply with the emission requirement of 0.1 ng/m³ (at reference conditions) regardless the content in the raw, untreated flue gas within any realistic operational range.

4.1 Destruction and formation of dioxin in the furnace/boiler system

Input waste to the furnace contains dioxin. The content of dioxin is destroyed in the course of the combustion process where the gas temperature reaches above 1'000 °C and also in the afterburning chamber where the temperature is maintained at minimum 850 °C for minimum 2 seconds.

Dioxin is known to oxidise at high temperatures, for instance the Australian Department of Environment indicated thermal decomposition at 700 °C. ⁵ Also Vehlow⁶ illustrated how the temperature affects the dioxin level, Figure 2.

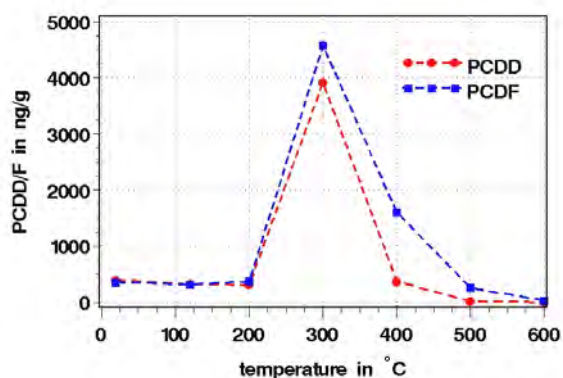


Figure 2 Formation of PCDD and PCDF in fly ashes from waste incineration during annealing in air atmosphere.

Also a report of US EPA⁷ stated that ‘a number of studies have provided evidence that most of the CDDs/CDFs present in the MSW are destroyed during combustion’.

The dioxin content in the raw, untreated flue gas originates mostly from formation on the boiler walls in the temperature range 250-400 °C.

The mass balance of dioxin is demonstrated by Vehlow. It indicates that the typical picture is that the dioxin content of the incoming waste grossly exceeds the sum of the outputs, so the EfW-facility is a net destructor of dioxin. The air emission is less than 1% of the content of the incoming waste. As mentioned previously the fly ash and flue gas treatment residue are disposed in a safe manner, outside reach of the environment.

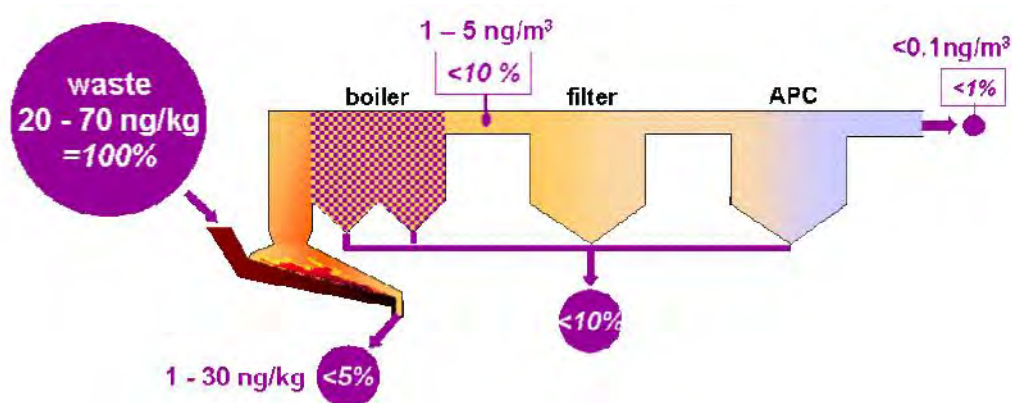


Figure 3 Dioxins (TEQ) in a state of the art EfW-facility. [Footnote 6]

⁵ <http://www.npi.gov.au/resource/polychlorinated-dioxins-and-furans>

⁶ Jürgen Vehlow, Dioxins in Waste Combustion – Conclusions from 20 Years of Research, Bioenergy Australia, Melbourne, 2005.

⁷ Mechanisms of formation of dioxin-like compounds during combustion of organic materials, Draft of May 2005.

http://www.epa.gov/ncea/pdfs/dioxin/2k-update/pdfs/Dioxin_Chapter_2.pdf

5. Dioxin emission and inventory

The total dioxin emission in 2014 in Australia⁸ is listed as around 300 g per year of TEQ dioxins of which more than half (170 g per year) originates from back yard incinerators.

The total dioxin emission from the TNG EfW facility is estimated as 0.7 g per year TEQ, emission if it operates at full capacity at the emission limit value of 0.1 ng/m³ (ref.) continuously. The typical emissions from EfW facilities are however around a factor 10 lower⁹, causing the expected dioxin emission to be around 0.07 g per year TEQ or around 0.02% of the Australian inventory, and 0.05% of the contribution from back yard incinerators.

6. On domestic burning of waste

Blacktown District Environmental Group argues on domestic incineration, that "Local residents have been prevented from incinerating rubbish in their own backyard - unfair to now impose industrial incinerator on those same residents."

The ban on domestic incineration appears to be in agreement with the provisions of the POP convention to reduce dioxin emissions, as cessation of open burning of waste is specifically mentioned in the convention Annex C (section A of part V), cf. section 3.1 above.

Transfer of waste from domestic incineration to the industrial EfW facility will save the environment for large amounts of dioxin, which is particularly important for the local community where domestic incineration happens.

⁸ Total national facility emissions for the substance: Polychlorinated dioxins and furans (TEQ)

<http://www.npi.gov.au/npdata/action/load/summary-result?jsessionid=26410198AE95A174F96749000E3FE4F9/criteria/substance/73/destination/ALL/source-type/ALL/substance-name/Polychlorinated%2Bdioxins%2Band%2Bfurans%2B%2528TEQ%2529/subthreshold-data/Yes/year/2014>

⁹ Emissions from decentralised chp plants 2007 - energinet.dk environmental project no. 07/1882, Appendix 3, listing an emission factor of 5 ng/GJ (TEQ) and considering a flue gas flow rate 550 m³/GJ (ref.).

Job **Compilation of COPC Memos**
 Client **EfW Facility TNG NSW**
 Date **2016-10-20**
 To **To Whom it may concern**
 From **Martin Brunner (Ramboll)**
 Copy to **Ian Malouf (DADI)**
Phill Andrew (Savills)
Amanda Lee (AECOM)
Lesley Randall (AECOM)
Rachael Snape (Urbis)
Damon Roddis (Pacific Environment)

Compilation and update of memos on compounds of potential concern (COPC)

Over the course of the project several memos concerning COPC for the HHRA have been established. Following a summary and overview of the memos with subject, date of issue and revision date is shown.

	Job	Date of Issue	Revision date
Memo 1	Compounds of Potential Concern (COPC) for HHRA	13.09.2015	-
Memo 2	COPC for HHRA	20.09.2015	19.10.2016
Memo 3	COPC for HHRA – Cr(VI)	03.11.2015	19.10.2016
Memo 4	VOC for HHRA	20.10.2016	-
Memo 5	Bromine in Waste	14.10.2016	-

These memos shall serve as an input to the air quality assessment (AQA) and the human health risk assessment (HHRA)

In summary the most important changes compared to the memos edited until end of 2015 are:

- Update of appendix B of Memo 2 (maximum TOC/VOC concentrations)
- Update Cr(VI) emissions
- Evaluation of further VOC compounds
- Assessing bromine emissions

Ramboll AG
 Hardturmstrasse 132
 CH-8005 Zürich
 Schweiz

Attachments

Memos 1 - 5

T +41 44 500 35 80
 F +41 44 500 35 89

info@ramboll.ch
www.ramboll.com

MEMO

Job **Compounds of Potential Concern (COPC) for HHRA**
Client **DADI TNG NSW**
Memo no. **1**
Date **13/09/2015**
To **Lesley Randall (AECOM)**
Damon Roddis (Pacific Environment)
From **Martin Brunner**
Copy to **Ian Malouf (DADI)**
Phill Andrew (Savills)
Mary Likar (Savills)
Amanda Lee (AECOM)
Skye Playfair Redmann (Urbis)
Geert Stryg (Ramboll)
Tore Hulgaard (Ramboll)
Ruedi Frey (HZI)

1. Reference and basis

Date 13/09/2015

Reference is made to the following memos:

- a) "TNG Energy from Waste Facility – Inputs to Human Health Risk Assessment", dated 11. September 2015 by Damon Roddis (Pacific Environment)
- b) "Advice to address EPA comments", dated 29. January 2015 by Rosalind Flavell (Fichtner)

Ramboll
Hardturmstrasse 132
CH-8005 Zürich
Switzerland

T +41 44 500 35 80
F +41 44 500 35 89
www.ramboll.com/energy

In line with the above information we have evaluated the in stack concentrations for normal and upset operation based on real data of 4 plants (7 lines and 7 different measuring campaigns) with identical Air Pollution Control system (APC) as planned to be installed at the TNG facility. We have further considered general literature on emission factors of WtE plants. Where no such data was available the concentration was calculated on the expected particulate emission and appropriate concentration of the compound in fly ash. More detailed description of the data used will follow in a separate memo. All values are given based on the following assessment:

Normal operation: Maximum value out of the following:

- Any measured value from the plants with identical APC system
- Literature emission factor for WtE plants

Upset operation: Definition of "Upset Operating Conditions" see memo b) chapter 1. Maximum value out of the following:

- Particulate emission of 150 mg/Nm³, emission based on specific compound concentration in fly ash
- Gas flow of 10% of total gas flow to stack bypassing APC (e.g. bag failure)
- Value of 10 times normal operation

When evaluating these data we found that in the memo b) some values were far above operational data. As a result we have re-evaluated the values of memo b) for normal operation. Further some in stack concentrations during upset operation (mainly HF and Dioxins) seem to be highly exaggerated, however (from footnote to table 1) we understand these values were requested by the EPA.

2. Table 1: Missing COPC

Compound All values at 11%O ₂ , dry gas		Operation condition	
		normal	upset
Beryllium	mg/Nm ³	7.00E-06	5.25E-04
Silver	mg/Nm ³	3.40E-04	2.55E-02
Cobalt	mg/Nm ³	4.00E-03	4.00E-02
PCB (WHO TEQ humans/mammal)	mg/Nm ³	1.60E-08	1.60E-07
PAH (WHO TEQ humans/mammal)	mg/Nm ³	5.00E-04	5.00E-03
Zinc	mg/Nm ³	3.70E-02	5.09E+00
Tin	mg/Nm ³	3.33E-03	2.50E-01
Molybdenum	mg/Nm ³	2.20E-05	2.63E-03
Selenium	mg/Nm ³	2.12E-03	2.12E-02
HCB	mg/Nm ³	8.21E-06	8.21E-05

3. Table 2: Overestimated COPC

Compound All values at 11%O ₂ , dry gas		Operation condition	
		normal	upset
Mercury	mg/Nm ³	0.004	0.013
Cadmium	mg/Nm ³	0.009	0.090
Thallium	mg/Nm ³	0.001	0.009
Nickel	mg/Nm ³	0.021	0.208
PCDD/F TEQ (WHO humans/mammal)	ng/Nm ³	0.010	0.500

4. Relevant flue gas volume

For calculation of the ground level concentration the methodology described in memo a) should be used. In case of any doubt the following revised flue gas flow shall be applied.

Parameter	Value		
	Design Point (LPN)		
Number of streams	1	2	4
Stack Height (m)	100		
Stack Diameter each stream inside (m)	2.2		
Temperature (°C)	120		
Flue Gas Flow (Nm ³ /s)	57.4	114.8	229.6
Gas Exit Flow Rate (Am ³ /s)	82.6	165.2	330.5
Gas Exit Velocity (m/s)	21.7		
Flue Gas Flow (Nm ³ /s) @ 11% O ₂	63.5	127.0	254.0
Flue gas composition (v/v)			
H ₂ O	15.90%		
O ₂	6.60%		
N ₂	67.80%		
CO ₂	9.70%		

5. Conclusion

For the further HHRA the data listed in table 1 (above) shall be used.

In case that as a result of the HHRA for one of the compounds listed in table 2 "overestimated COPC" (above) shows to be critical (when using the concentrations in memo b)) we suggest to use the values given in table 2 (above).

MEMO

Job **COPC for HHRA**
Client **EfW Facility TNG NSW**
Memo no. **2 – Rev 1**
Date **19/10/2016**
To **To Whom it May Concern**
From **Martin Brunner (Ramboll)**
Copy to **Ian Malouf (DADI)**
Lesley Randall (AECOM)
Amanda Lee (AECOM)
Damon Roddis (Pacific Environment)
Phill Andrew (Savills)
Rachael Snape (Urbis)

1. Background and goal

In the context of the input to the Human Health Risk Assessment (HHRA) there has been some discussion on the list of Compounds of Potential Concern (COPC). The following memo gives an explanation on why the current COPC's have been chosen.

Date 19/10/2016

Ramboll
Hardturmstrasse 132
CH-8005 Zürich
Switzerland

2. Basis of the current list of COPC's

An initial list of COPC's was established as a basis of the report "energy from waste facility - air quality and greenhouse gas assessment" produced by Pacific Environment in March 2015.

T +41 44 500 35 80
F +41 44 500 35 89
www.ramboll.com/energy

The COPC's chosen were based on the primary emissions from any Energy-from-Waste (EfW) facility, as defined by emission limits for waste incineration set by the European Union (EU) Industrial Emissions Directive (IED; Directive 2010/75/EU).

The emissions defined by the EID and chosen as COPC's are listed in Appendix A.1. In addition to the emissions identified in the IED, the substances listed in A.2 were included. As a result of the submissions from the Public Exhibition the substances listed in A.3 were added.

The current list of COPC's is substantially broader than substances usually taken into account in an Environmental Impact Assessment for an EfW plant in Europe. Nevertheless it is reasonable to question whether this list is complete. The following shall provide the rationale for our opinion that the current list is sufficient to perform the HHRA.

3. **The legislation principle of primary emissions and “lead substances”**

While emissions in general cover a broad range of toxic, carcinogenic, mutagenic, etc. substances every industry has a specific set of primary emissions which - for reasons of human health and environmental protection - have to be reduced. It is therefore obvious that legislation focuses on the relevant emissions for any industry.

Besides the primary emissions so-called “lead substances” can be defined. Lead substances are representative for an entire group of comparable compounds and either relevant in their toxicity or present in high concentration. These substances are often difficult to capture by an Air Pollution Control (APC) system. Measuring low concentrations of these lead substances therefore is the proof that the separation mechanisms of the APC control are working. Typical lead substances of an EFW plant are: HCl, SO₂, NO_x, TOC, CO, dioxins and furans, cadmium, mercury and further heavy metals as nickel, lead or arsenic.

The chosen approach to primarily focus on substances defined in the IED and further lead substances therefore is rational and good industry practice.

4. **The implications of the “lead substance approach”**

When considering the emissions of an Energy-from-Waste plant the following categories of compounds can be defined:

- particulate matter
- acid gases (HCl, HF, SO₂)
- NO_x
- heavy metals with low boiling point (mercury, cadmium) and volatile compounds, to a high degree present in vaporised form
- heavy metals with high boiling point (nickel, vanadium, etc.), predominantly present in particle form
- Organic substances (expressed as total organic carbon TOC)
- dioxins and furans

Every one of these substances (and therefore the appropriate category) has a specific reduction mechanism in combustion and the APC process. While the lime injection reduces the acid gases, the bag filter eliminates the particulates and any substance in particulate form (mainly heavy metals with high boiling point). Finally the activated carbon injection reduces organic substances and heavy metals with low boiling point by adsorption.

As mentioned earlier a low emission of any lead substance is the proof of an efficient reduction of the category they represent in general.

The COPC's recently added (appendix A.3) all can be classified in the above categories, e.g.:

- Copper, Molybdenum: metals with high boiling point
- PCBs and PAHs: organic substances
- Selenium, Beryllium: metals with low boiling point
- etc.

As a result any further substance can be classified in the above categories and therefore the reduction efficiency (respectively a low emission) can be assured.

5. TOC as guarantee for low organic emissions

While there is a limited number of toxic metals (including their compounds) there is an indefinite number of organic substances. The most important ones have been listed in the relevant regulations and are part of the current list of COPC's. However it is impossible to supply a complete list of individual organic substance and their emission data.

For this reason an additional emission parameter "total organic carbon" (TOC) has been introduced to legislation. The TOC measurement ensures that no relevant amount of organic substances is emitted. The TOC measurement is usually based on "Flame Ionisation Detection" (FID or FIA) and part of the continuous emission monitoring of any EfW plant. The TOC is a summary parameter for organic substances in general, the result is expressed in "carbon equivalent". Average TOC results of energy from waste plants are in the range of 1 - 2 mg/Nm³ (Nm³ is normal cubic meters, i.e. at standard temperature (0 °C) and pressure (101.3 kPa)).

In Europe extensive research has been done on the composition of the TOC of Energy-from-Waste plants. In total less around 50% of the TOC can be allocated to substances with higher molecular weight (see attachment B). The other 50% (or more) are "light" substances like methane, propane, etc. This is further underlined by theoretical considerations [2] which predict that a part of the TOC will be methane, ethane and propane.

To illustrate the low expected emission level, it can be mentioned that the background ambient air concentration of methane is around 1,800 ppb (volume basis) equivalent to around 1 mg/Nm³ TOC.

6. Operational Data

The above considerations are further supported by operational data (see appendix C). The appendix C.1 shows publicly available emission data from plants exclusively fired by C&I and C&D waste with semi dry APC system (as used for the TNG project) as well as plants with mixed waste (MSW plus C&I, C&D). In summary all values are comparable and far below the emission limits. Further details on operational data are found in appendix C.2 and C.3.

7. Summary and conclusions

The current list of COPC has been established on the following considerations:

- Compounds regulated by recent legislation (in this case the IED; Directive 2010/75/EU) and therefore relevant for the EfW Industry
- Additional COPC's which are not of primary relevance for a EfW plant but might be of public concern
- Lead substances which demonstrate the ability of the APC system to reduce pollutant categories and therefore not only assures a low emission of the substance itself, but also of the entire category
- TOC as an overall guaranty for low organic emissions which – as research has shown – contain very low concentrations of potentially harmful substances

As a result of the above and "real data" from comparable plants we are of the opinion that the current list of COPC is exhaustive and a sufficient basis to perform a robust and trustworthy HHRA.

Appendix A

1. The emissions defined by the EID and chosen as COPC's

- Particulate matter (PM), assumed to be emitted as PM10 and PM2.5.
- Hydrogen Chloride (HCl).
- Hydrogen Fluoride (HF).
- Carbon Monoxide (CO).
- Sulfur Dioxide (SO₂)
- Oxides of nitrogen (NO_x) (expressed as Nitrogen Dioxide (NO₂)).
- Heavy metals (including Mercury (Hg), Cadmium (Cd), Arsenic (As) and Chromium (Cr).
- Gaseous and vaporous organic substances (expressed as total organic carbon (TOC)).
- Dioxins and furans.

2. In addition the following substances were included:

- Hydrogen sulfide (H₂S).
- Chlorine (Cl₂).
- Ammonia (NH₃).
- Polycyclic aromatic hydrocarbons (PAHs).

3. As a result of the submission the list was amended by the following substances:

- Beryllium (Be)
- Silver (Ag)
- Asbestos
- Copper (Cu)
- Cobalt (Co)
- Manganese (Mn)
- Vanadium (V)
- Polychlorinated Biphenyls (PCBs)
- PAHs (as benzo(a)pyrene equivalent).
- Zinc (Zn)
- Tin (Sn)
- Molybdenum (Mo)
- Selenium (Se)
- Hexachlorobenzene (HCB)

Appendix B

TOC composition in emissions from an EfW plant [1].

Measurement based on adsorption and condensation. Detection limit 5 µg/Nm³.

Characterisation of Emissions from a Waste Incineration Plant

Total organic carbon (TOC)	1.2 mg/m ³
Identified single components	0.53 mg/m ³
Not identified aliphatic hydrocarbons	56% of TOC

Main Components (µg/m³)

Benzoic Acid	100
Hexadecanoic Acid	37
Ethyl Benzoic Acid	35
Toluene	30
Phthalates	20
Dichloromethane	20
Acetone (propanone)	18
Tetradecanoic Acid	15
Benzene	15
Acetonitrile	14
Xylene	10
Trichlorophenol	9
Methylhexane	6
Trichloroethylene	5
Heptane	5

Note: There is little literature on the above subject. Most dates from mid 1990ies, when new emission regulations were issued in Europe. The concentrations of the organic substances were consistently low and therefore no further research or measurements were performed.

For any other TOC compound a maximum in stack concentration of 5 µg/Nm³ can be assumed. In case of a compound listed as group (e.g. Phthalates) for a conservative approach a maximum concentration for each speciation according to the above value can be chosen.

Literature references

- [1] Ergebnisbericht über Forschung und Entwicklung 1994, Institut für Technische Chemie, Forschungszentrum Karlsruhe, Wissenschaftliche Berichte, FZKA 5531, S. 9
- [2] Stand der Gesamtkohlenstoff-Messung im Abgas von Abfallverbrennungsanlagen, Staub – Reinhaltung der Luft, 49 (1989), S. 221-225
- [3] Emissions from decentralized CHP plants 2007 - ENERGINET.DK
Environmental project No. 07/1882 – National Environmental Research Institute (NERI)
Technical Report no. 786, 2010 (available from <http://www2.dmu.dk/Pub/FR786.pdf>).

Emission Data from plants with C+I / C+D and/or semi dry APC
Publicly available Data

Plant	EEW Hürth-Knapsack		EEW Heringen		EEW Premnitz	EEW Grossräschen		Riverside			TIRME Mallorca				IED		
Country	DE		DE		DE	DE		UK			E						
Waste	C&I, C&D		C&I, C&D, RDF from MSW		C&I, C&D	C&I, C&D		Municipal Solid Waste, C&I			Municipal solid waste, C&I, Hospital waste, sewage sludge, tyres				IED limit value		
unit	Line 1	Line 2	Line 1	Line 2		Line 1	Line 2	Line 1	Line 2	Line 3	Line 1	Line 2	Line 3	Line 4			
Total Dust	mg/m ³	0.01	0.2	0.4	0	0.2	0.2	0.2	0.2	1	1	1	0.3	0	0.4	0.4	10
Total Organic Carbon (TOC)	mg/m ³	0.2	0.1	1	0	0.5	0.8	0.5	0.5	5	5	3	0.05	0.03	0	0	10
Inorganic chlorine compounds (HCl)	mg/m ³	9	9	6	7	6	6.6	3.5	6	3	6	0.5	0.1	0	0.1		10
Inorganic fluorine compounds (HF)	mg/m ³	0	0	-	-	0	-	-									1
Sulphur dioxide (SO ₂)	mg/m ³	2	1	27	11	7.5	18	18	0	0	5	4	2	15	11		50
Oxides of nitrogen (expressed as NO ₂)	mg/m ³	188	188	183	185	180	174	176	175	175	175	55	38	60	68		200
Mercury (Hg)	µg/m ³	4	23	1	0	3	0.3	0.1									50
Carbon monoxide (CO)	mg/m ³	23	23	6	7	12.5	8	8				2.5	5	2.5	2.5		50
Ammonia (NH ₃)	mg/m ³	2	2				0.4	0.9	0	1	2						
Dioxines and furanes	ng/m ³	0.01	0.02	-	-	0.015	-	-	-	-	-	-	-	-	-	-	0.1

all values at standard conditions, 11% O₂ dry

all values (except Hg and dioxines & furanes) as daily average, Hg and dioxines & furanes as spot sampling

all plants except Mallorca with SNCR DeNox, Mallorca with SCR

Sources

EEW Hürth-Knapsack

http://www.chemiepark-knapsack.de/fileadmin/user_upload/EEW_Emissionswerte_2013.pdf

EEW Heringen

<http://www.eew-energyfromwaste.com/de/emissionswerte-heringen.html>

EEW Premnitz

<http://www.eew-energyfromwaste.com/de/standorte/hannover.html#c347b>

EEW Grossräschen

<http://www.eew-energyfromwaste.com/de/standorte/heringen.html#c399b>

Riverside

<http://www.coryenvironmental.co.uk/energy-from-waste/riverside-resource-recovery-facility/>

TIRME Mallorca

http://www.tirme.com/uk/incineration_02f3s25.html

Extended values from plants with semi-dry APC

Detailed emission measurements from HZI plants with semi-dry APC

Metal	Symbol	Unit	Riverside			Newhaven		Cleveland	Evreux	Ingolstadt	Average	EU IED
			Line 1	Line 2	Line 3	Line 1	Line 2	Line 3		see note		
Mercury	Hg	mg/m³	0.0015	0.0004	0.0002	0.004	0.003	0.0017			0.002	< 0.05
Cadmium	Cd	mg/m ³	0.00270	0.00085	0.00111	0.009	0.001	0.004	0.004		0.00324	
Thallium	Tl	mg/m ³	0.00005	0.00003	0.00002	0.000	0.000	0.0009			0.00017	
Sum Cd+Tl	Cd + Tl	mg/m³	0.00275	0.00087	0.00113	0.009	0.001	0.0049			0.003	< 0.05
Arsenic	As	mg/m ³	0.0006	0.0003	0.0004	0.003	0.000	0.0013	0.004		0.0009	
Antimony	Sb	mg/m ³	0.0148	0.0047	0.0047	0.007	0.001	0.0026			0.0058	
Chromium	Cr	mg/m ³	0.0179	0.0115	0.0399	0.014	0.002	0.0467	0.004		0.0220	
Cobalt	Co	mg/m ³	0.0003	0.0002	0.0001	0.003	0.000	0.0006	0.004		0.0007	
Copper	Cu	mg/m ³	0.0085	0.0085	0.0263	0.051	0.001	0.0049			0.0167	
Lead	Pb	mg/m ³	0.0452	0.0137	0.0170	0.172	0.002	0.0094			0.0432	
Manganese	Mn	mg/m ³	0.0084	0.0041	0.0037	0.095	0.005	0.0051			0.0202	
Nickel	Ni	mg/m ³	0.0118	0.0058	0.0041	0.006	0.002	0.0208			0.0084	
Vanadium	V	mg/m ³	0.0003	0.0002	0.0004	0.003	0.000	0.0004			0.0007	
Sum heavy metal	As-V	mg/m³	0.11	0.049	0.097	0.35	0.015	0.092			0.12	< 0.5
Dioxins and Furanes	PCDD/F TEQ (WHO humans/mammal)	ng/m³	0.004	0.004	0.001	0.0015	0.0004				0.0022	
Dioxin-like PCB's	PCB (WHO TEQ humans/mammal)	ng/m³	0.016	0.011	0.014	0.00001	0.00001				0.008	
Hexachlorbenzol	HCB	µg/m ³								< 0.0012	0.001	
Benzo(a)pyren	B(a)P	µg/m ³							0.002	< 0.0013	0.002	
PAH's	PAH (WHO TEQ humans/mammal)	µg/m³				0.4	0.5				0.45	

all concentrations in gas ref. to STP and 11% O₂ dry

note: Ingolstadt has APC with wet scrubber and bag house filter

Appendix C.3

Extract of the revised 2006 (2007 for natural gas fuelled plants) emission factors for Danish decentralised CHP plants < 25MW_e. [3]

Note: For calculation to/from GJ to/from mg/m³ the report uses the flue gas amount of 523 Nm³ (dry, at 11% O₂) per GJ for MSW.

	Unit	Natural gas fuelled engines	Biogas fuelled engines	Natural gas fuelled gas turbines	Gas oil fuelled engines	Gas oil fuelled gas turbines	Fuel oil, steam turbines	Biomass producer gas, engines	MSW incineration	Straw	Wood
SO ₂	g per GJ	-	-	-	-	-	-	-	< 8.3	49	< 1.9
NO _x	g per GJ	135 ⁸⁾	202	48	942	83	136	173	102	125	81
UHC (C)	g per GJ	435 ⁸⁾	333	2.5 ⁹⁾	(46) ¹⁰⁾	-	(1.6) ¹⁰⁾	12	< 0.68	< 0.94 ⁵⁾	< 6.1 ⁶⁾
NMVOG	g per GJ	92 ⁴⁾ 8)	10 ⁴⁾	1.6 ⁴⁾	(37) ¹⁰⁾	-	(0.8) ¹⁰⁾	2.3 ⁴⁾	< 0.56 ⁴⁾	< 0.78 ⁴⁾	< 5.1 ⁴⁾
CH ₄	g per GJ	481 ⁴⁾ 8)	434 ⁴⁾	1.7 ⁴⁾	24	-	< 1.3	13 ⁴⁾	< 0.34 ⁴⁾	< 0.47 ⁴⁾	< 3.1 ⁴⁾
CO	g per GJ	58 ⁸⁾	310	4.8	130	2.6	2.8	586	< 3.9	67	90
N ₂ O	g per GJ	0.58	1.6	1.0	2.1	-	5.0	2.7	1.2	1.1	0.83
NH ₃	g per GJ	-	-	-	-	-	-	-	< 0.29	-	-
TSP	g per GJ	-	-	-	-	-	9.5	-	< 0.29	< 2.3	10
As	mg per GJ	< 0.045	< 0.042	-	< 0.055	-	-	0.116	< 0.59	-	-
Cd	mg per GJ	< 0.003	0.002	-	< 0.011	-	-	< 0.009	< 0.44	< 0.32 ³⁾	0.27
Co	mg per GJ	< 0.20	< 0.21	-	< 0.28	-	-	< 0.22	< 0.56	-	-
Cr	mg per GJ	0.048	0.18	-	0.20	-	-	0.029	< 1.6	-	-
Cu	mg per GJ	0.015	0.31	-	0.30	-	-	< 0.045	< 1.3	-	-
Hg	mg per GJ	< 0.098 ³⁾	< 0.12	-	< 0.11	-	-	0.54	< 1.8	< 0.31 ³⁾	< 0.40 ³⁾
Mn	mg per GJ	< 0.046	0.19	-	0.009	-	-	0.008	< 2.1	-	-
Ni	mg per GJ	0.045	0.23	-	0.013	-	-	0.014	< 2.1	-	-
Pb	mg per GJ	0.043	0.005	-	0.15	-	-	0.022	< 5.5	-	-
Sb	mg per GJ	< 0.049 ³⁾	0.12	-	< 0.055	-	-	< 0.045	< 1.1	-	-
Se	mg per GJ	(0.01) ⁷⁾	< 0.21	-	< 0.22	-	-	< 0.18	< 1.1	-	-
Tl	mg per GJ	< 0.20 ³⁾	< 0.21	-	< 0.22	-	-	< 0.18	< 0.45 ³⁾	-	-
V	mg per GJ	< 0.048	< 0.042	-	0.007	-	-	< 0.045	< 0.33	-	-
Zn	mg per GJ	2.9	4.0	-	58	-	-	0.058	2.3	0.41	2.3
PCDD/-F	ng per GJ	< 0.57	< 0.96 ¹⁾	-	< 0.99	-	-	< 1.7 ¹⁾	< 5.0	< 19	< 14
PBDD/-F	ng per GJ	-	< 5.0 ¹⁾	-	-	-	-	< 7.2 ¹⁾	< 6.3 ¹⁾	-	-
PAH (BaP)	µg per GJ	< 13	< 4.2	-	< 33	-	-	< 4.9	< 2	< 125	< 13
ΣPAH	µg per GJ	< 1025	< 606	-	< 8988	-	-	< 181	< 37	< 5946	< 664
Naphthalene	µg per GJ	2452	4577	-	17642	-	-	8492	< 129 ³⁾	12088	2314
HCB	µg per GJ	-	0.19	-	< 0.22	-	-	0.80	< 4.3	< 0.11	-
PCB	ng per GJ	-	< 0.19 ¹⁾	-	< 0.13 ¹⁾	-	-	< 0.24 ¹⁾	< 0.32	-	-
Formaldehyde	g per GJ	14.1	8.7	-	1.3	-	< 0.002	1.5	-	-	-
HCl	g per GJ	-	-	-	-	-	-	-	< 1.14	56	-
HF	g per GJ	-	-	-	-	-	-	-	< 0.14	-	-

¹⁾ Emission measurements were below detection limits for all congeners.

²⁾ Based on 1 emission measurement. The emission measurement was below the detection limit.

³⁾ All emission measurements were below the detection limit.

⁴⁾ Based on disaggregation of the total unburned hydrocarbon (UHC) emission factor.

⁵⁾ Only 1 out of 7 emission measurement was above the detection limit.

⁶⁾ Two out of three emission measurements were below the detection limit.

⁷⁾ Two emission measurements were performed, both below the detection limit. These results have been ignored and instead the lower emission factor 0.01 mg per GJ based on EEA (2009) have been applied.

⁸⁾ The increased emission level during start up and stop of the gas engines have been included in this emission factor.

⁹⁾ Based on emission measurements performed in 2003-2006.

¹⁰⁾ The emission factor based on emission measurements performed within this project has been ignored. Instead the NMVOC emission factor refers to EEA (2009). The UHC emission factor has been estimated based on the emission factors for NMVOC and CH₄.

MEMO

Job **COPC for HHRA – Cr(VI)**
Client **EfW Facility TNG NSW**
Memo no. **3 – Rev 1**
Date **19/10/2016**
To **To Whom it May Concern**
From **Martin Brunner (Ramboll)**
Copy to **Ian Malouf (DADI)**
Lesley Randall (AECOM)
Amanda Lee (AECOM)
Damon Roddis (Pacific Environment)
Phill Andrew (Savills)
Rachael Snape (Urbis)
Damon Roddis (Pacific Environment)

1. **Background and goal**

Chromium (Cr) is widely used metal and appears in different valences, mostly as trivalent Cr(III) but also as hexavalent Chromium Cr(VI). Cr(VI) is toxic and carcinogenic and therefore of major concern.

In case of emissions from Energy from Waste (EfW) facilities Chromium is considered as part of the sum of heavy metals and measured as total Chromium. In the context of the Human Health Risk Assessment (HHRA) for the TNG facility Ramboll has been requested to give a forecast on the emission of Cr(VI).

2. **Basis of the Cr(VI) forecast**

As mentioned earlier, Chromium emissions are limited as total Chromium and therefore very little data on Cr(VI) emissions are available. Existing data date back to the 1980 and these emissions are not comparable to today's Air Pollution Control (APC) systems.

The forecast for updated Cr(VI) emissions therefore is based on total Cr emission, the APC removal behaviour and recent data of Cr(VI) values in APC residues.

3. **Existing data on Cr(VI) in APC residues**

There is a variety of data on total Chromium in EfW fly ash. The values for total Chromium typically range from 500 to 1000 mg/kg of fly ash.

Few measurements exist on Cr(VI) in fly ash. While many are below the detection limit (< 0.05 mg/kg) some values in the range of 1 - 3 mg/kg are found.

Chromium in the flue gas is predominantly present in form of particulates; the vapour pressure is very low and not relevant for the emission level. As a result it can be expected that the in stack concentrations will have a similar distribution as the fly ash.

Date 19/10/2016

Ramboll
Hardturmstrasse 132
CH-8005 Zürich
Switzerland

T +41 44 500 35 80
F +41 44 500 35 89
www.ramboll.com/energy

4. Data considered for total Cr emissions

The following plants with a flue gas cleaning system identical to TNG were considered

Plant	No of Measurements	Max value mg/Nm ³	Mean value mg/Nm ³
Riverside UK	3	0.040	0.023
Newhaven UK	2	0.014	0.008
Cleveland UK	1	0.047	0.047
Mallorca ES	2	0.002	0.002
Phitiviers FR	1	0.002	0.002
Perpignan FR	1	0.024	0.024
Le Mans FR	3	0.009	0.005
Evreux FR	2	0.007	0.006
Ludwigslust DE	6	0.007	0.004
Zorbau DE	6	0.014	0.011
Total/max/mean	27	0.047	0.010

All values refer to 11% O₂, dry

5. Evaluation of Cr(IV) in APC residues

The Cr(VI) content in APC residues is in the order of 1-3 mg/kg in relation to a total Chromium content of 500-1000 mg/kg. Expressed as fraction this is 0.1 to 0.3% of the total. To allow for uncertainties due to variations a content of 0.5% as average and 1% as worst case is assumed

6. Conclusion

Based on results of 27 emission measurements of existing plants with identical APC equipment a maximum of total Chromium of 0.047 mg/Nm³ and a mean of 0.010 mg/Nm³ (see table above) is reported. This is well in line with a report of the UK EPA (see attachment) which lists a maximum of 0.052 mg/Nm³ and a mean of 0.011 mg/Nm³ as a result of measurements in 10 plants in the UK.

As a worst case scenario during normal operation therefore a Cr(VI) emission of 0.0005 mg/Nm³ (1% of 0.052 mg/Nm³) and an average of 0.00005 mg/Nm³ (0.5% of 0.010 mg/Nm³) can be assumed.

The above results are well in line with a recent publication by the Environment Agency of the UK (see attached) which predicts maximum Cr(VI) levels of 0.00013 mg/Nm³ and a mean value of 0.000035 mg/Nm³.

Releases from municipal waste incinerators

September 2012 version 3

Guidance to applicants on impact assessment for group 3 metals stack

Scope

This paper provides guidance to Applicants on how we will consider air quality impact assessments from Group 3 metals stack emissions from Municipal Waste Incinerators when we determine permit applications in respect of Schedule 1 activities under the Environmental Permitting Regulations 2010 (EPR). Metals assessments from other plant subject to the Waste Incineration Directive may use the method in this guidance if they can justify the data as representative.

Background

In April 2010, the Environment Agency published revised Environmental Assessment Levels (EALs) for arsenic, nickel and chromium(VI) in our H1 Guidance ([H1 Environmental Risks Assessment](#)). The revised EALs are substantially lower than the former EALs:

- Arsenic – 3 ng/m³
- Nickel – 20 ng/m³
- Chromium (VI) – 0.2 ng/m³

The EALs refer to that portion of the metal emissions contained only within the PM10 fraction of particulates in ambient air.

Arsenic, nickel and (total) chromium are three of the nine Group 3 metals whose emissions are subject to a mandatory minimum emission limit by the Waste Incineration Directive (WID). WID sets an aggregate limit of 0.5 mg/m³ for nine “Group 3” metals (Sb, As, Pb, Cr, Co, Cu, Mn, Ni and V and their compounds (total)). Previous air dispersion modelling studies supporting permit applications typically made very conservative assumptions that emissions of each individual metal occurs at the WID aggregate limits. Such an analysis may conclude that there is a risk that the current EALs might be exceeded. Where such a theoretical risk exists, a more detailed assessment is required to determine whether the impact of the release is acceptable.

Detailed Modelling Assessment Methodology

Step 1 - Screening scenario

Predictions made assuming each metal is emitted at 100% of the WID ELV (i.e. 0.5 mg/m³). Where the impact of any metal exceeds the assessment criteria (below), relative to their respective EALs, we consider that there is a potential for significant pollution. Under these circumstances, proceed to Step 2.

Assessment Criteria:

- Long-term Process Contribution (PC) <1% or Short-term Process Contribution (PC) <10%; or
- Long-term and Short-term Predicted Environmental Concentration (PEC) <100% [taking likely modelling uncertainties into account].

[For screening only, assume Cr(VI) comprises 20% of the total background chromium). Selection of all other background data should be justified.]

Step 2

Worst case scenario based on currently operating plant – make predictions based on assuming each metal comprises 11% of the total group (i.e. 0.5 mg/m³ apportioned across the nine metals). Our emissions monitoring data indicates that it is reasonable to assume that each Group 3 metal comprises no more than 11% of the Group ELV.

Where the impact of any metal is above the assessment criteria given in Step 1 above proceed to Step 3.

Step 3 - Case specific scenario

We will require Applicants to justify their use of percentages lower than 11% of the Group 3 WID ELV or Cr(VI) background levels of <20% for their Step 3 assessment. Assessments should be made using the criteria below Step 1. We will review any use of Applicants' data to identify whether they can achieve the levels proposed and whether that data can be justified as representative.

Appendix A of this guidance contains summary of measured metals stack releases from a range of operating Municipal Waste Incinerators between 2007 and 2009, presented as a range and a mean of actual release and percentage of the WID ELV. The data in Appendix A should be considered as indicative only. Note that although the maximum Nickel concentration is greater than 11%, this represents one single measurement outlier; the mean value is around 4% of the Group ELV.

Appendix B contains data showing the effective Cr(VI) concentration from a range of Municipal Waste Incinerators. Measurement of Cr(VI) at the levels anticipated at the stack emission points is expected to be difficult, with the likely levels being below the level of detection by the most advanced methods. The concentrations presented in the table are based on stack measurements for total chromium and measurements of the proportion of Cr(VI) to total chromium in APC residues collected at the same plant. We have considered the concentration of total chromium and Cr(VI) in the Air Pollution Control (APC) residues collected upstream of the emission point for existing Municipal Waste Incinerators (MWI) and have assumed these to be similar to the particulate matter released from the emission point.

Appendix A – Monitoring Data from Municipal Waste Incinerators

	Measured Concentrations mg/m ³			Percentage of WID Group 3		
	Mean	Max	Min	Mean	Max	Min
Antimony	0.0033	0.0115	0.0001	0.7%	2.3%	0.02%
Arsenic	0.0007	0.0030	0.0003	0.14%	0.6%	0.06%
Chromium	0.0109	0.0521	0.0004	2.2%	10.4%	0.08%
Cobalt	0.0004	0.0039	0.0002	0.07%	0.8%	0.04%
Copper	0.0077	0.0163	0.0025	1.5%	3.3%	0.50%
Lead	0.0158	0.0368	0.0003	3.2%	7.4%	0.06%
Manganese	0.0172	0.0365	0.0015	3.4%	7.3%	0.30%
Nickel	0.0220	0.1362	0.0000	4.4%	27.2%	0.00%
Tin		0.0024	0.0024		0.48%	0.48%
Vanadium	0.0003	0.0010	0.0002	0.06%	0.20%	0.04%

Values correspond to the distribution from 19 measurements at 13 plant between 2007 and 2009. The data differs slightly from previous guidance notes.

* Minimum values correspond in some cases to the detection limit

Appendix B – Chromium VI analysis from APC Residues

	Effective Cr(VI) emission concentration ^a (mg/Nm ³)
Mean	3.5*10 ⁻⁵
Minimum	2.3*10 ⁻⁶
Maximum	1.3*10 ⁻⁴

These data are taken from ten MWI plant in England and Wales. We are in the process of gathering more data in order to fully understand the implications of metals emissions.

^a Note the maximum total chromium concentration does not coincide with the plant where the maximum chromium VI fraction in the APC residue was observed.

MEMO

Job **COPC for HHRA - VOC**
Client **EfW Facility TNG NSW**
Memo no. **4**
Date **2016-10-20**
To **To Whom it may concern**
From **Ahmet Erol (Ramboll)**
Copy to **Ian Malouf (DADI)**
Phill Andrew (Savills)
Amanda Lee (AECOM)
Lesley Randall (AECOM)
Rachael Snape (Urbis)
Damon Roddis (Pacific Environment)

VOC for HHRA/ Air quality Assessment

Background

In Ramboll Memo 2 COPC for HHRA, dated 20.09.2015 the COPC for AQA and HHRA have been listed. The selected COPC were based on the primary emissions from any Energy-from-Waste (EfW) facility, as defined by emission limits for waste incineration set by the European Union (EU) Industrial Emissions Directive (IED; Directive 2010/75/EU). It has been questioned if this list is covering all necessary compounds.

Further input to the selection of COPC

The study "Site specific risk assessment of an energy-from-waste thermal treatment facility in Durham Region, Ontario, Canada. Part A: Human health risk assessment"¹ (following referred to as "the study") has considered a wide range of COPC. This study is one of the most comprehensive investigations on the relevance of emissions from EfW facilities currently available.

The study categorizes the COPC's in five groups:

1. Metals
2. Chlorinated Polycyclic Aromatics
3. Chlorinated Monocyclic Aromatics
4. Poly Aromatic Hydrocarbons (PAH)
5. Volatile Organic Chemicals (VOC)

Methodology

COPC listed in the study and not selected so far for the TNG project were extracted. Then they were evaluated if the study found that they contribute to more than 1% of the background concentration.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-022-VOC for
HHRA.docx
Ver. 2

¹ Site specific risk assessment of an energy-from-waste thermal treatment facility in Durham Region, Ontario, Canada. Part A: Human health risk assessment, dated 4th of July 2013 (attached)

Evaluation

Below the COPC are listed according to the categories of the study and evaluated if they are already part of the AQA/HHRA. If they have not been selected so far then to what extent they contribute to an increase of the ground level concentration compared to the baseline.

1. Metals

The metals listed in the study are already included in the AQA. Therefore no further assessment is needed.

2. Chlorinated Polycyclic Aromatics

Chlorinated Polycyclic Aromatics listed in the study are already included in the AQA. Therefore no further assessment is needed.

3. Chlorinated Monocyclic Aromatics (CMA)

The table below shows all COPC categorized under CMA in the study and the evaluation if they have already been included in the AQA.

	Listed in the study	TNG Air quality Assessment Memo 2, Appendix A
1,2-Dichlorobenzene	x	not included
1,2,4,5-Tetrachlorobenzene	x	not included
1,2,4 – Trichlorobenzene	x	not included
Pentachlorophenol	x	not included
Hexachlorobenzene	x	x
Pentachlorobenzene	x	not included
2,3,4,6-Tetrachlorophenol	x	not included
2,4,6-Trichlorophenol	x	not included
2,4-Dichlorophenol	x	not included

Only hexachlorobenzene has been considered for the AQA so far. The assessment concerning impact of the EfW facility on the ground level concentration found in the study is shown below.

The concentration ratio values are listed below (see study table 5)

Chlorinated Monocyclic Aromatics	Baseline	Project Alone	Effect level
1-hour	0.0006	7.5E-05	12,5%
24-hour	0.0001	5.2E-07	0,5%
Annual	0.002	3.0E-06	0,15%

Only the 1-hour value is higher than 1%. All other values are below 1%.

Conclusion

Hexachlorobenzene is the most relevant CMA compound present in the emissions from EfW plants. The concentrations measured during normal operation are in the range of below 1 up to max. 10 ng/Nm³.

The other CMA are mostly expressed as the sum of compounds with identical number of chlorine atoms (dichlorobenzene, trichlorobenzene, dichlorophenol, etc.). The measured values for such a group are in the range of below 1 up to max. 10 ng/Nm³. For any assessment a concentration of max. 10 ng/Nm³ per group during normal operation and 100 ng/Nm³ (ten-fold value) during upset operation can be assumed.

4. Poly Aromatic Hydrocarbons

Poly Aromatic Hydrocarbons (PAH) listed in the study have been included in the AQA. No further assessment is needed.

5. Volatile Organic Chemicals (VOC)

The table below shows all COPC categorized under Volatile Organic Chemicals (VOC) in the study and the evaluation if they have already been included in the AQA.

	Listed in the study	TNG Air quality Assessment Memo 2, Appendix A
Acetaldehyde	x	not included
Benzene	x	x (Appendix B)
Biphenyl	x	not included
Bromodichloromethane	x	not included
Bromomethane	x	not included
Dichlorodifluoromethane	x	not included
Dichloroethene	x	not included
1,1 - Ethylbenzene	x	not included
Ethylene Dibromide (1,2-dibromoethane)	x	not included
Formaldehyde	x	not included
Tetrachloroethylene	x	not included
Toluene	x	x (Appendix B)
Trichloroethylene	x	x (Appendix B)
1,1,2, Vinyl chloride (chloroethene)	x	not included
Xylenes	x	x (Appendix B)
m-, p- and o-Bromoform (tribromomethane)	x	not included
Carbon tetrachloride	x	not included
Chloroform	x	not included
Dichloromethane	x	x (Appendix B)
O-terphenyl	x	not included
Trichloroethane	x	not included
1,1,1 -, Trichlorofluoromethane	x	not included

The concentration ration values are listed below (see assessment EfW facility table 5)

Volatle Organic Chemicals (VOC)	Baseline	Project Alone	Effect level
1-hour	0.55	0.005	0,9%
24-hour	0.41	0.002	0,5%
Annual	0.18	0.0002	0,1%

All effect levels are below 1%. No further assessment for VOC is needed.

Summary and conclusion

Except for chlorinated monocyclic aromatics all compounds evaluated in the study "Site specific risk assessment of an energy-from-waste thermal treatment facility in Durham Region, Ontario, Canada. Part A: Human health risk assessment" are either already included in the AQA or their effect level found in the study is below 1% under all conditions.

For the chlorinated monocyclic aromatics hexachlorobenzene (HCB) - the most relevant compound - is already included in the AQA. Measured values of HCB in EfW plants range from 1-10 ng/Nm³. For any other group of compound (as sum of compounds with identical number of chlorine atoms) a concentration of 10 ng/Nm³ during normal operation and 100 ng/Nm³ (tenfold value) during upset operation can be assumed.



Site specific risk assessment of an energy-from-waste thermal treatment facility in Durham Region, Ontario, Canada. Part A: Human health risk assessment

Christopher A. Ollson^{a,*}, Loren D. Knopper^a, Melissa L. Whitfield Aslund^a, Ruwan Jayasinghe^b

^a *Intrinsic Environmental Sciences, 6605 Hurontario Street, Mississauga, ON L5T 0A3, Canada*

^b *Stantec, 675 Cochrane Dr, Markham, ON L3R 0B8, Canada*

HIGHLIGHTS

- Human health risk assessment was performed for an Energy-From-Waste facility
- Results suggest minimal risks to humans expected at approved operating capacity
- Future expansion may cause slightly elevated risks under upset conditions
- Further risk assessment required if/when future expansion is pursued

ARTICLE INFO

Article history:

Received 27 May 2013

Received in revised form 3 July 2013

Accepted 4 July 2013

Available online 2 August 2013

Editor: D. Barcelo

Keywords:

Environmental assessment

Waste management

Incineration

Persistence

Human health risk assessment protocol

Thermal mass burn technology

ABSTRACT

The regions of Durham and York in Ontario, Canada have partnered to construct an energy-from-waste thermal treatment facility as part of a long term strategy for the management of their municipal solid waste. This paper presents the results of a comprehensive human health risk assessment for this facility. This assessment was based on extensive sampling of baseline environmental conditions (e.g., collection and analysis of air, soil, water, and biota samples) as well as detailed site specific modeling to predict facility-related emissions of 87 identified contaminants of potential concern. Emissions were estimated for both the approved initial operating design capacity of the facility (140,000 tonnes per year) and for the maximum design capacity (400,000 tonnes per year). For the 140,000 tonnes per year scenario, this assessment indicated that facility-related emissions are unlikely to cause adverse health risks to local residents, farmers, or other receptors (e.g., recreational users). For the 400,000 tonnes per year scenarios, slightly elevated risks were noted with respect to inhalation (hydrogen chloride) and infant consumption of breast milk (dioxins and furans), but only during predicted 'upset conditions' (i.e. facility start-up, shutdown, and loss of air pollution control) that represent unusual and/or transient occurrences. However, current provincial regulations require that additional environmental screening would be mandatory prior to expansion of the facility beyond the initial approved capacity (140,000 tonnes per year). Therefore, the potential risks due to upset conditions for the 400,000 tonnes per year scenario should be more closely investigated if future expansion is pursued.

© 2013 The Authors. Published by Elsevier B.V. Open access under [CC BY-NC-ND license](https://creativecommons.org/licenses/by-nc-nd/4.0/).

1. Introduction

The Regions of Durham and York in Ontario, Canada partnered in 2005 to seek a long-term sustainable solution for managing their municipal solid waste. Both Regions have made considerable commitments to decreasing waste production and increasing waste diversion (e.g. through recycling or composting initiatives), but a management strategy is still required for residual waste not diverted through these strategies. Previously, this residual waste was largely exported out of the Regions (primarily to Michigan) for landfill. However, when it was announced that the Michigan border would be closed to municipal waste from Canada as of December 2010, it became imperative to identify a viable waste management alternative.

Abbreviations: CAC, Criteria air contaminant; COPC, Contaminant of potential concern; CR, Concentration ratio; CSF, Cancer slope factor; EA, Environmental assessment; EFW, Energy-from-waste; ERA, Environmental risk assessment; HHRA, Human health risk assessment; HQ, Hazard quotient; ILCR, Incremental lifetime cancer risk; LADD, Lifetime average daily dose; LCR, Lifetime cancer risk; LRASA, Local risk assessment study area; MDL, Method detection limit; RfC, Reference concentration; RfD, Reference dose; TEF, Toxic equivalency factor; TRV, Toxicity reference value; UR, Unit risk.

* Corresponding author at: Intrinsic Environmental Sciences Inc., 6605 Hurontario Street, Suite 500, Mississauga, ON L5T 0A3, Canada. Tel.: +1 905 364 7800x232, +1 416 456 1388 (mobile).

E-mail address: collson@intrinsic.com (C.A. Ollson).

Due to public opposition, establishment of a new local landfill was considered unacceptable. In addition, it was recognized that continuing to ship the waste to an external landfill could not provide a stable and secure alternative due to the vulnerability of this option to public policy decisions made by external governments. Therefore, processing and treatment options such as mechanical, biological, and thermal treatment were considered. Through an extensive public consultation process as well as a detailed evaluation of environmental, social and economic considerations, the preferred option was determined to be the construction of an Energy-From-Waste (EFW) thermal treatment plant. Such facilities have the capacity to reduce the volume of waste by >90% while also recovering metals and producing energy that can be sold to offset annual operating costs (Rushton, 2003).

EFW facilities are widespread in Europe and other jurisdictions (Bogner et al., 2008). Research and monitoring programs around these facilities suggest that in light of strict emissions guidelines and modern engineering controls, these facilities are unlikely to be hazardous to human health or the environment (Bordonaba et al., 2011; Cangialosi et al., 2008; Lee et al., 2007; Morselli et al., 2011; Rovira et al., 2010; Schuhmacher and Domingo, 2006). However, a new EFW facility had not been built in Ontario for over 20 years. As part of the approval process for construction of this new facility in Ontario, extensive human health and ecological risk assessments were performed to determine the potential effects of this project on surrounding communities and ecosystems. This paper describes the methods and results of human health risk assessment; the methods and results of the ecological risk assessment are provided in a separate publication (Ollson et al., 2014). These risk assessments formed an important component of the final Environmental Assessment for this project, which was submitted to the Ontario Ministry of the Environment (MOE) in 2009 and received final approval in 2010. On the basis of this approval, the project was permitted to proceed to the construction phase, which was initiated in 2011. Facility start-up is currently projected to occur by the end of 2014.

2. Material and methods

2.1. Scope of the assessment

This risk assessment examined the potential for emissions from the proposed project (i.e., construction, operation, and eventual decommissioning of a modern EFW thermal treatment facility) to pose an unacceptable risk to human health over both short-term and long-term (i.e., after 30 years of operation). Existing conditions at the proposed location for the facility were also assessed in order to provide a baseline for the assessment (Table 1). The entire assessment was carried out following the US EPA human health risk assessment protocol for hazardous waste combustion facilities (US EPA, 2005).

The initial operating design capacity of the proposed facility was 140,000 tonnes per year, with a capacity for expansion to 400,000 tonnes per year within the 30-year planning period. As the expansion

of the facility beyond the initial approved capacity of 140,000 tonnes per year would require additional environmental screening under provincial regulations, the present risk assessment focused primarily on the potential risks from the facility with respect to operation at the 140,000 tonnes per year level. However, for comparison purposes, consideration was also given to the potential risks associated with the maximum design capacity of 400,000 tonnes per year.

2.2. Facility description

Facility design information for this assessment was provided by Covanta Energy Corporation, which was selected by the Regions as the preferred vendor for this project. Covanta, the largest provider of thermal treatment services in North America (with 40 facilities in the United States and one in Canada), was contracted by the Regions to direct the design, engineering, construction and operation of the facility. Therefore, they were able to provide detailed information, specific to the planned facility, which also reflects the features and functionality of existing modern EFW facilities elsewhere in North America.

This facility will be accepting municipal solid waste from typical Ontario curbside waste collection (i.e. household waste excluding separated recyclable materials and organics). No additional feed stock separation will occur at the facility. The facility will use a thermal mass burn technology, wherein municipal solid waste is fed into a furnace and burned at very high temperatures. For the initial operating design capacity of 140,000 tonnes per year, there will be two independent waste processing trains consisting of a feed chute, stoker, integrated furnace/boiler, dry recirculation acid gas scrubber, a fabric filter bag house and associated ash and residue collection systems. Expansion to the maximum design capacity (400,000 tonnes per year) would include the addition of two more waste processing trains. Steam produced in each boiler will drive a turbine-generator to produce electricity for delivery to the grid, for in-plant use and/or district heating. After the removal of residual metals for recycling, ash produced by the process will be shipped to landfill for use as daily cover or will be reused, possibly as road construction material or other civil projects. Air pollution control equipment throughout the facility will ensure that emissions do not exceed the provincial guidelines outlined by the Ontario Ministry of the Environment (MOE, 2004a) and specific conditions of Certificate of Approval 7306-8FDKNX issued June 28, 2011 for the Facility.

2.3. Identification of chemicals of potential concern (COPC)

Chemicals that could potentially be released by the facility to the atmosphere were identified by reviewing sources such as existing provincial guidelines for municipal incinerators (MOE, 2004a), the Canadian National Pollutant Release Inventory for waste incinerators (Environment Canada, 2007), and the results of stack testing of an existing waste incinerator in nearby Brampton, Ontario. From this review, a COPC list consisting of 87 chemicals was developed (Table 2) that consisted of both Criteria Air Contaminants (CACs,

Table 1
Project scenarios considered in the human health risk assessment.

Project Scenarios	Case	Conditions assessed
Existing Conditions	Baseline	Existing conditions in the assessment area. No Facility-related emissions or exposures were included as this was completed prior to construction and operation of the Facility.
Construction Operation	Baseline Traffic	Offsite vehicle traffic emissions prior to the start-up of the Facility.
	Construction	Construction and commissioning of the Facility.
	Project Alone	Emissions from the Facility alone.
	Project (Baseline + Project)	Emissions from the Facility combined with existing/baseline conditions.
Process Upset	Process Upset	Emissions from the Facility operating at upset conditions (i.e., Facility start-up, shutdown, and loss of air pollution control).
	Process Upset Project (Baseline + Upset)	Emissions from the Facility operating at upset conditions combined with existing/baseline conditions.
Decommissioning	Traffic	Emissions from offsite and onsite traffic associated with the Facility combined with baseline traffic conditions and onsite stationary source emissions for the Facility.
	Decommissioning (Closure Period)	Emissions related to the removal of infrastructure and rehabilitation of the Site.

for which regulatory limits already exist) and non-CACs (substances that are capable of causing environmental or health effects for which no regulatory limits were identified).

All COPC were evaluated for their potential to pose a risk to human health via inhalation as this was expected to be the primary route of human exposure to facility-related air emissions (Table 2). In addition, COPC that were considered to be persistent and/or bioaccumulative (i.e., half-life in soil ≥ 6 months and/or $\text{Log } K_{ow} \geq 5$) were also included in a multi-pathway risk assessment that addressed the possibility that these compounds may persist in and/or be transferred to various environmental media (e.g., soil, water, and food) following their release to air (Table 2).

2.4. Study area

The selected location for the facility is located within the Municipality of Clarington, Ontario, Canada (approximately 80 km east of Toronto, Ontario). This location is bordered by Lake Ontario to the south, commercial properties to the north and agricultural lands to the east and west. The Darlington Nuclear Generating Station is located approximated 2 km to the east.

In order to define the study area, the CALPUFF dispersion model (Scire et al., 1995) was applied to predict ground level concentrations of COPC as well as wet and dry deposition fluxes over a 40×40 km grid around the proposed facility location. The inputs to this model included geophysical (terrain and land use) and meteorological data specific to the region (Environment Canada, 2008; USGS, 2007; UCAR, 2008) as well as COPC physical-chemical properties. Stack parameters (i.e., location, base elevation, stack height, stack diameter, gas exit velocity, gas exit temperature, and emission rates) were provided by the vendor with respect to the planned facility. Potential stack emissions of COPC were estimated based on manufacturer's guarantees of maximum emissions, emission levels measured by the preferred vendor at one or more of their existing facilities that utilise similar technologies (measured at maximum load), and literature sources for other facilities.

Results of the CALPUFF model showed that the highest concentrations of emissions and depositions would be located in the area immediately surrounding the facility with a radius of approximately 10 km. Therefore, this area was defined as the Local Risk Assessment Study Area (LRASA) for consideration in this risk assessment. This LRASA includes the urban centers of Oshawa, Courtice, Bowmanville, and Port Darlington, Ontario.

2.5. Receptor identification and exposure pathways

Residential land use in the LRASA is mainly suburban residential and rural residential. The rural residential areas include large, dispersed lots that may be used for agricultural purposes (e.g., cash crops or livestock). Within the larger urban centers there are numerous commercial and institutional developments. Recreational opportunities in the area include hiking, camping, equestrian activities, hunting, fishing and swimming.

In light of these identified land uses, the human receptors considered in this risk assessment included local residents, local farmers, daycare/school attendees, and recreational users (sport and/or camping) (Table 3). Potential exposure pathways determined for each receptor included inhalation of vapours and particulate emissions, ingestion and dermal exposure to soil and/or dust, and food chain exposures (Table 3). It was also assumed that some receptors may incur additional exposures to COPC via hunting, fishing, or swimming within the LRASA. Therefore, additional exposures related to these activities that can be added to any of the identified receptors were also assessed (Table 3). Consumption of local drinking water was not considered since it was found that residents in the LRASA obtain their drinking water from municipal water supply services, which would not be affected by facility-related emissions. Similarly, consumption of grocery store bought foods was not considered.

The life stages considered for each receptor and for the hunting/angling and swimming additional exposures were selected to represent those with the greatest sensitivity and/or exposure to each COPC. For non-carcinogenic COPC, which act via a threshold mechanism, the

Table 2
Contaminants of potential concern (COPC) considered in this assessment.

COPC	Inhalation	Multi-Pathway
Criteria Air Contaminants:		
Sulfur Dioxide (SO ₂), Hydrogen Chloride (HCl), Hydrogen Fluoride (HF), Nitrogen Dioxide (NO ₂), Particulate Matter (PM ₁₀), Particulate Matter (PM _{2.5}), Total Particulate Matter (TSP), Ammonia (Slip at Stack)	✓	
Chlorinated Polycyclic Aromatics:		
Dioxins and Furans as Toxic Equivalents (TEQ), Total PCBs (as Aroclor 1254)	✓	✓
Metals:		
Antimony, Arsenic ^b , Barium, Beryllium ^b , Boron, Cadmium ^b , Chromium (hexavalent) ^b , Total Chromium (and compounds) ^b , Cobalt, Lead, Mercury ^a , Nickel, Phosphorus, Silver, Selenium, Thallium, Tin, Vanadium, Zinc	✓	✓
Chlorinated Monocyclic Aromatics:		
1,2-Dichlorobenzene, 1,2,4,5-Tetrachlorobenzene, 1,2,4 - Trichlorobenzene, Pentachlorophenol ^b , Hexachlorobenzene ^b , Pentachlorobenzene	✓	✓
2,3,4,6-Tetrachlorophenol, 2,4,6-Trichlorophenol ^b , 2,4-Dichlorophenol	✓	
Poly Aromatic Hydrocarbons:		
Acenaphthylene ^b , Acenaphthene ^b , Anthracene, Benzo(a)anthracene ^b , Benzo(b)fluoranthene ^b , Benzo(k)fluoranthene ^b , Benzo(a)fluorene, Benzo(b)fluorene, Benzo(ghi)perylene ^b , Benzo(a)pyrene TEQ ^b , Benzo(e)pyrene ^b , Chrysene ^b , Dibenzo(a,c)anthracene ^b , Dibenzo(a,h)anthracene ^b , Fluoranthene ^b , Fluorene, Indeno(1,2,3 - cd)pyrene ^b , Perylene ^b , Phenanthrene ^b , Pyrene ^b	✓	✓
1 - methylnaphthalene, 2 - methylnaphthalene, Naphthalene	✓	
Volatile Organic Chemicals (VOC):		
Acetaldehyde ^b , Benzene ^b , Biphenyl, Bromodichloromethane, Bromomethane, Dichlorodifluoromethane, Dichloroethene, 1,1 - , Ethylbenzene, Ethylene Dibromide (1,2-dibromoethane) ^b , Formaldehyde ^b , Tetrachloroethylene ^b , Toluene, Trichloroethylene, 1,1,2 ^b , Vinyl chloride (chloroethene) ^b , Xylenes, m-, p- and o-	✓	
Bromoform (tribromomethane), Carbon tetrachloride ^b , Chloroform ^b , Dichloromethane ^b , O-terphenyl, Trichloroethane, 1,1,1 - , Trichlorofluoromethane	✓	✓

^a Inorganic and methylmercury.

^b This chemical was evaluated as a non-carcinogen and a carcinogen.

Table 3
Exposure pathways and life stages evaluated for identified receptor types.

	Receptor Type					Additional Exposures ^a	
	Resident	Farmer	Recreation User – Sport	Recreation User - Camping	Daycare	Swimming	Hunting/Angling
<i>Exposure Pathway</i>							
Direct Inhalation	✓	✓	✓	✓	✓		
Soil Ingestion	✓	✓	✓	✓	✓		
Dermal Contact – Soil	✓	✓	✓	✓	✓		
Dermal Contact – Water						✓	
Incidental Surface Water Ingestion						✓	
Garden Produce	✓	✓					
Fish							✓
Breast Milk	✓	✓					
Wild Game							✓
Agriculture		✓					
<i>Life stage considered for threshold (non-carcinogenic) COPC</i>							
Infant (0 to 6 mo)	✓	✓					
Toddler (7 mo to 4 yr)	✓	✓	✓	✓	✓	✓	✓
<i>Life stage considered for non-threshold (carcinogenic) COPC</i>							
Adult (20 to 75 yr)					✓		
Composite	✓	✓	✓	✓		✓	✓

^a Exposures through these pathways can be added to identified receptors.

toddler life stage (i.e., 6 months to 4 years) was considered to represent the most sensitive life stage based on receptor characteristics (e.g., lower body weights) combined with behavioural patterns (e.g., higher soil ingestion rates). Therefore, all health risks associated with exposures to non-carcinogenic COPC were estimated for the toddler receptor (Table 3). In addition, the infant life stage (i.e., 0 to 6 months) was evaluated for farmer and resident receptors in the multi-pathway risk assessment for non-carcinogenic COPC in order to address the potential health risks associated with consumption of breast milk (Table 3). For carcinogenic COPC (non-threshold), a composite life stage for most receptors was considered that combines the characteristics of infant (i.e., 0 to 6 months), toddler (i.e., 7 months to 4 years), child (i.e., 5 years to 11 years), adolescent (i.e., 12 to 19 years), and adult (i.e., 20 years to 75 years) life stages (Health Canada, 2007) (Table 3). However, for the daycare/school receptor, exposure to carcinogenic COPC was assessed only for the adult stage (Table 3) since this class of receptor has the potential to have the longest duration of exposure to the daycare/school conditions (assuming employment from youth to retirement at that location).

2.6. Collection of baseline data

In order to characterize pre-project baseline conditions, ambient air monitoring and soil, water, and biota sampling was performed in the vicinity of the proposed facility location. All laboratory analyses of the collected samples were conducted by ALS Laboratory Group using standard methods (See Supporting Information Section S1).

2.6.1. Baseline ambient air monitoring

An air monitoring station was set up approximately 2 km southwest of the proposed facility location. Data was collected and analyzed over a 15 month period (September 2007 to December 2008). The station continuously monitored Sulfur Dioxide (SO₂), Nitrogen Oxides (NO_x), Carbon Monoxide (CO), Ozone (O₃), and Particulate Matter smaller than 2.5 microns (PM_{2.5}). Hi-volume air samplers were also installed to collect 24-hour average samples of Total Suspended Particulate (TSP) and metals, Polycyclic Aromatic Hydrocarbons (PAHs), and Dioxins and Furans (PCDD/F).

In addition, baseline offsite vehicle emissions prior to the start up of the facility were estimated using traffic volume estimates provided by URS Canada Inc. These traffic estimates were combined with the existing baseline ambient air conditions in the airshed to produce the baseline traffic case.

2.6.2. Baseline soil and biota sampling

Additional baseline soil and biota samples were collected and analyzed for the COPC identified for consideration in the multi-pathway risk assessment. The sampling program included collection of soil, terrestrial vegetation (forage, browse, and crops), small mammals, surface water, sediment and fish sampled within a 1 km radius of the proposed facility location. Where possible, samples were collected in areas where air modeling predicted maximum rates of deposition for various COPC, and locations were also selected to be representative of different land uses. In addition, agricultural products (beef, chicken, pork, dairy and eggs) and produce were collected from farms and markets located outside a 1 km radius due to limited availability. However, efforts were made to ensure that farms were located as close as possible to the proposed facility location, and therefore the collected samples are considered sufficient to represent baseline conditions for this assessment.

2.7. Fate and transport modeling of COPC from project-related emissions

The potential impacts of facility-related emissions on the concentrations of COPC in the surrounding environment were predicted using best available data (i.e., results of the CALPUFF modeling described in Section 2.4, physical-chemical properties of the COPC, and detailed geophysical and meteorological data specific to the LRASA) and accepted modeling techniques as described in the US EPA human health risk assessment protocol for hazardous waste combustion facilities (US EPA, 2005). Specifically, the contributions of facility-related emissions to ambient air concentrations were predicted for all COPC at 309 distinct receptor locations selected to represent a variety of land uses as well as areas where initial modeling suggested the highest acute (1-hr or 24-hr) or chronic (annual) ground level concentrations were likely to occur. Additionally, for the persistent and/or bioaccumulative COPC considered in the multi-pathway risk assessment (Table 2), facility-related changes in COPC concentrations in soil, surface water, garden and farm produce and fruit, agricultural products (i.e., beef, chicken, pork, dairy and eggs), wild game, fish, and breast milk were predicted at 133 of the 309 locations.

In addition to predictions made for emissions from the normal operating scenarios at both 140,000 and 400,000 tonnes per year, the potential emissions under 'process upset' conditions (i.e., facility start-up, shutdown, and loss of air pollution control) were modeled following protocol suggested by the US EPA (2005). Specifically, for determining short-term (1-hour to 24-hour average) ground level COPC concentrations under upset conditions, the emission rates for

the facility under normal operation were conservatively increased by a factor of ten. This factor was applied to all COPC except for SO₂ and NO_x for which emissions were increased by factors of 16 and 1.63 respectively, based on data received from the vendor. As per US EPA (2005) guidance, for metals and CACs it was assumed that the facility would operate under upset conditions for 5% of the year. Therefore, emission rates for these COPC were increased by a factor of 1.45 [(0.95 × 1) + (0.05 × 10) = 1.45], with the exception of SO₂ and NO_x, for which emission rates were increased by factors of 1.75 and 1.03, respectively using the same assumptions. For the remaining COPC (organics), annual average concentrations for the process upset case were increased by a factor of 2.8 based on an assumption that the facility would operate under upset conditions for 20% of the year [(0.80 × 1) + (0.20 × 10) = 2.8] (also as suggested by US EPA, 2005). This upset case is considered an absolute extreme scenario, given that the Ministry of the Environment would not allow the facility to operate in upset conditions for 20% of the year.

2.8. Exposure assessment

The sources of chemical concentrations used in the exposure assessment are described in Sections 2.5 and 2.6. In order to ensure a conservative estimate of risk, all exposure assessments were conducted deterministically using exposure point concentrations representative of reasonable maximum exposure. For the baseline values (described in Section 2.6), a single baseline exposure point concentration (i.e., the maximum detected concentration, 95% upper confidence limit of the mean, or method detection limit as described in Supporting Information, Section S2) was used to model exposure for each environmental medium collected for all receptor types. Although individual baseline concentrations were not obtained at the location of each receptor group evaluated, the baseline exposure point concentrations used are considered representative of reasonable maximum exposure, to all receptors, from background concentrations. A different approach was applied for the modeled facility-related contributions of COPC to the environment. In this case, the receptor locations were grouped by similar land use and the maximum or 95% upper confidence limit of the mean (selected as described in Supporting Information, Section S2) of the air and/or deposition concentration of each COPC within each receptor grouping was used to calculate the level of exposure for the entire grouping.

Physiological and behavioural characteristics of the receptors (e.g., respiration rate, soils/dusts intake, time spent at various activities and in different areas) were selected, if available, from existing guidance documents (Health Canada, 1994, 2007; MOE, 2005; Richardson, 1997; US EPA, 1997, 2005). In addition, oral and dermal bioavailability factors were compiled from Health Canada (2007) or the US Department of Energy's Oak Ridge National Laboratory Risk Assessment Information System (RAIS) database (ORNL, 2008). Whenever possible, preference was given to Canadian guidance documents and literature (e.g. Health Canada, 2007; Richardson, 1997). More details regarding the specific assumptions, input parameters and calculations used for each exposure pathway and receptor are provided in the Supporting Information (Section S3).

Exposure estimation was facilitated through the use of an integrated multi-pathway environmental risk assessment model developed by the Study Team. The model is spreadsheet based (Microsoft Excel™) and incorporates the techniques and procedures for exposure modeling developed by the MOE and Health Canada, and the US EPA (Health Canada, 1994; 2007; MOE, 2005; Richardson, 1997; US EPA, 1997, 2005).

2.9. Hazard assessment

2.9.1. Identification of toxicity reference values (TRVs)

For chemicals that follow a threshold dose-response (i.e., non-carcinogens), a threshold level must be exceeded in order for toxicity to occur, and it is possible to derive a reference concentration (RfC, for

inhalation receptors) or reference dose (RfD, for multi-pathway receptors) that is expected to be safe to sensitive subjects following exposure for a prescribed period of time (US EPA, 1989). For chemicals that follow non-threshold dose-responses (i.e., carcinogens), a specific dose where toxic effects manifest themselves cannot be identified as any level of long-term exposure to carcinogenic chemicals is associated with some hypothetical cancer risk. As a result, risk assessment of these types of chemicals typically considers evaluation of the incremental lifetime cancer risk (ILCR) associated with exposure to the chemical (US EPA, 1989). This may be estimated based on the unit risk (UR) or cancer slope factor (CSF) of the chemical, where UR represents the upper-bound excess lifetime cancer risk estimated to result from continuous exposure to an agent at a concentration of 1 µg/L in water, or 1 µg/m³ in air and CSF provides an upper bound estimate of the increased cancer risk from lifetime exposure to an agent (US EPA, 1989).

Literature and public guidance documents were reviewed to identify RfCs, RfDs, URs or CSFs for inclusion as toxicity reference values (TRVs) for each COPC. Regulatory benchmarks, which are also health-based but often also policy derived, were also considered as TRVs for some COPC. A summary of the non-carcinogenic and carcinogenic TRVs used in both the inhalation and multi-pathway exposure assessment are presented in Supporting Information (Section S4).

2.9.2. Chemical mixtures and additivity of risks

In order to properly assess health risks to the human receptors, certain groups of chemicals were assessed as mixtures. Specifically, dioxin and furan congeners and carcinogenic PAHs were assessed using the toxic equivalency factor (TEF) approach (Supporting Information, Section S5). TEFs for dioxin and furan congeners represent their potency relative to 2,3,7,8 TCDD (Van den Berg et al., 2006), while TEFs for carcinogenic PAHs represent their toxicity relative to benzo(a)pyrene (IPCS, 1998).

Additional groups of chemicals were identified that may have additive, synergistic, or antagonistic effects due to their similar toxic modes of action (see Table S7 in Supporting Information, Section S5). However, there is currently very little available toxicological data or regulatory guidance to support the prediction of the effects of simultaneous exposure to these chemicals. In the original risk assessment an approach assuming additivity of the effects was used (see details in Supporting Information, Section S5). However, as this approach is not based on actual toxicological study results and cannot consider more complex interactions (i.e. synergism or antagonism), it is considered highly speculative and was presented for information purposes only. In light of these uncertainties, the effects of simultaneous exposure to multiple pollutants are not discussed further in the present manuscript. It is acknowledged that the interpretation of the potential effects of simultaneous exposure to chemical mixtures remains a considerable source of uncertainty in human health risk assessments conducted in Ontario.

2.10. Risk characterization

2.10.1. Threshold chemicals (non-carcinogens)

The risk associated with threshold chemicals was assessed using a Concentration Ratio (CR) for the inhalation pathway. CR values were calculated by dividing the predicted ground level air concentration (1-hour, 24-hour or annual average) by the appropriate toxicity reference value (reference concentration [RfC] or health based inhalation benchmark), according to Eq. (1):

$$CR_{duration} = \frac{[Air]_{duration}}{RfC_{duration} \text{ or health benchmark}} \quad (1)$$

Where CR_{duration} represents a duration specific Concentration Ratio (unitless), calculated for 1-hr, 24-hr and chronic durations as

appropriate; $[Air]_{duration}$ represents the predicted ground-level air concentration ($\mu\text{g}/\text{m}^3$) for that duration and $RfC_{duration}$ represents the selected (duration specific) reference concentration ($\mu\text{g}/\text{m}^3$). A CR less than or equal to one signifies that the estimated exposure is less than or equal to the exposure limit; therefore, no adverse health risk is expected. Conversely, a CR greater than one signifies the potential for adverse health effects.

For the multi-pathway risk assessment, a Hazard Quotient (HQ) approach was applied. HQ values were calculated by dividing the predicted exposure dose (via multiple pathways) by the appropriate toxicity reference value (reference dose [RfD]), according to Eq. (2):

$$HQ = \frac{\sum Exp}{RfD} \quad (2)$$

Where $\sum Exp$ represents the chronic exposure estimate resulting from the sum of multiple exposure pathways ($\mu\text{g}/\text{kg}/\text{day}$) and RfD represents the selected chronic reference dose ($\mu\text{g}/\text{kg}/\text{day}$). For the purposes of this assessment, it was considered that the intake of the COPC by all routes of exposure was unlikely to exceed the tolerable intake level when the HQ was less than 0.2. This conservative approach allows 80% of the tolerable daily intake of a COPC to be received from other sources not considered in this risk assessment.

2.10.2. Non-threshold chemicals (carcinogens)

Incremental lifetime cancer risk (ILCR) and lifetime cancer risk (LCR) estimates resulting from direct air inhalation were calculated described in Eqs. (3) and (4):

$$ILCR = [Air]_{project\ alone} \times UR \quad (3)$$

$$LCR = [Air]_{all\ sources} \times UR \quad (4)$$

Where $[Air]_{project\ alone}$ represents the predicted annual average ground-level air concentration from the Project Alone ($\mu\text{g}/\text{m}^3$), $[Air]_{all\ sources}$ represents predicted annual average ground-level air concentrations from all sources, and UR represents COPC-specific unit risk ($\mu\text{g}/\text{m}^3$)⁻¹.

For the multi-pathway risk assessment, ILCR/LCR estimates resulting from a lifetime of exposure through multiple pathways were calculated using Eqs. (5) and (6):

$$ILCR = \sum LADD_{project\ alone} \times CSF \quad (5)$$

$$LCR = \sum LADD_{all\ sources} \times CSF \quad (6)$$

Where $\sum LADD_{project\ alone}$ represents the sum of average daily dose via multiple pathways from the project alone ($\mu\text{g}/\text{kg}/\text{day}$), $\sum LADD_{all\ sources}$ represents the sum of average daily dose via multiple pathways from the all sources ($\mu\text{g}/\text{kg}/\text{day}$), and CSF represents the cancer slope factor ($\mu\text{g}/\text{kg}/\text{day}$)⁻¹.

In this risk assessment, an ILCR of 1-in-1,000,000 was considered acceptable, as outlined in relevant provincial guidelines (MOE, 2005). As no regulatory guidance exists for LCRs, this value was compared with the typical observed cancer incidence in the Canadian population, which is 38% for women and 44% for men (Canadian Cancer Society, 2007).

3. Results and discussion

3.1. Risk characterization: Existing conditions

Human health risks resulting from baseline exposures to individual COPC in the baseline scenario (prior to construction of the facility) were estimated using the results of the baseline ambient air monitoring and the baseline soil and biota sampling (Supporting Information, Section S6).

3.1.1. Inhalation risk assessment: Non-carcinogens

For criteria air contaminants (CACs, for which regulatory limits already exist), no baseline case acute (1-hr or 24-hr) or chronic (annual) CR risk estimates exceeded the regulatory benchmark (CR = 1), therefore no adverse health risks were expected from exposure to baseline air concentrations of these compounds (Table 4). Additionally, baseline case CACs (including NO₂, SO₂, PM_{2.5}, and PM₁₀) were also compared to WHO benchmarks for informational purposes and no exceedances were observed (Table 4). Similar results were noted for the baseline traffic case, in which estimated offsite vehicle emissions were added to the measured baseline ambient air conditions, except for a slight exceedance (CR = 1.1) for annual nitrogen dioxide compared to the WHO benchmark (Supporting information Section S8). However, the concentration of nitrogen dioxide measured in the baseline ambient air monitoring program in the LRASA was similar to that observed in other urbanized areas such as Toronto, Hamilton, and Windsor (Supporting information, Section S7), therefore this observation does not represent a unique property-specific risk. For non-criteria air contaminants (for which no relevant criteria were identified) baseline case concentrations were also shown not to exceed the acute (1-hr or 24-hr) or chronic (annual) CR regulatory benchmark (Table 5).

3.1.2. Inhalation risk assessment: Carcinogens

For non-criteria air contaminants assessed as possible carcinogens, the estimated lifetime cancer risk (LCR) values associated with their baseline ambient air concentrations were calculated (Supporting information Section S8). Because there are no acceptable benchmarks for comparison of LCR values, the implications of baseline results for each receptor group and scenario are not discussed in detail. However, to put these values in context, the maximum LCR associated with an individual baseline ambient air concentration for a COPC addressed in this study was $3.1 \times 10^{-3}\%$ (Supporting information Section S8), while the typical observed cancer incidence in the Canadian population is 38% for women and 44% for men (Canadian Cancer Society, 2007).

3.1.3. Multi-pathway risk assessment: Non-carcinogens

For all non-carcinogens, baseline chronic risk estimates (via multiple exposure pathways) were expressed as HQ values (Tables 6, 7, and Supporting Information Section S8). For most receptors and COPC, the predicted hazard quotients did not exceed the regulatory benchmark of 0.2 for the Baseline Case. However, some exceedances were noted for resident and farmer infants and toddlers. Also, addition of the swimming or hunting/angling exposures to the toddler receptor also led to some exceedances. Therefore, these cases were examined further.

3.1.3.1. Resident infant. For the resident infant receptor, the multi-pathway assessment indicated that potential risks may exist from exposure to baseline concentrations of PCBs and dioxins/furans (Table 6, HQ values of 11 and 3.8, respectively). The identified risk from these compounds was entirely related to the ingestion of breast milk, for which the COPC concentrations had been predicted based on exposure of the infant's mother to measured or estimated background COPC concentrations in relevant exposure media (i.e., soil) and food items (e.g., produce, poultry, etc.). However, in the results of the baseline sampling program, concentrations of PCBs, dioxins and furans were frequently below detection limit for these exposure media and food items (Supporting Information, Section S6). In these cases, the method detection limit (MDL) was substituted for the contaminant concentration in order to provide a 'worst-case scenario' estimate of exposure. However, it is possible that actual contaminant concentrations were significantly lower than the MDL (or not present at all). Therefore, the HQ values for PCBs and dioxins/furans that were calculated in this assessment for the resident infant receptor may represent a significant overestimation of the actual risk.

Table 4

Concentration Ratio (CR) Values for Baseline and 140,000 tpy for Criteria Air Contaminants at the Maximum Ground Level Concentration. A bolded cell indicates exposure for that particular scenario and COPC exceeded the selected benchmark.

COPC	Concentration Ratio (CR) Values					Concentration Ratio (CR) Values –WHO Benchmarks ^f				
	Baseline	Project Alone	Project	Process Upset	Process Upset Project	Baseline	Project Alone	Project	Process Upset	Process Upset Project
<i>1-Hour</i>										
Ammonia ^a	-	0.0006	0.0006	0.006	0.006	-	-	-	-	-
Carbon Monoxide (CO)	0.07	0.001	0.07	0.01	0.08	-	-	-	-	-
Hydrogen Chloride (HCl) ^a	-	0.04	0.04	0.44	0.44	-	-	-	-	-
Hydrogen Fluoride (HF) ^a	-	0.01	0.01	0.13	0.13	-	-	-	-	-
Nitrogen Dioxide (NO ₂)	0.16	0.11	0.27	0.18	0.34	0.32	0.22	0.54	0.36	0.68
Particulate Matter - PM ₁₀ ^{a, b, e}	-	-	-	-	-	-	-	-	-	-
Particulate Matter - PM _{2.5} ^{b, e}	-	-	-	-	-	-	-	-	-	-
Particulate Matter - Total ^{b, e}	-	-	-	-	-	-	-	-	-	-
Sulfur Dioxide (SO ₂)	0.03	0.02	0.05	0.29	0.32	-	-	-	-	-
<i>24-Hour</i>										
Ammonia ^a	-	0.003	0.003	0.03	0.03	-	-	-	-	-
Carbon Monoxide (CO) ^c	-	-	-	-	-	-	-	-	-	-
Hydrogen Chloride (HCl) ^a	-	0.02	0.02	0.23	0.23	-	-	-	-	-
Hydrogen Fluoride (HF) ^{a, c}	-	-	-	-	-	-	-	-	-	-
Nitrogen Dioxide (NO ₂)	0.29	0.03	0.32	0.05	0.34	-	-	-	-	-
Particulate Matter - PM ₁₀ ^{a, e}	-	0.01	0.01	0.11	0.11	-	0.01	0.01	0.11	0.11
Particulate Matter - PM _{2.5} ^e	0.68	0.02	0.70	0.18	0.86	0.82	0.02	0.84	0.21	1.0
Particulate Matter - Total ^e	0.29	0.004	0.30	0.04	0.34	-	-	-	-	-
Sulfur Dioxide (SO ₂)	0.07	0.006	0.08	0.10	0.17	0.15	0.01	0.17	0.22	0.38
<i>Annual</i>										
Ammonia ^a	-	7.8E-05	7.8E-05	0.0001	0.0001	-	-	-	-	-
Carbon Monoxide (CO) ^d	-	-	-	-	-	-	-	-	-	-
Hydrogen Chloride (HCl) ^a	-	0.0007	0.0007	0.0010	0.0010	-	-	-	-	-
Hydrogen Fluoride (HF) ^{ad}	-	-	-	-	-	-	-	-	-	-
Nitrogen Dioxide (NO ₂)	0.62	0.003	0.62	0.003	0.62	0.93	0.005	0.93	0.005	0.93
Particulate Matter - PM ₁₀ ^{a, d, e}	-	-	-	-	-	-	0.0008	0.0008	0.001	0.001
Particulate Matter - PM _{2.5} ^{d, e}	-	-	-	-	-	0.98	0.002	0.98	0.002	0.98
Particulate Matter - Total ^e	0.35	0.0003	0.35	0.0004	0.35	-	-	-	-	-
Sulfur Dioxide (SO ₂)	0.20	0.002	0.21	0.003	0.21	-	-	-	-	-

^a Baseline Data Not Available.

^b 1-hr TRV Not Available.

^c 24-hr TRV Not Available.

^d Annual TRV Not Available.

^e Particulate Matter results include contribution of Secondary Particulate.

^f "-" indicates WHO benchmark not available.

3.1.3.2. Resident toddler. The multi-pathway assessment for exposure of the toddler resident receptor to COPC indicates that potential risks may exist from exposure to baseline concentrations of PCBs (HQ = 0.49), arsenic (HQ = 0.32) and thallium (HQ = 0.25) (Table 6). For PCBs, it was determined that the majority of risk was associated with ingestion of homegrown produce and fruit. However, as was previously noted in the discussion of the risk of PCBs to resident infants, the PCB concentrations in these media in the baseline sampling program were below detection limits and were replaced with the value of the MDL in the risk assessment. Therefore, the HQ value for PCB exposure for the toddler resident likely overestimates the actual risk.

For arsenic, risk to the toddler resident receptor was attributed to incidental ingestion of soil. In contrast to PCBs, arsenic was widely detected in soil in the baseline sampling program. However the maximum detected soil arsenic concentration (8 mg/kg) used in the risk characterization was within the range of concentrations previously reported in natural, uncontaminated soils in Canada (Wang and Mulligan, 2006) and was less than the current Ontario Ministry of the Environment regulatory soil chemical standard of 11 mg/kg for arsenic at sensitive sites (MOE, 2004b). Therefore, this soil is not likely to cause any undue risk to human receptors within the LRASA. The elevated HQ values observed for the resident toddler receptors for arsenic can likely be attributed to conservative model assumptions applied throughout the risk assessment process.

For thallium, the relevant exposure pathways that contributed to the potential risk to resident toddlers were incidental soil ingestion and produce and fruit ingestion. However, none of the soil, produce, or fruit samples collected during the baseline sampling program had detectable levels of thallium. Therefore, the risk assessment for thallium was based entirely on the substitution of the method detection limit (1 mg/kg) for the undetected values and likely provides a significant overestimation of risk. In addition, the detection limit (1 mg/kg) was less than the Ontario Ministry of the Environment regulatory soil chemical standard for sensitive sites of 2.5 mg/kg (MOE, 2004b). This also suggests that the elevated HQ values observed in this assessment for thallium for the resident toddler are likely due to conservative model assumptions applied throughout the risk assessment process.

3.1.3.3. Farmer Infant. The multi-pathway assessment for exposure of the farmer infant receptor to COPC also suggested potential risks may exist from exposure to baseline concentrations of PCBs, dioxins/furans, and 1,2,4-trichlorobenzene (Table 6, HQ values of 118, 20, and 0.21, respectively). However, as was noted for the resident infant receptor, PCBs and the majority of dioxins/furans were not detected in any media relevant to exposure of farmers (i.e., soil, home-grown produce, or farm-raised livestock) (Supporting Information, Section S6). Furthermore, 1,2,4-trichlorobenzene was also not detected in any samples collected in the baseline sampling program (Supporting Information, Section S6). Therefore, these HQ values may also represent a significant

Table 5
Concentration Ratio (CR) Values for Baseline and 140,000 tonnes per year operating scenarios at the Maximum Ground Level Concentration. Each value represents the maximum observed CR value for an individual COPC within each chemical class. A bolded cell indicates exposure for that particular scenario and COPC exceeded the selected benchmark.

COPC	Concentration Ratio (CR) Values – 140,000 tpy														
	1-hour			24-hour			Annual			Annual					
	Baseline	Project Alone	Project	Process Upset	Project	Baseline	Project Alone	Project	Process Upset	Project	Baseline	Project Alone	Project	Process Upset	Project
Metals	0.04	0.03	0.04	0.25	0.27	0.03	0.01	0.04	0.14	0.16	0.12	0.003	0.12	0.004	0.12
Chlorinated Polycyclic Aromatics	0.001	0.0003	0.001	0.003	0.004	0.005	0.0006	0.005	0.006	0.01	0.002	9.0E-06	0.002	2.0E-05	0.002
Chlorinated Monocyclic Aromatics	0.0006	7.5E-05	0.0007	0.0008	0.001	0.0001	5.2E-07	0.0001	5.0E-06	0.0001	0.002	3.0E-06	0.002	1.0E-05	0.002
Polycyclic Aromatic Hydrocarbons (PAH)	0.01	6.9E-05	0.01	0.0007	0.01	0.07	0.0002	0.07	0.002	0.07	0.002	1.0E-06	0.002	2.0E-06	0.002
Volatile Organic Chemicals (VOC)	0.55	0.005	0.55	0.05	0.56	0.41	0.002	0.41	0.02	0.41	0.18	0.0002	0.18	0.0005	0.18

overestimation of the actual risk due to the substitution of the MDL for non-detect values.

3.1.3.4. Farmer Toddler. HQ values greater than 0.2 were observed for the farmer toddler receptor for total PCBs, bromoform, carbon tetrachloride, chloroform, dichloromethane, 1,2,4,5-tetrachlorobenzene, 1,2,4-trichlorobenzene, antimony, arsenic, beryllium, thallium, and dioxins/furans (Table 6). When the risks to the farmer toddler from each COPC were apportioned into their respective exposure pathways, it was observed that ingestion of dairy was the primary exposure pathway associated with risks to the farmer toddler (>65% of total exposure for all chemicals except for arsenic for which only 47% of exposure was related to ingestion of dairy). However, none of these chemicals were actually detected in dairy products in the baseline sampling program and risk assessment was performed using the method detection limit. Therefore, as has been observed for other receptors and COPC in this assessment, the hazard quotients resulting from this substitution likely represent overestimations of the true risk. Furthermore, as toddler-specific ingestion rates for food items produced on farms were not available, child-specific ingestion rates were adopted from US EPA (2005) as a conservative measure that may also have resulted in an overestimate of exposure since ingestion rates are typically proportional to body weight (Health Canada, 2007).

The farmer toddler also received a significant proportion of its exposure to arsenic via soil and dust ingestion (26%). As was previously discussed with respect to the resident toddler, the maximum soil arsenic concentration used for risk characterization in this assessment (8 mg/kg) is within the expected range for uncontaminated soils in Canada and is also less than the Ontario Ministry of the Environment regulatory soil chemical standard for sensitive sites (MOE, 2004b). Therefore, it is not considered likely that soil and dust ingestion will pose significant undue risk with respect to arsenic exposure for any of the human receptors in the LRASA.

3.1.3.5. Additional Risks Related to Swimming and Hunting/Angling. Additional risks from exposure to surface water while swimming, wading or playing in surface water bodies, as well as from engaging in hunting and angling activities within the LRASA were assessed (Table 7). Results of the swimming exposure assessment indicate that the incremental risks associated with exposure to surface water are between one to six orders of magnitude less than the acceptable multi-pathway HQ benchmark of 0.2 (Table 7). When this additional exposure pathway was added to an existing receptor (e.g., the resident Toddler), the only HQ exceedances noted were for COPC that exceeded the regulatory guideline prior to addition of the swimming pathway (Table 7). In contrast, results of the hunter/angler assessment suggested that this pathway alone may be sufficient to increase COPC exposure above the regulatory guideline for arsenic, cadmium, total PCBs and dioxins/furans (Table 7, HQ values of 0.43, 0.46, 0.67, and 0.38, respectively). Some of these contaminants were not detected in small mammals or fish collected in the baseline sampling program (Supporting Information, Section S6), therefore some of the perceived risk may relate to the replacement of non-detect values with the method detection limit. Furthermore, the concentrations of COPC that were detected in fish (PCBs, arsenic, cadmium, and certain dioxins/furans) and small mammals (arsenic and cadmium), were similar to what would be expected at other areas across Ontario and are therefore not unique to this project (Supporting Information, Section S7).

3.1.4. Multi-pathway risk assessment: Carcinogens

The baseline case multi-pathway assessment also provided oral/dermal lifetime cancer risk (LCR) estimates for all carcinogenic COPC for the defined multi-pathway receptors and for the incremental exposures resulting from recreational swimming and/or hunting/angling (Supporting Information, Section S8). As discussed in Section 3.1.2, there is no acceptable benchmark for comparison of LCR values, as

they represent an individual's lifetime cancer risks associated with all potential exposures to a given carcinogenic COPC within the environment. However, the maximum ILCR observed under baseline conditions for these COPC was 0.03%, which is much lower than the typical observed rates of cancer in Canada (38% for women and 44% for men) (Canadian Cancer Society, 2007).

3.2. Risk characterization: Construction case

For consideration of the construction case, it was assumed that construction activities would occur intermittently, during daylight hours, over a period of approximately 30 months. The primary concerns related to these activities with respect to human health were considered to be dust emissions from construction activities and exhaust emissions from fuel combustion by vehicles on the site. In addition, construction activities such as welding, use of solvents, sand blasting and painting may also affect air quality in the construction area. However, relative to the anticipated operational emissions, construction emissions will be minor, short-term and transitory. Therefore, it was expected that the assessment of operational scenarios (Sections 3.3–3.4) will be protective of any potential health risks that could arise during periods of construction and this case was not assessed in detail.

3.3. Risk characterization: Operational scenarios (140,000 tonnes per year)

3.3.1. Inhalation risk assessment: Non-carcinogens

For CACs, predicted maximum 1-hour, 24-hour and annual air concentrations for predicted operational scenarios at 140,000 tonnes per year (i.e. Project Alone Case, Project Case, Process Upset Case or Process Upset Project Case) did not exceed their relevant exposure limits (Table 4); therefore, no adverse health risk is expected from potential exposure to CACs. Additionally, when predicted CAC concentrations were compared to WHO benchmarks for informational purposes, no exceedances were noted for any of the considered assessment scenarios, except for PM_{2.5} in the Process Upset Project Case (CR = 1.01, Table 4). The exceedance of fine particulate matter is driven by baseline concentrations as the CR for baseline conditions alone is 0.82, while the CR for process upset conditions is only 0.21 (Table 4). However, the baseline concentration of PM_{2.5} in this area is similar to other urban areas in Ontario (Supporting Information, Section S7). In addition, frequency analysis of the baseline monitoring performed as part of this assessment showed that 24-hour PM_{2.5} concentrations exceeding the WHO benchmark of 25 µg/m³ are very rare (Supporting Information, Section S9). No exceedance was noted in comparison to the selected 24-hour PM_{2.5} Canada-Wide Standard (Table 4).

In addition, for the CACs, the Traffic Case (which combined emissions from offsite and onsite traffic with the anticipated onsite stationary source emissions for the facility) was contrasted with the baseline traffic case. In this case, the predicted 1-hour, 24-hour and annual air concentrations for the CAC at 140,000 tonnes per year did not exceed their relevant exposure limit for either the Baseline Traffic Case, or the Traffic Case (Supporting Information, Section S8). Therefore, no adverse health risk is expected from potential exposure to CACs due to the combined effect of facility emissions at 140,000 tonnes per year and local vehicular traffic. When compared to WHO benchmarks for informational purposes, an exceedance was noted for annual nitrogen dioxide (CR = 1.2) for both the baseline traffic case and the traffic case (Supporting Information, Section S8). However, as discussed in Section 3.1.1, this exceedance was driven by baseline concentrations, which were within a normal range for an urban area in Ontario (Supporting Information, Section S7). Therefore, this does not represent an unusual level of risk associated with this location.

For remaining COPC, none of the predicted maximum 1-hour, 24-hour or annual air concentrations exceeded their relevant exposure limit for any of the operational scenarios (Table 5).

3.3.2. Inhalation risk assessment: Carcinogens

For all carcinogenic COPC, chronic incremental lifetime cancer risks (ILCR) values were calculated for the 140,000 tonnes per year Project Alone Case and Process Upset Case at the maximum predicted ground level concentration (Supporting Information, Section S8). As outlined in Section 2.10.2, an ILCR less than or equal to 1-in-1,000,000 (i.e., 1×10^{-6}) signifies that the incremental lifetime cancer risk is less than the regulatory benchmark (i.e., the assumed safe level of exposure); therefore, no adverse risk is expected. Conversely, an ILCR greater than 1×10^{-6} indicates that the potential for an elevated level of risk may be present and suggests further investigation should be pursued to confirm the identified risk. In this assessment, none of the predicted ILCR exceeded the regulatory benchmark for the carcinogenic COPC in either the Project Alone Case or Process Upset Case (Supporting Information, Section S8). Therefore, it is not expected that concentrations of carcinogenic COPC from the facility at 140,000 tonnes per year will pose any individual adverse carcinogenic risk to the health of human receptors via inhalation.

3.3.3. Multi-pathway risk assessment: Non-carcinogens

For most receptors, COPC, and operational scenarios, the HQ values did not exceed the regulatory benchmark of 0.2 (Tables 6, 7). The only exceedances noted were for operational scenarios that also incorporated the baseline conditions (i.e., the Project Case and Process Upset Project Case). In these cases, the source of the exceedance was always the baseline case. For instance, for the local resident infant and toddler receptors neither the Project Alone Case nor the Process Upset Case ever represented more than approximately 0.5% of the Project Case or Process Upset Project Case risk, respectively. Similarly, for the farmer infant and toddler receptors, the Project Alone Case or Process Upset Case never represented more than approximately 2% of the Project Case or Process Upset Project Case risk, respectively.

As discussed in Section 3.1.3, the exceedances observed in the baseline conditions were related to a number of issues such as the use of laboratory method detection limits as environmental media concentrations and the conservative nature of risk assessment exposure calculations. In addition, some COPC concentrations actually exceeded relevant guidelines in specific media. However, the baseline COPC concentrations were found to be no different in the LRASA than in other similar areas of Ontario and are therefore not unique to this project.

3.3.4. Multi-pathway risk assessment: Carcinogens

Incremental lifetime cancer risks (ILCR) were estimated for all receptors under the Project Alone Case and Process Upset Case assessment scenarios (Supporting Information, Section S8). In addition, activity specific ILCR values were calculated with respect to hunting/angling and swimming and were added to that of the worst case resident receptor. None of the predicted ILCR values exceeded the accepted regulatory benchmark for the Project Alone Case or Process Upset Case; therefore, it is not expected that the facility will pose any additional adverse cancer risk to the health of local receptors at 140,000 tonnes per year.

3.4. Risk characterization: Operational scenarios (400,000 tonnes per year)

For comparison purposes, a human health risk assessment was also performed that considered the possible expansion of the facility to its maximum design operating capacity of 400,000 tonnes per year. This assessment was performed using identical methods and assumptions as those described for the 140,000 tonnes per year assessment, except that the facility related emissions were increased. Most of the conclusions of this assessment were similar to those identified for operational scenarios at 140,000 tonnes per year (i.e., most observed risks were related to existing baseline conditions rather than facility-related emissions). However, in the Process Upset Case,

Table 6
Summary of Multi-Pathway Risk Assessment Hazard Quotient (HQ) Results for Baseline and 140,000 tonnes per year operating scenarios for a. the worst-case resident infant and toddler and b. farmer infant and toddler receptors. Each value represents the maximum observed HQ value for an individual COPC within each chemical class. A bolded cell indicates exposure for that particular scenario and COPC exceeded the selected benchmark.

a.										
	Worst-case resident infant					Worst-case resident toddler				
	Baseline	Project Alone	Project	Process Upset	Process Upset Project	Baseline	Project Alone	Project	Process Upset	Process Upset Project
<i>PAHs</i>										
Maximum observed	6.3E-06	3.4E-11	6.3E-06	9.6E-11	6.3E-06	2.0E-05	5.7E-10	2.0E-05	1.6E-09	2.0E-05
<i>PCBs</i>										
Aroclor 1254 (Total PCBs)	10.8	0.0003	10.8	0.0008	10.8	0.49	3.4E-05	0.49	9.6E-05	0.49
<i>VOCs</i>										
Max	0.0002	1.0E-12	0.0002	2.8E-12	0.0002	0.03	2.7E-09	0.03	7.6E-09	0.03
<i>Chlorinated Monocyclic Aromatics</i>										
Maximum observed	0.003	1.2E-08	0.003	3.4E-08	0.003	0.06	1.2E-07	0.06	3.5E-07	0.06
<i>Inorganics</i>										
All except Arsenic and Thallium	0.02	4.0E-05	0.02	5.9E-05	0.02	0.07	0.0002	0.07	0.0004	0.07
Arsenic	0.10	5.0E-07	0.10	7.3E-07	0.10	0.32	3.2E-06	0.32	4.6E-06	0.32
Thallium	0.05	0.0004	0.05	0.0006	0.05	0.25	0.002	0.25	0.003	0.26
<i>Dioxins/Furans and Lead</i>										
2,3,7,8-TCDD Equivalent	3.8	0.002	3.8	0.004	3.8	0.17	0.0002	0.17	0.0006	0.17
Lead	0.04	0.0002	0.04	0.0002	0.04	0.12	0.0005	0.12	0.0007	0.12
b.										
	Farmer infant					Farmer toddler				
	Baseline	Project Alone	Project	Process Upset	Process Upset Project	Baseline	Project Alone	Project	Process Upset	Process Upset Project
<i>PAHs</i>										
Maximum observed	6.8E-06	4.7E-11	6.8E-06	1.3E-10	6.8E-06	5.8E-05	1.5E-09	5.8E-05	4.1E-09	5.8E-05
<i>PCBs</i>										
Aroclor 1254 (Total PCBs)	117.5	0.004	117.5	0.01	117.5	4.2	0.0001	4.2	0.0004	4.2
<i>VOCs</i>										
1,1,1-Trichloroethane	1.8E-07	1.6E-14	1.8E-07	4.6E-14	1.8E-07	0.0006	5.1E-11	0.0006	1.4E-10	0.0006
Bromoform	6.6E-05	4.4E-11	6.6E-05	1.2E-10	6.6E-05	0.32	1.9E-07	0.32	5.3E-07	0.32
Carbon Tetrachloride	0.003	4.0E-11	0.003	1.1E-10	0.003	4.6	6.3E-08	4.6	1.8E-07	4.6
Chloroform	3.1E-05	2.3E-13	3.1E-05	6.4E-13	3.1E-05	0.32	2.0E-09	0.32	5.6E-09	0.32
Dichloromethane	2.8E-05	2.1E-12	2.8E-05	6.0E-12	2.8E-05	0.65	4.9E-08	0.65	1.4E-07	0.65
Trichlorofluoromethane	5.9E-06	1.2E-11	5.9E-06	3.4E-11	5.9E-06	0.02	3.8E-08	0.02	1.1E-07	0.02
<i>Chlorinated Monocyclic Aromatics</i>										
Maximum observed (excepting 1,2,4,5-Tetrachlorobenzene and 1,2,4-Trichlorobenzene)	0.03	4.0E-08	0.03	1.1E-07	0.03	0.17	3.2E-07	0.17	9.0E-07	0.17
1,2,4,5-Tetrachlorobenzene	0.02	1.6E-08	0.02	4.4E-08	0.02	0.40	2.4E-07	0.40	6.8E-07	0.40
1,2,4-Trichlorobenzene	0.21	1.7E-10	0.21	4.8E-10	0.21	20.1	1.3E-08	20.1	3.7E-08	20.1
<i>Inorganics</i>										
Maximum observed (excepting antimony, arsenic, beryllium, and thallium)	0.02	4.2E-05	0.02	6.1E-05	0.02	0.18	0.0006	0.18	0.0009	0.18
Antimony	0.01	5.9E-06	0.01	8.6E-06	0.01	0.24	8.3E-05	0.24	0.0001	0.24
Arsenic	0.10	7.0E-07	0.10	1.0E-06	0.10	0.57	7.6E-06	0.57	1.1E-05	0.57
Beryllium	0.001	6.6E-07	0.001	9.6E-07	0.001	0.42	2.8E-06	0.42	4.1E-06	0.42
Thallium	0.05	0.0006	0.05	0.0008	0.05	1.2	0.01	1.2	0.02	1.2
<i>Dioxins/Furans and Lead</i>										
2,3,7,8-TCDD Equivalent	20.3	0.05	20.3	0.13	20.4	0.72	0.002	0.72	0.004	0.73
Lead	0.04	0.0002	0.04	0.0003	0.04	0.20	0.0010	0.20	0.001	0.20

slightly elevated potential risks above the government benchmarks for human health were noted that were not explained by baseline conditions. Maximum exposure to the 1 hour hydrogen chloride concentration at the commercial/industrial receptor location resulted in a CR of 1.0 (benchmark CR = 1.0) and exposure of farmer infant to breast milk of a mother living in close proximity to the facility under the Process Upset Case resulted in an infant dioxin and furan HQ of 0.22, which was slightly in excess of the government benchmark of 0.2. However, these slight exceedances of benchmark risk levels

were seen only under upset conditions, it is possible that they may be prevented through the application of adequate engineering controls. Regardless, in the event that a 400,000 tonnes per year expansion of the facility is eventually contemplated, special consideration should be given at that time to ensure that Process Upset Conditions do not result in an undue risk to people living and working in the area surrounding the facility. Overall, the results suggest that a 400,000 tonnes per year facility could be safely sited in Clarington, Ontario using the pollution control technology suggested by Covanta.

Table 7

Summary of multi-pathway risk assessment hazard quotient (HQ) results for baseline and 140,000 tonnes per year operating scenarios for additional exposure via a. swimming and b. hunting/angling. The results of adding these exposure pathways to the worst case resident toddler are also shown. Each value represents the maximum observed HQ value for an individual COPC within each chemical class. A bolded cell indicates exposure for that particular scenario and COPC exceeded the regulatory benchmark.

a.	Hazard quotients for swimming exposure alone (toddler)					Swimming exposure added to worst case resident toddler				
	Baseline	Project Alone	Project	Process Upset	Process Upset Project	Baseline	Project Alone	Project	Process Upset	Process Upset Project
<i>PAHs</i>										
Maximum observed	1.2E-06	2.8E-11	1.2E-06	7.8E-11	1.2E-06	2.1E-05	5.7E-10	2.1E-05	1.6E-09	2.1E-05
<i>PCBs</i>										
Aroclor 1254 (Total PCBs)	0.03	6.8E-07	0.03	1.9E-06	0.03	0.52	3.5E-05	0.52	9.8E-05	0.52
<i>VOCs</i>										
Maximum observed	0.001	2.1E-08	0.001	5.8E-08	0.001	0.03	2.6E-08	0.03	7.3E-08	0.03
<i>Chlorinated Monocyclic Aromatics</i>										
Maximum observed	0.0007	1.1E-07	0.0007	3.0E-07	0.0007	0.06	2.3E-07	0.06	6.5E-07	0.06
<i>Inorganics</i>										
Maximum observed excepting arsenic, cadmium, and thallium	0.02	1.3E-05	0.02	1.9E-05	0.02	0.07	0.0002	0.07	0.0003	0.07
Arsenic	0.01	2.7E-06	0.01	3.9E-06	0.01	0.33	5.8E-06	0.33	8.5E-06	0.33
Cadmium	0.0003	2.6E-05	0.0003	3.8E-05	0.0003	0.03	0.0003	0.03	0.0004	0.03
Thallium	0.005	0.001	0.006	0.001	0.008	0.26	0.003	0.26	0.004	0.26
<i>Dioxins/Furans and Lead</i>										
2,3,7,8-TCDD Equivalent	0.003	2.8E-07	0.003	8.0E-07	0.003	0.17	0.0002	0.17	0.0006	0.17
Lead	0.0008	2.3E-05	0.0008	3.4E-05	0.0008	0.12	0.0005	0.12	0.0007	0.12
b.										
b.	Hazard quotients for hunter/angler exposure alone (toddler)					Hunter/angler exposure added to worst case resident toddler				
	Baseline	Project Alone	Project	Process Upset	Process Upset Project	Baseline	Project Alone	Project	Process Upset	Process Upset Project
<i>PAHs</i>										
Maximum observed	2.1E-05	3.4E-12	2.1E-05	9.6E-12	2.1E-05	4.1E-05	5.7E-10	4.1E-05	1.6E-09	4.1E-05
<i>PCBs</i>										
Aroclor 1254 (Total PCBs)	0.67	0.002	0.67	0.006	0.68	1.20	0.002	1.20	0.006	1.20
<i>VOCs</i>										
Maximum observed	–	6.2E-09	–	1.7E-08	–	0.03	6.2E-09	0.03	1.7E-08	0.03
<i>Chlorinated Monocyclic Aromatics</i>										
Maximum observed	0.06	8.3E-06	0.06	2.3E-05	0.06	0.11	8.4E-06	0.11	2.4E-05	0.11
<i>Inorganics</i>										
Maximum observed excepting arsenic, cadmium, and thallium	0.16	0.001	0.16	0.002	0.16	0.17	0.001	0.17	0.002	0.17
Arsenic	0.43	3.3E-05	0.43	4.7E-05	0.43	0.75	3.6E-05	0.75	5.2E-05	0.75
Cadmium	0.47	0.008	0.47	0.01	0.48	0.49	0.008	0.50	0.01	0.50
Thallium	0.17	0.002	0.17	0.003	0.17	0.42	0.004	0.42	0.006	0.43
<i>Dioxins/Furans and Lead</i>										
2,3,7,8-TCDD Equivalent	0.38	0.002	0.38	0.005	0.38	0.54	0.002	0.54	0.005	0.55
Lead	0.04	0.0006	0.04	0.0009	0.04	0.15	0.001	0.15	0.002	0.15

3.5. Risk characterization: Decommissioning and abandonment

Decommissioning and abandonment of the facility is not expected to occur for several decades. Similar to the construction case, it is expected that this process would entail short-term, localized emissions of air contaminants. While it is unlikely that these activities would significantly increase any potential risk to human health, it is expected that a more current assessment of these potential risks would be conducted prior to the commencement of decommissioning activities. Consequently, the prediction of risks to human health from decommissioning and abandonment were not undertaken in this assessment.

4. Uncertainty Analysis

As part of this risk assessment, it was necessary to make certain assumptions in order to be able to quantitatively evaluate the risks to human health from exposure to the Project. These assumptions

inherently add an element of uncertainty to the risk assessment. Where variability and uncertainty are known to exist, it is standard risk assessment practice to make assumptions and select data that are likely to overestimate, rather than underestimate, potential exposure and effects. As a result, risk assessments tend to overstate the actual level of risk. Some of the conservative assumptions applied in this risk assessment include the use of method detection limits to represent chemical concentrations and use of child-specific ingestion rates to represent toddler rate of ingestion. A full accounting of the assumptions and uncertainties relied upon in this HHRA is provided in the Supporting Information (Section S10).

5. Conclusions

Overall, the results of the human health risk assessment indicate that it is not expected that the proposed project (i.e., construction, operation, and eventual decommissioning of a modern EFW thermal

treatment facility) will result in any adverse health risk to local residents, farmers or other receptors in the Local Risk Assessment Study Area at 140,000 tonnes per year. Although some risk has been identified through the assessment of Baseline Case concentrations, this risk can be attributed to conservative modeling assumptions that overestimate the actual risk present (e.g., use of method detection limits to represent chemical concentrations and use of child-specific ingestion rates to represent toddler rate of ingestion) and/or pre-existing natural or anthropogenic conditions that correlate to baseline risk. These pre-existing natural or anthropogenic conditions were generally shown not to differ from those of similar urbanized areas in Ontario.

Based on the success of this human health risk assessment and an accompanying ecological risk assessment (see Ollson et al., 2014), the regions of Durham and York were able to move forward with this project, and the described facility is currently under construction, with operational start-up anticipated in Fall 2014. This facility will be capable of processing 140,000 tonnes of post-diversion residual waste annually while recovering metals and energy.

Conflict of interest

The authors have no actual or potential conflicts of interest to declare.

Acknowledgements

The authors wish to acknowledge the contribution of Greg Crooks and his Air Quality team at Stantec who provided the required air input data. We would also like to thank the Chair Anderson, Council, and Cliff Curtis and his staff at Durham Region; without them this project would not have been undertaken. The direction of the overall environmental assessment was provided by James McKay, now with HDR Canada.

Appendix A. Supplementary data

Supplementary data to this article can be found online at <http://dx.doi.org/10.1016/j.scitotenv.2013.07.019>.

References

- Bogner J, Pipatti R, Hashimoto S, Diaz C, Mareckova K, Diaz L, et al. Mitigation of global greenhouse gas emissions from waste: Conclusions and strategies from the Intergovernmental Panel on Climate Change (IPCC) Fourth Assessment Report. Working Group III (Mitigation). *Waste Manag Res* 2008;26:11–32.
- Bordonaba JG, Vilavert L, Nadal M, Schuhmacher M, Domingo JL. Monitoring environmental levels of trace elements near a hazardous waste incinerator human health risks after a decade of regular operations. *Biol Trace Elem Res* 2011;144:1419–29.
- Canadian Cancer Society. *Canadian Cancer Statistics 2007*. Toronto, ON: Canadian Cancer Society's Steering Committee on Cancer Statistics; 2007.
- Cangialosi F, Intini G, Liberti L, Notarnicola M, Stellacci P. Health risk assessment of air emissions from a municipal solid waste incineration plant - A case study. *Waste Manag* 2008;28:885–95.
- Environment Canada. National Pollutant Release Inventory. Available at: <http://www.ec.gc.ca/inrp-npri/default.asp?lang=En&n=4A577BB9-1> Ottawa: Environment Canada; 2007.
- Environment Canada. Canadian climate normals 1971–2000. Accessed on November 15, 2008 from: climate.weatheroffice.gc.ca/climate_normals/index_e.html, 2008.
- Health Canada. Human Health Risk Assessment for Priority Substances: Canadian Environmental Protection Act. Ottawa, ON: Canada Communication Group—Publishing; 1994.
- Health Canada. Federal Contaminated Risk Assessment in Canada Part I: Guidance on Human Health Preliminary Quantitative Risk Assessment (PQRA). Version 2.0. Ottawa, ON: Health Canada, Environmental Health Assessment Services, Safe Environments Programme; 2007.
- International programme on chemical safety (IPCS). *Environmental Health Criteria 202 – Selected non-heterocyclic polycyclic aromatic hydrocarbons*. Geneva: World Health Organization; 1998.
- Lee SJ, Choi SD, Jin GZ, Oh JE, Chang YS, Shin SK. Assessment of PCDD/F risk after implementation of emission reduction at a MSWI. *Chemosphere* 2007;68:856–63.
- MOE (Ontario Ministry of the Environment). Guideline A-7 Combustion and Air Pollution Control Requirements for New Municipal Waste Incinerators. Toronto: Standards development branch; 2004a.
- MOE (Ontario Ministry of the Environment). Record of Site Condition Regulation. Ontario Regulation 153/04 – Part XV.1 of the Environmental Protection Act; 2004b.
- MOE (Ontario Ministry of the Environment). Procedures for the Use of Risk Assessment under Part XV.1 of the Environmental Protection Act. Available online at http://www.ene.gov.on.ca/stdprodconsume/groups/lr/ene/@resources/documents/resource/stdprod_081550.pdf, 2005.
- Morselli L, Passarini F, Piccari L, Vassura I, Bernardi E. Risk assessment applied to air emissions from a medium-sized Italian MSW incinerator. *Waste Manag Res* 2011;29:48–56.
- Ollson CA, Whitfield Aslund ML, Knopper LD, Dan T. Site specific risk assessment of an energy-from-waste/ thermal treatment facility in Durham Region, Ontario, Canada. Part B: ecological risk assessment. *Sci Total Environ* 2014;466–467:242–52.
- ORNL (Oak Ridge National Laboratory). Risk Assessment Information System: Chemical Specific Parameters. Accessed on November 15, 2008 from: http://rais.ornl.gov/cgi-bin/tools/TOX_search?select=chem_spef, 2008.
- Richardson GM. *Compendium of Canadian Human Exposure Factors for Risk Assessment*. Ottawa: O'Connor Associates Environmental Inc.; 1997.
- Rovira J, Mari M, Nadal M, Schuhmacher M, Domingo JL. Environmental monitoring of metals, PCDD/Fs and PCBs as a complementary tool of biological surveillance to assess human health risks. *Chemosphere* 2010;80:1183–9.
- Rushton L. Health hazards and waste management. *Br Med Bull* 2003;68:183–97.
- Schuhmacher M, Domingo JL. Long-term study of environmental levels of dioxins and furans in the vicinity of a municipal solid waste incinerator. *Environ Int* 2006;32:397–404.
- Scire JS, Strimatis DG, Yamartino RJ. *Model formulation and user's guide for the CALPUFF dispersion model*. Concord, MA: Earth Tech. Inc.; 1995.
- United States Geological Survey (USGS). SRTM Terrain Data. Accessed November 10, 2008 from [ftp://eomss21u.ecs.nasa.gov/srtm/North_America_3arcsec/3arcsec/United States Geological Survey \(USGS\);](ftp://eomss21u.ecs.nasa.gov/srtm/North_America_3arcsec/3arcsec/United_States_Geological_Survey_(USGS);) 2007.
- University corporation for atmospheric research (UCAR). Weather Research and Forecasting (WRF) Modeling system overview. Accessed November 10, 2008 from <http://www.mmm.ucar.edu/wrf/users/model.html>, 2008.
- US EPA (United States Environmental Protection Agency). Risk Assessment Guidance for Superfund Volume I: Human Health Evaluation Manual (Part A). Washington, DC: US EPA Office of Emergency and Remedial Response; 1989.
- US EPA (United States Environmental Protection Agency). *Exposure Factors Handbook*. Washington, DC: US EPA Office of Research and Development; 1997.
- US EPA (United States Environmental Protection Agency). *Human Health Risk Assessment Protocol for Hazardous Waste Combustion Facilities (HHRAP)*. Washington, DC: US EPA Office of Solid Waste; 2005.
- Van den Berg M, Birnbaum LS, Denison M, De Vito M, Farland W, Feeley M, et al. The 2005 World Health Organization reevaluation of human and mammalian toxic equivalency factors for dioxins and dioxin-like compounds. *Toxicol Sci* 2006;93:223–41.
- Wang S, Mulligan CN. Occurrence of arsenic contamination in Canada: Sources, behavior and distribution. *Sci Total Environ* 2006;366:701–21.

MEMO

Job **Bromine in Waste**
Client **EfW Facility TNG NSW**
Memo no. **5**
Date **2016-10-14**
To **To Whom it may concern**
From **Ahmet Erol (Ramboll)**
Copy to **Ian Malouf (DADI)**
Phill Andrew (Savills)
Amanda Lee (AECOM)
Lesley Randall (AECOM)
Rachael Snape (Urbis)
Damon Roddis (Pacific Environment)

Bromine Emissions from WtE

Background

The most common use of brominated flame retardants (BFRs) is in building materials, textiles and electronic supplies, e.g. TVs, PCs and photocopiers. In incineration plants with good combustion BFRs will decompose and form other brominated compounds (Söderström, G. et al, 2000), mainly hydrogen bromide (HBr) (Vehlow, J. et al, 1998).

In addition, other brominated compounds will also be formed, in particular brominated organic compounds, such as dioxins where chlorine is fully or partly substituted by bromine (brominated and brominated/chlorinated dioxins).¹

Characterization of the brominated waste

Data from literature regarding bromine content in municipal waste from households and small businesses indicates typical bromine content of 0,003-0,006 % by weight of bromine.

Floc waste TNG

Analysis of 17 floc samples from TNG facility done by HRL Technology shows that the average bromine content is 0,01 % on dry basis (db). Maximal bromine content was 0,04 % (db). TNG has 14,4% floc waste in the design waste.

Increase of bromine content by floc waste

Assuming an average content of 0.0045% bromine (average of reported minimum and maximum content of 0.003% and 0.006%) in all waste streams except floc waste and 0,01% bromine in floc this results in an increase of bromine in the total waste from 0.0045% to 0.00529%. The final concentration of 0.00529% is still within the reported range of MSW.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-021-Bromine in
Waste.docx
Ver. 1

¹ Emission Measurements During Incineration of Waste Containing Bromine, TemaNord 2005:529

Effect of increased bromine content in waste

The most extensive measurements were performed at the largest municipal waste incineration plant in Oslo (Klemetsrud Plant). The plant has two incinerator lines, each with the capacity of incinerating 10 tons of waste per hour. Each line is equipped with a flue gas cleaning system, consisting of a bag house filter with active coal injection, and a wet scrubber.

At this plant sampling and analysis were carried out in three different situations:

- No addition of brominated waste
- Mix with 5 % by weight brominated waste; i.e. approximately 0,05 % by weight bromine in total waste.
- Mix with 10 % by -weight brominated waste; i.e. approximately 0,1 % by weight bromine in total waste.

Results

The in stack (after flue gas treatment) concentration of gaseous bromine (HBr and Br₂) was reported to be < 2,2 mg/Nm³ even in the case of addition of 10% brominated waste.

The in stack concentration of BFR in case of the Klemetsrud Plant was 14-22 ng/Nm³, in case of the Energos Plant (Ranheim) <5 ng/Nm³. The BFR detected where DekabDE and TBBPA, in the flue gas DekabEDE has the highest concentration level.

Brominated waste has no adverse effect on dioxin formation nor on additional formation of brominated and chlorinated/brominated dioxins.

Conclusions

Using flocc waste as a fuel has no adverse effect on the emissions of a WtE facility.

In case of TNG (with a comparable flue gas cleaning technology as the Energos plant) the in stack concentrations for gaseous bromine can be assumed to be below 2 mg/Nm³, BFR below 5 ng/Nm³ and total brominated dioxins far below 0,05 ng/Nm³.

Reference (attached):

Emission Measurements During Incineration of Waste Containing Bromine, TemaNord 2005: 529, © Nordic Council of Ministers, Copenhagen 2005

Emission Measurements During Incineration of Waste Containing Bromine

Emission Measurements During Incineration of Waste Containing Bromine

TemaNord 2005:529

© Nordic Council of Ministers, Copenhagen 2005

ISBN 92-893-1185-1

Print: Ekspresen Tryk & Kopicenter

Layout: Publication Unit, NCM

Copies: 165

Printed on environmentally friendly paper

This publication can be ordered on www.norden.org/order. Other Nordic publications are available at www.norden.org/publications

Printed in Denmark

Nordic Council of Ministers

Store Strandstræde 18

DK-1255 Copenhagen K

Phone (+45) 3396 0200

Fax (+45) 3396 0202

Nordic Council

Store Strandstræde 18

DK-1255 Copenhagen K

Phone (+45) 3396 0400

Fax (+45) 3311 1870

www.norden.org

Nordic Environmental Co-operation

Environmental co-operation is aimed at contributing to the improvement of the environment and forestall problems in the Nordic countries as well as on the international scene. The co-operation is conducted by the Nordic Committee of Senior Officials for Environmental Affairs. The co-operation endeavours to advance joint aims for Action Plans and joint projects, exchange of information and assistance, e.g. to Eastern Europe, through the Nordic Environmental Finance Corporation (NEFCO).

Nordic Co-operation

Nordic co-operation, one of the oldest and most wide-ranging regional partnerships in the world, involves Denmark, Finland, Iceland, Norway, Sweden, the Faroe Islands, Greenland and Åland. Co-operation reinforces the sense of Nordic community while respecting national differences and similarities, makes it possible to uphold Nordic interests in the world at large and promotes positive relations between neighbouring peoples.

Co-operation was formalised in 1952 when *the Nordic Council* was set up as a forum for parliamentarians and governments. The Helsinki Treaty of 1962 has formed the framework for Nordic partnership ever since. The *Nordic Council of Ministers* was set up in 1971 as the formal forum for co-operation between the governments of the Nordic countries and the political leadership of the autonomous areas, i.e. the Faroe Islands, Greenland and Åland.

Content

Preface	7
Abstract	9
1. Background and Objective	15
2. Terms and Abbreviations	17
3. Incineration of Plastics Containing Brominated Flame-Retardants	19
3.1 Plastics from EE-waste	19
3.2 Emissions of brominated flame-retardants	20
3.3 Formation and emissions of chlorinated, brominated and brominated/chlorinated dioxins	20
4. Former Incineration Tests	23
4.1 Brominated and brominated/chlorinated dioxins	23
4.1.1 Incineration tests in pilot plants	23
4.1.2 Measurements at full scale plants	25
4.1.3 Comparison of test programs from earlier tests	25
4.2 Brominated flame-retardants	27
4.3 Studies of other bromine compounds at Klemetsrud Plant, Norway	29
5. Incineration Tests at Three Norwegian Waste Incineration Plants	31
5.1 Measurement program	31
5.2 Characterization of the brominated waste	32
5.3 Description of plants and sampling points	34
5.3.1 Klemetsrud Plant	34
5.3.2 Energos Plant	37
5.3.3 FREVAR Plant	38

6.Results.....	39
6.1 Operating conditions	39
6.2 Measurements of gaseous bromine in flue gas before cleaning	39
6.3 Mass balance for bromine	40
6.4 Brominated, chlorinated and brominated/chlorinated dioxins	41
6.5 Brominated flame-retardants (BFRs)	43
Sammendrag	47

Preface

Background

The most common use for BFRs is in building materials, textiles and electronic supplies, e.g. TVs, PCs and photocopiers. In incineration plants with good combustion BFRs will decompose and form other brominated compounds, mainly hydrogen bromide (HBr).

In addition, other brominated compounds will also be formed, in particular brominated organic compounds, such as dioxins where chlorine is fully or partly substituted by bromine (brominated and brominated/chlorinated dioxins).

There have been few Studies regarding incineration of plastics containing BFRs at full-scale incineration plants with a modern flue gas cleaning system.

The Norwegian Ministry of the Environment presented in the autumn of 2002 a working plan for reducing the emissions and discharges of BFRs. One action is to investigate the emissions from incineration of waste containing BFRs.

The project has been organised as follows:

Management group:

- Håkon Jentoft, Norwegian Solid Waste Assosiation (NRF)
- Bernt Ringvold, Norwegian Pollution Control Authority (SFT)
- Ole Viggo Svendsen, Elektronikkretur AS
- Tor Christian Svendsen, Hvitevareretur AS
- Hallgeir Betele, Renas
- Fredrik Eide Aas, Stena Miljø AS
- Gerhard Dürbeck, Oslo kommune renovasjonsetaten
- Nordic working group for Thermal Treatment

Reference group:

- NRF's working group for Thermal Treatment
- NRF has been the secretary for the project.

The work has been done by Kjelforeningen Norsk Energi. Authors are Dag Borgnes and Bente Rikheim.

Abstract

Project objective

The objective of the project is to investigate the emissions of dioxin-compounds that may occur from incineration of plastic waste containing brominated flame retardants (BFRs) together with waste from households and the commercial sector. The decomposition of BFRs will also be investigated.

The project results will serve as a basis for both the authorities and the owners of incineration plants, to make decisions about whether, and under what conditions, this type of waste may be incinerated.

Literature search and initial studies

The objective of the literature search and initial studies is to establish a detailed program for measurements. It should also be the basis for comparison and evaluation of the results from the measurements.

Studies in small-scale pilot plants

Incineration tests with waste containing BFRs have been carried out in small-scale pilot plants in Sweden (University of Umeå) and in Germany (TAMARA Plant).

The results from Sweden, where the content of bromine was increased up to 1-2 % by weight, showed that the concentration of halogenated dioxins in untreated flue gas was significantly higher with BFRs than without.

At the TAMARA-Plant, the content of bromine varied from 0 to approximately 0,2 % by weight. Increasing the content of bromine showed no increase in the concentration of chlorinated dioxins, or in brominated or brominated/chlorinated dioxins in untreated flue gas.

Measurements on full-scale plants

Studies of emissions of brominated dioxins to air were earlier carried out on incineration plants in Denmark, Sweden and Norway. Measurements performed in Denmark also included brominated/chlorinated dioxins. All plants were equipped with advanced flue gas treatment systems. Measurements were performed during incineration of waste from households and the commercial sector (waste with low BFR content), and results showed very low levels for all analysed dioxins.

There is little relevant data of emissions of BFRs from waste incineration plants. We have found results from emission measurements carried out at a Japanese incineration plant burning plastic waste containing

BFRs, mixed with waste from households and the commercial sector. Total input of BFRs was less than 500 g/hr, and the emission to air of PBDE (polybrominated diphenyl ethers) and TBBPA (tetrabromobisphenol) was respectively 3,5 and 8 ng/Nm³.

Incineration tests at three Norwegian plants

The main goal of the incineration tests was to establish the flue gas concentration of brominated, chlorinated and brominated/chlorinated dioxins before and after flue gas cleaning, and with different proportions of plastic waste containing BFRs. To verify the input, the contents of bromine and chlorine in all output flows (bottom ash, fly ash, scrubber water and flue gas) were analysed. The decomposition of BFRs was investigated by analysing BFRs in output flows.

Execution of tests

The incineration test included sampling and analysis at two larger plants for mixed municipal waste, and one smaller plant for ground/shredded industrial waste. The brominated waste added was waste from a plant for demolition of electric and electronic devices. It was estimated to contain approximately 1 % by weight bromine. Approximately 80% of this contained PBDE.

The most extensive measurements were performed at the largest municipal waste incineration plant in Oslo (Klemetsrud Plant). The plant has two incinerator lines, each with the capacity of incinerating 10 tons of waste per hour. Each line is equipped with a flue gas cleaning system, consisting of a bag house filter with active coal injection, and a wet scrubber.

At this plant sampling and analysis were carried out in three different situations:

- No addition of brominated waste
- Mix with 5 % by weight brominated waste; i.e. approximately 0,05 % by weight bromine in total waste.
- Mix with 10 % by -weight brominated waste; i.e. approximately 0,1 % by weight bromine in total waste.

At the second plant (FREVAR Plant, Fredrikstad) measurements were carried out with no addition of BFRs.

At the third and smaller plant (Energos Plant, Ranheim) measurements were performed incinerating a mix with 0 and 20 % by weight bromine containing waste (i.e. 0,2 % by weight bromine in the total mix).

Results and conclusions

The incinerating conditions during sampling and measurements at Klemetsrud Plant (Oslo) were normal for the plant, with average CO-levels at approximately 20-30 mg/Nm³. During sampling at the FREVAR Plant average CO-levels were approximately 50 mg/Nm³. At FREVAR Plant they also experienced some problems with the fabric filters during the measurements.

At the Energos Plant (Ranheim) CO was not detectable, which indicates that incineration was good.

Bromine in output flows


Measured results for gaseous bromine in untreated flue gas during incineration of normal waste mix indicates a bromine content equal to or lower than what is common for waste from households and the commercial sector.

Measured results of bromine in output flows at Klemetsrud Plant (Oslo) and at the Energos Plant (Ranheim) indicate that the content of bromine in the plastic mixture was correctly estimated.

Brominated flame retardants (BFRs)

The amount of BFRs in the waste mixture used in the tests at Klemetsrud Plant (Oslo) was not analysed, but calculated/estimated to be approximately 30 kg/hr. The measured results confirm that BFRs decompose in the incineration process. The amount of BFRs in output flows is less than 0,001 % by weight of the total amount of BFRs in the waste mix (see figure below).

Observed input and output flows of brominated flame retardants at Klemetsrud Plant (Oslo) with 10 % by weight addition of brominated waste.

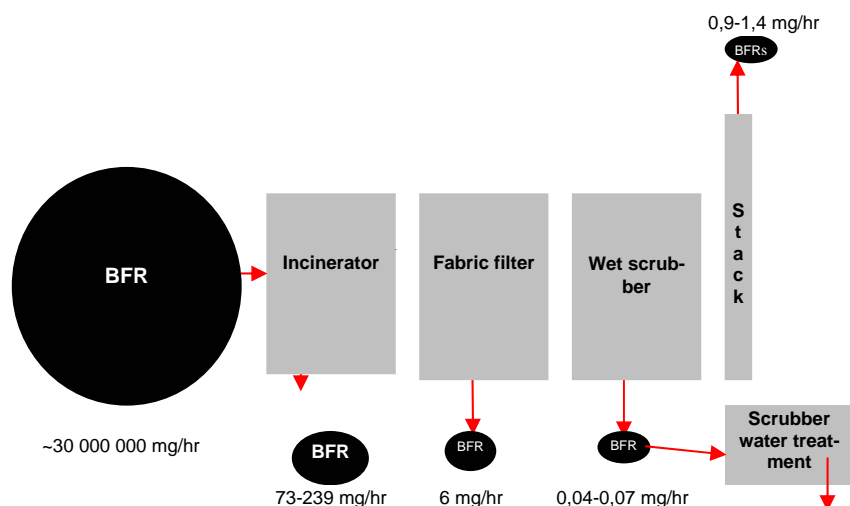

The concentration of BFRs in flue gas from Klemetsrud Plant (Oslo) was 14-22 ng/Nm³. This equals 0,9-1,4 mg/hour and approximately 0,01 kg/year, assuming 8000 running hours/year at the same emission level. A Danish study (Miljøstyrelsen, 1999) estimates the total national Danish emissions of BFRs from incineration to be < 0,04 tons. A report from the Norwegian National State Pollution Control Authority (SFT), estimates the national emissions from combustion in Norway to be < 0,01 tons (1998), i.e. < 10 kg/year.

At the Energos Plant (Ranheim) the reported concentration of BFRs in the flue gas was <5 ng/Nm³.


The concentration of BFRs in bottom ash from the tests at Klemetsrud Plant (Oslo) shows levels far below the threshold value stated in the Hazardous Waste Directive.

DekaBEDE and TBBPA (Tetrabrombisphenol A) are the dominating compounds of BFRs in the bottom ash at Klemetsrud Plant (Oslo). In the flue gas dekaBEDE has the highest concentration level.

Concentration of dioxins in emissions to air (after cleaning)


The figure below shows emissions of chlorinated, brominated and chlorinated/brominated dioxins without any addition of brominated waste, and with the addition of 5 % by weight, 10 % by weight and 20 % by weight bromine containing waste.

Emissions of chlorinated, brominated and chlorinated/brominated dioxins. The results are reported as actual emission, not toxic equivalents.

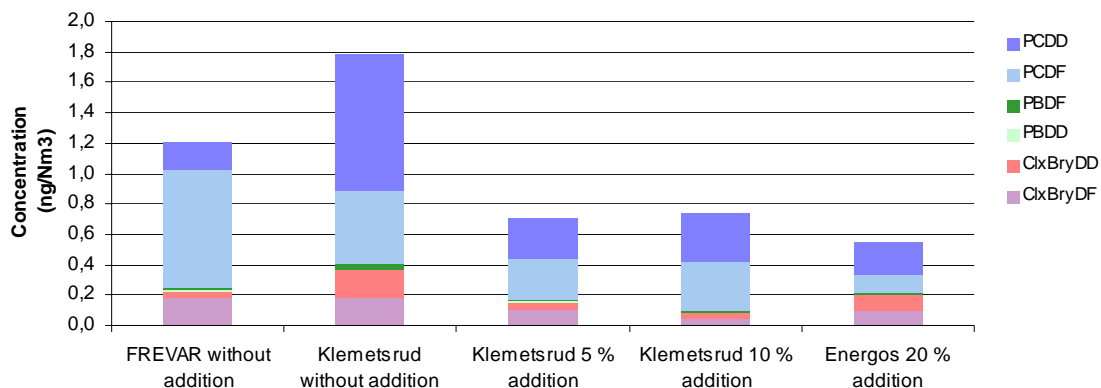

Emissions of chlorinated dioxins (PCDDs/Fs), in terms of Nordic toxic equivalents, resulting from the addition of brominated waste, are presented in the figure below.

Emissions of chlorinated dioxins (PCDDs/Fs), in terms of Nordic toxic equivalents, resulting from addition of brominated waste.

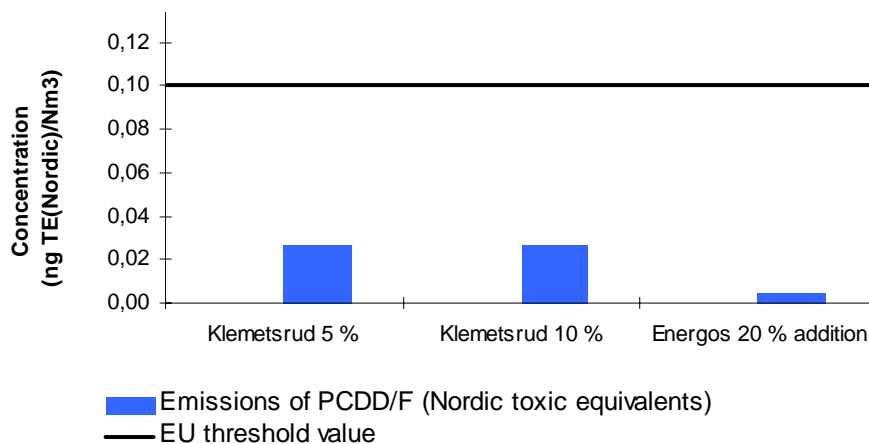

Uncertainty in sampling and analysis, variations in operating conditions and waste mixture, differences between laboratories with respect to methods of analysis (especially dioxins), makes comparison of results difficult. We may although draw the following main conclusions:

- Increasing the content of BFRs in the waste gave no significant increase in the emissions of chlorinated dioxins, or either brominated and chlorinated/brominated dioxins
- The emission level is highest for chlorinated dioxins, lower for chlorinated/brominated dioxins and lowest for brominated dioxins


- The emission levels for chlorinated dioxins, reported as Nordic toxic equivalents, are low compared to emission threshold value in the EU-directive for incineration of waste. The reported emission levels were 0,03 ng/Nm³ and 0,006 ng/Nm³ respectively for the Klemetsrud Plant (Oslo) and Energos Plant (Ranheim), and the EU threshold value is 0,1 ng/Nm³.
- The emission measurement results indicate that the incineration efficiency and the operating conditions of the flue gas treatment systems are of greater importance to the resulting emission levels for dioxins, rather than the bromine content level.

Concentration of dioxins in emissions before and after cleaning

Measurements of dioxins in the flue gas before and after flue gas cleaning were carried out with addition of 10 % by weight bromine containing waste at the Klemetsrud Plant (Oslo)

The concentration of chlorinated/brominated dioxins before cleaning was approximately 28 ng/Nm³, which was three times the concentration of chlorinated dioxins. After cleaning the concentration was approximately 0,1 ng/Nm³. This gives a removal efficiency for chlorinated/brominated dioxins of >99% and for chlorinated dioxins approximately 93%. The removed dioxins end up in the fly ash from the fabric filter, which is treated as hazardous waste.

Concentration of chlorinated, brominated and chlorinated/brominated dioxins in flue gas before and after flue gas cleaning, Klemetsrud Plant (Oslo). The levels are given as actual measured levels, not corrected for toxicity.

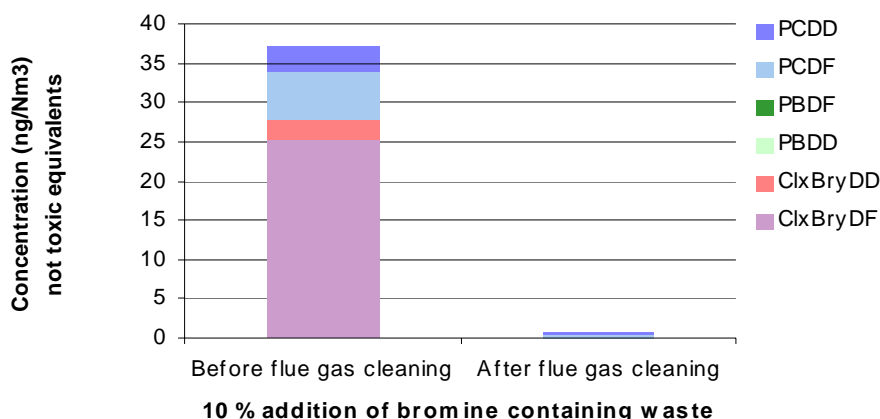

1. Background and Objective

The most common use of BFRs is in building materials, textiles and electronic supplies, e.g. TVs, PCs and photocopiers. In incineration plants with good combustion BFRs will decompose and form other brominated compounds (Söderström, G. et al, 2000), mainly hydrogen bromide (HBr) (Vehlow, J. et al, 1998). Additionally, other brominated compounds will also be formed, in particular brominated organic compounds, such as dioxins where chlorine is fully or partly substituted by bromine (brominated and brominated/chlorinated dioxins).

The formation of brominated/chlorinated dioxins during incineration of waste with BFRs has been proven earlier, in the project “Co-incineration of brominated flame-retardants and MSW in small-scale reactor” in 2000 (financed by the Nordic PA-group and documented in TEMA-Nord Report No 2001:512). The tests were carried out at Umeå University, in at laboratory pilot plant with no flue gas treatment.

There have been few studies regarding incineration of plastics containing BFRs at full-scale incineration plants with a modern flue gas cleaning system.

The Norwegian Ministry of the Environment presented in the autumn of 2002 a working plan for reducing the emissions and discharges of BFRs. One action is to investigate the emissions from incineration of waste containing BFRs.

The objective of the project is to investigate the emissions of dioxin-compounds that may occur from incineration of plastic waste containing brominated flame-retardants (BFRs) together with waste from households and the commercial sector. The decomposition of BFRs will also be investigated.

The project results will serve as a basis for both the authorities and the owners of incineration plants, to make decisions about whether, and under what conditions, this type of waste may be incinerated.

This report is based on separate reports from incineration tests at Klemetsrudanlegget (Oslo) (Kjelforeningen-Norsk Energi, 2004), and at FREVAR (Kjelforeningen-Norsk Energi, 2004b), which also include detailed description of measurement methods and analysis results.

The incineration tests at Energos Ranheim are reported in a report from TÜV Nord Umweltschutz (2003).

2. Terms and Abbreviations

Brominated flame-retardants (BFRs)

Name specific compound	IUPAC-no. [*]	Abbreviation	Abbreviation groupname	Groupname
TBA		TBA	TBA	Tribromanisol
4,4'-DiBB	15	DiBB	PBB	Polybrominated Biphenyls
2,2',4,5'-TetBB	49	TetBB		
2,2',5,5'-TetBB	52			
2,2',4,4',5,5'-HexBB	153	HeksaBB		
2,4,4'-TriBDE	28	TriBDE	PBDE	Polybrominated diphenyl ethers
2,2',4,4'-TetBDE	47	TetBDE		
2,3',4',6'-TetBDE	71			
3,3',4,4'-TetBDE	77			
2,2',4,4',5-PenBDE	99	PeBDE		
2,2',4,4',6-PenBDE	100			
2,3',4,4',6-PenBDE	119	HexBDE		
2,2',3,4,4',5'-HexBDE	138			
2,2',4,4',5,5'-HexBDE	153			
2,2',4,4',5,6'-HexBDE	154			
2,2',3,4,4',5',6-HepBDE	183	HepBDE		
DecaBDE	209	DecaBDE		
TBBPA		TBBPA		
alpha-HBCD		HBCD	HBCD	Hexabrom-cyklododecane
beta-HBCD				
gamma-HBCD				

^{*} Indexes according to International Union of Pure and Applied Chemistry (IUPAC).

Chlorinated dioxins (PCDD+PCDF)

PCDD = polychlorinated dibenzo-p-dioxins

PCDF = polychlorinated dibenzofurans

Brominated dioxines (PBDD+PBDF)

PBDD = polybrominated dibenzo-p-dioxins

PBDF = polybrominated dibenzofurans

Brominated/chlorinated dioxins (ClxBryDD+ClxBryDF)

ClxBryDD, PXDD = polychlorinated/brominated dibenzo-p-dioxins

ClxBryDF, PXDF = polychlorinated/brominated dibenzofurans

3. Incineration of Plastics Containing Brominated Flame-Retardants

3.1 Plastics from EE-waste

Brominated flame-retardants are being found in i.e. electric and electronic (EE) products. In Norway and Sweden there is established extensive collection systems for discarded EE products. As a consequence of new EU regulations, similar systems will have to be established in all EU/EEA countries within the end of 2005.

Table 1 shows the amounts of plastics from EE-waste, based on the information from collection companies in Norway (Svendsen, T. C., 2003).

Table 1 Amounts of plastics from EE-waste, based on the information from collection companies (tons/år)

Collection company	Separated plastics (tons/år)	Plastics in shredderfluff (tons/år)
Elektronikkretur AS	1800	180
Hvitevareretur AS	150	4000
RENAS AS	45	239
Total	1995	4419

As will be seen from Table 1, approximately 2000 tons separated plastics is generated yearly from EE-waste. This is bigger plastic items with and without BFRs, which relatively easy may be sorted out manually, for example the cover of a data monitor, back-cover of a TV and soap container in a dishwasher. These plastic components will mainly be incinerated in advanced waste incinerators with adequate flue gas cleaning.


The largest amount of plastics will however be found in the so-called shredderfluff, with an amount of approximately 4400 tons/year. Shredderfluff is the waste fraction from wrecked car/scrap metal fragmenting plants, and it contains (among other things) a mix of plastics, rubber, wood, concrete, and small amounts of metals. In Norway, shredderfluff is normally deposited in landfills.

3.2 Emissions of brominated flame-retardants

The most applied brominated flame-retardants are the group polybrominated diphenylethers (PBDE) and the compounds tetrabromobisphenol A (TBBPA) and hexabromocyclododecane (HBCD).

Figure 1 shows an example of polybrominated diphenylethers (DeBDE), TBBPA and HBCD.

Figure 1 Polybrominated diphenylether (DeBDE), TBBPA og HBCD.

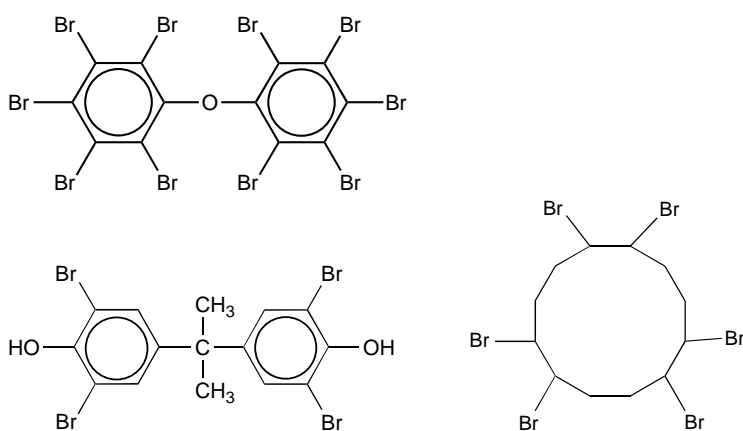

Decabromodiphenyl ether (DeBDE)
Hexabromocyclododecane (HBCD)

Tetrabromobisphenol A (TBBPA)

In incinerators with good combustion, the BFRs will decompose and form other brominated compounds (Söderström, G. et al, 2000), mainly hydrogenbromide (HBr) (Vehlow, J. et al, 1998).

3.3 Formation and emissions of chlorinated, brominated and brominated/chlorinated dioxins

Chlorinated dioxins is a collective term for organic compounds consisting of dibenzo-p-dioxins and dibenzofurans with 1-8 chlorine substituents in different positions. This gives a total 210 different polychlorinated dibenzo-p-dioxins (PCDD) and polychlorinated dibenzofurans (PCDF). Chlorinated dioxins and furans are often referred to as "dioxins".


Brominated dioxines is a collective term for the corresponding 210 organic compounds substituted with bromine instead of chlorine. These are normally also referred to as PBDD og PBDF (polybrominated dibenzo-p-dioxins og polybrominated dibenzofurans).

Brominated/chlorinated dioxins includes dibenzo-p-dioxins and dibenzofurans with both bromine and chlorine substituents, in total 4600 different compounds. See figure 2.

Air emissions of chlorinated dioxins are regulated through the standard regulations for incineration, and the emissions are checked every 6 or 12 months. The emission limit value is given in terms of toxic equivalents, which is generated by weighted calculation, giving each compound a relative weight value between 0 and 1, depending on the toxicity. 2,3,7,8-tetrachlorine dibenzo-p-dioxin is known as the most toxic compound, and therefore has the relative weight value 1.

Toxic equivalents terms is however not established for compounds of brominated and brominated/chlorinated dioxins.

Figure 2 Brominated/chlorinated dibenzo-p-dioxins and dibenzofurans

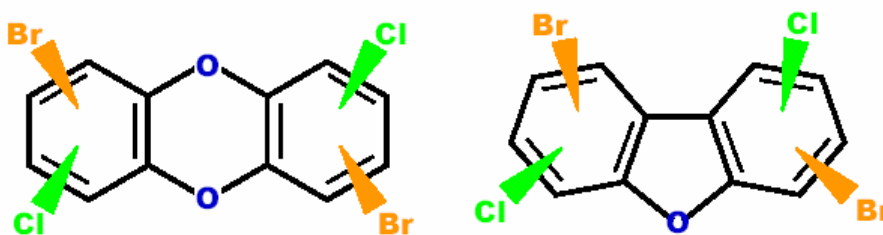

Formation of dioxins

The formation of dioxins during incineration has been studied extensively for nearly 30 years.

Different formation mechanisms has been found:

- De Novo synthesis
- Precursor reactions
- Secondary halogenations in flue gas

In the de Novo synthesis, the formation takes place by chlorination of compounds in flue gas containing carbon. The chlorination step is assumed to occur as HCl combine to form Cl_2 (the Deacon-reaction), with subsequently chlorination of aromatics. The Deacon-reaction is catalysed by (among others) compounds of copper, and is favoured by oxygen excess.

Chlorinated dioxins may also be formed from precursors, for example chlor-phenols, which can condensate on particle surfaces, and also by halogenation of non-chlorinated dioxins and furans in flue gas. Studies have shown that the highest formation of dioxins takes place at temperatures between 200-600° C.

Emissions of dioxins may also occur if the incinerated waste or the added combustion air contains dioxins. To minimize the formation of chlorinated dioxins, one has found the following to be important:

- Short residence time at temperatures favouring dioxin formation
- Efficient combustion
- Minimize chlorine content in waste
- Minimize particle content in flue gas
- Increased sulphur/chlorine content ratio
- Minimize oxygen excess
- Minimize content of metals which can act as catalysers (especially copper)

Several studies have shown that there is no clear relation between the rate of dioxin formation and the chlorine content (SFT, 1994) (Wikström, E., 1999). However, some waste incineration tests indicate that dioxin formation increases with increasing chlorine content, when the chlorine content exceeds a certain value.

Several studies of waste incineration have shown that combustion efficiency is of greater importance for the dioxin formation, rather than the chlorine content.

Formation mechanisms for brominated and brominated/chlorinated dioxins are less investigated. It is however reasonable to assume that mechanism has similarities with the formation mechanism of chlorinated dioxins.

Incineration plants which comply with the regulations of the EU-directive for waste incineration, are all equipped with flue gas cleaning systems which reduce the concentration of chlorinated dioxins in the flue gas substantially. The similarities between chlorinated, brominated and brominated/chlorinated dioxins indicates strongly that the cleaning efficiency is also high for brominated and brominated/chlorinated dioxins.

4. Former Incineration Tests

Swedish, Danish and Finnish environmental authorities has been contacted to get data from incineration tests including measurements of brominated and brominated/chlorinated dioxins.

Information has also been gathered from universities and research communities in Sweden, Denmark and Germany, and also through search on the Internet. Articles from the last three Dioxin conferences (2001, 2002, 2003) are also examined.

The objective of this work has been to establish a detailed measurement program. The possibility to estimate input amounts of bromine from measurements/calculations of output bromine containing flows (bromine in bottom ash, fly ash, flue gas and scrubber water) is also investigated. The work should also form basis for comparison and evaluation of measurement results from the incineration test.

4.1 Brominated and brominated/chlorinated dioxins

4.1.1 Incineration tests in pilot plants

Emissions and formation of brominated dioxins is investigated in a pilot plant in Germany. The TAMARA Plant has a capacity of 250 kgs of waste per hour, and is equipped with textile filter, quenching and a wet scrubber. At this plant incineration tests of polystyrene- and polyurethane foam containing BFRs has been carried out, together with waste from households and smaller industries/businesses (Vehlow, J. et al, 1996).

The incineration temperature was ranging from 850 to 950 °C. The additional inputs of bromine during the tests were ranging up to 6 times the original bromine content in the household waste.


Measurement results showed low concentrations of brominated dioxins, and the study concluded that incineration of limited amounts of specific foams in efficient plants with “state of the art” flue gas cleaning, is environmentally acceptable.

Tests with incineration of plastics from EE-waste, together with waste from households and smaller industries/businesses, have also been carried out in the TAMARA Plant (Vehlow, J. et al, 1997). The tests included four different types of plastics, with different contents of bromine.

Measurements of brominated, chlorinated, and brominated/chlorinated dioxins in flue gas, both prior to and after cleaning, were carried out. The tests also included analysis of bromine content in the plastics, bromine-,

chlorine- and antimony-content in bottom ash, fly ash and flue gas before cleaning. Antimony is often added to enhance the effect of BFRs. It was concluded that EE-waste containing bromine and bromine and chlorine did not increase the total formation of dioxins. Figure 3 shows concentration levels of PCDDs/Fs and Cl_xBr_yDDs/Fs in flue gas before cleaning as a function of the bromine content in the waste.

Figur 3 Concentration levels of PCDDs/Fs and Cl_xBr_yDDs/Fs in flue gas before cleaning as a function of the bromine content in the waste, recorded from incineration tests with EE-waste at TAMARA Plant, Germany (Vehlow, J. et al, 1997).

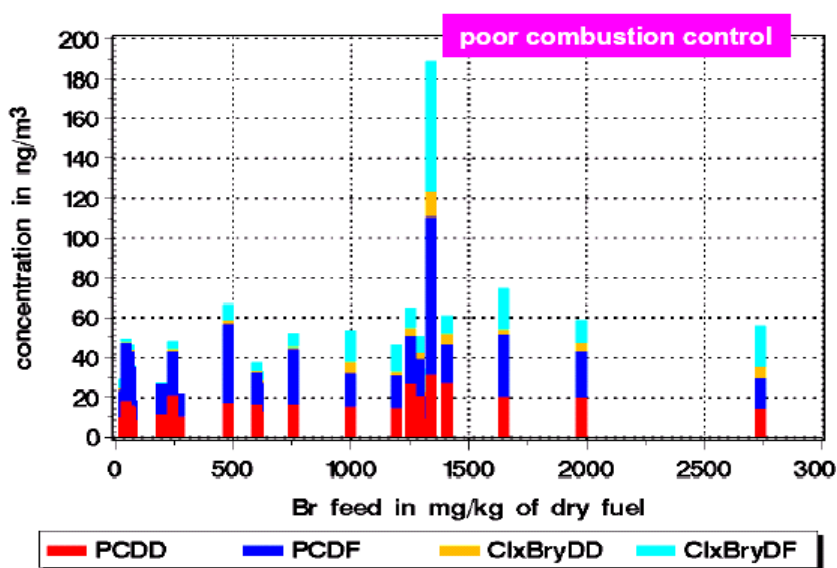

The formation of brominated dioxins from co-incineration of household waste and brominated flame-retardants is investigated in a 5kW incineration reactor (fluidised bed) in pilot scale at the university of Umeå (Söderström, G. et al, 2000). Different types of flame-retardants were added in amounts corresponding to a "worst case scenario" for batch wise incineration of flame retarded products med BFRs. The incineration temperature was slightly above 800 °C.

The results from the studies in Umeå showed that the formation of halogenated dioxins were much higher when adding BFRs, than with only chlorine present. Additionally, the study showed that bromine caused significant higher formation of halogenated dioxins than the equal amount of chlorine, which is assumed to relate to the ratio between Br₂ and HBr, which again is substantially different from the ratio between Cl₂ and HCl. The conclusion from the study is that batch incineration of wastes containing BFRs should be avoided.

4.1.2 Measurements at full scale plants

In 2002 measurements of emissions of brominated dioxins were carried out at Energos Hurum Plant, Norway (Energos Hurum Energigjenvinning) with normal waste composition (wastes from households and small industries/businesses).


It was found 0,003 ng/Nm³ tetrabrominated dibenzo-p-dioxins. Concentrations of other single compounds were lower than the detection limit, i.e. than 0,0001-0,02 ng/Nm³. Note that the concentrations is given as actual measured values, not as toxic equivalents (Energos ASA, 2002).

In 1999 measurements of brominated dioxins were carried out at Uppsala Energi, Sweden and at Renova, Gothenburg, during incineration of ordinary municipal waste. Both plants are equipped with advanced flue gas cleaning systems, with low emissions of chlorinated dioxins (substantially lower than 0,1 ng/Nm³ in 1999). The emissions of brominated dioxins were lower than the detection limit for the measurements, i.e. < 0,05 ng/Nm³ for all measured dioxins (Westas, H., 2000).

Autumn 2002, Danmarks Miljøundersøgelser carried out a study regarding the content of brominated, chlorinated and brominated/chlorinated dioxins in flue gas and in remains from flue gas cleaning at Vestforbrænding (VF) (wastes from households and small industries/businesses) and Kommunekemi (KK) (hazardous waste) (Vikelsøe, J., 2000). Both plants were equipped with advanced flue gas cleaning systems.

Figure 4 shows comparison of PBDDs/Fs and PCDDs/Fs in flue gas from the plants after cleaning

Figur 4 Comparison of PBDDs/Fs and PCDDs/Fs in flue gas from Vestforbrænding and Kommunekemi (after cleaning). PBDDs/Fs total "B-TEQ" og PCDD/F I-TEQ, ng/Nm³. (Vikelsøe, J., 2000).

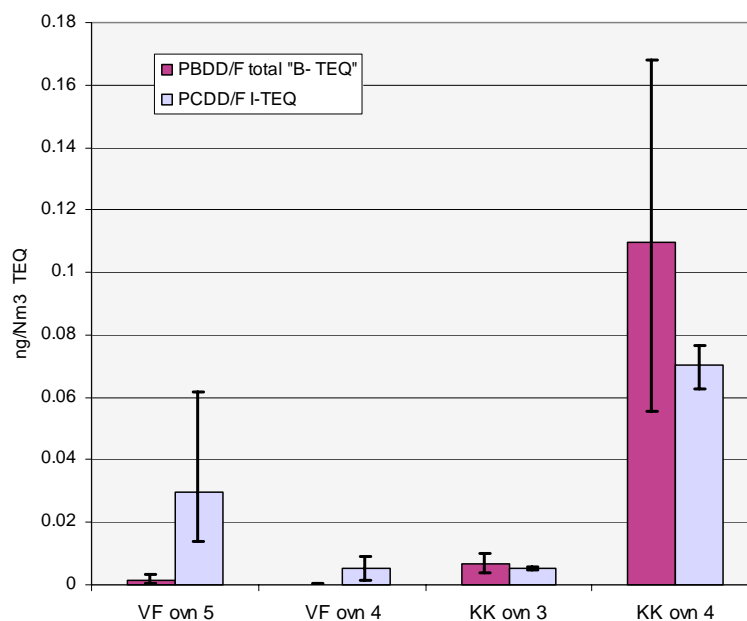

4.1.3 Comparison of test programs from earlier tests

Table 2 shows the added amount of bromine/brominecontaining plastics in earlier testprograms in small-scale pilot plants.

Table 2 Former test programs/measurements

Plant/test description	Bromine content		Bromine content
	Share BFR-plastics [% by weight]	in BFR-plastics [% by weight]	in waste [% by weight]
TAMARA Polystyrene- and polyurethane foam + waste from households and small industry/ businesses	1-3	2,2-4,2	0,02-0,08
TAMARA Plastics from EE-waste + waste from households and small industry/ businesses	3-12	0,4-1,5	0,01-0,18
Umeå University Waste from households and small in- dustry/businesses added different BFRs	-	-	0,9-1,7

Table 3 shows the measurements included in incineration tests with brominated dioxins and/or chlorinated/brominated dioxins.

Table 3 Measurements included in incineration tests with brominated dioxins and/or chlorinated/brominated dioxins

	Analyzed param- eters	Analyzed param- eters	Analyzed param- eters	Additional analy- zed parameters
	in waste	Raw flue gas	Clean flue gas	
TAMARA PS- og PU- foam + waste from households and small industry/ businesses	Bromine, chlorine	PXDDs/Fs		Bromine in fly ash
TAMARA Plastics from EE-waste + waste from households and small industry/ businesses	Bromine, chlori- ne, antimony (Sb), PXDDs/Fs ⁰⁾ and flame- retardants ¹⁾	Bromine (HBr, Br ₂) , chlori- ne, antimony (Sb), PXDDs/Fs	PCDDs/Fs Non-brominated dioxins	Bromine, chlori- ne, antimony (Sb) in bottom- and flyash
Umeå Universitet Waste from households and small businesses added different BFRs	Bromine, chlorine and flame- retardants ²⁾	Cl ₂ , HCl, Br ₂ , HBr, PXDDs/Fs ³⁾		
Uppsala Energi, Renova Waste from households and small industry/businesses			PXDDs/Fs	
Vestforbrænding Waste from households and small industry/businesses			PXDDs/Fs	PXDDs/Fs in residue from flue gas cleaning
Kommunekemi Hazardous waste			PXDDs/Fs	PXDDs/Fs in residue from flue gas cleaning

0) PXDDs/Fs: Dioxins containing bromine and/or chlorine
PBB, PBDE, TBBA
DeBDE, TBBP-A, HBCD
PCDD, PCDF, TeBCDD, TeBCDF, TeBDF, TeBDD

Relatively extensive incineration tests, with different input of bromine, have been carried out at pilot plants both in Sweden and Germany. In both tests analysis were carried out with respect to brominated and brominated/chlorinated dioxins on raw flue gas only (before cleaning).

Analysis of brominated dioxins in flue gas after cleaning is carried out on some Swedish and Danish waste incineration plants, with normal waste composition.

Our literature search and preliminary studies indicated clearly a need for more incineration tests and studies of brominated and brominated/chlorinated dioxins, especially in full scale plants. The scope of former studies indicates that the main goal with such tests should be to decide the concentrations in flue gas of brominated, chlorinated and brominated/chlorinated dioxins before and after cleaning, and at different levels of bromine content in the waste. To verify the input of bromine and chlorine, all output flows (bottom ash, fly ash, water from scrubbers and flue gas) should also be analyzed for bromine and chlorine.

4.2 Brominated flame-retardants

An article presented by Chen, Y. et al (Dioxin 2003) reports from sampling and analysis of emissions of BFRs and brominated dioxins carried out at an incineration plant burning wastes from households and small industry/businesses. The plant is not described in the article, nor the waste or the operating conditions of the plant. The method used to determine BFRs and dioxins is not the same as the methods used in the tests at Klemetsrud Plant, Oslo and Energos Plant, Ranheim. It is carried out five series of measurements of air emissions from a waste incinerator and 3 series from an electric smelter. Average results are quoted in Table 4. Seven congeners of PBDE (BDE-28, -47, -100, -99, -154, -153, -183) was detected in all the samples. The three most dominating congeners is BDE -47, -99 og -28 and both the tests shows equal distribution between the congeners.

Table 4 Emissions of BFRs and brominated dioxins from waste incinerator and electric smelter. (Chen, Y. et al, 2003).

	BFRs (ng/m ³)	Brominated dioxins (ng/m ³)
Waste incinerator	99±31	0,275-4,01
Electric smelter	68±25	0,079-0,485

An article presented by Tamade, Y. et al, Japan (Dioxin 2003) reports from measurements during incineration of plastic waste with BFRs. The measurements include analysis of brominated dioxins and furans, PBDE and TBBPA on the input waste, such as back covers from TVs, dust from

TVs, and also in mass flows from a recovery plant for plastics, and finally in mass flow from an incineration plant.

The incineration plant was equipped with an electric precipitator and a fabric filter. The incinerated waste was a mixture of residues from the plastic waste recovery plant (with BFRs) and waste from households and small industry/businesses. The waste was analysed with respect to content of PBDE, TBBPA and brominated dioxins. Total input amount of PBDE and TBBPA were 18-360 g/hr and 6,2-96 g/hr respectively. Analysis of brominated dioxins and furans in air emissions showed a total concentration of 0,014 ng/Nm³. Air emission of PBDE and TBBPA was 3,5 and 8 ng/Nm³ respectively. Bottom ash and filter dust showed a content of PBDE of 300 and 470 ng/g respectively. The content of TBBPA in bottom ash and filter dust was 20 and 1,3 ng/g respectively.

Due to few studies and lack of emission limit values for BFRs from waste incineration, we have also looked at reported concentration levels in other types of samples.

A study of indoor dust in common households in Germany includes analysis of 40 samples (taken from vacuum cleaners) with respect to 10 different PBDE congeners (BDE-28, -47, -49, -85, -99, -100, -153, -154, -183, -209) (Knoth, W. et al, 2003). The results show huge variations in concentrations between the different congeners, and also between the samples. BDE-209 was the dominating congener in 35 of the 40 samples, as BDE-99 dominated in 4 of the samples. The source for PBDE in the samples was reported unknown, with exception for some samples of dust from mattresses which showed high levels of dekaBDE. Average total concentration of the 10 PBDEs in the 40 samples was determined to 1404 ng/g.

The Norwegian Institute for Air Research (NILU) has taken samples of sediments for analysis of BFRs in the Drammen river, Norway (Fjeld et al, 2004).

Samples of sediment were taken at seven different spots in the river, four samples from the inner Drammensfjord and one sample in the marine environment of the fjord. The sum of PBDEs analysed showed a concentration level of 4-80 ng/g. The BDE-209 congener dominated in all samples.

NILU have also made studies of BFRs in leachate from landfills (Schlabach, M. et al, 2002).

Samples were taken from sediments in leachate from 6 larger landfills. PBBs were not detected in any of the samples. PBDE-209 was detected in all samples, with a concentration level in the range of 0,49-91 ng/g wet weight. The three HBCD-isomeres was detected in almost all samples, and the concentrations was in the range <0,1-84 ng/g wet weight for HBCD. TBBPA was detected in all sediment samples from the landfills, with a concentration level in the range of 01,9-44 ng/g wet weight.

PBDE-209 and HBCD are also detected in samples of moss, which implies that the compounds may be transported by air. NILU has estimated that maximum discharge from a larger landfill might rate up to 1-10 g/year per single compound of PBDE, HBCD and TBBPA. The concentrations found in the investigations are at the same levels as concentrations found in sewage sludge in Sweden.

Table 5 Results from different studies of BFRs

Type of study	BFR-compound	µg/g	ng/m ³
Air emissions from waste incineration	PBDE		99
Air emissions from electric smelter	PBDE		68
Dust from households	PBDE	1,4	
River sediments	PBDE	0,004-0,08	
Sediments from landfill leachate	PBDE	0,0005-0,09	
	HBCD	<0,0001-0,08	
	TBBPA	0,001-0,044	
Bottom ash from incinerator, Japan	PBDE	0,3	
	TBBPA	0,02	
Fly ash from incinerator, Japan	PBDE	0,47	
	TBBPA	0,0013	
Air emissions from incinerator, Japan	PBDE		3,5
	TBBPA		8

Our preliminary studies and literature search indicated clearly a need for more incineration tests and studies of emissions and decomposition of BFRs in connection with waste incineration.

4.3 Studies of other bromine compounds at Klemetsrud Plant, Norway

In 2002 measurements of brominated and brominated/chlorinated organic compounds were carried out at the Klemetsrud Plant in Norway. The measurements were performed by Kjelforeningen-Norsk Energi (Kjelforeningen-Norsk Energi, 2002).

In 1998 incineration tests with EE-waste were carried out at the same plant, and online measurements of a variety of brominated components in flue gas were performed (not dioxins). A portable GC was used for the measurements (Det Norske Veritas, 1998). In parallel measurements of emissions of chlorinated dioxins after flue gas cleaning was performed. The results indicated an increased level of dioxins during incineration of EE-waste. It should be noted that this was before active coal injection and fabric filtration were introduced at the plant.

5. Incineration Tests at Three Norwegian Waste Incineration Plants

Measurements of emissions of brominated and brominated/chlorinated dioxins, and brominated flame-retardants (BFRs) are carried out during incineration of waste with both normal and increased content of BFRs in the waste. For verification of input, analysis of bromine and chlorine in output flows were made. Decomposition of BFRs during incineration was also investigated by analysis of BFRs in output flows.

Tests and measurements were carried out at the following Norwegian plants:

- Klemetsrud Plant, Oslo : municipal waste incinerator, capacity 2 x 10 tons/hr
- Energos Plant, Ranheim : municipal waste incinerator*, capacity 1,5 tons/hr
- FREVAR Plant, Fredrikstad : municipal waste incinerator, capacity 2 x 5 tons/hr

* source separated and shredded waste

5.1 Measurement program

The program for measurements during tests at three Norwegian waste incineration plants are shown in Table 6 below.

Table 6 Program for measurements during tests at three Norwegian waste incineration plants

	Type of waste	Analysed parameters in flue gas before cleaning	Analysed parameters in flue gas after cleaning	Other analysed parameters
Klemetsrud-Plant	Waste from households and small industry/businesses	HCl, Cl ₂ , HBr, Br ₂	Chlorinated, brominated and chlorinated / brominated dioxins	-
	Waste from households and small industry/businesses + 5 % by weight brominated waste	HCl, Cl ₂ , HBr, Br ₂	Chlorinated, brominated and chlorinated / brominated dioxins	-
	Waste from households and small industry/businesses + 10 % by weight brominated waste	Chlorinated, brominated and chlorinated / brominated dioxins HCl, Cl ₂ , HBr, Br ₂	Chlorinated, brominated and chlorinated / brominated dioxins BFRs	Bromine, Chlorine and BFRs in bottom ash, fly ash, flue gas, scrubberwater
FREVAR Plant	Waste from households and small industry/businesses	HCl, Cl ₂ , HBr, Br ₂	Chlorinated, brominated and chlorinated / brominated dioxins	-
Energos Plant	Hospital waste		Chlorinated and brominated dioxins	-
	Industrial waste	HCl, Cl ₂ , HBr, Br ₂	Chlorinated, brominated and chlorinated / brominated dioxins	Bromine, Chlorine and BFRs in bottom ash
	Industrial waste + 20 % by weight brominated waste	HCl, Cl ₂ , HBr, Br ₂	HCl, Cl ₂ , HBr, Br ₂ BFRs	

Sampling and analysis of dioxins during tests with no addition of brominated waste at Klemetsrud Plant, and all sampling and analysis at Energos Plant, were performed by the German consultancy TÜV. Kjelforeningen-Norsk Energi did all other sampling at Klemetsrud Plant, and at FREVAR Plant. NILU laboratory made the analysis of dioxins and BFRs, Eurofins laboratory (Oslo) analysed the flue gas samples, and Analytica laboratory made the bottom ash, filter dust and scrubber water analysis.

5.2 Characterization of the brominated waste

Data from literature regarding bromine content in municipal waste from households and small businesses, indicates typical bromine content of 0,003-0,006 % by weight of bromine. One source (Söderström, G. et al, 2000) reports typical content of 0,004 % by weight from a study in 1992, but that the level has increased the last decade. In comparison is normal chlorine level in municipal waste approximately 0,75 % by weight (Söderström, G. et al, 2000).

The brominated waste added to the municipal waste was generated in a demolition plant for electric and electronic waste (Stena Miljø AS, Oslo). In total approximately 70 tons brominated waste were generated for the incineration tests.

Stena Miljø AS has calculated the level of bromine in the actual mixture (brominecontaining plastics) which were used in the tests at Kle-

metsrud and Energos Plants. The calculations gave the following levels : 27 % by weight brominated plastics, 16 % by weight wooden material, 57 % by weight plastics without bromine (Aass, F.E., 2003a). The bromine level in plastics is reported to be 3-4,5 % by weight, and the bromine level in the total mixture approximately 1 % by weight (Sjølin, S., 2003).

Approximately 80 % by weight of the brominated plastics is reported to contain PBDE (polybrominated diphenylethers).

Exact level of BFRs in the plastics is not known, but is earlier reported to be approximately 12 % by weight (SFT, 2003) (Aass, F.E., 2003b). This is determined mainly from PCs and monitors, and the level relatively uncertain.

A Danish report from 1999 reports the content of TBBPA and other BFRs separately in different electronic products (Miljøstyrelsen i Danmark, 1999). Reported levels are:

- Colour TVs :
 - a) TBBPA 12 % by weight
 - b) BFRs 12 % by weight

- PCs
 - a) TBBPA 12-14 % by weight
 - b) BFRs 12-14 % by weight

Levels in printers, photocopiers and fax-machines are reported to be lower.

As the brominated plastics used in the tests mainly origins from TV- and monitor-cabinets, it is assumed a BFR-level in the plastics of 12 % by weight.

Stena Miljø AS has also reported that the waste mix may contain approx. 1 % by weight PVC (Aass, F.E., 2004), from which on may derive that the chlorine level in the waste is significantly lower than in municipal waste from households and businesses.

The Norwegian State Pollution Control Authority (SFT) has done a preliminary analysis of BFRs in 60-100 kgs of plastic waste from the Stena Miljø AS demolition plant.

The total concentration level of BFRs was determined to be approximately 20 000 mg/kg, i.e. 2 % by weight.

The level of BFRs in the these plastics is therefore lower than the assumed levels for the plastics used in the tests. Still, the samples analysed by SFT may not necessarily be representative for the brominated waste used in the tests. Further, SFT showed that octaBDE and decaBDE was the dominating BFR-compounds, with a level of 8 000 - 9 000 mg/kg for each of the compounds.

Figure 5 shows brominated waste used in the incineration tests (before shredding).

Figur 5 Brominated waste used in the incineration tests (before shredding).




5.3 Description of plants and sampling points

5.3.1 *Klemetsrud Plant*

Measurements are carried out at Oslo Municipality's incineration plant at Klemetsrud in Oslo. The plant incinerates untreated municipal waste from households and businesses in 2 lines, each with a capacity of approx. 10 tons/hr. Each line is equipped with a flue gas cleaning system, consisting of active coal injection, a fabric filter and a wet scrubber.

A sketch of the plant, with marking of the sampling points, is shown in figure 6.

Figure 6 Sketch of Klemetsrud Plant, with marking of the sampling points.

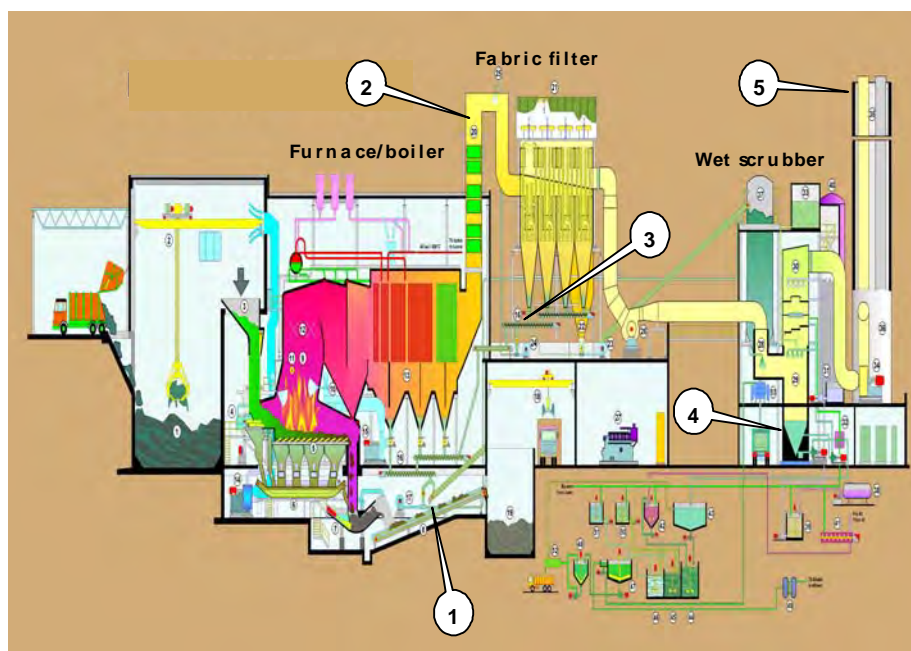

- 1 **Bottom ash** Total bromine, total chlorine. Brominated flame-retardants.
 2 **Raw flue gas** Gaseous bromine and chlorine. Brominated, chlorinated, brominated/chlorinated dioxins
 3 **Filter dust** Total bromine, total chlorine. Brominated flame-retardants.
 4 **Scrubber water** Total bromine, total chlorine. Brominated flame-retardants.
 5 **Cleaned flue gas** Brominated, chlorinated, brominated/chlorinated dioxins. Brominated flame-retardants.

Measurements without addition of bromine containing waste

Measurements of brominated, chlorinated, brominated/chlorinated dioxins were done on line 1 by TÜV in parallel to the annual emission control measurements October 16th -17th 2003. Measurements of total bromine and chlorine in raw flue gas were done on line 2 December 18th 2003 by Kjelforeningen-Norsk Energi.

Measurements with addition of bromine containing waste

The measurements with addition of bromine containing waste were done October 28th and 30th 2003 by Kjelforeningen Norsk Energi.

Measurements were done with two different mixtures:


- Low addition: 5 % by weight addition of bromine containing waste. This mixture gives a feed rate for bromine containing waste of approx. 0,5 tons/hr, i.e. slightly above 5 % by weight. The resulting bromine feed rate was approx. 5 kg bromine/hr.
- High addition: 10 % by weight addition of bromine containing waste. It is possible to feed up to 2 tons/hr of bromine containing waste at line 2 at the Klemetsrud Plant. This is however an unrealistic high share, because it may significantly affect the incineration conditions. A realistic maximum addition is approx. 1 ton/hr (10 % by weight

bromine containing waste). This mixture gives a feed rate of approx. 10 kg bromine/hr.


In order to maintain stable concentrations in output flows from the process, feeding of bromine containing waste to the incinerator has to start in due time before sampling.

Figure 7 shows the calculated theoretical change in concentration of bromine in filter dust, and in circulating fluids in scrubber (HCl-step). One can see from the figure that the concentration level in filter dust during sampling period is approx. 80-90 % by weight of maximum concentration level, and that the actual time of feed start, 24 hours before sampling, was sufficient to maintain a stable concentration level in circulating fluids in scrubber.

Figure 7 Calculated change in concentrations of bromine in filter dust and circulating fluids in scrubber (HCl-step).

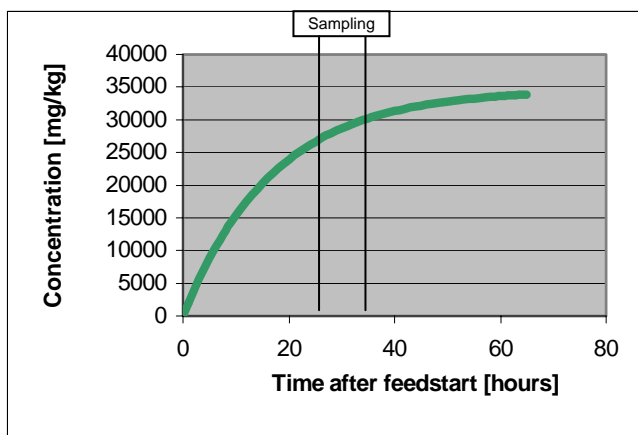

Concentration change in filter dust

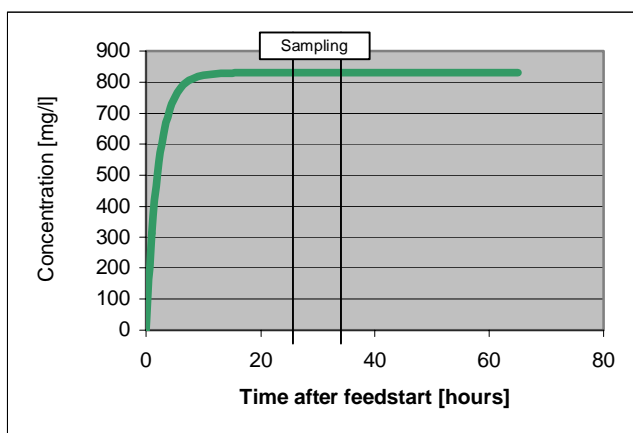

Concentration change in circulating fluids in scrubber

5.3.2 Energos Plant


The Energos Plant at Ranheim incinerates annually approx. 10 000 tons of waste. The plant has approx. 4 MW thermal output, and a steamproduction of approx. 25 GWh/year, supplied to a neighbouring industrial plant, Peterson Linerboard Ranheim (PLR). The waste is a mixture of waste from PLR and other industries.

The flue gas is treated in a fabric filter after injection of coal and lime. Output flows are bottom ash/slag, fly ash and emissions to air from stack.

A flow sheet for the plant is shown in Figure 8. The waste is fed from the storage silo (1) with the conveyor (2) into the 2nd storage (3). From this storage the waste is fed in portions onto the fire grate in the primary chamber of the furnace (4). On the fire grate the waste is dried, gasified and burned-out at sub-stoichiometric conditions. A conveyor brings the waste through the primary chamber, and to the output shaft, where the burned waste falls down as slag. The flue gases are led through the boiler (convection unit) (5) and are cleaned in the fabric filter (8) after addition of activated carbon and lime.

Measurements with and without addition of 20 % by weight of bromine containing waste were carried out November 11th-13th 2003 by TÜV. The sampling points are positioned right into the inlet to the filter (8), and in the vertical outlet of the filter/inlet to stack (9).

Figure 8 Flow sheet for the Energos Plant at Ranheim

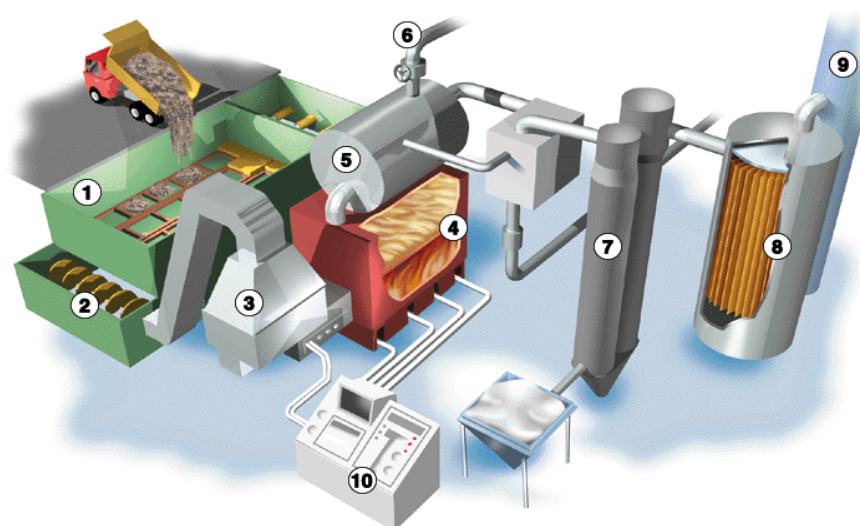

- | | |
|-----------------|----------------------------------|
| 1. Storage silo | 2. Conveyor |
| 3. 2nd storage | 4. Furnace |
| 5. Boiler | 6. Steam system |
| 7. Reactor | 8. Filter system |
| 9. Chimney | 10. Control- / monitoring system |

5.3.3 FREVAR Plant

FREVAR Incineration Plant is owned by Fredrikstad municipality. The plant incinerates approximately

78 000 tons waste annually, using two incineration furnaces. The plant produces 185 GWh steam per year, and has 99 % utilization of the produced energy (FREVAR, 2004).

The waste is fed into the feedershaft with a crane. From the shaft, the waste is fed in portions onto the fire grate. On the grate, the waste is dried, combusted and burned out. The movable grate takes the waste through the furnace to the outgoing shaft, into which the burned waste drops down as slag.

The flue gases are burned in a secondary combustion zone over the grate. The flue gas is cleaned in an electric precipitator, wet scrubber and a fabric filter. Active coal is added prior to the wet scrubber, and activated carbon and lime prior to the fabric filter.


The flue gases from the two furnaces are led in to the same duct before the scrubber, and let out through a joint stack.

FREVAR also has a incinerator for hospital waste. The flue gas from this furnace is quenched and treated through a separate wet scrubber, before it is led in to one of the other furnaces for further combustion and cleaning. Annual control measurements at FREVAR are normally done with the hospital waste incinerator running.

Measurements of gaseous bromine and chlorine, and brominated, chlorinated and brominated/chlorinated dioxins were carried out parallel to the annual control measurements on November 5th 2003, by Kjelforeningen Norsk Energi.

A flow sheet of the plant is shown in Figure 9.

Figure 9 Sketch of the FREVAR incineration plant for household waste (FREVAR, 2004), with sampling points.

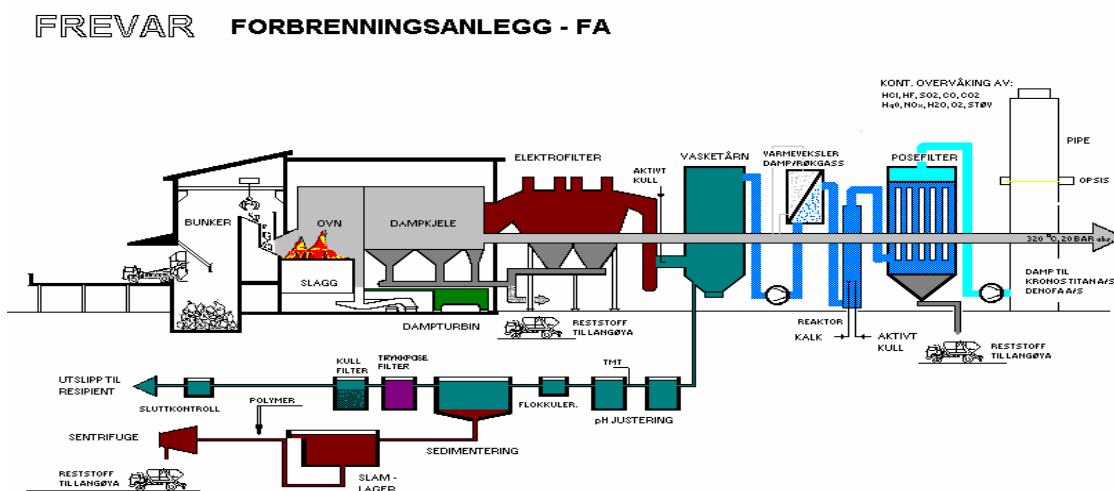

6. Results

6.1 Operating conditions

The combustion conditions were normal during sampling and measurement at the Klemetsrud plant, with CO-levels of approximately 20-30 mg/Nm³. CO-levels during sampling at FREVAR Plant were approx. 50 mg/Nm³. At the Energos Plant, CO was not detected during measurements, which indicates a very effective combustion.

Some problems were experienced with the fabric filter at FREVAR Plant during the sampling period.

6.2 Measurements of gaseous bromine in flue gas before cleaning

Results of measurements of gaseous bromine in flue gas before cleaning are shown in Table 7.

Table 7 Results from measurements in uncleaned flue gas with different addition of bromine containing waste

Plant		Addition of bromine containing waste	Gaseous bromine			
			HBr		Br ₂	
			mg/Nm ³	kg/hour	mg/Nm ³	kg/hour
Klemetsrud Plant	No addition	3,6	0,2	0,1	0,007	
	5 % by weight addition	6	0,4	0,3	0,02	
	10 % by weight addition	40	2,5	2,3	0,1	
FREVAR Plant	No addition	1,2	0,08	<0,5	<0,03	
Energos Plant	No addition	< 2,15	< 0,014	< 2,15	< 0,014	
	20 % by weight addition	97-200 ¹⁾	0,95-1,97	< 2,15	< 0,014	

1) During the approx. 12 hour sampling period, the HBr-concentration in raw flue gas varied from approx. 97 to 200 mg/Nm³, with the highest level during the last sample.

The measurement results for gaseous bromine in uncleaned flue gas, with a normal waste composition, indicates a bromine level equal to, or slightly lower than what is normal for waste from households and small businesses (0,003-0,006 % bromine by weight).


Results from measurements during addition of bromine containing waste, shows a clear increase in the HBr-concentration in uncleaned flue gas, compared to results from measurements with no brominated waste.

At the Energos Plant, gaseous bromine was also measured after the filter. The concentration was $< 2,2 \text{ mg/Nm}^3$, which leads to a removal efficiency of $>97 \%$ for the filter.

6.3 Mass balance for bromine

Figure 10 shows a mass balance for bromine after addition of 10 % by weight bromine containing waste at Klemetsrud Plant.

Figure 10 Mass balance for bromine after addition of 10 % by weight bromine containing waste at Klemetsrud Plant.

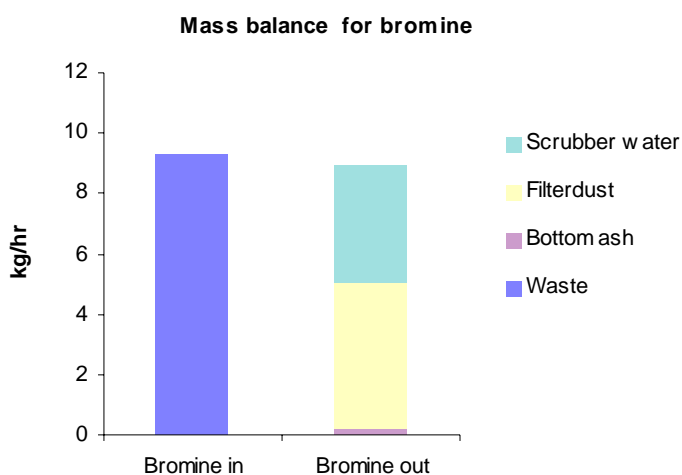

From Figure 10, we can see that the mass balance of bromine from Klemetsrud Plant shows good correspondence between input and output flows in the plant.

At the Energos Plant, 20 % by weight of bromine containing waste was fed into the furnace.

Table 8 shows resulting bromine levels in input and output mass flows.

Table 8 Bromine in input and output mass flows, Energos Plant

Mass flow	Amount (kg/hour)
Bromine in input waste (total input)	2,1
Bottom ash	0,045
Flue gas before filter	0,95-1,97
Flue gas after filter	0,014
Total output (excl. bromine in filterdust)	1,0-2,0


During the approximately 12 hours of sampling and measurement, the bromine content in flue gas before filter varied between approximately 1-2 kgs/hr, with the highest level during the last measurement. According to Energos, it is very likely that the adsorption-/desorption-processes in the boiler system leads to a slow increase of HBr-level in flue gas. Bromine in filterdust is not measured.

6.4 Brominated, chlorinated and brominated/chlorinated dioxins

Concentrations in emissions to air (flue gas after cleaning)

Figure 11 shows resulting emissions of brominated, chlorinated and brominated/chlorinated dioxins with no addition of brominated waste, and with the addition of 5 % , 10 % and 20 % by weight of brominated waste respectively. The results are reported as the actual concentration levels, not as toxic equivalents.

Figure 11 Total emissions of the brominated, chlorinated and brominated/chlorinated dioxins analysed.

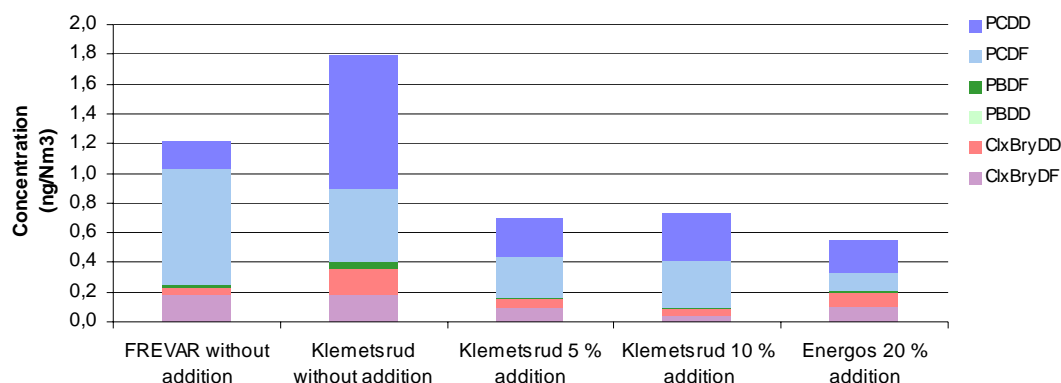

From Figure 11 one can see that the emissions of *chlorinated dioxins* (PCDDs+PCDFs, as actual concentrations, not toxic equivalents) from Klemetsrud Plant were approx. 1,5 ng/Nm³ with no addition of brominated waste, and approx. 0,5 ng/Nm³ with 5 % and 10 % by weight of bromine containing waste. At the FREVAR Plant, the emissions of chlorinated dioxins were approx. 1 ng/Nm³ (with no addition of bromine containing waste). The Energos Plant had an emission concentration of approx. 0,3 ng/Nm³ with the addition of 20 % bromine containing waste.

Further, one can see that the emission of *brominated dioxins* (PBDDs+PBDFs) was very low, both with and with no addition of bromine containing waste.


The emissions of *brominated/chlorinated dioxins* (ClxBryDDs+ClxBryDFs) with no addition of brominated waste (Klemetsrud and FRE-

VAR plants) were apparently higher than with addition of brominated waste (Klemetsrud and Energos plants).

Resulting concentrations of brominated/chlorinated dioxins (ClxBryDDs+ClxBryDFs) during measurements with addition of brominated waste, were less than half of the concentrations of chlorinated dioxins (PCDDs+PCDFs).

The emissions of *chlorinated dioxins (PCDDs/Fs), presented as nordic toxic equivalents*, resulting from addition of brominated waste, is shown in Figure 12.

Figure 12 Emissions of chlorinated dioxins (PCDDs/Fs), presented as Nordic Toxic Equivalents, resulting from addition of brominated waste

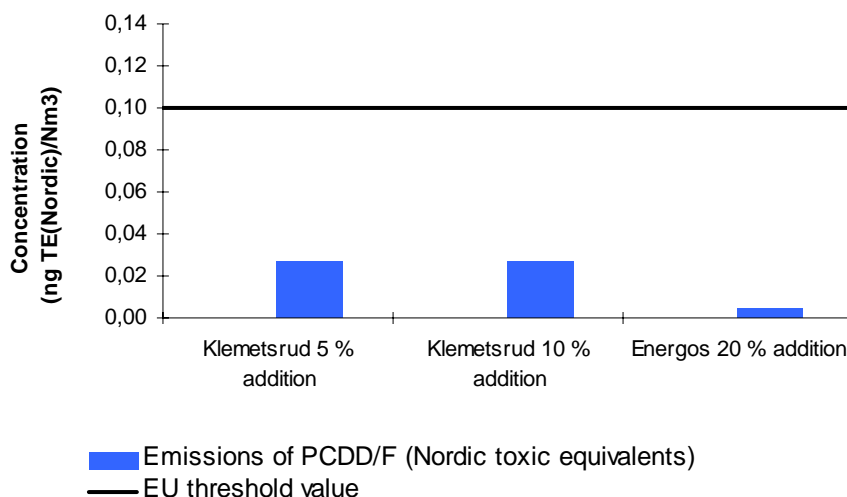

From Figure 12, one can see that the emissions of chlorinated dioxins, presented as Nordic Toxic Equivalents, were approx. 0,03 ng/Nm³ from the Klemetsrud Plant, both with addition of 5 % and 10 % by weight of bromine containing waste. From the Energos Plant, the concentration level was 0,006 ng/Nm³ with addition of 20 % by weight of bromine containing waste.

The corresponding emission limit value in the EU-directive for waste incineration is 0,1 ng/Nm³.

Uncertainty in sampling and analysis, variations in operating conditions and waste mixture, differences between laboratories with respect to methods of analysis (especially dioxins), makes comparison of results difficult. We may however draw the following main conclusions:

- Increasing the content of BFRs in the waste gave no significant increase in the emissions of chlorinated dioxins, or either brominated and chlorinated/brominated dioxins
- The emission level is highest for chlorinated dioxins, lower for chlorinated/brominated dioxins and lowest for brominated dioxins
- The emission levels for chlorinated dioxins, reported as Nordic toxic equivalents, are low compared to the emission threshold value in the


EU-directive for incineration of waste. The reported emission levels were 0,03 ng/Nm³ and 0,006 ng/Nm³ respectively for the Klemetsrud Plant (Oslo) and Energos Plant (Ranheim), and the EU threshold value is 0,1 ng/Nm³.

The emission measurement results indicate that the incineration efficiency and the operating conditions of the flue gas treatment systems are of greater importance to the resulting emission levels for dioxins, rather than the bromine content level.

Flue gas concentrations before and after cleaning

Measurements of dioxins in flue gas before and after cleaning were carried out with addition of a high proportion (10 % by weight) bromine containing waste, see Figure 13.

Figure 13 Concentrations of brominated, chlorinated and brominated/chlorinated dioxins analysed in raw flue gas/emission outlet from Klemetsrud Plant, resulting from addition of 10 % by weight of bromine containing waste.

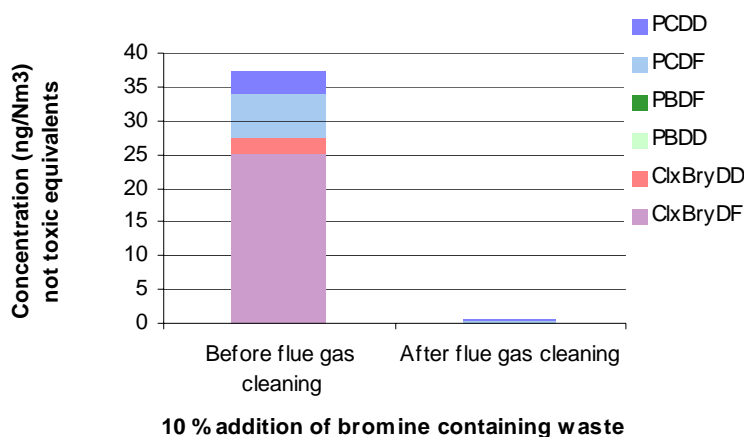

Concentration of brominated/chlorinated dioxins before cleaning is significantly higher than the corresponding concentration of chlorinated dioxins. After cleaning, the brominated/chlorinated dioxins amounts to only 10-20 % of the total emissions of dioxin compounds. Dioxins removed from flue gas are found in the filter dust. The filter dust from incineration plants is treated as hazardous waste.

6.5 Brominated flame-retardants (BFRs)

Table 9 shows concentrations of BFRs in bottom ash, filter dust, water from the scrubber and in emissions to air from tests with addition of bromine containing plastics at Klemetsrud and Energos Plants.

Table 9 Concentrations of BFRs from incineration tests with addition of bromine containing plastics at Klemetsrud and Energos Plants.

	Unit	Level of BFRs	
		Klemetsrud Plant	Energos Plant
Bottom ash	mg/kg	0,034-0,1	<0,016
Filter dust	mg/kg	0,04	-
Scrubber water (untreated)	ng/l	0,01	-
Emissions to air (after cleaning)	ng/Nm ³	14-22	< 5

From table 9, one can see that the concentration of BFRs in flue gas from Klemetsrud Plant was 14-22 ng/Nm³. This equals 0,9-1,4 mg/hour and approximately 0,01 kg/year, assuming 8000 running hours/year at the same emission level. A Danish study (Miljøstyrelsen, 1999) estimates the total annual Danish emissions of BFRs from incineration to be < 0,04 tons. A report from the Norwegian National State Pollution Control Authority (SFT), estimates the national emissions from combustion in Norway to be < 0,01 tons/year (1998), i.e. < 10 kg/year.

At the Energos Plant (Ranheim) the reported concentration of BFRs in the flue gas was <5 ng/Nm³.


The concentration of BFRs in bottom ash from the tests at Klemetsrud Plant (Oslo) shows levels far below the emission limit value of 0,25 % by weight stated in the Hazardous Waste Directive.

DekaBDE and TBBPA (Tetrabrombisphenol A) are the dominating compounds of BFRs in the bottom ash from Klemetsrud Plant. In water from the scrubber and in the flue gas, dekaBEDE has the highest concentration level.

The amount of BFRs in the waste mixture used in the tests at Klemetsrud Plant was not analysed, but calculated/estimated to be approximately 30 kg/hr, based on a share of bromine containing plastics of 27 % by weight, and an assumed content of BFRs in the plastics of 12 % by weight.

Figure 14 shows input and output flows of brominated flame-retardants at Klemetsrud Plant (Oslo) with 10 % by weight addition of brominated waste.

Figure 14 Input and output flows of brominated flame-retardants at Klemetsrud Plant (Oslo) with 10 % by weight addition of brominated waste.

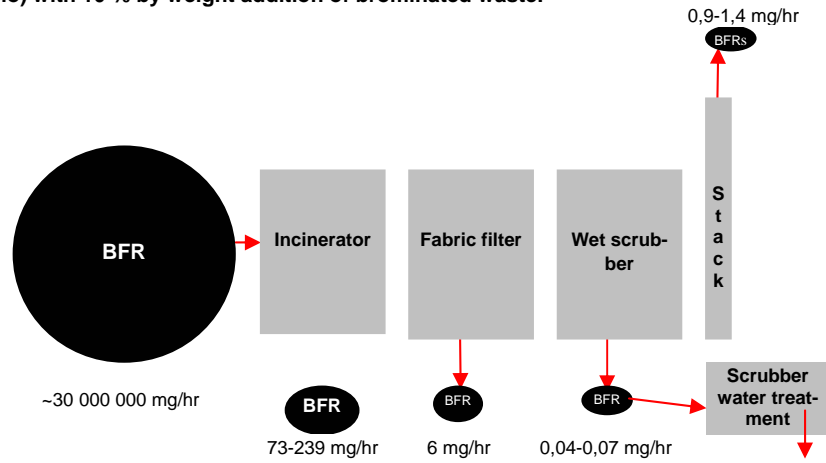

The results indicates that the BFR-level in output flows amounts to less than 0,001 % by weight of the total BFRs in the waste mixture

MEMO

Job **TNG Energy from Waste Facility, Eastern Creek,
References Facilities**
Date **2016-10-26**
From **Ahmet Erol, Martin Brunner**

Background

TNG has been requested to provide further information on the capacity of the technology to process/handle the proposed volume (approx. 50%) of C&D waste. Ramboll has been asked to identify such plants and supply information on the operational experience of such plants.

Results

We acknowledge that it has not been possible to identify an EfW plant (neither with comparable nor with alternative technology) processing a documented input of 50% C&D waste. The main reason is the fact, that any EfW plant treating primarily pre-processed waste (as this is the case for TNG) receives these pre-processed waste streams from different sorting/pre-processing plants. Once waste has been pre-processed it "looses" its waste declaration/identification and cannot be tracked back to its origin. Therefore it is not possible neither to declare the initial origin of the waste nor the exact composition concerning C&D, C&I, etc.

Nevertheless when taking in to account the relevant aspects for the design of an EfW plant (mainly the physical and chemical waste composition) it is possible to demonstrate that TNG operates well within the range of comparable facilities, namely the listed reference plants.

Reference facilities

The information on reference facilities provided in February 2016 (attached) provides details on the capacity, technology type and fuel mix including the chemical analysis of the design fuel of these plants.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-023-Referenc
Facilities.docx
Ver. 1

Ramboll Danmark A/S
DK reg.no. 35128417

Member of FRI

The reference plants are treating big variation in the feedstock, which shows that the technology can be used on a broader level. There variation in the feedstock profile of all of the reference facilities combined is evidence to demonstrate a technological capacity to withstand a wide range of variance. The provided technology with moving grate technology and semi dry flue gas treatment is able to run with the waste composition of TNG.

Following several key design parameters are listed and discussed in relation to the design parameters of TNG.

Plant capacity

The mechanical throughput of TNG is comparable with the plant in Grossräschen (DE) and Ferrybridge (UK). While the plant capacity of TNG seems higher than these plants the thermal capacity (throughput x CV) – the most important design parameter – is identical. TNG therefore is in no way an exceptionally large plant

Calorific value

The calorific value defines the combustion characteristics of the waste. Generally it can be said that - except for very low CV below 8 MJ/kg - the higher the CV, the more difficult to maintain an ideal combustion process. With a CV of 12.3 MJ/kg TNG falls in the medium range between i.e. Knapsack with 15 MJ/kg or Riverside with 9.6 MJ/kg.

Chemical waste composition

Within the waste composition the most important parameters are:

- Moisture (limits the controlled ignition of the waste)
- Inert (ash) content (limits homogenous combustion and burnout)
- The larger of Chlorine or Sulphur content (is the limiting factor for the APC system)
- C/O ratio (high C/O ratio is an indicator for high plastic content which limits homogenous combustion and burnout)

For all these aspects TNG is well within the range of all the reference plants.

Summary

None of the listed reference facilities is an exact replica of the TNG fuel profile, however all relevant design parameters of TNG are well within comparable plants which are successfully in operation. As a result it can be said that the technology option pursued, being moving grate technology with semi dry flue gas treatment, was selected based on its capacity to handle a wide range of fuel types and variation of feed stock.

Appendix A Reference Facilities

Key Plant Parameters

Facility/Location	Country	Commission year	Capacity t/a	Fuel mix	Furnace/Boiler	Supplier Furnace/Boiler	APC	Supplier APC
TNG	AU	-	4 x 276'250	C&I, C&D	Grate	HZI	Semi dry (lime)	-
Grossräschen	DE	2008	1 x 246'000	C&I, C&D	Grate	AEE *	Semi dry (lime)	LAB
Heringen	DE	2009	2 x 148'500	C&I, C&D, some MSW	Grate	AEE *	Semi dry (lime)	LAB
Premnitz	DE	2008	1 x 150'000	C&I, C&D	Grate	AEE *	Semi dry (lime)	Lühr
Hannover	DE	2005	2 x 140'000	C&I, C&D, some MSW	Grate	AEE *	Semi dry (lime)	LAB
Knapsack	DE	2009	2 x 150'000	C&I, C&D	Grate	AEE *	Semi dry (lime)	Lühr
Ferrybridge	UK	2015	2 x 256'500	C&I, C&D, some MSW, waste wood	Grate	HZI	Semi dry (lime)	HZI
Riverside	UK	2011	3 x 195'000	MSW, C&I	Grate	HZI	Semi dry (lime)	HZI

* up to 2010 HZI was part of the AEE Group

Appendix B Reference Facilities

Chemical Analysis Design Fuel

		TNG	Grossräschen	Heringen	Premnitz	Hannover	Knapsack	Ferrybridge	Riverside
Carbon (C)	%	31.44	35.20	n.a.	28.50	n.a.	n.a.	35.60	26.63
Hydrogen (H)	%	4.07	1.88	n.a.	3.96	n.a.	n.a.	5.20	3.78
Nitrogen (N)	%	0.26	3.80	n.a.	0.32	n.a.	n.a.	0.60	0.54
Sulphur(S)	%	0.43	0.37	n.a.	0.18	n.a.	<0.8	0.20	0.10
Chloride (Cl)	%	0.88	0.70	n.a.	0.54	n.a.	1.20	0.50	0.70
Oxygen (O)	%	18.06	14.25	n.a.	19.50	n.a.	n.a.	25.10	17.79
Water (H2O)	%	23.38	25.00	n.a.	22.00	n.a.	18.00	20.00	30.76
Ash	%	21.49	18.80	n.a.	25.00	n.a.	19.00	12.80	19.70
Total	%	100.00	100.00	-	100.00	-	-	100.00	100.00
NCV	MJ/kg	12.30	12.50	12.6	13.00	13.5	15.00	13.50	9.60

Percentage of wood (estimation based on chemical analysis of waste)

		TNG	Grossräschen	Heringen	Premnitz	Hannover	Knapsack	Ferrybridge	Riverside
Wood	%	30.24	23.86	n.a.	32.65	n.a.	n.a.	42.03	29.79

Chloride range of fuel (average)

		TNG	Grossräschen	Heringen	Premnitz	Hannover	Knapsack	Ferrybridge	Riverside
Cl	%	< 1	<1	n.a.	0.2-1.5	n.a.	0.5-1.7	<1	n.a.

information source for reference plants: HZI

Appendix C Reference Facilities

Fuel Mix

	Mixed C&D								Mixed C&I					SRF from MSW	MSW	
		paper/card	plastic	textile	glass	vegetation	wood	hazardous (hospital waste)		paper/card	plastic	textile				flock waste
TNG	28.7%	x	x	x	x	x	x	-	71.3%	x	x	x	x	0.0%	-	-
Grossräschen *	9.8%	x	x	-	x	x	x	x	83.2%	x	x	x	x	7.0%	x	x
Heringen *	13.6%	x	x	x	-	x	x	x	62.4%	x	x	x	-	24.0%	x	-
Premnitz *	14.3%	x	x	x	-	x	x	x	57.0%	x	x	x	x	28.7%	x	-
Hannover *	9.0%	x	x	x	-	x	x	x	75.3%	x	x	x	x	15.7%	x	x
Knapsack	10.0%	x	x	x	-	x	x	x	90.0%	x	x	x	-	0.0%	x	-
Ferrybridge ¹⁾	10.0% ²⁾	n.a.	n.a.	n.a.	n.a.	n.a.	x	n.a.	30.0%	n.a.	n.a.	n.a.	n.a.	60.0%	x	x
Riverside	n.a.	x	x	x	x	x	x	-	n.a.	x	x	x	-	n.a.	x	-

¹⁾ Design Waste

²⁾ Waste Wood

* values from the year 2014, see <https://www.itad.de/information/abfallverwertungsanlagen>

all other values given from the operators verbally

SRF Solid Recovered Fuel

MSW Municipal Solid Waste

n.a. not available

MEMO

Job **TNG Energy from Waste Facility, Eastern Creek,
850°C minimum operating temperature**
Date **2016-09-27**
From **Ahmet Erol**

850°C minimum operating temperature

The design of the proposed Energy from Waste (EfW) facility includes a secondary combustion chamber to optimise flow conditions and temperature profile and reduce CO, VOC and other organic pollutants emissions.

A minimum flue gas temperature of 850°C with a residence time of at least 2 seconds is kept at any time after the last injection of air (in this case the secondary air). The energy contained in the waste, the design of the secondary combustion chamber and the combustion control enable the plant to run at these conditions without any additional fuel or energy input.

Running an EfW facility at a temperature of 1100°C and a residence time of at least 2 seconds after secondary air injection is not possible with only the energy of the waste. The auxiliary burners (fuelled by gas or diesel) have to support the combustion to reach this temperature and residence time. This additional (fossil) energy input reduces the overall energy efficiency of the facility.

The requirement of 1100°C given by the IED is in Europe only applies for hazardous waste treatment facilities where rather small quantities of hazardous/chemical waste are treated and where (due to the limited size of the plant) energy efficiency is not a key issue.

Based on the waste analysis and the mixing described in the Project Definition Brief (chapter 2.3.1) a maximum chlorine content of the mixed waste of 1% can be assumed.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-019-850°C
minimum operating
temperature.docx
Ver. A

Ramboll Danmark A/S
DK reg.no. 35128417

Member of FRI

MEMO

Job **TNG Energy from Waste Facility, Eastern Creek,
Treated Wood Waste**
Date **2016-08-30**
From **Martin Brunner, Ahmet Erol**

Treated wood waste

Treated wood waste (TWW) represents a large proportion of waste wood arising. A WRAP study on waste composition found that (including laminated and veneered wood) an average of 85% of the wood from the observed Civic Amenity sites was treated and 23% of the wood from the observed construction and demolition sites was treated.

TWW is defined as wood that has been treated with one or more of the following:

- Copper Chromium Arsenic (CCA)
- Copper Organics
- Creosote
- Light Organic Solvent Preservatives (LOSP)
- Micro-emulsion
- Paint / stain
- Varnish

The EfW **plant must burn waste** aligning with the relevant requirements of Australian and NSW Regulatory Framework.

According to NSW Energy from Waste Policy Statement, chapter 4 Energy recovery facilities, technical criteria the gas resulting from the process should be raised, after the last injection of combustion air to a minimum temperature of **850 °C for two** seconds. If a waste has a content of more than 1% of halogenated organic substances, expressed as chlorine, the temperature should be raised to 1,100°C for at least 2 seconds after the last injection of air.

Certain wood wastes are treated with wood preservatives or coatings like listed above.

One of the main sources for organic chlorine is varnish containing Polychlorinated biphenyl (PCB).

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-001-013
Treated Wood Waste.docx
Ver. 1

Ramboll Danmark A/S
DK reg.no. 35128417

Member of FRI

To get an idea of how much chlorine in treated wood can be, a simple calculation with following assumptions made:

Wood size:	0.0254 m x 0.0254 m x 1 m (1 inch x 1 inch)
Varnish thickness on wood:	60 μm
Specific weight wood	700 kg/m^3
Specific weight varnish	900 kg/m^3
Calculated varnish weight on treated wood	5.48 g
Calculated wood weight	452 g
Percentage of varnish on wood	1.2%

The chlorine content of PCB varies from 20% to 70% depending on PCB configuration¹.

With the assumptions and calculation above the possible chlorine content in treated wood for TNG is as follows.

The wood content in TNG design fuel is varying from 0 to 58.20% with an average of 30.24%. Assumption: 100% CRW incineration with 58.20% of waste wood and varnish contents 100% chlorine. The chlorine content for this unrealistic case of the incinerated waste would be about 0.71%.

More realistic is to calculate with the average waste wood content of 30.24% and chlorine content in varnish of 50%. For this case the chlorine content in incinerated waste would be about 0.19%.

Conclusion

Even if TNG would incinerate 100% CRW fraction with the highest waste wood content, it is unrealistic to reach the chlorine content of 1%. There is no reason at any time to raise the incineration temperature to 1,100°C for at least two seconds.

Source

Options and Risk Assessment for Treated Wood Waste, The Waste & Resources Action Programme

http://www2.wrap.org.uk/downloads/Options_and_Risk_Assessment_for_Treated_Wood_Waste.6ac4f667.2237.pdf

¹ Polychlorinated biphenyl (PCB) is an organic chlorine compound with the formula $\text{C}_{12}\text{H}_{10-x}\text{Cl}_x$. There are 209 configurations with 1 to 10 chlorine atoms.
https://en.wikipedia.org/wiki/Polychlorinated_biphenyl

MEMO

Job **BAT Evaluation**
 Client **DADI TNG NSW**
 Memo no. **4**
 Date **18/02/2016**
 To **To whom it may concern**
 From **Martin Brunner**
 Copy to **Ian Malouf (DADI)**
Phill Andrew (Savills)
Rachael Snape (Urbis)
Geert Stryg (Ramboll)

1. Methodology to compare the TNG technology with the BAT requirements

Date 11.02.2016

Based on the long term experience of Waste-to-Energy in Europe the best available techniques (BAT) have been evaluated, defined and documented in the "Reference Document on the Best Available Techniques for Waste Incineration (August 2006)" (in short BREF).

Ramboll
 Hardturmstrasse 132
 CH-8005 Zürich

Following a request by TNG Ramboll has compared the requirements as summarized as 68 basic requirements in Chapter 5.1 and 5.2 of the above document.

T +41 44 500 35 80
 F +41 44 500 35 89
www.ramboll.com/energy

Revision 100

2. Results and conclusions

The detailed evaluation of each point is found in the attachment. In summary the results of the evaluation are:

1. Design: all requirements defined by BREF are fulfilled
2. Emissions: The expected emissions are within the required operational values given by BREF
3. Energy efficiency: The TNG facility exceeds the requirements of the BREF

It can therefore be concluded that the TNG facility fulfils the BREF requirements and therefore is BAT.

BAT	TNG	BAT fulfilled?
<p>1. the selection of an installation design that is suited to the characteristics of the waste received, as described in 4.1.1 and 4.2.1 and 4.2.3</p>	<p>The thermal treatment is calculated for a calorific value of 8,5 MJ/kg- 16,5 MJ/kg. The plant is designed for a waste throughput of 25,35 t/h to 46,48 t/h. The waste type is mainly Chute Residual Waste (CRW) from the Genesis Facility, Commercial and Industrial (C&I), Construction and Demolition (C&D) and flock waste.</p> <p>A combination of water cooled grate and air cooled grate was chosen. The air cooled grate is characterized through:</p> <ul style="list-style-type: none"> - suitable for waste with low to medium heat values - suitable for municipal and other heterogeneous solid wastes - can cope with sewage sludge and/or medical waste mixed with municipal waste - applied at most modern MSW installations <p>The water cooled grate protects the grate against intense heat (LCV: 10 – 20 GJ/t) otherwise it has the same characteristics.</p> <p>The design features of the secondary combustion chamber are a central current flow.</p>	<p>Yes</p>
<p>2. the maintenance of the site in a generally tidy and clean state, as described in 4.1.2</p>	<p>It is integral part of the contract; it is defined as one the operator's tasks.</p>	<p>Yes</p>
<p>3. to maintain all equipment in good working order, and to carry out maintenance inspections and preventative maintenance in order to achieve this</p>	<p>The Proposed Facility will be operated and maintained by a dedicated Operations and Maintenance team.</p> <p>For planning the major shutdown a short shutdown is carried out approx. 1 year in advance. A normal duration for such a short shutdown is generally a few days.</p> <p>The operator installs a computer-controlled program used to ensure ongoing maintenance of the plant components.</p> <p>The program records conducted maintenance jobs and systematic maintenance can be planned for the individual components.</p> <p>A maintenance plan will be established to determine weekly, monthly, annual or longer interval inspections, tests and maintenance activities which have to be performed.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>4. to establish and maintain quality controls over the waste input, according to the types of waste that may be received at the installation, as described in:</p> <p>4.1.3.1 Establishing installation input limitations and identifying key risks, and</p> <p>4.1.3.2 Communication with waste suppliers to improve incoming waste quality control, and</p> <p>4.1.3.3 Controlling waste feed quality on the incinerator site, and</p> <p>4.1.3.4 Checking, sampling and testing incoming wastes, and</p> <p>4.1.3.5 Detectors for radioactive materials.</p>	<p>A three point checking procedure will be on-site to ensure only permitted waste is unloaded into the waste bunker.</p> <p>Initial inspections of the vehicle loads are undertaken at the weighbridge to check the content of the incoming and its origin.</p> <p>All loads are recorded and monitored by on-site CCTV when entering the tipping hall and while the loads are tipped off. Suspect loads are either rejected from the facility or are analysed in a designated inspection area or on the tipping hall floor prior to being tipped into the waste bunker. If the analysis shows that the load contains unsuitable material the waste is reloaded to the vehicle and rejected. Detectors for radioactive material are not necessary.</p>	Yes
<p>5. the storage of wastes according to a risk assessment of their properties, such that the risk of potentially polluting released is minimised. In general it is BAT to store waste in areas that have sealed and resistant surfaces, with controlled and separated drainage as described in 4.1.4.1.</p>	<p>The waste bunker is built of concrete and has a resistant surface. Due to the high thermal value of the waste there is no need for controlled and separated drainage.</p>	Yes
<p>6. to use techniques and procedures to restrict and manage waste storage times, as described in 4.1.4.2, in order to generally reduce the risk of releases from storage of waste/container deterioration, and of processing difficulties that may arise. In general it is BAT to:</p> <p><input type="checkbox"/> prevent the volumes of wastes stored from becoming too large for the storage provided</p> <p><input type="checkbox"/> in so far as is practicable, control and manage deliveries by communication with waste suppliers, etc.</p>	<p>- The waste bunker has the capacity to store the amount of 5-7 days of waste delivery.</p> <p>- The waste is continuously removed.</p> <p>- It is ensured that no excessive amounts will arrive.</p>	Yes
<p>7. to minimise the release of odour (and other potential fugitive releases) from bulk waste storage areas (including tanks and bunkers, but excluding small volume wastes stored in containers) and waste pre-treatment areas by passing the extracted atmosphere to the incinerator for combustion (see 4.1.4.4).</p> <p>In addition it is also considered to be BAT to make provision for the control of odour (and other potential fugitive releases) when the incinerator is not available (e.g. during maintenance) by:</p> <p>a. avoiding waste storage overload, and/or</p> <p>b. extracting the relevant atmosphere via an alternative odour control system</p>	<p>The incineration air supply (primary or secondary) is taken from the waste storage areas. By enclosing the waste storage areas and limiting the size of the entrances to the waste storage areas, a slight under pressure can be ensured on whole waste storage area.</p>	
<p>8. the segregation of the storage of wastes according to a risk assessment of their chemical and physical characteristics to allow safe storage and processing, as described in 4.1.4.5</p>	<p>The waste is delivered in defined fractions. Segregation of the storage of wastes is not necessary.</p>	Yes

BAT	TNG	BAT fulfilled?
9. the clear labelling of wastes that are stored in containers such that they may continually be identified, as described in 4.1.4.6.	The waste is not stored in containers.	Not relevant
10. the development of a plan for the prevention, detection and control (described in 4.1.4.7) of fire hazards at the installation, in particular for: <ul style="list-style-type: none"> <input type="checkbox"/> waste storage and pre-treatment areas <input type="checkbox"/> furnace loading areas <input type="checkbox"/> electrical control systems <input type="checkbox"/> bag house filters and static bed filters. It is generally BAT for the plan implemented to include the use of: <ul style="list-style-type: none"> a. automatic fire detection and warning systems, and b. the use of either a manual or automatic fire intervention and control system as required according to the risk assessment carried out. 	Fire detection and firefighting systems are installed at the critical areas of the plant (e.g. waste bunker, electrical rooms, feed hopper,...). In case of fire detection the firefighting systems start automatically.	Yes
11. the mixing (e.g. using bunker crane mixing) or further pre-treatment (e.g. the blending of some liquid and pasty wastes, or the shredding of some solid wastes) of heterogeneous wastes to the degree required to meet the design specifications of the receiving installation (4.1.5.1). When considering the degree of use of mixing/pre-treatment it is of particular importance to consider the cross-media effects (e.g. energy consumption, noise, odour or other releases) of the more extensive pre-treatment's (e.g. shredding). Pre-treatment is most likely to be a requirement where the installation has been designed for a narrow specification, homogeneous waste.	The waste bunker has sufficient space and sufficient capacity for the mixing of different waste streams. The waste is mainly delivered as shredded fraction.	Yes
12. the use of the techniques described in 4.1.5.5 or 4.6.4 to, as far as practicably and economically viable, remove ferrous and non-ferrous recyclable metals for their recovery either: <ul style="list-style-type: none"> a. after incineration from the bottom ash residues, or b. where the waste is shredded (e.g. when used for certain combustion systems) from the shredded wastes before the incineration stage. 	The recyclable material is removed before the waste is delivered to the waste incineration plant.	Yes
13. the provision of operators with a means to visually monitor, directly or using television screens or similar, waste storage and loading areas, as described in 4.1.6.1	A video system is installed to monitor waste reception, feeding and storage, furnace as well as main out streams and their loading areas.	Yes
14. the minimisation of the uncontrolled ingress of air into the combustion chamber via waste loading or other routes, as described in 4.1.6.4	To minimize the uncontrolled ingress of air into the combustion chamber, the feed hopper always has to be filled to a certain level during operation. The level of the feed hopper is checked by the DCS.	Yes

BAT	TNG	BAT fulfilled?
<p>15. the use of flow modelling which may assist in providing information for new plants or existing plants where concerns exist regarding the combustion or FGT performance (such as described in 4.2.2), and to provide information in order to:</p> <p>a. optimise furnace and boiler geometry so as to improve combustion performance, and</p> <p>b. optimise combustion air injection so as to improve combustion performance, and</p> <p>c. where SNCR or SCR is used, to optimise reagent injection points so as to improve the efficiency of NO_x abatement whilst minimising the generation of nitrous oxide, ammonia and the consumption of reagent (see general sections on SCR and SNCR at 4.4.4.1 and 4.4.4.2).</p>	<p>The incineration and the boiler layout are based on good experiences and are realised on several operating plants. The SNCR (injection of ammonia), the secondary combustion chamber and the FGT design is based on a fluid dynamics flow model.</p>	<p>Yes</p>
<p>16. in order to reduce overall emissions, to adopt operational regimes and implement procedures (e.g. continuous rather than batch operation, preventative maintenance systems) in order to minimise as far as practicable planned and unplanned shutdown and start-up operations, as described in 4.2.5</p>	<p>The waste feeding is continuously.</p> <p>Implementation of a process orientated automatic start up and shut down procedure to minimise the emissions in those operational cases.</p> <p>Mixture of the waste to get a homogeneous fuel and preventative maintenance system avoid unplanned shutdowns.</p>	<p>Yes</p>
<p>17. the identification of a combustion control philosophy, and the use of key combustion criteria and a combustion control system to monitor and maintain these criteria within appropriate boundary conditions, in order to maintain effective combustion performance, as described in 4.2.6. Techniques to consider for combustion control may include the use of infrared cameras (see 4.2.7), or others such as ultra-sound measurement or differential temperature control</p>	<p>The following information is part of the combustion control system:</p> <ul style="list-style-type: none"> - grate temperatures at various positions - caloric value of the waste - thickness of waste layer on the grate (visual control) - furnace and flue gas temperature at various positions - CO-, O₂-, CO₂- and H₂O-measurements at various positions - steam production data (e.g. temperature, pressure) - openings in the combustion wall for visual observation by cameras - length and position of the fire in the furnace - emission data for combustion related substances 	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>18. the optimisation and control of combustion conditions by a combination of:</p> <ul style="list-style-type: none"> a. the control of air (oxygen) supply, distribution and temperature, including gas and oxidant mixing b. the control of combustion temperature level and distribution, and c. the control of raw gas residence time. <p>Appropriate techniques for securing these objectives are described in:</p> <ul style="list-style-type: none"> 4.2.8 Optimisation of air supply stoichiometry 4.2.9 Primary air supply optimisation and distribution 4.2.11 Secondary air injection, optimisation and distribution 4.2.19 Optimisation of time, temperature, turbulence of gases in the combustion zone, and oxygen concentrations 4.2.4 Design to increase turbulence in the secondary combustion chamber 	<p>For an optimal combustion the thermal processes are monitored and regulated by measurements of the furnace temperature and the content of CO and O₂ in the flue gas.</p> <p>For a more detailed description see point 17.</p> <p>by means of combustion control the following elements are controlled:</p> <ul style="list-style-type: none"> - Primary air quantity and distribution - Oxygen content of flue gas (stoichiometry) - Secondary air quantity and distribution - Injection of recirculating flue gas in order to increase turbulence in the 	<p style="text-align: center;">Yes</p>
<p>19. in general it is BAT to use those operating conditions (i.e. combustion temperatures residence times and turbulence) that are specified in Article 6 of Directive 2000/76. The use of operating conditions in excess of those that are required for efficient destruction of the waste should generally be avoided. The use of other operating conditions may also be BAT – if they provide for a similar or better level of overall environmental performance. For example, where the use of operational temperatures of below the 1100 °C (as specified for certain hazardous waste in 2000/76/EC) have been demonstrated to provide for a similar or better level of overall environmental performance, the use of such lower temperatures is considered to be BAT.</p>	<p>The temperature / time requirements of the post-combustion chamber are continuously monitored. See point 17.</p>	<p style="text-align: center;">Yes</p>
<p>20. the preheating of primary combustion air for low calorific value wastes, by using heat recovered within the installation, in conditions where this may lead to improved combustion performance (e.g. where low LCV/high moisture wastes are burned) as described in 4.2.10. In general this technique is not applicable to hazardous waste incinerators.</p>	<p>For high energy efficiency and optimal combustion conditions preheating of primary and secondary combustion air is realised by using low pressure steam and saturated steam from the boiler drum.</p>	<p style="text-align: center;">Yes</p>
<p>21. the use of auxiliary burner(s) for start-up and shut-down and for maintaining the required operational combustion temperatures (according to the waste concerned) at all times when unburned waste is in the combustion chamber, as described in 4.2.20</p>	<p>Only in the case that the temperature in the secondary combustion chamber drops below a minimum temperature of 850 °C oil or gas fired support burners automatically start operation. Otherwise, the burners remain in a standby position.</p>	<p style="text-align: center;">Yes</p>

BAT	TNG	BAT fulfilled?
<p>22. the use of a combination of heat removal close to the furnace (e.g. the use of water walls in grate furnaces and/or secondary combustion chambers) and furnace insulation (e.g. refractory areas or other lined furnace walls) that, according to the NCV and corrosiveness of the waste incinerated, provides for:</p> <p>a. adequate heat retention in the furnace (low NCV wastes require higher retention of heat in the furnace)</p> <p>b. additional heat to be transferred for energy recovery (higher NCV wastes may allow/require heat removal from earlier furnace stages)</p> <p>The conditions under which the various techniques may be applicable are described in 4.2.22 and 4.3.12</p>	<p>To protect the walls of the boiler against corrosion Inconel will be clad in sections where the flue gas temperature exceeds 850 °C.</p>	<p>Yes</p>
<p>23. the use of furnace (including secondary combustion chambers etc.) dimensions that are large enough to provide for an effective combination of gas residence time and temperature such that combustion reactions may approach completion and result in low and stable CO and VOC emissions, as described in 4.2.23</p>	<p>The furnace dimensions are large enough to ensure that for 2 seconds residence time the flue gas has a temperature above 850 °C (for all operational conditions).</p> <p>Experiences of several plants have shown low values for CO and VOC.</p> <p>After the combustion chamber two empty passes are installed to enable a complete burnout. In addition to secondary air a part of the flue gas is recirculated and injected together with the secondary air to achieve a maximum turbulence and burnout as well as stable CO and VOC emissions.</p>	<p>Yes</p>
<p>24. When gasification or pyrolysis is used, in order to avoid the generation of waste, it is BAT to:</p> <p>a. combine the gasification or pyrolysis stage with a subsequent combustion stage with energy recovery and flue-gas treatment that provides for operational emission levels to air within the BAT associated emission ranges specified in this BAT chapter, and/ or</p> <p>b. recover or supply for use of the substances (solid, liquid or gaseous) that are not combusted</p>	<p>No gasification or pyrolysis.</p>	<p>Not relevant</p>

BAT	TNG	BAT fulfilled?
<p>25. in order to avoid operational problems that may be caused by higher temperature sticky fly ashes, to use a boiler design that allows gas temperatures to reduce sufficiently before the convective heat exchange bundles (e.g. the provision of sufficient empty passes within the furnace/boiler and/or water walls or other techniques that aid cooling), as described in 4.2.23 and 4.3.11. The actual temperature above which fouling is significant is waste type and boiler steam parameter dependent. In general for MSW it is usually 600 – 750 °C, lower for HW and higher for SS. Radiative heat exchangers, such as platten type super heaters, may be used at higher flue-gas temperatures than other designs (see 4.3.14).</p>	<p>At the first position in the horizontal pass a protection evaporator is installed. The calculated gas temperature before the protection evaporator is around 650°C. This evaporator protects the superheater in order to minimize fouling. Further a conservative spacing of the boiler tubes prevents clogging and resulting operational problems.</p>	<p>Yes</p>
<p>26. the overall optimisation of installation energy efficiency and energy recovery, taking into account the techno-economic feasibility (with particular reference to the high corrosivity of the flue-gases that results from the incineration of many wastes e.g. chlorinated wastes), and the availability of users for the energy so recovered, as described in 4.3.1, and in general:</p> <p>a. to reduce energy losses with flue-gases, using a combination of the techniques described in 4.3.2 and 4.3.5</p> <p>b. the use of a boiler to transfer the flue-gas energy for the production of electricity and/or supply of steam/heat with a thermal conversion efficiency of:</p> <p>i. for mixed municipal waste at least 80 % (ref. Table 3.46)</p> <p>ii. for pretreated municipal wastes (or similar waste) treated in fluidized bed furnaces, 80 to 90 %</p> <p>iii. for hazardous wastes giving rise to increased boiler corrosion risks (typically from chlorine/sulphur content), above 60 to 70 %</p> <p>iv. for other wastes conversion efficiency should generally be increased in the range 60 to 90 %</p> <p>c. for gasification and pyrolysis processes that are combined with a subsequent combustion stage, the use of a boiler with a thermal conversion efficiency of at least 80 %, or the use of a gas engine or other electrical generation technology</p>	<p>The most important measures to reduce the energy loss are:</p> <p>a) reduce excess air</p> <p>b) recirculate flue gas</p> <p>c) reduce the flue gas temperature at the boiler exit of 145°C</p> <p>d) heat recovery by condensate preheating</p> <p>The thermal conversion of the boiler is 91,9%.</p>	<p>Yes</p>
<p>27. to secure where practicable, long-term base-load heat/steam supply contracts to large heat/steam users (see 4.3.1) so that a more regular demand for the recovered energy exists and therefore a larger proportion of the energy value of the incinerated waste may be used.</p>	<p>The average net electrical efficiency is 29,6%. Necessary measures have been foreseen for later export of heat.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>28. the location of new installations so that the use of the heat and/or steam generated in the boiler can be maximised through any combination of:</p> <ul style="list-style-type: none"> a. electricity generation with heat or steam supply for use (i.e. use CHP) b. the supply of heat or steam for use in district heating distribution networks c. the supply of process steam for various, mainly industrial, uses (see examples in 4.3.18) d. the supply of heat or steam for use as the driving force for cooling/air conditioning systems <p>Selection of a location for a new installation is a complex process involving many local factors (e.g. waste transport, availability of energy users, etc) which are addressed by IPPC Directive Article 9(4). The generation of electricity only may provide the most energy efficient option for the recovery of the energy from the waste in specific cases where local factors prevent heat/steam recovery.</p>	<p>See point 27.</p>	<p>Yes</p>
<p>29. in cases where electricity is generated, the optimisation of steam parameters (subject to user requirements for any heat and steam produced), including consideration of (see 4.3.8):</p> <ul style="list-style-type: none"> a. the use of higher steam parameters to increase electrical generation, and b. the protection of boiler materials using suitably resistant materials (e.g. claddings or special boiler tube materials) <p>The optimal parameters for an individual installation are highly dependent upon the corrosivity of the flue-gases and hence upon the waste composition.</p>	<p>Depending on the flue gas composition and the waste conditions the steam parameters were determined to be 73barA/430°C. This superheated steam parameters ensure high energy efficiency. The net electrical efficiency is 29,6%.</p>	<p>Yes</p>
<p>30. the selection of a turbine suited to:</p> <ul style="list-style-type: none"> a. the electricity and heat supply regime, as described in 4.3.7 b. high electrical efficiency 	<p>A condensing turbine was chosen as there are no possibilities to supply heat to customers.</p>	<p>Yes</p>
<p>31. at new or upgrading installations, where electricity generation is the priority over heat supply, the minimisation of condenser pressure, as described in 4.3.9</p>	<p>The turbine exhaust pressure (100 mbar, 22°C) and the air cooled condenser are designed so that the high ambient temperatures of Sydney can be handled.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>32. the general minimisation of overall installation energy demand, including consideration of the following (see 4.3.6):</p> <p>a. for the performance level required, the selection of techniques with lower overall energy demand in preference to those with higher energy demand</p> <p>b. wherever possible, ordering flue-gas treatment systems in such a way that flue gas reheating is avoided (i.e. those with the highest operational temperature before those with lower operational temperatures)</p> <p>c. where SCR is used;</p> <p>i. to use heat exchangers to heat the SCR inlet flue-gas with the flue-gas energy at the SCR outlet</p> <p>ii. to generally select the SCR system that, for the performance level required (including availability/fouling and reduction efficiency), has the lower operating temperature</p> <p>d. where flue-gas reheating is necessary, the use of heat exchange systems to minimise flue-gas reheating energy demand</p> <p>e. avoiding the use of primary fuels by using self produced energy in preference to imported sources</p>	<p>To minimise the overall energy consumption the following measures were taken:</p> <ul style="list-style-type: none"> - SNCR instead of SCR to avoid the flue gas reheating for the catalytic reaction - efficient preheating of primary and secondary air - minimal condenser pressure - placing high temperature equipment before (upstream) lower temperature equipment - use of frequency controlled rotating equipment for those equipment parts which operate at variable speeds. - high efficient DCS system to minimise the measure failure <p>SCR is not relevant.</p>	<p>Yes</p>
<p>33. where cooling systems are required, the selection of the steam condenser cooling system technical option that is best suited to the local environmental conditions, taking particular account of potential cross-media impacts, as described in 4.3.10</p>	<p>As result of the local conditions and to minimize the water consumption an air cooled condenser has been chosen.</p>	<p>Yes</p>
<p>34. the use of a combination of on-line and off-line boiler cleaning techniques to reduce dust residence and accumulation in the boiler, as described in 4.3.19</p>	<p>Online cleaning devices for all parts of the boiler are foreseen. Offline cleaning is carried out manually during revisions.</p>	<p>Yes</p>
<p>35. the use of an overall flue-gas treatment (FGT) system that, when combined with the installation as a whole, generally provides for the operational emission levels for releases to air associated with the use of BAT listed in Table 5.2</p>	<p>The emission guarantees are in accordance with the European Industrial Emission Directive. The expected operational emission levels are in line with the values given in Table 5.2.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>36. when selecting the overall FGT system, to take into account:</p> <ul style="list-style-type: none"> a. the general factors described in 4.4.1.1 and 4.4.1.3 b. the potential impacts on energy consumption of the installation, as described in section 4.4.1.2 c. the additional overall-system compatibility issues that may arise when retrofitting existing installations (see 4.4.1.4) 	<p>The following factors have been taken account for the selection of the FGT system:</p> <ul style="list-style-type: none"> - type of waste, its composition and variation - type of combustion process, and its size - through recirculation of flue gases less flue gas flow and lower flue gas temperature - flue gas composition and fluctuations in the composition - target emission limit values - restrictions on discharge of aqueous effluents - availability of land and space - availability and cost of outlets for residues accumulated/recovered - minimize consumables 	<p>Yes</p>
<p>37. when selecting between wet / semi-wet / and dry FGT systems, to take into account the (non-exhaustive) general selection criteria given as an example in Table 5.3 [See at the end of this document]</p>	<p>The Flue gas cleaning process is characterised by the following features:</p> <ul style="list-style-type: none"> - No effluent as necessary for wet FGT - minimized consumables and residues - Dry injection of Calcium Hydroxide (Ca(OH)₂) and Powdered Activated Carbon (PAC) - Separate injection of water for conditioning and reactivation of recycled lime particles - Compact design - Low manpower requirement 	<p>Yes</p>
<p>38. to prevent the associated increased electrical consumption, to generally (i.e. unless there is a specific local driver) avoid the use of. two bag filters in one FGT line (as described in 4.4.2.2 and 4.4.2.3)</p>	<p>The installation has only one bag filter.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>39. the reduction of FGT reagent consumption and of FGT residue production in dry, semi-wet, and intermediate FGT systems by a suitable combination of:</p> <p>a. adjustment and control of the quantity of reagent(s) injected in order to meet the requirements for the treatment of the flue-gas such that the target final operational emission levels are met</p> <p>b. the use of the signal generated from fast response upstream and/or downstream monitors of raw HCl and/or SO₂ levels (or other parameters that may prove useful for this purpose) for the optimisation of FGT reagent dosing rates, as described in 4.4.3.9</p> <p>c. the re-circulation of a proportion of the FGT residues collected, as described in 4.4.3.7</p> <p>The applicability and degree of use of the above techniques that represents BAT will vary according to, in particular: the waste characteristics and consequential flue-gas nature, the final emission level required, and technical experience from their practical use at the installation</p>	<p>a) The quantity of reagents injected is regularly checked by measuring the target final operational emission levels. Depending on the emission level the reagents are injected.</p> <p>b) Measuring devices are installed to check the raw gas</p> <p>c) A part of the residues are recirculated into the semi dry reactor which results in a high efficiency, lower consumption of absorbent, protection of filter bags and a higher operational safety.</p>	<p>Yes</p>
<p>40. the use of primary (combustion related) NO_x reduction measures to reduce NO_x production, together with either SCR (4.4.4.1) or SNCR (4.4.4.2), according to the efficiency of flue-gas reduction required. In general SCR is considered BAT where higher NO_x reduction efficiencies are required (i.e. raw flue-gas NO_x levels are high) and where low final flue-gas emission concentrations of NO_x are desired.</p> <p>One MS reported that technical difficulties have been experienced in some cases when retrofitting SNCR abatement systems to existing small MSW incineration installations, and that the cost effectiveness (i.e. NO_x reduction per unit cost) of NO_x abatement (e.g. SNCR) is lower at small MSWIs (i.e. those MSWIs of capacity <6 tonnes of waste/hour).</p>	<p>In the first pass of the boiler ammonia is injected into the flue gas stream. The results are well controlled and low NO_x emissions which are below the levels given by the Industrial Emissions Directive. The most important factors for NO_x reduction measures are:</p> <ul style="list-style-type: none"> - O₂ content - flue gas recirculation - optimized secondary air injection <p>Neither retrofitting nor small installation, therefore not relevant.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>41. for the reduction of overall PCDD/F emissions to all environmental media, the use of:</p> <p>a. techniques for improving knowledge of and control of the waste, including in particular its combustion characteristics, using a suitable selection of techniques described in 4.1, and</p> <p>b. primary (combustion related) techniques (summarised in 4.4.5.1) to destroy PCDD/F in the waste and possible PCDD/F precursors, and</p> <p>c. the use of installation designs and operational controls that avoid those conditions (see 4.4.5.2) that may give rise to PCDD/F reformation or generation, in particular to avoid the abatement of dust in the temperature range of 250 – 400 °C. Some additional reduction of de-novo synthesis is reported where the dust abatement operational temperature has been further lowered from 250 to below 200 °C, and</p> <p>d. the use of a suitable combination of one or more of the following additional PCDD/F abatement measures:</p> <p>i. adsorption by the injection of activated carbon or other reagents at a suitable reagent dose rate, with bag filtration, as described in 4.4.5.6, or</p> <p>ii. adsorption using fixed beds with a suitable adsorbent replenishment rate, as described in 4.4.5.7, or</p> <p>iii. multi layer SCR, adequately sized to provide for PCDD/F control, as described in 4.4.5.3, or</p> <p>iv. the use of catalytic bag filters (but only where other provision is made for effective metallic and elemental Hg control), as described in 4.4.5.4</p>	<p>For the reduction of PCDD/F emissions the following techniques are applied:</p> <ul style="list-style-type: none"> - optimized secondary air injection - maximal gas burn out - minimization of fly ash deposits in the boiler - continuous boiler cleaning - no dedusting equipment where the gas temperature is above 200°C - SNCR 	<p>Yes</p>
<p>42. where wet scrubbers are used, to carry out an assessment of PCDD/F build up (memory effects) in the scrubber and adopt suitable measures to deal with this build up and prevent scrubber breakthrough releases. Particular consideration should be given to the possibility of memory effects during shut-down and start-up periods.</p>	<p>No wet scrubbers are used.</p>	<p>Not relevant</p>
<p>43. if re-burn of FGT residues is applied, then suitable measures should be taken to avoid the re-circulation and accumulation of Hg in the installation</p>	<p>No re-burn of FGT residues is applied.</p>	<p>Not relevant</p>

BAT	TNG	BAT fulfilled?
<p>44. for the control of Hg emissions where wet scrubbers are applied as the only or main effective means of total Hg emission control:</p> <p>a. the use of a low pH first stage with the addition of specific reagents for ionic Hg removal (as described in 4.4.6.1, 4.4.6.6 and 4.4.6.5), in combination with the following additional measures for the abatement of metallic (elemental) Hg, as required in order to reduce final air emissions to within the BAT emission ranges given for total Hg</p> <p>b. activated carbon injection, as described in 4.4.6.2, or</p> <p>c. activated carbon or coke filters, as described in 4.4.6.7</p>	<p>No wet scrubbers are used.</p>	<p>Not relevant</p>
<p>45. for the control of Hg emissions where semi-wet and dry FGT systems are applied, the use of activated carbon or other effective adsorptive reagents for the adsorption of PCDD/F and Hg, as described in 4.4.6.2, with the reagent dose rate controlled so that final air emissions are within the BAT emission ranges given for Hg</p>	<p>For the control of Hg emissions an activated carbon injection into the semi dry reactor is applied. The reagent dose rate is controlled to ensure that the final air emissions are within the BAT ranges given for Hg.</p>	<p>Yes</p>
<p>46. the general optimisation of the re-circulation and re-use of waste water arising on the site within the installation, as described in 4.5.8, including for example, if of sufficient quality, the use of boiler drain water as a water supply for the wet scrubber in order to reduce scrubber water consumption by replacing scrubber feed-water (see 4.5.6)</p>	<p>To avoid additional water consumption a complete recirculation of condensate is installed. The boiler drain water is used for the bottom ash quenching.</p>	<p>Yes</p>
<p>47. the use of separate systems for the drainage, treatment and discharge of rainwater that falls on the site, including roof water, so that it does not mix with potential or actual contaminated waste water streams, as described in 4.5.9. Some such waste water streams may require only little or no treatment prior to their discharge, depending on contamination risk and local discharge factors</p>	<p>A separate system is used for the drainage, treatment and discharge of rainwater so that it does not mix with potential or actual contaminated waste water streams.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>48. where wet flue-gas treatment is used:</p> <ul style="list-style-type: none"> a. the use of on-site physico/chemical treatment of the scrubber effluents prior to their discharge from the site, as described in 4.5.11, and thereby to achieve, at the point of discharge from the effluent treatment plant (ETP), emission levels generally within the BAT associated operational emission level ranges that are identified in Table 5.4 [See at the end of this document] b. the separate treatment of the acid and alkaline waste water streams arising from the scrubber stages, as described in 4.5.13, when there are particular drivers for the additional reduction of releases to water that result, and/or where HCl and/or gypsum recovery is to be carried out c. the re-circulation of wet scrubber effluent within the scrubber system, and the use of the electrical conductivity (mS/cm) of the re-circulated water as a control measure, so as to reduce scrubber water consumption by replacing scrubber feed-water, as described in 4.5.4 d. the provision of storage/buffering capacity for scrubber effluents, to provide for a more stable waste water treatment process, as described in 4.5.10 e. the use of sulphides (e.g. M-trimercaptotriazine) or other Hg binders to reduce Hg (and other heavy metals) in the final effluent, as described in 4.5.11 f. when SNCR is used with wet scrubbing the ammonia levels in the effluent discharge may be reduced using ammonia stripping, as described in 4.5.12, and the recovered ammonia re-circulated for use as a NOX reduction reagent 	<p>No wet flue gas treatment is used.</p>	<p>Not relevant</p>

BAT	TNG	BAT fulfilled?
<p>49. the use of a suitable combination of the techniques and principles described in 4.6.1 for improving waste burnout to the extent that is required so as to achieve a TOC value in the ash residues of below 3 wt % and typically between 1 and 2 wt %, including in particular:</p> <p>a. the use of a combination of furnace design (see combustion technology selection in 4.2.1), furnace operation (see 4.2.17) and waste throughput rate (see 4.2.18) that provides sufficient agitation and residence time of the waste in the furnace at sufficiently high temperatures, including any ash burn-out areas</p> <p>b. the use of furnace designs that, as far as possible, physically retain the waste within the combustion chamber (e.g. narrow grate bar spacings for grates, rotary or static kilns for appreciably liquid wastes) to allow its combustion. The return of early grate riddlings to the combustion chamber for re-burn may provide a means to improve overall burn out where they contribute significantly to the deterioration of burnout (see 4.2.21)</p> <p>c. the use of techniques for mixing and pre-treatment of the waste, as described in BAT 11, according to the type(s) of waste received at the installation</p> <p>d. the optimisation and control of combustion conditions, including air (oxygen) supply and distribution, as described in BAT 18</p>	<p>The expected value of TOC is < 1%.</p> <p>A combination of different techniques/measures is used to improve the waste burnout:</p> <ul style="list-style-type: none"> - optimal combustion conditions with a classic combustion control system, - flow optimised secondary combustion chamber, - visual check of the fire on the grate, - optimal design of the boiler geometry, - optimal temperature distribution on the grate, - optimal waste distribution over the grate - adjustment of particular grate speed - ensuring that the plant is operated within its capacity (fire control diagram) - good mixing of the waste before feeding 	<p>Yes</p>
<p>50. the separate management of bottom ash from fly ash and other FGT residues, so as to avoid contamination of the bottom ash and thereby improve the potential for bottom ash recovery, as described in 4.6.2. Boiler ash may exhibit similar or very different levels of contamination to that seen in bottom ash (according to local operational, design and waste specific factors) – it is therefore also BAT to assess the levels of contaminants in the boiler ash, and to assess whether separation or mixing with bottom ash is appropriate. It is BAT to assess each separate solid waste stream that arises for its potential for recovery either alone or in combination.</p>	<p>There is a separate management of bottom ash from fly ash and FGT residues. The FGT residues will be stored in separate enclosed silos before being transported by sealed tankers to an appropriate offsite treatment facility. This complies with the hazardous waste legislation.</p>	<p>Yes</p>
<p>51. where a pre-dedusting stage (see 4.6.3 and 4.4.2.1) is in use, an assessment of the composition of the fly ash so collected should be carried out to assess whether it may be recovered, either directly or after treatment, rather than disposed of</p>	<p>No pre-dedusting stage is installed.</p>	<p>Not relevant</p>
<p>52. the separation of remaining ferrous and non-ferrous metals from bottom ash (see 4.6.4), as far as practicably and economically viable, for their recovery</p>	<p>A magnetic separator is placed above a conveyor to remove ferrous metals from bottom ash.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>53. the treatment of bottom ash (either on or off-site), by a suitable combination of:</p> <p>a. dry bottom ash treatment with or without ageing, as described in 4.6.6 and 4.6.7, or</p> <p>b. wet bottom ash treatment, with or without ageing, as described in 4.6.6 and 4.6.8, or</p> <p>c. thermal treatment, as described in 4.6.9 (for separate treatment) and 4.6.10 (for in-process thermal treatment) or</p> <p>d. screening and crushing (see 4.6.5)</p> <p>to the extent that is required to meet the specifications set for its use or at the receiving treatment or disposal site e.g. to achieve a leaching level for metals and salts that is in compliance with the local environmental conditions at the place of use.</p>	<p>The bottom ash is treated according to b) before reuse or landfill</p>	<p>Yes</p>
<p>54. the treatment of FGT residues (on or off-site) to the extent required to meet the acceptance requirements for the waste management option selected for them, including consideration of the use of the FGT residue treatment techniques described in 4.6.11</p>	<p>The FGT residues will be stored in separate enclosed silos before being transported by sealed tankers to an appropriate offsite treatment facility. This complies with the hazardous waste legislation.</p>	<p>Yes</p>
<p>55. the implementation of noise reduction measures to meet local noise requirements (techniques are described in 4.7 and 3.6)</p>	<p>Noise reduction measures are installed at the turbine-generator, at the fans and at other critical plant sections.</p>	<p>Yes</p>
<p>56. apply environmental management. A number of environmental management techniques are determined as BAT. The scope (e.g. level of detail) and nature of the EMS (e.g. standardised or non-standardised) will generally be related to the nature, scale and complexity of the installation, and the range of environmental impacts it may have. BAT is to implement and adhere to an Environmental Management System (EMS) that incorporates, as appropriate to individual circumstances, the following features: (see Chapter 4.8)</p> <p>[Number of bullet points omitted]</p>	<p>The plant is operated by qualified personnel and the staff will be sent to relevant qualifying courses.</p> <p>To ensure that employees are aware of the relevant parts of the environmental permit, regular dialogue meetings are held with the employees.</p> <p>The plant is ISO 14001 and OSHA 18001 certified.</p> <p>Additional information can be found in the quality manual where environmental measurements, reports and factors such as environmental requirements, responsibilities and competencies of facilities and technical installations are described. The operator is responsible to install the environmental system.</p>	<p>Yes</p>
<p>57. the storage of all waste, (with the exception of wastes specifically prepared for storage or bulk items with low pollution potential e.g. furniture), on sealed surfaces with controlled drainage inside covered and walled buildings</p>	<p>The waste is stored in the waste bunker. The waste bunker has sealed surfaces.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>58. when waste is stockpiled (typically for later incineration) it should generally be baled (see Section 4.1.4.3) or otherwise prepared for such storage so that it may be stored in such a manner that risks of odour, vermin, litter, fire and leaching are effectively controlled.</p>	<p>The risks of odour, vermin, litter, fire and leaching are effectively controlled because the waste is stockpiled in a closed building. There is no influence to the environment (only the open delivery boxes).</p>	<p>Yes</p>
<p>59. to pre-treat the waste, in order to improve its homogeneity and therefore combustion characteristics and burn-out, by:</p> <ul style="list-style-type: none"> a. mixing in the bunker (see 4.1.5.1), and b. the use of shredding or crushing for bulky wastes e.g. furniture (see 4.1.5.2) that are to be incinerated, <p>to the extent that is beneficial according to the combustion system used. In general grates and rotary kilns (where used) require lower levels of pre-treatment (e.g. waste mixing with bulky waste crushing) whereas fluidized bed systems require greater waste selection and pre-treatment, usually including full shredding of the MSW.</p>	<p>The pre-treat of waste in order to improve its homogeneity is</p> <ul style="list-style-type: none"> a) mixing of waste in the bunker b) shredding of waste. 	<p>Yes</p>
<p>60. the use of a grate design that incorporates sufficient cooling of the grate such that it permits the variation of the primary air supply for the main purpose of combustion control, rather than for the cooling of the grate itself. Air-cooled grates with well distributed air cooling flow are generally suitable for wastes of average NCV of up to approx 18 MJ/kg. Higher NCV wastes may require water (or other liquid) cooling in order to prevent the need for excessive primary air levels (i.e. levels that result in a greater air supply than the optimum for combustion control) to control grate temperature and length/position of fire on the grate (see section 4.2.14)</p>	<p>For the grate a combination of water cooled blocks and air cooled blocks is used. The calorific value is below 18 GJ/t (usually 10-11 GJ/t).</p>	<p>Yes</p>
<p>61. the location of new installations so that the use of CHP and/or the heat and/or steam utilisation can be maximised, so as to generally exceed an overall total energy export level of 1.9 MWh/tonne of MSW (ref. Table 3.42), based on an average NCV of 2.9 MWh/tonne (ref. Table 2.11)</p>	<p>The thermal efficiency is above 79,3 % (based on calculation of R1). Currently no heat or steam export is planned (however the plant is designed for heat export in case of future possibilities)</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>62. in situations where less than 1.9 MWh/tonne of MSW (based on an average NCV of 2.9 MWh /tonne) can be exported, the greater of:</p> <p>a. the generation of an annual average of 0.4 – 0.65 MWh electricity/tonne of MSW (based on an average NCV of 2.9 MWh/tonne (ref. Table 2.11) processed (ref. Table 3.40), with additional heat/steam supply as far as practicable in the local circumstances, or</p> <p>b. the generation of at least the same amount of electricity from the waste as the annual average electricity demand of the entire installation, including (where used) on-site waste pre-treatment and on-site residue treatment operations (ref. Table 3.48)</p>	<p>The annual average production is 1,02 MWh electricity/tonne of waste.</p>	<p>Yes</p>
<p>63. to reduce average installation electrical demand (excluding pre-treatment or residue treatment) to be generally below 0.15 MWh/tonne of MSW processed (ref. Table 3.47 and section 4.3.6) based on an average NCV of 2.9 MWh/tonne of MSW (ref. Table 2.11)</p>	<p>The electrical demand of the of the plant is 0,123 MWh electricity/tonne of waste.</p>	<p>Yes</p>
<p>64. the storage of wastes:</p> <p>a. in enclosed hoppers or,</p> <p>b. on sealed surfaces with controlled drainage inside covered and walled buildings</p>	<p>The waste is stored in the waste bunker. The waste bunker has sealed surfaces and is inside a closed building.</p>	<p>Yes</p>
<p>65. when waste is stockpiled (typically for later incineration) it should generally be baled (see Section 4.1.4.3) or otherwise prepared for such storage so that it may be stored in such a manner that risks of odour, vermin, litter, fire and leaching are effectively controlled</p>	<p>see point 58.</p>	
<p>66. at new and existing installations, the generation of the greater of:</p> <p>a. an annual average of generally at least 0.6 – 1.0 MWh electricity/tonne of waste (based on an average NCV of 4.2 MWh/tonne), or</p> <p>b. the annual average electricity demand of the entire installation, including (where used) on-site waste pretreatment and on-site residue treatment operations</p>	<p>The annual average production is 1,02 MWh electricity/tonne of waste.</p>	<p>Yes</p>

BAT	TNG	BAT fulfilled?
<p>67. the location of new installations so that:</p> <p>a. as well as the 0.6 – 1.0 MWh/ tonne of electricity generated, the heat and/or steam can also be utilised for CHP, so that in general an additional thermal export level of 0.5 – 1.25 MWh/tonne of waste (ref. section 3.5.4.3) can be achieved (based on an average NCV of 4.2 MWh/tonne), or</p> <p>b. where electricity is not generated, a thermal export level of 3 MWh/tonne of waste can be achieved (based on an average NCV of 4.2 MWh/tonne)</p>	<p>The annual average production is 1,02 MWh electricity/tonne of waste.</p>	<p>Yes</p>
<p>68. to reduce installation energy demand and to achieve an average installation electrical demand (excluding pretreatment or residue treatment) to generally below 0.2 MWh/tonne of waste processed (ref. Table 3.47 and section 4.3.6) based on an average NCV of 4.2 MWh/tonne of waste</p>	<p>The electrical demand of the plant is 0,123 MWh electricity/tonne of waste.</p>	<p>Yes</p>

MEMO

Job **TNG Energy from Waste Facility, Eastern Creek,
Differences between quoted design Ash outputs and operational ash outputs**
Date **2016-10-24**
From **Ahmet Erol**

Differences between quoted design Ash outputs and operational ash outputs**Introduction**

TNG have been asked to provide an explanation for the differences between quoted design ash outputs and operational ash outputs from the reference facilities.

Factors influencing bottom ash quantity of EfW plants

The design of an EfW plant is based on the waste amount, the waste composition and the calorific value (CV) of the waste.

An important aspect of the waste composition is the ash content which is made up of the ash of combustible fuel (ash of wood, paper, etc.) as well as inert materials like metal, glass, stone, sand etc.

Depending on the nature of the waste the ash content varies. Even different waste streams with identical CV can have a variation of the ash content. The CV is mainly influenced by the relation between combustible, water and inert. A waste with high water but low ash content can have the same CV as a waste with high ash and low water content.

As a result there can be a certain variation (usually +/- 3-5% points) of the ash in real operation compared to the design value even if a plant is running at its designed throughput capacity.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-015 Explanation
design Ash and operational Ash
outputs.docx
Ver. 3

Ramboll Danmark A/S
DK reg.no. 35128417

Member of FRI

Ash outputs

Facility/Location	LHV @ LPN MJ/kg	Design t/a	Fuel mix	bottom ash (wet) t/a	bottom ash Quantity (wet) %	Bottom Ash Dry %	
						Operation	Design
TNG	12.3	4 x 276'250	C&I, C&D	293'166	26.5%	-	21.49%
Grossräschen	12.5	1 x 246'000	C&I, C&D	68'729	27.9%	22.4%	18.8%
Knapsack	11-17	2 x 150'000	C&I, C&D	81'000	27.0%	21.6%	19.0%
Ferrybridge	8.5	2 x 256'500	C&I, C&D, some MSW, wood	57'830	11.3%	9.0%	12.8%
Riverside	9.6	3 x 195'000	MSW, C&I	146'250	25.0%	20.0%	19.7%
TIRME Mallorca	10	2 x 208'000	MSW, C&I, C&D, Hospital waste, sewage sludge, tyres	92'350	22.2%	17.8%	20.0%

The above table shows updated the design and operational values of several EfW plants. The operation and design bottom ash quantities are all within a variation range of 3-4%.

The ash quantities in case of TIRME Mallorca have been derived from the Environmental Master plan (design) and information received from the operator (operation). The data given in earlier memos was data from the initial design fuel and the reference sheet of the supplier which were obviously outdated.

Appendix D FUEL COMPOSITION

Table D-1: Proposed design fuel analysis, as received basis (Ramboll, 2016)

	Units	CRW	C&D	C&I	Floc waste	Paper Pulp	Glass Recovery	GO Residual	AWT Residual	MRF Residual	Design Fuel Mix
Fuel Mix	%	23.37%	28.69%	16.84%	14.43%	4.81%	1.72%	2.06%	6.87%	1.20%	100
Compositional Analysis											
Paper/Card	%	4.30	14.05	22.44	3.93	78.40	62.00	30.00	21.05	38.54	16.75
Plastic Film	%	10.20	6.37	10.90	10.90	21.60	3.80	2.50	20.00	26.94	10.47
Dense Plastic	%	0.00	6.37	10.90	10.90	0.00	34.20	2.50	21.05	0.00	7.32
Textiles	%	5.30	0.00	12.89	0.18	0.00	0.00	0.00	10.53	0.00	4.16
Glass	%	0.00	0.00	1.81	0.00	0.00	0.00	4.00	0.00	8.50	0.49
Vegetation	%	8.30	0.00	1.70	0.00	0.00	0.00	35.00	3.16	0.00	3.16
Other combustibles	%	0.00	0.00	0.00	70.40	0.00	0.00	0.00	0.00	0.00	10.16
Metal	%	1.80	1.12	0.37	0.00	0.00	0.00	5.00	0.00	7.59	1.00
Fines	%	0.00	0.94	0.18	0.00	0.00	0.00	0.00	11.58	0.00	1.10
Wood	%	58.20	43.90	21.53	0.85	0.00	0.00	0.00	4.21	0.00	30.24
Combustibles	%	0.00	0.00	2.84	2.84	0.00	0.00	0.00	2.11	0.00	1.03
Non-Combustibles	%	4.50	0.00	0.00	0.00	0.00	0.00	21.00	1.05	0.03	1.56
Hazardous	%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Gyprock	%	2.40	6.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.42
Other	%	5.00	20.75	14.44	0.00	0.00	0.00	0.00	5.26	18.40	10.14
Total	%	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
Chemical Analysis											
Carbon (C)	%	31.34	27.02	35.00	29.65	42.90	41.01	16.98	38.96	32.63	31.44
Hydrogen (H)	%	4.21	3.51	4.29	3.80	5.84	4.63	2.12	4.98	4.84	4.07
Nitrogen (N)	%	0.34	0.06	0.59	0.18	0.00	0.00	0.12	0.47	0.00	0.26
Sulphur(S)	%	0.42	1.04	0.05	0.11	0.12	0.09	0.06	0.04	0.06	0.43
Chloride (Cl)	%	0.09	0.66	1.15	1.78	0.19	3.27	0.26	2.18	0.23	0.88
Oxygen (O)	%	21.11	21.50	17.50	7.04	24.64	26.69	12.58	13.77	12.11	18.06
Water (H2O)	%	28.47	21.51	21.68	22.62	22.58	20.81	36.20	18.40	15.20	23.38
Ash	%	14.03	24.70	19.74	34.82	3.73	3.50	31.68	21.20	34.93	21.49
Total	%	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
NCV	MJ/kg	11.95	9.97	13.84	12.59	17.22	15.24	5.67	16.33	14.23	12.30

Table D-2: Fuel mix (Ramboll, 2016)

Fuel component		Minimum	Maximum
Nitrogen(N)	%	0.19	0.34
Sulphur(S)		0.31	0.57
Chloride (Cl)		0.64	0.96
Ash		13	26
Water(H ₂ O)		14	34
NCV	MJ/kg	8.5	16.5

D.1 RAMBOLL MEMO – DESIGN FUEL MIX



ENERGY

MEMO

Job **TNG Energy from Waste Facility, Eastern Creek,
Differences Design fuel mix between UTDI (Nov 15) and Concept of Design
(March 15) reports**
Date **2016-10-24**
From **Martin Brunner, Ahmet Erol**

Differences of the Design fuel mix between UTDI (Nov 15) and Concept of Design (March 15) reports

Introduction

EPA requested an explanation why there are such differences in the design fuel mix between Updated Technical Design Information (UTDI Nov 15) report and the Concept of Design (March 15) report and why it has not had an impact on the percentage make-up of the design fuel mix.

Explanation

Ramboll was asked to review the basis design fuel in the Fichtner Concept Design Report. As a basis for this review Ramboll was provided a comprehensive report with description and pictures of the waste streams treated at the Genesis plant and the products produced by the screening and sorting process. Based on Ramboll's experience the composition of every product and every waste stream to the future TNG facility was evaluated and redefined.

Ramboll
Hannemanns Allé 53
DK-2300 Copenhagen S
Denmark

T +45 5161 1000
F +45 5161 1001
www.ramboll.com

File: TNGWTE-141-016 Differences
UTDI and CER fuel mix.docx
Ver. 2

Made by AHTE
Checked by MBR, Urbis
Approved by



Composition of waste streams by products

The following table shows the composition of the design fuel based on products (paper, plastic, etc.) in the different waste streams (CRW, C&D, etc.) according to the Concept Design Report (CDR).

	LIMITS	CRW	C&D	C&I	Flock waste	Paper Pulp	Glass Recovery	GO Residual	AWT Residual	MRF Residual	Design Fuel Mix
Fuel Mix	%	23.37%	28.69%	16.84%	14.43%	4.81%	1.72%	2.06%	6.87%	1.20%	100
Compositional Analysis											
Paper/Card	%	4.30	14.05	22.44	3.93	78.40	62.00	30.00	21.05	38.54	16.75
Plastic Film	%	10.20	6.37	10.90	10.90	21.60	3.80	2.50	20.00	26.94	10.47
Dense Plastic	%	0.00	6.37	10.90	10.90	0.00	34.20	2.50	21.05	0.00	7.32
Textiles	%	5.30	0.00	12.89	0.18	0.00	0.00	0.00	10.53	0.00	4.16
Glass	%	0.00	0.00	1.81	0.00	0.00	0.00	4.00	0.00	8.50	0.49
Vegetation	%	8.30	0.00	1.70	0.00	0.00	0.00	35.00	3.16	0.00	3.16
Other combustibles	%	0.00	0.00	0.00	70.41	0.00	0.00	0.00	0.00	0.00	10.16
Metal	%	1.80	1.12	0.37	0.00	0.00	0.00	5.00	0.00	7.59	1.00
Fines	%	0.00	0.94	0.18	0.00	0.00	0.00	0.00	11.58	0.00	1.10
Wood	%	58.20	43.91	21.53	0.85	0.00	0.00	0.00	4.21	0.00	30.24
Combustibles	%	0.00	0.00	2.84	2.84	0.00	0.00	0.00	2.11	0.00	1.03
Non-Combustibles	%	8.90	6.50	0.00	0.00	0.00	0.00	21.00	1.05	0.03	3.98
Hazardous	%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Other	%	5.00	20.75	14.44	0.00	0.00	0.00	0.00	5.26	18.40	10.14
Total	%	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00

Table 1 Fichtner Concept Design Report (March 2015), Design fuel analysis

Based on the description and pictures of the waste streams it was obvious, that one important product in the CRW and C&D waste (so called Gyprock, waste from gypsum building material) had not been considered. As gypsum contains sulphur (CaSO₄), which contributes to the SO₂ content of the flue gas, this waste stream was added to the list of products. To compensate for this change the fraction of non-combustible was reduced. The updated composition (changes shown in green) is shown in Table 2 below.

Ramboll revised	Material Sources and Compositions										
	136000	167000	98000	84000	28000	10000	12000	40000	7000	582000	
Fuel Mix	23.37%	28.69%	16.84%	14.43%	4.81%	1.72%	2.06%	6.87%	1.20%	100%	
	CRW	C&D	C&I	Flock Waste	Paper Pulp	Glass Residual	GO Residual	AWT Residual	MRF Residual	Design Fuel Mix	
Paper/card	4.30%	14.05%	22.44%	3.93%	78.40%	62.00%	30.00%	21.05%	38.54%	16.75%	
Plastic film	10.20%	6.37%	10.90%	10.90%	21.60%	3.80%	2.50%	20.00%	26.94%	10.47%	
Dense plastic	0.00%	6.37%	10.90%	10.90%	0.00%	34.20%	2.50%	21.05%	0.00%	7.32%	
Textiles	5.30%	0.00%	12.89%	0.18%	0.00%	0.00%	0.00%	10.53%	0.00%	4.16%	
Glass	0.00%	0.00%	1.81%	0.00%	0.00%	0.00%	4.00%	0.00%	8.50%	0.49%	
Vegetation	8.30%	0.00%	1.70%	0.00%	0.00%	0.00%	35.00%	3.16%	0.00%	3.16%	
Other combustibles	0.00%	0.00%	0.00%	70.41%	0.00%	0.00%	0.00%	0.00%	0.00%	10.16%	
Metal	1.80%	1.12%	0.37%	0.00%	0.00%	0.00%	5.00%	0.00%	7.59%	1.00%	
Fines	0.00%	0.94%	0.18%	0.00%	0.00%	0.00%	0.00%	11.58%	0.00%	1.10%	
Wood	58.20%	43.91%	21.53%	0.85%	0.00%	0.00%	0.00%	4.21%	0.00%	30.24%	
Combustibles	0.00%	0.00%	2.84%	2.84%	0.00%	0.00%	0.00%	2.11%	0.00%	1.03%	
Non-combustibles	4.50%	0.00%	0.00%	0.00%	0.00%	0.00%	21.00%	1.05%	0.03%	1.56%	
Hazardous	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	
Gyprock	2.40%	6.50%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	2.43%	
Other	5.00%	20.75%	14.44%	0.00%	0.00%	0.00%	0.00%	5.26%	18.40%	10.14%	
Total	100.00%	100.00%	100.00%	100.01%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	

Table 2 Ramboll Updated Technical Design Information (UTDI Nov 15), Design fuel mix revised



Composition of waste streams chemical analysis

The following table shows the initial composition of the design fuel according to the CDR.

	Units	CRW	C&D	C&I	Floc waste	Paper Pulp	Glass Recovery	GO Residual	AWT Residual	MHF Residual	Design Fuel Mix
Chemical Analysis											
Carbon (C)	%	37.37	38.90	40.05	23.44	35.31	40.32	18.53	38.81	30.87	35.83
Hydrogen (H)	%	4.78	5.02	5.40	3.30	5.11	5.61	2.50	5.37	4.53	4.76
Nitrogen (N)	%	0.90	0.71	0.95	0.90	0.37	0.42	0.50	0.85	0.34	0.80
Sulphur(S)	%	0.12	0.12	0.12	0.12	0.12	0.11	0.18	0.17	0.12	0.12
Chloride (Cl)	%	0.17	0.66	1.09	1.03	0.39	2.35	0.39	1.73	0.41	0.75
Oxygen (O)	%	28.21	28.28	24.86	11.84	24.57	22.87	14.30	16.68	15.78	23.81
Water (H2O)	%	17.12	13.81	16.57	50.00	25.00	19.57	31.65	23.77	21.96	22.39
Ash	%	11.33	12.50	8.97	9.36	9.14	8.75	31.95	12.63	25.97	11.53
Total	%	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
NCV	MJ/kg	13.68	12.08	13.46	8.46	13.22	16.13	6.31	14.86	10.09	12.34

Table 3: Fichtner Concept Design Report (March 2015), Chemical Analysis

In order to reassess the design fuel, every single product was analysed and its chemical composition redefined based on a database of comparable products. The chemical composition of each product as used for the assessment is shown in the appendix of this memo. The chemical composition of each waste stream was then calculated based on the chemical composition of its products. The results of the redefinition are shown in the table below.

	Units	CRW	C&D	C&I	Floc waste	Paper Pulp	Glass Recovery	GO Residual	AWT Residual	MHF Residual	Design Fuel Mix
Chemical Analysis											
Carbon (C)	%	31.34	27.02	35	29.65	42.9	41.01	16.98	38.96	32.63	31.44
Hydrogen (H)	%	4.21	3.51	4.29	3.8	5.84	4.63	2.12	4.98	4.84	4.07
Nitrogen (N)	%	0.34	0.06	0.59	0.18	0	0	0.12	0.47	0	0.26
Sulphur(S)	%	0.42	1.04	0.05	0.11	0.12	0.09	0.06	0.04	0.06	0.43
Chloride (Cl)	%	0.09	0.66	1.15	1.78	0.19	3.27	0.26	2.18	0.23	0.88
Oxygen (O)	%	21.11	21.5	17.5	7.04	24.64	26.69	12.58	13.77	12.11	18.06
Water (H2O)	%	28.47	21.51	21.68	22.62	22.58	20.81	36.2	18.4	15.2	23.38
Ash	%	14.03	24.7	19.74	34.82	3.73	3.5	31.68	21.2	34.93	21.49
Total	%	100	100	100	100	100	100	100	100	100	100
NCV	MJ/kg	11.95	9.97	13.84	12.59	17.22	15.24	5.67	16.33	14.23	12.3

Table 4: Ramboll Updated Technical Design Information (UTDI Nov 15), Chemical Analysis revised

The following tables summarize the overall chemical analysis in the Fichtner CDR (March 2015) and the Ramboll UTDI (Nov 2015).

	C	H	O	N	S	Cl	Ash	H ₂ O	NCV
Concept of Design (March 15) report	35.83%	4.76%	23.81%	0.80%	0.12%	0.75%	11.53%	22.39%	12.34 MJ/kg
UTDI (Nov 15) report	31.4%	4.1%	18.1%	0.3%	0.4%	0.9%	21.5%	23.4%	12.30 MJ/kg

Table 5: Comparison of Fichtner CDR and Ramboll UTDI

The major change is the increased ash content. This is mainly a result of increased inert content in C&D, C&I and floc waste. In C&D the inert is mainly coming from adherent mineral substances like gypsum or mortar. The ash in floc waste is made up from paints, dirt, fine metals and rust.

As a result of the higher ash content the percentage of combustible (mainly C, H, O) is reduced accordingly. There further is an increase of the sulphur and chloride content. Both are important parameters for the design of the air pollution control equipment and need to be chosen carefully.

The decrease of oxygen is more than proportional and a result of the chemical reassessment of the different products. As oxygen has a negative impact on the calorific value, the reduction of oxygen results in a constant overall CV – irrespective of the decrease of combustible.

Appendix E SENSITIVE RECEPTORS

Table E-1: Sensitive receptor locations

Sensitive Receptor	Easting (m)	Northing (m)
James Erskine Primary School	296748	6257187
Eskrine Park High School	296709	6256992
Clairgate Public School	296299	6258187
Minchinbury Public School	299287	6259084
Pinegrove Memorial Park Lawn Cemetery	300567	6258692
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266
Eastern Creek Public School	301201	6259319
St Agnes Catholic High School	300761	6259894
All Areas Family Day Care Pty	299581	6258986
Maria Hawey Child Care Centre	299370	6259272
Jiminey Cricket Long Day Care	298562	6259310
White Bunny Child Care Centre	299792	6259530
LITTLES MARTIES	296419	6258212
Kidz Fun Factory	298128	6259445
Industrial facility	297743	6259085
Industrial facility	298017	6259102
Industrial facility	298262	6259157
Industrial facility	298362	6259444
Industrial facility	298106	6259473
Industrial facility	297650	6259598
Industrial facility	297391	6259845
Industrial facility	297425	6259607
Industrial facility	297528	6259706
Industrial facility	297827	6259711
Industrial facility	297923	6259624
Industrial facility	298057	6259589
Industrial facility	298165	6259576
Industrial facility	298169	6259723
Industrial facility	297988	6259754
Industrial facility	297855	6259871
Industrial facility	298473	6259809
Industrial facility	298254	6259912
Industrial facility	297964	6259979
Industrial facility	297807	6260039
Industrial facility	299645	6258440
Industrial facility	299645	6258037
Industrial facility	299709	6257886
Industrial facility	299541	6257851
Industrial facility	299441	6258055
Industrial facility	299490	6257405
Industrial facility	299906	6257425
Industrial facility	300157	6257390
Industrial facility	300263	6257339
Industrial facility	300447	6257583

Sensitive Receptor	Easting (m)	Northing (m)
Industrial facility	300228	6257651
Industrial facility	300560	6257928
Industrial facility	300633	6257735
Industrial facility	300948	6257833
Industrial facility	300802	6257591
Industrial facility	300633	6257403
Industrial facility	300755	6257374
Industrial facility	301037	6257567
Industrial facility	301057	6257410
Industrial facility	301003	6257186
Industrial facility	300950	6257066
Industrial facility	300910	6256975
Industrial facility	300682	6257126
Industrial facility	300691	6257026
Industrial facility	300830	6257241
Industrial facility	300436	6257299
Industrial facility	299601	6257064
Industrial facility	299490	6256891
Industrial facility	299689	6256705
Industrial facility	299501	6256224
Industrial facility	300008	6256426
Industrial facility	300219	6256526
Industrial facility	300529	6256577
Industrial facility	300899	6256202
Industrial facility	300786	6255839
Industrial facility	301006	6255854
Industrial facility	298652	6255402
Industrial facility	298508	6255389
Industrial facility	298584	6255037
Industrial facility	296204	6256521
Industrial facility	296614	6256526
Industrial facility	296388	6256355
Industrial facility	296643	6256280
Industrial facility	296700	6256087
Industrial facility	296946	6256040
Industrial facility	296598	6255723
Industrial facility	296410	6255743
Industrial facility	296055	6255881

Appendix F FIVE YEAR ANALYSIS OF METEOROLOGY

As specified in the EPA's *Approved Methods for the Modelling and Assessment of Air Pollutants in New South Wales* five years of data are required to be reviewed so that a representative year of meteorological conditions can be selected.

Annual and seasonal wind roses for Horsley Park Equestrian Centre have been prepared for 2009 through 2013 and are shown below. All five years of data collected at Horsley Park Equestrian Centre show a similar pattern both annually and seasonally. There are some minor differences which are discussed below.

On an annual basis the prevailing wind directions originate from all directions of the compass, with fewer winds experienced from the northeast and north-northeast.

During summer the prevailing winds are dominated by flows originating from the eastern and south-eastern quadrants.

Conversely, the months of winter are dominated by wind from the south-western and north-western quadrants. Almost no winds are experienced from the north-eastern and north-north-eastern directions across all years of data examined.

The wind distribution patterns for autumn and spring are less consistent and present a transition of summer to winter and vice versa across all years.

The percentage of calms is fairly consistent across all years and ranged between 14.2 % for 2009 and 24.5% for 2013.

Further analysis was conducted for the five years of data. The long term trend of monthly average temperature and monthly average wind speed is also shown below.

A strong seasonal trend in monthly average temperatures is evidenced with the highest temperatures experienced during the summer months of December, January and February and the lowest temperatures during the winter months of June, July and August. 2009 and 2013 are shown to experience higher monthly average temperatures across most months. Generally speaking, the monthly average temperatures at Horsley Park Equestrian Centre do not vary significantly from year to year.

There is no strong relationship between the time of year and the monthly average wind speed. Generally speaking, the monthly average wind speeds are less during the months of autumn. Both 2009 and 2010 measured the highest winds speed across the five years investigated. The lowest wind speed was recorded in 2013.

From this analysis, in addition to the consistent wind distribution patterns experienced discussed above it is considered that 2013 is a typical year and is therefore deemed a representative year for dispersion modelling.

Annual and Seasonal Windroses Horsley Park Equestrian Centre 2009

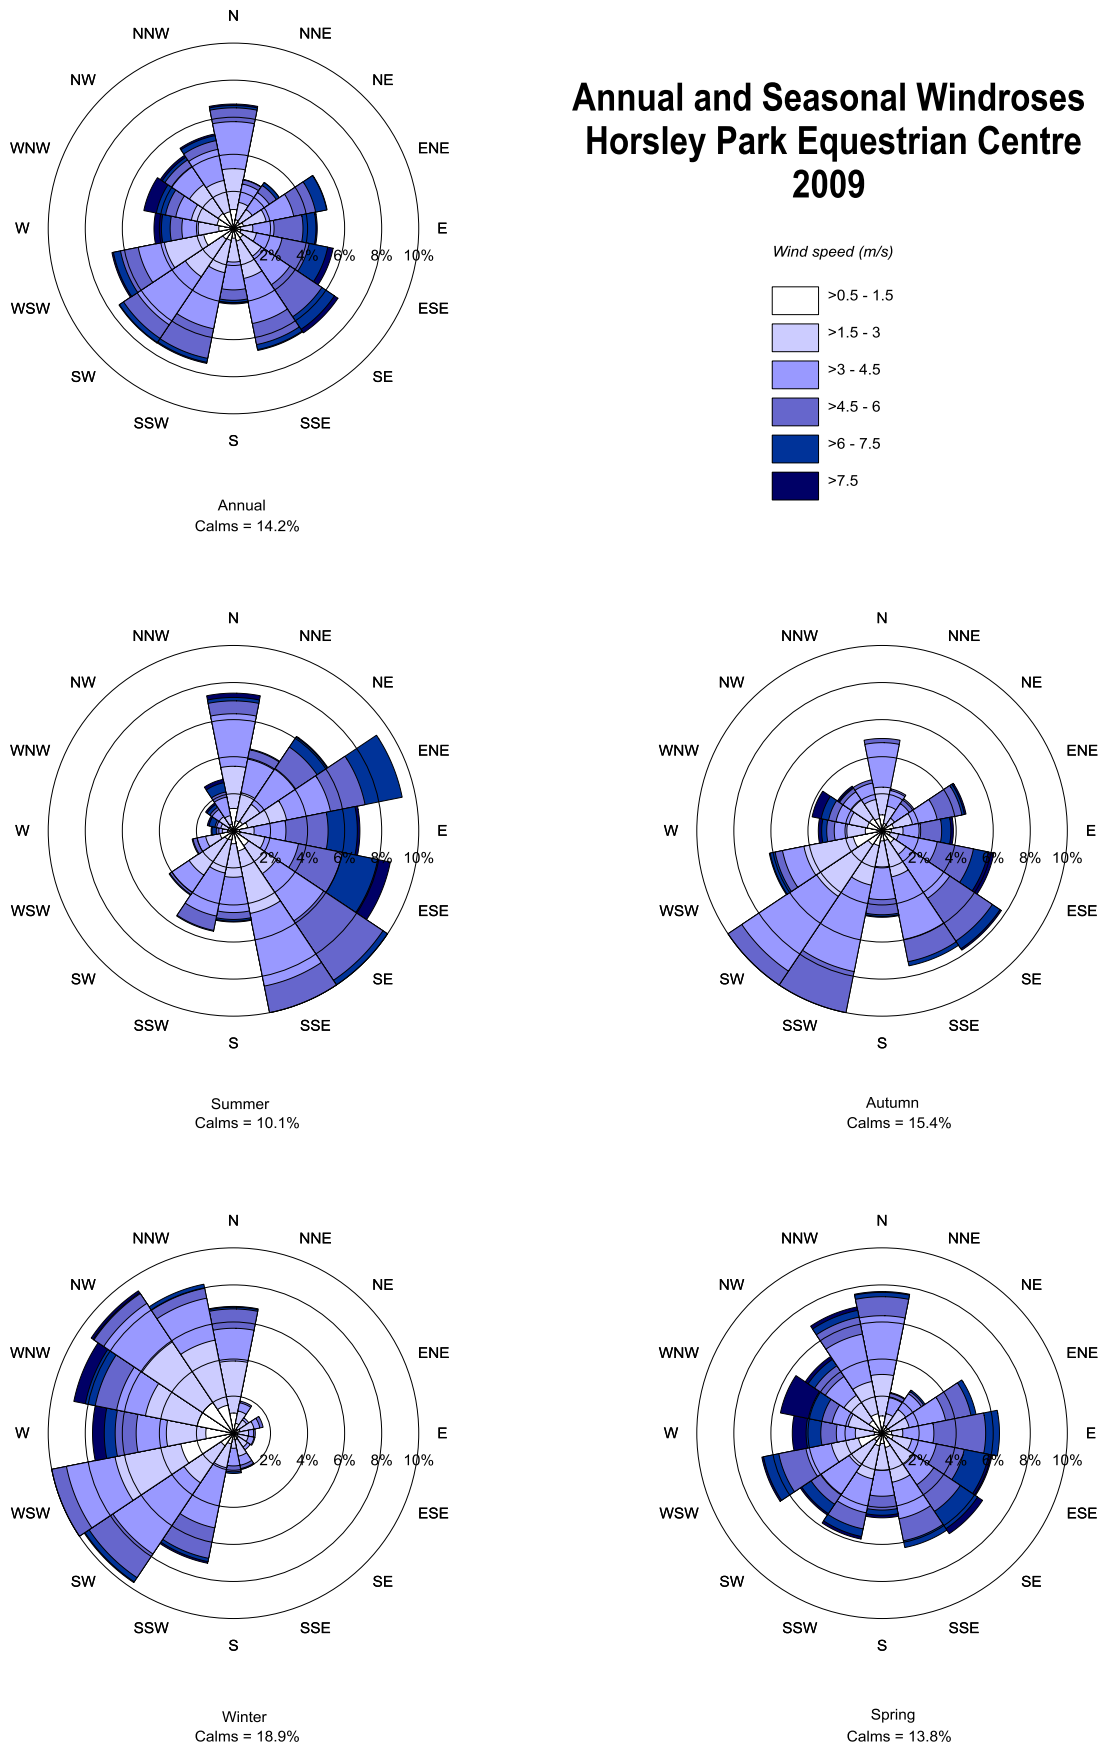


Figure F-1: Annual and seasonal wind roses for Horsley Park Equestrian Centre (2009)

Annual and Seasonal Windroses Horsley Park Equestrian Centre 2010

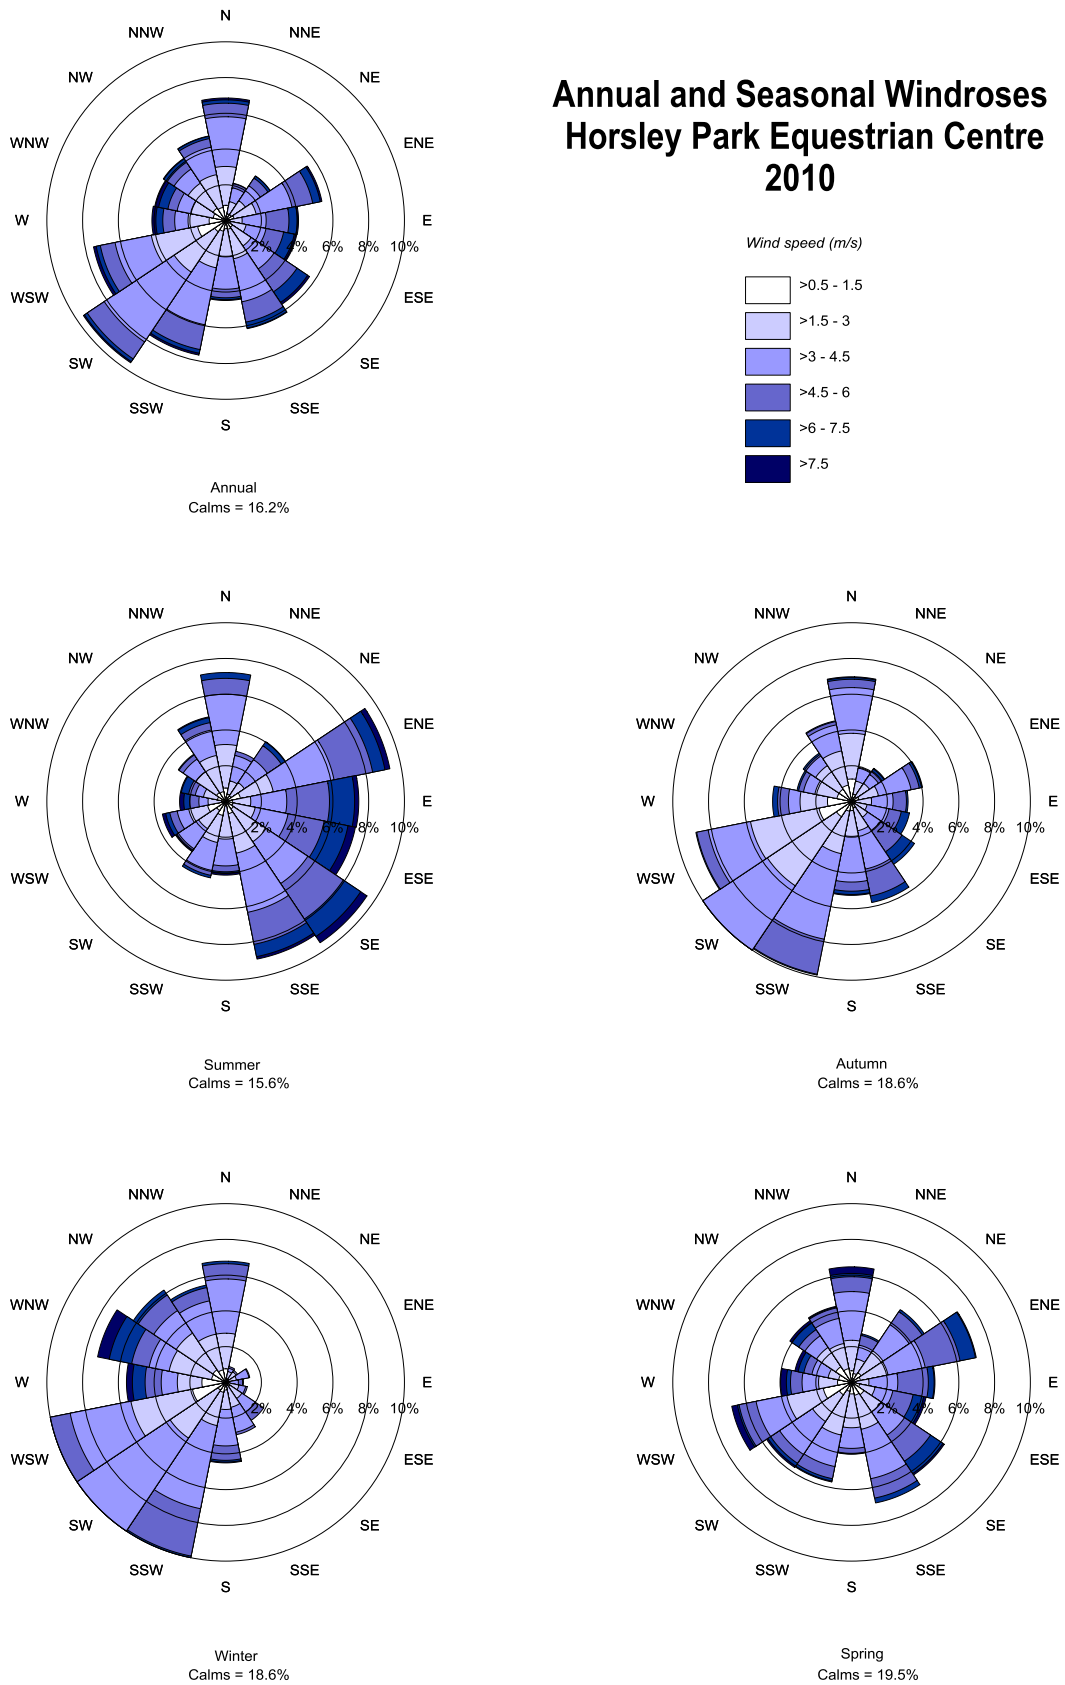


Figure F-2: Annual and seasonal wind roses for Horsley Park Equestrian Centre (2010)

Annual and Seasonal Windroses Horsley Park Equestrian Centre 2011

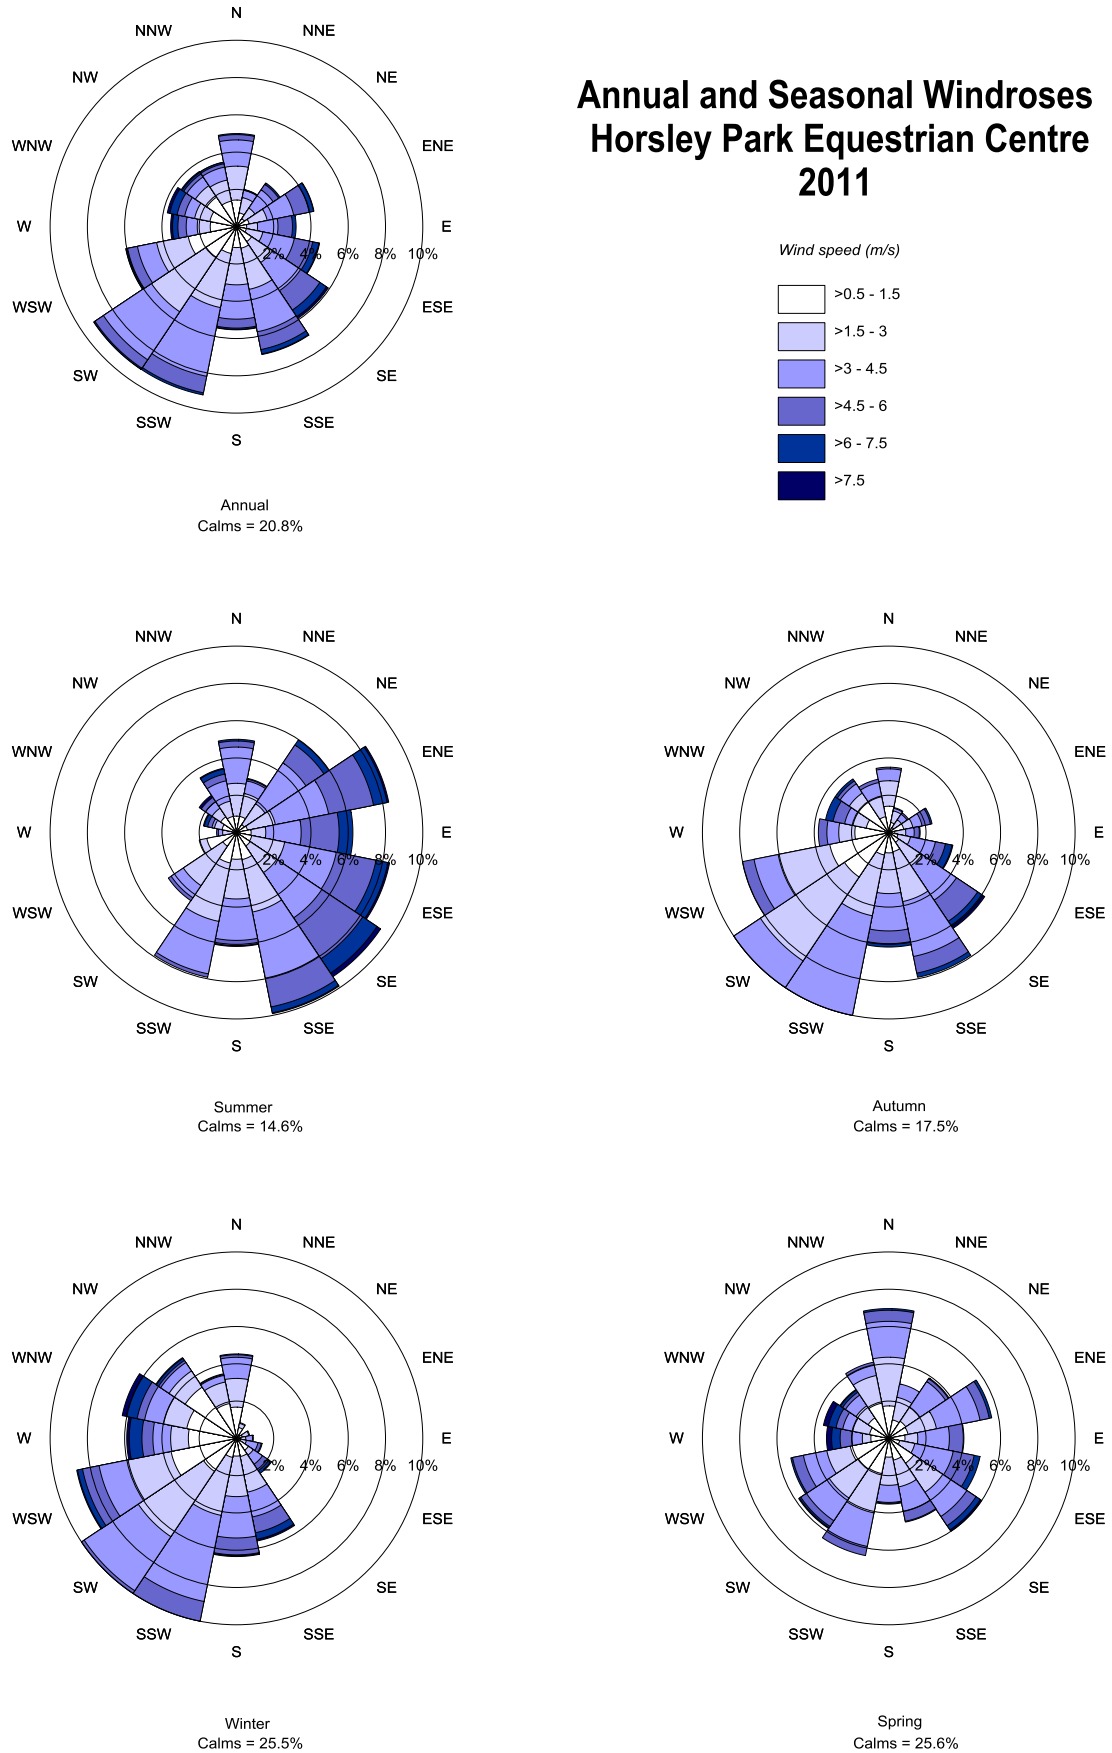


Figure F-3: Annual and seasonal wind roses for Horsley Park Equestrian Centre (2011)

Annual and Seasonal Windroses Horsley Park Equestrian Centre 2012



Figure F-4: Annual and seasonal wind roses for Horsley Park Equestrian Centre (2012)

Annual and Seasonal Windroses Horsley Park Equestrian Centre 2013

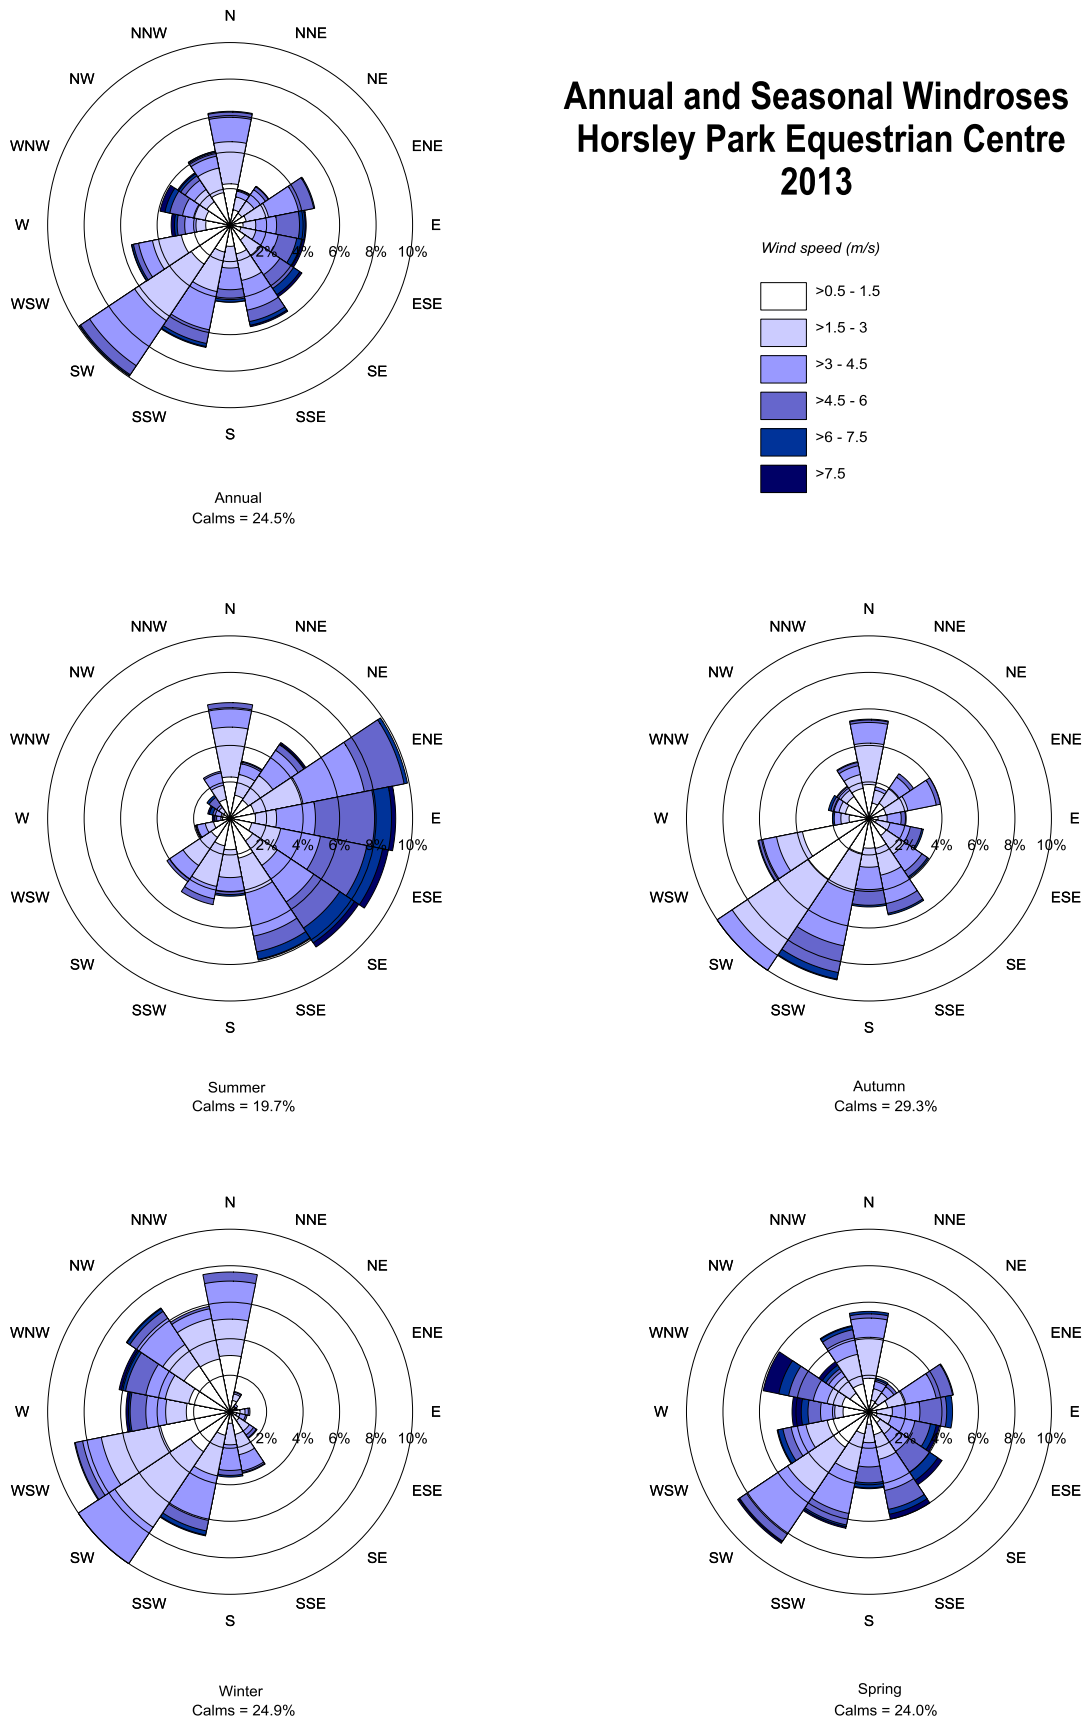


Figure F-5: Annual and seasonal wind roses for Horsley Park Equestrian Centre (2013)

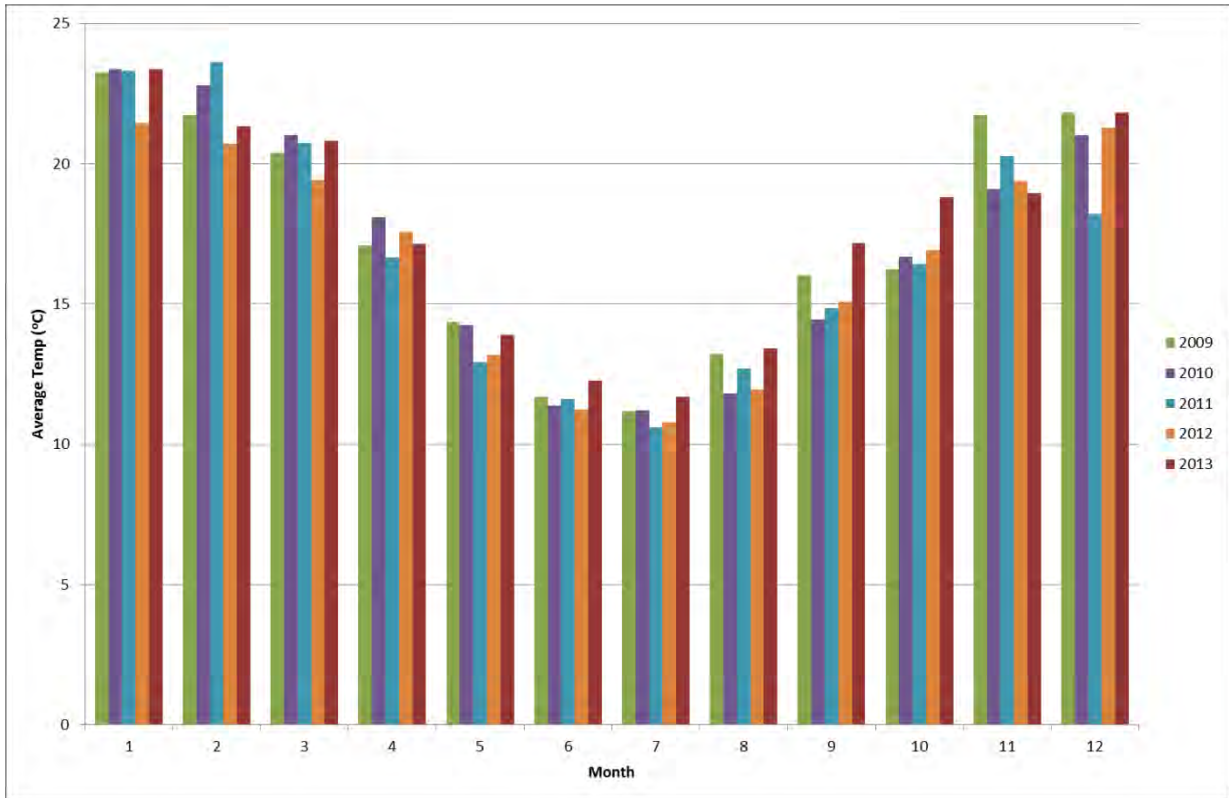


Figure F-6: Monthly average temperature at Horsley Park Equestrian Centre (2009 – 2013)

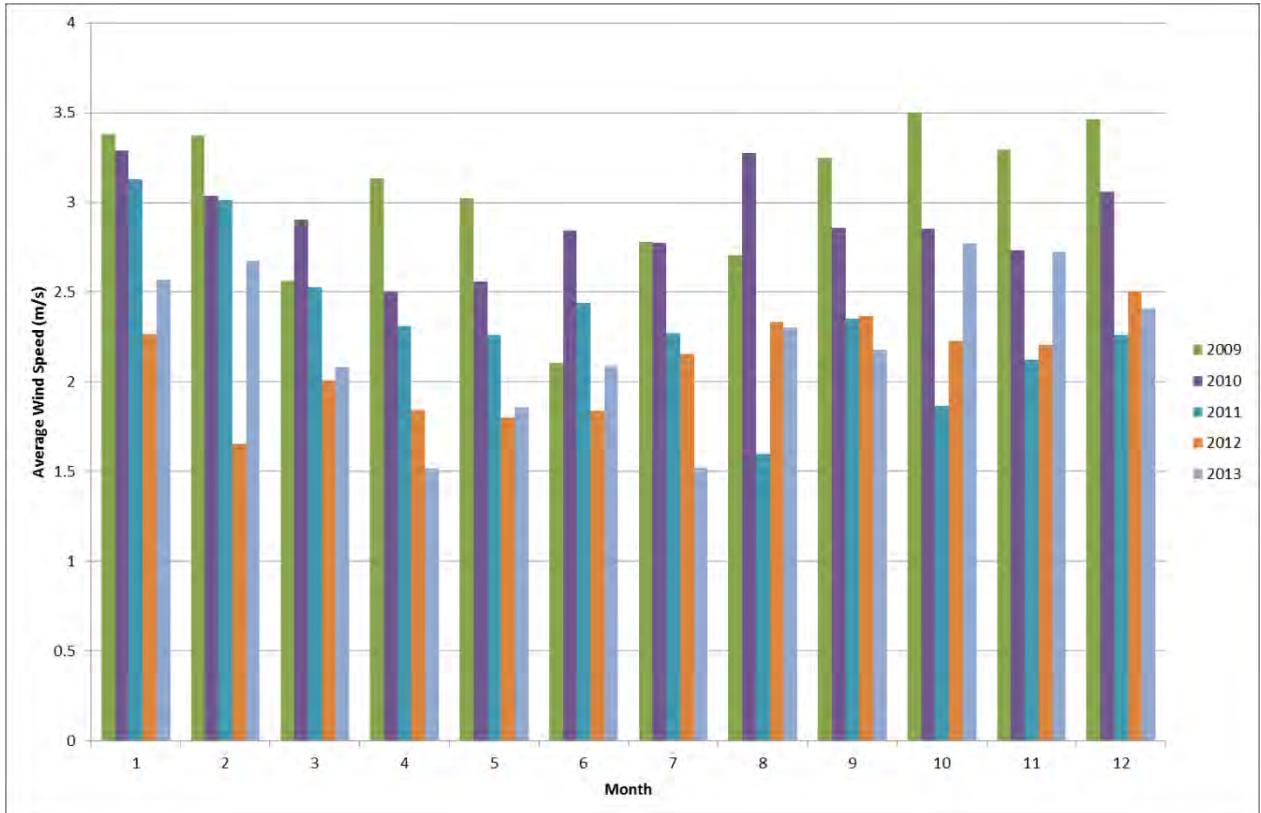


Figure F-7: Monthly average wind speed at Horsley Park Equestrian Centre (2009 – 2013)

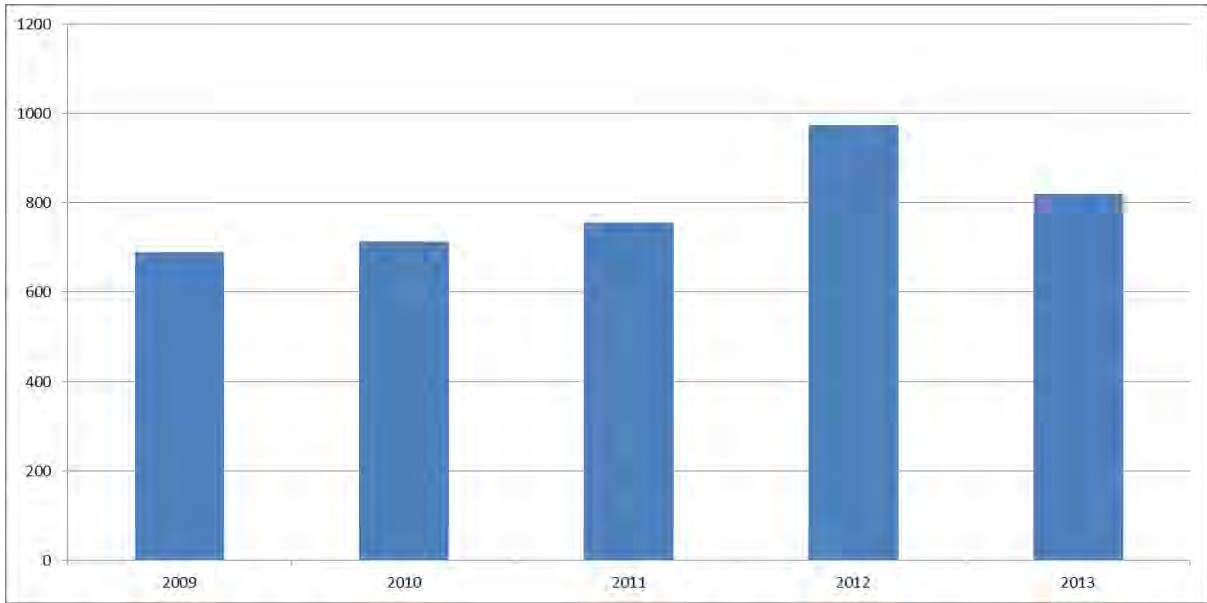


Figure F-8: Annual rainfall at Horsley Park Equestrian Centre (2009 – 2013)

Appendix G SUMMARY OF IN-STACK CONCENTRATION ESTIMATES

Table G-1: In-stack concentrations

Parameter	In Stack Concentration (mg/m ³)	
	Normal Conditions	Upset Conditions
Benzoic Acid	1.00E-01	1.00E+00
Hexa-decanoic Acid	3.70E-02	3.70E-01
Ethyl Benzoic Acid	3.50E-02	3.50E-01
Toluene	3.00E-02	3.00E-01
Phthalate	2.00E-02	2.00E-01
Dichloro-methane	2.00E-02	2.00E-01
Acetone (propanone)	1.80E-02	1.80E-01
Tetra-decanoic Acid	1.50E-02	1.50E-01
Benzene	1.50E-02	1.50E-01
Acetonitrile	1.40E-02	1.40E-01
Xylene	1.00E-02	1.00E-01
Trichloro-phenol	9.00E-03	9.00E-02
Methyl-hexane	6.00E-03	6.00E-02
Trichloro-ethylene	5.00E-03	5.00E-02
Heptane	5.00E-03	5.00E-02
PM10	1.00E+00	1.50E+02
PM2.5	1.00E+00	1.50E+02
HCl	9.00E+00	9.00E+01
HF	4.00E+00	4.00E+01
H2S	5.00E+00	5.00E+01
SO2	2.70E+01	2.70E+02
NO2	1.88E+02	1.88E+03
CO	2.30E+01	2.30E+02
NH3	2.00E+00	2.00E+01
Hg	4.00E-03	1.30E-02
Cd	9.00E-03	9.00E-02
Tl	1.00E-03	9.00E-03
Be	7.00E-06	5.25E-04
Ag	3.40E-04	2.55E-02
Zn	3.70E-02	5.09E+00
Sn	3.33E-03	2.50E-01
Mo	2.20E-05	2.63E-03
Se	2.12E-03	2.12E-02
As	4.00E-03	4.00E-02
Sb	1.48E-02	1.48E-01
Cr	4.67E-02	4.67E-01
Pb	1.72E-01	1.72E+00
Ni	2.10E-02	2.08E-01
Cu	1.63E-02	2.45E-01
Co	4.00E-03	4.00E-02

Parameter	In Stack Concentration (mg/m ³)	
	Normal Conditions	Upset Conditions
Mn	3.65E-02	4.58E-01
V	1.00E-03	1.50E-02
PCDD/F	1.00E-08	5.00E-07
PCBs	1.60E-08	1.60E-07
HCB	8.21E-06	8.21E-05
PAHs	5.00E-04	5.00E-03

Appendix H PERFORMANCE SPECIFICATIONS FOR EMERGENCY DIESEL GENERATORS



**EPA Tier 2 Exhaust Emission
Compliance Statement
C3000 D5e
40CFR 60 Subpart IIII
50 Hz Diesel Generator Set**

Compliance Information:

The engine used in this generator set complies with Tier 2 emissions limit of U.S. EPA New Source Performance Standards for stationary emergency engines under the provisions of 40 CFR 60 Subpart IIII when tested per ISO8178 D2.

Engine Manufacturer: Cummins Inc
EPA Certificate Number: ECEXL060.AAD
Effective Date: 05/20/2013
Date Issued: 05/20/2013
EPA Engine Family (Cummins Emissions Family): ECEXL060.AAD-017

Engine Information:

Model: Cummins Inc. QSK78-G15
Engine Nameplate HP: 3403 (Standby)
Type: 4 Cycle, VEE 18 Cylinder Diesel
Aspiration: Turbocharged and Aftercooled
Emission Control Device: Turbocharged and Aftercooled
Bore: 6.69 in. (170 mm)
Stroke: 7.48 in. (190 mm)
Displacement: 4735 cu. in. (77.6 liters)
Compression Ratio: 15.5:1

**Diesel Fuel Emission Limits
D2 Cycle Exhaust Emissions**

	Grams per BHP-hr			Grams per kWm-hr		
	NOx NMHC	CO	PM	NOx NMHC	CO	PM
Test Results - Diesel Fuel (300-4000 ppm Sulfur)	3.30	1.50	0.22	4.40	2.00	0.29
EPA Emissions Limit	3.50	3.70	0.22	4.70	5.00	0.30

Test Methods: EPA/CARB Nonroad emissions recorded per 40CFR89 (ref. ISO8178-1) and weighted at load points prescribed in Subpart E, Appendix A for Constant Speed Engines (ref. ISO8178-4, D2)

Diesel Fuel Specifications: 40-48 Cetane Number, ASTM D975 No. 2-D..

Reference Conditions: Air Inlet Temperature: 25°C (77°F), Fuel Inlet Temperature: 40°C (104°F). Barometric Pressure: 100 kPa (29.53 in Hg), Humidity: 10.7 g/kg (75 grains H₂O/lb) of dry air, required for NO_x correction, Restrictions: Intake Restriction set to a maximum allowable limit for clean filter, Exhaust Back Pressure set to a maximum allowable limit.

Tests conducted using alternate test methods, instrumentation, fuel or reference conditions can yield different results. Engine operation with excessive air intake or exhaust restriction beyond published maximum limits, or with improper maintenance, may result in elevated emission levels.

Inhaltsverzeichnis

Contents

	Genset	Marine	O & G	Rail	C & I
Application	x				
Engine model	20V4000G63L 6ETC				
Application group	3B	3E	3F	3G	3H
Emission Stage/Optimisation	fuel-optimised				
Test cycle	D2 + 110%				
Data Set	XZ59654100282				
Fuel sulphur content [ppm]	5				


Inhalt content	Notiz Note	Seite Page	Buchstabe/Revision change index
Emissions Daten Blatt (EDS) <i>emission Data Sheet (EDS)</i>	O2 gem. O2 meas.	2	a/b
Emissions Daten Blatt (EDS) <i>emission Data Sheet (EDS)</i>	O2 5% O2 5%	3	a/b/c
Emissions Daten Blatt (EDS) <i>emission Data Sheet (EDS)</i>	O2 15% O2 15%	4	b/c
Not to exceed Werte <i>Not to exceed values</i>	O2 gem. O2 meas.	5	a/b
Not to exceed Werte <i>Not to exceed values</i>	O2 5% O2 5%	6	a/b/c
Not to exceed Werte <i>Not to exceed values</i>	O2 15% O2 15%	7	b/c

							Benennung/Title
							Emissionsdatenblatt Emission Data Sheet
c	Fehler korrigiert	09.08.16	Khakhol	MTU Friedrichshafen GmbH			
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhol	Datum/Date	Name/Name		Zeichnungs-Nr./Drawing No.
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhol	Bearbeiter/Drawn by	15.05.2012	Koehler	
-	Freigabe	15.05.12	Link	Geprüft/Checked	15.05.2012	Koehler	
Buchstabe/ Revision	Anderung Modifikation	Datum Date	Name Name	Org.-Einheit/Dept.	TKF	Veser	
							EDS 4000 0461

Vers. 2.0

Für diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfältigt, noch Dritten zugänglich gemacht, noch in anderer Weise missbräuchlich verwendet werden.
We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Revision	a	b							
Change index									
Motordaten									
<i>engine data</i>									
	Genset	Marine	O & G	Rail	C & I				
Application	x								
Engine model	20V4000G63L 6ETC								
Application group	3B	3E	3F	3G	3H				
Emission Stage/Optimisation	fuel-optimised								
Test cycle	D2 + 110%								
fuel sulphur content [ppm]	5								
mg/mN³ values base on residual oxygen value of [%]	measured								
Motor Rohemissionen*									
<i>Engine raw emissions*</i>									
Cycle point	[-]	n1	n2	n3	n4	n5	n6	n7	n8
Power (P/PN)	[-]	1,1	1	0,75	0,50	0,25	0,10		
Power	[kW]	2850	2590	2138	1425	712			
Speed (n/nN)	[-]	1	1	1	1	1			
Speed	[rpm]	1500	1500	1500	1500	1500			
Exhaust temperature after turbine	[°C]	509	498	482	443	365			
Exhaust massflow	[kg/h]	13744	12196	10390	7963	5965			
Exhaust back pressure	[mbar]	27	21	14	7	3			
NOx	[g/kWh]	8,3	10,3	10,9	9,7	7,0			
	[mg/mN³]	2581	3274	3338	2556	1205			
CO	[g/kWh]	0,8	0,6	0,4	0,4	0,9			
	[mg/mN³]	223	177	108	87	152			
HC	[g/kWh]	0,11	0,12	0,16	0,21	0,42			
	[mg/mN³]	31	36	45	52	68			
O2	[%]	8,4	8,4	8,8	10,1	12,9			
Particulate measured	[g/kWh]	-	-	-	-	-			
	[mg/mN³]	-	-	-	-	-			
Particulate calculated	[g/kWh]	0,05	0,04	0,05	0,06	0,13			
	[mg/mN³]	12	12	12	13	19			
Dust (only TA-Luft)	[mg/mN³]	-	-	-	-	-			
FSN	[-]	0,2	0,2	0,2	0,3	0,6			
NO/NO2**	[-]	-	-	-	-	-			
CO2	[g/kWh]	604,1	589,9	591,3	612,2	689,0			
	[mg/mN³]	175320	175277	169783	151727	112002			
SO2	[g/kWh]	0,002	0,002	0,002	0,002	0,002			
	[mg/mN³]	0,6	0,6	0,5	0,5	0,4			
* Emission data measurement procedures are consistent with the respective emission evaluation process. Noncertified engines are measured to sales data (TVU/TEN) standard conditions. These boundary conditions might not be representative for detailed dimensioning of exhaust gas aftertreatment, in this case it is recommended to contact the responsible department for more information. Measurements are subject to variation. The nominal emission data shown is subject to instrumentation, measurement, facility, and engine-to-engine variations. All data applies to an engine in new condition. Over extended operating time deterioration may occur which might have an impact on emission. Exhaust temperature depends on engine ambient conditions.									
** No standard test. To be measured on demand.									


					Benennung/Title				
					Emissionsdatenblatt				
					Emission Data Sheet				
c	Fehler korrigiert	09.08.16	Khakhol	MTU Friedrichshafen GmbH					
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhol		Datum/Date	Name/Name	Zeichnungs-Nr./Drawing No.		
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhol	Bearbeiter/Drawn by	15.05.2012	Koehler	EDS 4000 0461		
-	Freigabe	15.05.12	Link	Geprüft/Checked	15.05.2012	Koehler			
Buchstabe/Revision	Anderung/Modifikation	Datum/Date	Name/Name	Org.-Einheit/Dept.	TKF	Veser			

Vers 2.0
Für diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfältigt, noch Dritten zugänglich gemacht, noch in anderer Weise missbräuchlich verwendet werden.
We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Revision	a	b	c						
Revision									
<i>Change index</i>									
Motordaten									
<i>engine data</i>									
	Genset	Marine	O & G	Rail	C & I				
Application	x								
Engine model	20V4000G63L 6ETC								
Application group	3B	3E	3F	3G	3H				
Emission Stage/Optimisation	fuel-optimised								
Test cycle	D2 + 110%								
fuel sulphur content [ppm]	5								
mg/mN³ values base on residual oxygen value of [%]	5								
Motor Rohemissionen*									
<i>Engine raw emissions*</i>									
Cycle point	[-]	n1	n2	n3	n4	n5	n6	n7	n8
Power (P/PN)	[-]	1,1	1	0,75	0,50	0,25	0,10		
Power	[kW]	2850	2590	2138	1425	712			
Speed (n/nN)	[-]	1	1	1	1	1			
Speed	[rpm]	1500	1500	1500	1500	1500			
Exhaust temperature after turbine	[°C]	509	498	482	443	365			
Exhaust massflow	[kg/h]	13744	12196	10390	7963	5965			
Exhaust back pressure	[mbar]	27	21	14	7	3			
NOx	[g/kWh]	8,3	10,3	10,9	9,7	7,0			
	[mg/mN³]	3267	4150	4371	3741	2367			
CO	[g/kWh]	0,8	0,6	0,4	0,4	0,9			
	[mg/mN³]	283	224	142	128	298			
HC	[g/kWh]	0,11	0,12	0,16	0,21	0,42			
	[mg/mN³]	39	46	59	76	133			
O2	[%]	5,0	5,0	5,0	5,0	5,0			
Particulate measured	[g/kWh]	-	-	-	-	-			
	[mg/mN³]	-	-	-	-	-			
Particulate calculated	[g/kWh]	0,05	0,04	0,05	0,06	0,13			
	[mg/mN³]	16	15	16	20	38			
Dust (only TA-Luft)	[mg/mN³]	-	-	-	-	-			
FSN	[-]	0,2	0,2	0,2	0,3	0,6			
NO/NO2**	[-]	-	-	-	-	-			
CO2	[g/kWh]	604,1	589,9	591,3	612,2	689,0			
	[mg/mN³]	221936	222178	222343	222043	219919			
SO2	[g/kWh]	0,002	0,002	0,002	0,002	0,002			
	[mg/mN³]	0,7	0,7	0,7	0,7	0,7			

* Emission data measurement procedures are consistent with the respective emission evaluation process. Noncertified engines are measured to sales data (TVU/TEN) standard conditions. These boundary conditions might not be representative for detailed dimensioning of exhaust gas aftertreatment, in this case it is recommended to contact the responsible department for more information. Measurements are subject to variation. The nominal emission data shown is subject to instrumentation, measurement, facility, and engine-to-engine variations. All data applies to an engine in new condition. Over extended operating time deterioration may occur which might have an impact on emission. Exhaust temperature depends on engine ambient conditions.

** No standard test. To be measured on demand.

					Benennung/Title	
					Emissionsdatenblatt	
					Emission Data Sheet	
c	Fehler korrigiert	09.08.16	Khakhol	MTU Friedrichshafen GmbH		
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhol		Datum/Date	Name/Name
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhol	Bearbeiter/Drawn by	15.05.2012	Koehler
-	Freigabe	15.05.12	Link	Gepüft/Checked	15.05.2012	Koehler
Buchstabe/Revision	Anderung/Modifikation	Datum/Date	Name/Name	Org.-Einheit/Dept.	TKF	Veser
EDS 4000 0461						

Für diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfältigt, noch Dritten zugänglich gemacht, noch in anderer Weise missbräuchlich verwendet werden. We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Revision	b	c							
Change index									
Motordaten									
<i>engine data</i>									
	Genset	Marine	O & G	Rail	C & I				
Application	x								
Engine model	20V4000G63L 6ETC								
Application group	3B	3E	3F	3G	3H				
Emission Stage/Optimisation	fuel-optimised								
Test cycle	D2 + 110%								
fuel sulphur content [ppm]	5								
mg/mN³ values base on residual oxygen value of [%]	15								
Motor Rohemissionen*									
<i>Engine raw emissions*</i>									
Cycle point	[-]	n1	n2	n3	n4	n5	n6	n7	n8
Power (P/PN)	[-]	1,1	1	0,75	0,50	0,25	0,10		
Power	[kW]	2850	2590	2138	1425	712			
Speed (n/nN)	[-]	1	1	1	1	1			
Speed	[rpm]	1500	1500	1500	1500	1500			
Exhaust temperature after turbine	[°C]	509	498	482	443	365			
Exhaust massflow	[kg/h]	13744	12196	10390	7963	5965			
Exhaust back pressure	[mbar]	27	21	14	7	3			
NOx	[g/kWh]	8,3	10,3	10,9	9,7	7,0			
	[mg/mN³]	1225	1556	1639	1403	887			
CO	[g/kWh]	0,8	0,6	0,4	0,4	0,9			
	[mg/mN³]	106	84	53	48	112			
HC	[g/kWh]	0,11	0,12	0,16	0,21	0,42			
	[mg/mN³]	15	17	22	29	50			
O2	[%]	15,0	15,0	15,0	15,0	15,0			
Particulate measured	[g/kWh]	-	-	-	-	-			
	[mg/mN³]	-	-	-	-	-			
Particulate calculated	[g/kWh]	0,05	0,04	0,05	0,06	0,13			
	[mg/mN³]	6	6	6	7	14			
Dust (only TA-Luft)	[mg/mN³]	-	-	-	-	-			
FSN	[-]	0,2	0,2	0,2	0,3	0,6			
NO/NO2**	[-]	-	-	-	-	-			
CO2	[g/kWh]	604,1	589,9	591,3	612,2	689,0			
	[mg/mN³]	83226	83317	83379	83266	82470			
SO2	[g/kWh]	0,002	0,002	0,002	0,002	0,002			
	[mg/mN³]	0,3	0,3	0,3	0,3	0,3			

* Emission data measurement procedures are consistent with the respective emission evaluation process. Noncertified engines are measured to sales data (TVU/TEN) standard conditions.
These boundary conditions might not be representative for detailed dimensioning of exhaust gas aftertreatment, in this case it is recommended to contact the responsible department for more information.
Measurements are subject to variation. The nominal emission data shown is subject to instrumentation, measurement, facility, and engine-to-engine variations.
All data applies to an engine in new condition. Over extended operating time deterioration may occur which might have an impact on emission. Exhaust temperature depends on engine ambient conditions.

** No standard test. To be measured on demand.

					Benennung/Title	
					Emissionsdatenblatt	
					Emission Data Sheet	
c	Fehler korrigiert	09.08.16	Khakhol	MTU Friedrichshafen GmbH		
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhol		Datum/Date	Name/Name
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhol	Bearbeiter/Drawn by	15.05.2012	Koehler
-	Freigabe	15.05.12	Link	Geprüft/Checked	15.05.2012	Koehler
Buchstabe/Revision	Anderung/Modifikation	Datum/Date	Name/Name	Org.-Einheit/Dept.	TKF	Veser
Vers. 2.0						
					EDS 4000 0461	

Fuer diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfaeltigt, noch Dritten zugaenglich gemacht, noch in anderer Weise missbraeuchlich verwendet werden.
We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Revision	a	b							
Change index									
Motordaten									
<i>engine data</i>									
	Genset	Marine	O & G	Rail	C & I				
Application	x								
Engine model	20V4000G63L 6ETC								
Application group	3B	3E	3F	3G	3H				
Emission Stage/Optimisation	fuel-optimised								
Test cycle	D2 + 110%								
fuel sulphur content [ppm]	5								
mg/mN³ values base on residual oxygen value of [%]	measured								
Not to exceed Werte*									
<i>not to exceed values*</i>									
Cycle point	[-]	n1	n2	n3	n4	n5	n6	n7	n8
Power (P/PN)	[-]	1	0,75	0,50	0,25				
Power	[kW]	2590	2138	1425	712				
Speed (n/nN)	[-]	1	1	1	1				
Speed	[rpm]	1500	1500	1500	1500				
Exhaust back pressure	[mbar]	21	14	7	3				
NOx	[g/kWh]	13,4	14,2	12,6	10,5				
	[mg/mN³]	4256	4339	3323	1808				
CO	[g/kWh]	1,0	0,6	0,7	1,9				
	[mg/mN³]	301	184	166	304				
HC	[g/kWh]	0,21	0,27	0,40	0,83				
	[mg/mN³]	61	77	99	135				
O2	[%]	8,4	8,8	10,1	12,9				
Particulate calculated	[g/kWh]	0,07	0,08	0,09	0,20				
	[mg/mN³]	18	20	20	29				

* Calculated values are not proven by tests and therefore the accuracy cannot be guaranteed. Emissions data measurement procedures are consistent with those described in the applicable rules and standards. The NOx, CO, HC and PM emission data tabulated here were taken from a single new engine under the test conditions shown above and are valid for the following conditions:


- Ambient air pressure 1 bar
- Air intake temperature approx. 25°C
- Rel. Humidity 30%-60%
- New Engine
- New standard- air filter
- Exhaust gas back pressure according the given value in this EDS
- Fuel according to EN 590 or US EPA 40CFR89
- Coolant and Lubricants according MTU Fuels and Lubricants Specification

The nominal emissions data shown is subject to instrumentation, measurement, facility and engine to engine variations. Emissions data is based on single operating points and thus cannot be used to compare to EPA regulations which use values based on a weighted cycle. Emissions data may vary depending on the type of exhaust gas aftertreatment that may be installed on the engine, therefore it is suggested that the engine manufacturer be contacted directly for further information.

Field emission test data are not guaranteed to these levels. Actual field test results may vary due to test site conditions, installation, fuel specification, test procedures, and instrumentation. Over time deterioration may occur which may have an impact on emission levels. Engine operation with excessive air intake or exhaust restriction beyond published maximum limits, or with improper maintenance, may result in elevated emission levels.

MTU Friedrichshafen GmbH has made efforts to ensure that the information in this data sheet is accurate, but reserves the right to amend specifications and information without notice and without obligation or liability. No liability for any errors, facts or opinions is accepted. Customers must satisfy themselves as to the suitability of this product for their application. No responsibility for any loss as a result of any person placing reliance on any material contained in this data sheet will be accepted.

MTU Friedrichshafen GmbH reserves all rights in the information contained in this data sheet. It shall not be reproduced, made available to a third party or otherwise used in any way whatsoever.

					Benennung/Title		
					Emissionsdatenblatt		
					Emission Data Sheet		
c	Fehler korrigiert	09.08.16	Khakhhol	MTU Friedrichshafen GmbH			Zeichnungs-Nr./Drawing No.
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhhol	Datum/Date	Name/Name		
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhhol	Bearbeiter/Drawn by	15.05.2012	Koehler	
-	Freigabe	15.05.12	Link	Gepüft/Checked	15.05.2012	Koehler	
Buchstabe/Revision	Änderung/Modifikation	Datum/Date	Name/Name	Org.-Einheit/Dept.	TKF	Veser	

EDS 4000 0461

Vers 2.0

Für diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfältigt, noch Dritten zugänglich gemacht, noch in anderer Weise missbräuchlich verwendet werden. We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Revision	a	b	c						
Change index									
Motordaten									
<i>engine data</i>									
	Genset	Marine	O & G	Rail	C & I				
Application	x								
Engine model	20V4000G63L 6ETC								
Application group	3B	3E	3F	3G	3H				
Emission Stage/Optimisation	fuel-optimised								
Test cycle	D2 + 110%								
fuel sulphur content [ppm]	5								
mg/m ³ values base on residual oxygen value of [%]	5								
Not to exceed Werte*									
<i>not to exceed values*</i>									
Cycle point	[-]	n1	n2	n3	n4	n5	n6	n7	n8
Power (P/PN)	[-]	1	0,75	0,50	0,25				
Power	[kW]	2590	2138	1425	712				
Speed (n/nN)	[-]	1	1	1	1				
Speed	[rpm]	1500	1500	1500	1500				
Exhaust back pressure	[mbar]	21	14	7	3				
NOx	[g/kWh]	13,4	14,2	12,6	10,5				
	[mg/m ³]	5395	5683	4863	3550				
CO	[g/kWh]	1,0	0,6	0,7	1,9				
	[mg/m ³]	381	241	242	597				
HC	[g/kWh]	0,21	0,27	0,40	0,83				
	[mg/m ³]	78	100	145	265				
O2	[%]	5,0	5,0	5,0	5,0				
Particulate calculated	[g/kWh]	0,07	0,08	0,09	0,20				
	[mg/m ³]	23	26	29	57				

* Calculated values are not proven by tests and therefore the accuracy cannot be guaranteed.
Emissions data measurement procedures are consistent with those described in the applicable rules and standards.
The NOx, CO, HC and PM emission data tabulated here were taken from a single new engine under the test conditions shown above and are valid for the following conditions:


- Ambient air pressure 1 bar
- Air intake temperature approx. 25°C
- Rel. Humidity 30%-60%
- New Engine
- New standard- air filter
- Exhaust gas back pressure according the given value in this EDS
- Fuel according to EN 590 or US EPA 40CFR89
- Coolant and Lubricants according MTU Fuels and Lubricants Specification

The nominal emissions data shown is subject to instrumentation, measurement, facility and engine to engine variations. Emissions data is based on single operating points and thus cannot be used to compare to EPA regulations which use values based on a weighted cycle. Emissions data may vary depending on the type of exhaust gas aftertreatment that may be installed on the engine, therefore it is suggested that the engine manufacturer be contacted directly for further information.

Field emission test data are not guaranteed to these levels. Actual field test results may vary due to test site conditions, installation, fuel specification, test procedures, and instrumentation. Over time deterioration may occur which may have an impact on emission levels. Engine operation with excessive air intake or exhaust restriction beyond published maximum limits, or with improper maintenance, may result in elevated emission levels.

MTU Friedrichshafen GmbH has made efforts to ensure that the information in this data sheet is accurate, but reserves the right to amend specifications and information without notice and without obligation or liability. No liability for any errors, facts or opinions is accepted. Customers must satisfy themselves as to the suitability of this product for their application. No responsibility for any loss as a result of any person placing reliance on any material contained in this data sheet will be accepted.

MTU Friedrichshafen GmbH reserves all rights in the information contained in this data sheet. It shall not be reproduced, made available to a third party or otherwise used in any way whatsoever.

					Benennung/Title	
					Emissionsdatenblatt	
					Emission Data Sheet	
c	Fehler korrigiert	09.08.16	Khakhol	MTU Friedrichshafen GmbH		Zeichnungs-Nr./Drawing No.
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhol	Datum/Date	Name/Name	
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhol	Bearbeiter/Drawn by	15.05.2012	Koehler
-	Freigabe	15.05.12	Link	Geprüft/Checked	15.05.2012	Koehler
Buchstabe/Revision	Anderung/Modifikation	Datum/Date	Name/Name	Org.-Einheit/Dept.	TKF	Veser
Vers 2.0						

Fuer diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfaeltigt, noch Dritten zugaenglich gemacht, noch in anderer Weise missbraeuchlich verwendet werden.
We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Revision	b	c							
Change Index									
Motordaten									
<i>engine data</i>									
	Genset	Marine	O & G	Rail	C & I				
Application	x								
Engine model	20V4000G63L 6ETC								
Application group	3B	3E	3F	3G	3H				
Emission Stage/Optimisation	fuel-optimised								
Test cycle	D2 + 110%								
fuel sulphur content [ppm]	5								
mg/mN ³ values base on residual oxygen value of [%]	15								
Not to exceed Werte*									
<i>not to exceed values*</i>									
Cycle point	[-]	n1	n2	n3	n4	n5	n6	n7	n8
Power (P/PN)	[-]	1	0,75	0,50	0,25				
Power	[kW]	2590	2138	1425	712				
Speed (n/nN)	[-]	1	1	1	1				
Speed	[rpm]	1500	1500	1500	1500				
Exhaust back pressure	[mbar]	21	14	7	3				
NOx	[g/kWh]	13,4	14,2	12,6	10,5				
	[mg/mN ³]	2023	2131	1824	1331				
CO	[g/kWh]	1,0	0,6	0,7	1,9				
	[mg/mN ³]	143	90	91	224				
HC	[g/kWh]	0,21	0,27	0,40	0,83				
	[mg/mN ³]	29	38	54	99				
O2	[%]	15,0	15,0	15,0	15,0				
Particulate calculated	[g/kWh]	0,07	0,08	0,09	0,20				
	[mg/mN ³]	9	10	11	21				

* Calculated values are not proven by tests and therefore the accuracy cannot be guaranteed.
Emissions data measurement procedures are consistent with those described in the applicable rules and standards.
The NOx, CO, HC and PM emission data tabulated here were taken from a single new engine under the test conditions shown above and are valid for the following conditions:


- Ambient air pressure 1 bar
- Air intake temperature approx. 25°C
- Rel. Humidity 30%-60%
- New Engine
- New standard- air filter
- Exhaust gas back pressure according the given value in this EDS
- Fuel according to EN 590 or US EPA 40CFR89
- Coolant and Lubricants according MTU Fuels and Lubricants Specification

The nominal emissions data shown is subject to instrumentation, measurement, facility and engine to engine variations. Emissions data is based on single operating points and thus cannot be used to compare to EPA regulations which use values based on a weighted cycle. Emissions data may vary depending on the type of exhaust gas aftertreatment that may be installed on the engine, therefore it is suggested that the engine manufacturer be contacted directly for further information.

Field emission test data are not guaranteed to these levels. Actual field test results may vary due to test site conditions, installation, fuel specification, test procedures, and instrumentation. Over time deterioration may occur which may have an impact on emission levels. Engine operation with excessive air intake or exhaust restriction beyond published maximum limits, or with improper maintenance, may result in elevated emission levels.

MTU Friedrichshafen GmbH has made efforts to ensure that the information in this data sheet is accurate, but reserves the right to amend specifications and information without notice and without obligation or liability. No liability for any errors, facts or opinions is accepted. Customers must satisfy themselves as to the suitability of this product for their application. No responsibility for any loss as a result of any person placing reliance on any material contained in this data sheet will be accepted.


MTU Friedrichshafen GmbH reserves all rights in the information contained in this data sheet. It shall not be reproduced, made available to a third party or otherwise used in any way whatsoever.

					Benennung/Title	
					Emissionsdatenblatt	
					Emission Data Sheet	
c	Fehler korrigiert	09.08.16	Khakhhol	MTU Friedrichshafen GmbH		
b	Seite 4 und 7 hinzugefügt	20.06.16	Khakhhol		Datum/Date	Name/Name
a	5% O2 und NTE-Datenblätter hinzu	27.05.15	Khakhhol	Bearbeiter/Drawn by	15.05.2012	Koehler
-	Freigabe	15.05.12	Link	Gepüft/Checked	15.05.2012	Koehler
Buchstabe/Revision	Anderung/Modifikation	Datum/Date	Name/Name	Org.-Einheit/Dept	TKF	Veser
Vers 2.0						EDS 4000 0461

Fuer diese technische Unterlage behalten wir uns alle Rechte vor. Sie darf ohne unsere Zustimmung weder vervielfaeltigt, noch Dritten zugaenglich gemacht, noch in anderer Weise missbraeuchlich verwendet werden.
We reserve all rights to this technical document. Without our prior permission it shall not be reproduced, made available to any third party or otherwise misused in any way whatsoever.

Appendix I SUMMARY OF EMISSIONS PERFORMANCE

I.1 SUMMARY OF EMISSIONS PERFORMANCE REPORTED IN WSP (2000)

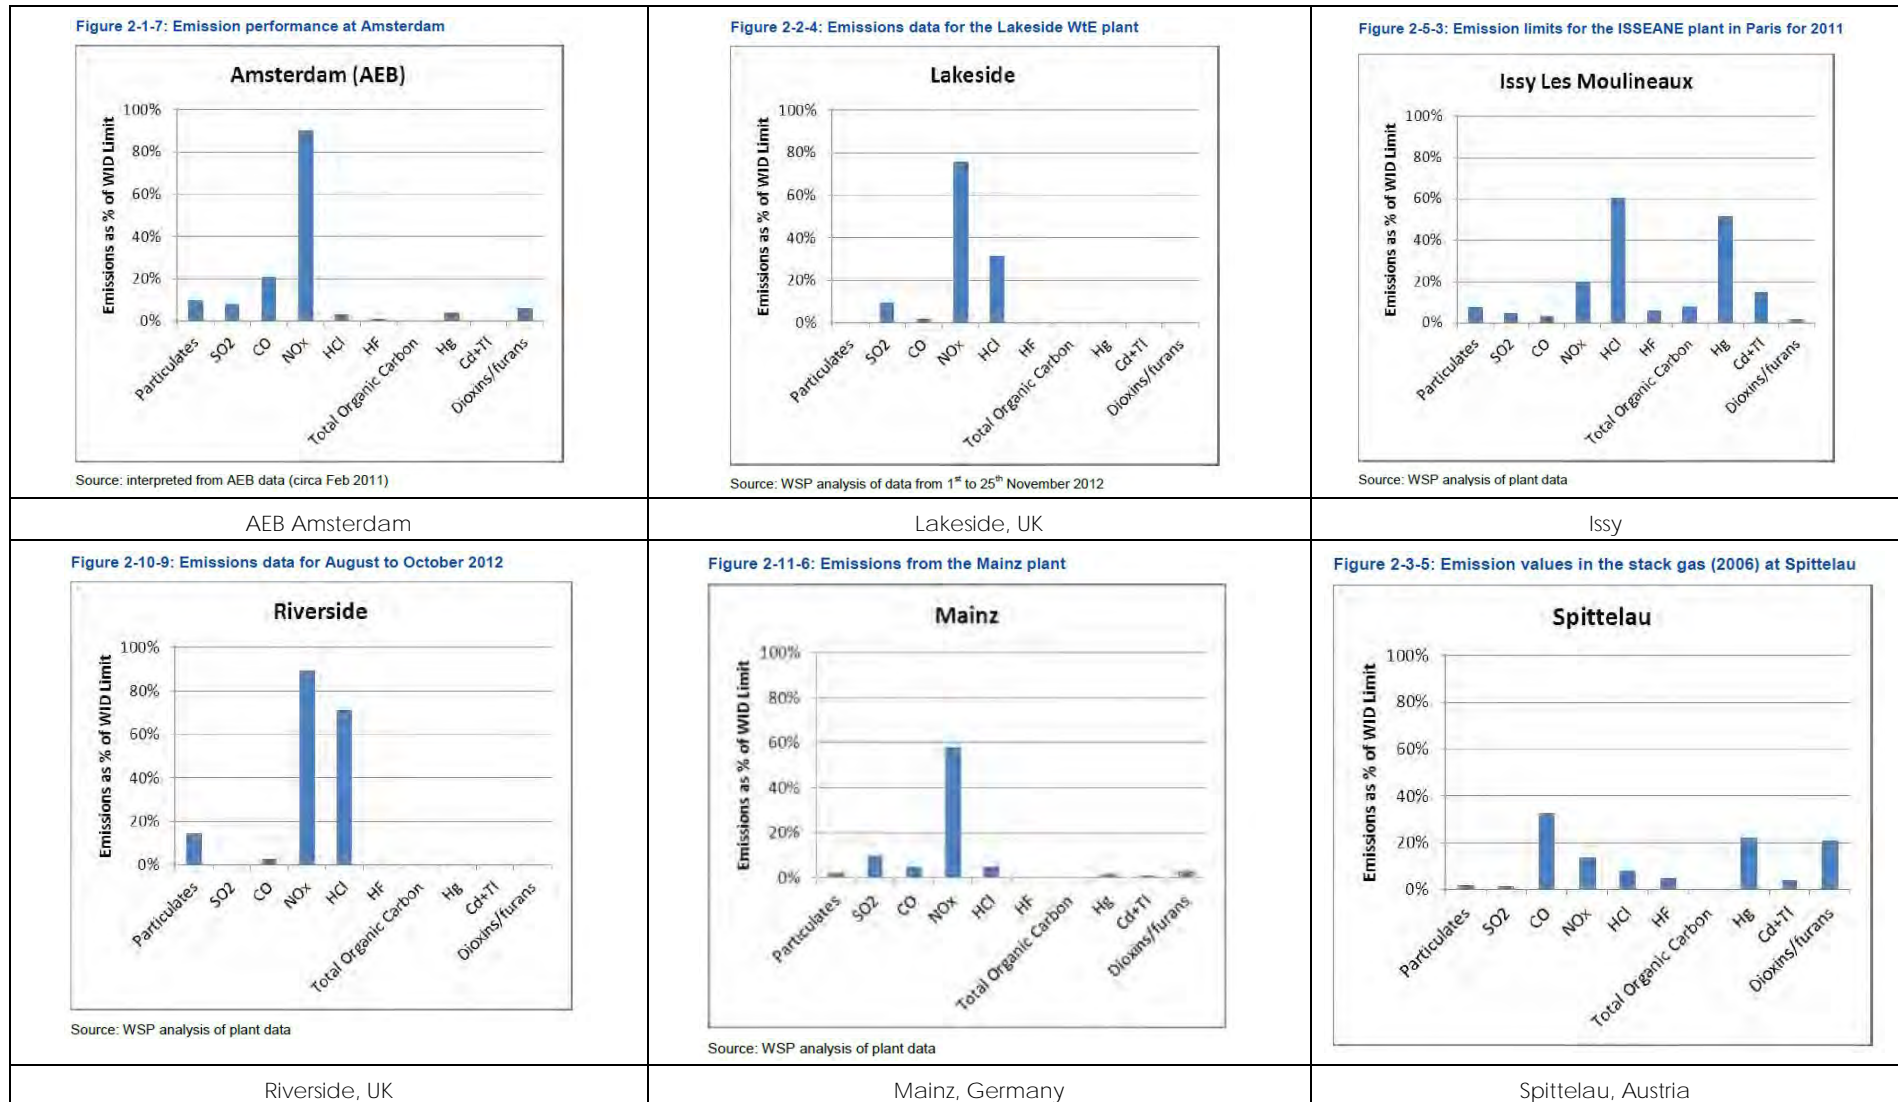

I.2 CADMIUM AND METALS EMISSIONS PERFORMANCE IN HZI PLANTS

Heavy metal emissions HZI plants with semi-dry FGT in UK

all data in mg/m³ at STP and referred to 11% O₂ dry


Metal	Symbol	Plant A			Plant B		Plant C	Average	EU WID
		Line 1	Line 2	Line 3	Line 1	Line 2	Line 3		
Mercury	Hg	0.0015	0.0004	0.0002	0.004	0.003	0.0017	0.002	< 0.05
Cadmium	Cd	0.00270	0.00085	0.00111	0.009	0.001	0.004		
Thallium	Tl	0.00005	0.00003	0.00002	0.000	0.000	0.0009		
Sum Cd+Tl	Cd + Tl	0.00275	0.00087	0.00113	0.009	0.001	0.0049	0.003	< 0.05
Arsenic	As	0.0006	0.0003	0.0004	0.003	0.000	0.0013		
Antimony	Sb	0.0148	0.0047	0.0047	0.007	0.001	0.0026		
Chromium	Cr	0.0179	0.0115	0.0399	0.014	0.002	0.0467		
Cobalt	Co	0.0003	0.0002	0.0001	0.003	0.000	0.0006		
Copper	Cu	0.0085	0.0085	0.0263	0.051	0.001	0.0049		
Lead	Pb	0.0452	0.0137	0.0170	0.172	0.002	0.0094		
Manganese	Mn	0.0084	0.0041	0.0037	0.095	0.005	0.0051		
Nickel	Ni	0.0118	0.0058	0.0041	0.006	0.002	0.0208		
Vanadium	V	0.0003	0.0002	0.0004	0.003	0.000	0.0004		
Sum heavy metal	As-V	0.11	0.049	0.097	0.35	0.015	0.092	0.12	< 0.5

28.4.2014 / HZI / Fy

I.3 SAMPLE CEMS REPORT FROM RIVERSIDE


Riverside Resource Recovery emission report – February 2014

The following charts summarise the emission data for the Riverside Resource Recovery facility. The charts show the **MAXIMUM** readings taken during the month.

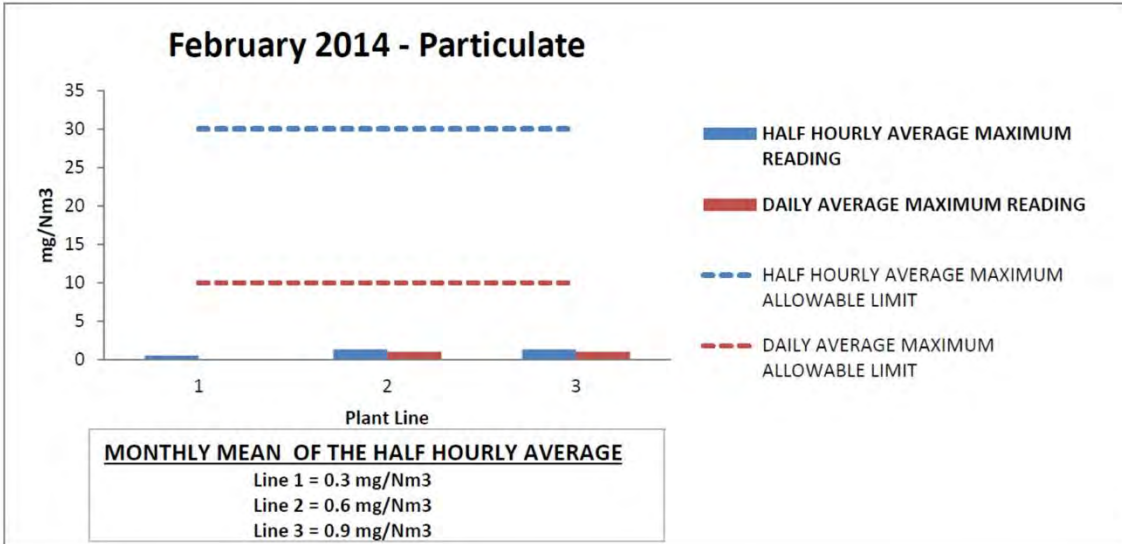


Why do we control and monitor Particulates (dust)?

Particulates is the term used to describe tiny particles in the air, made up of a complex mixture of soot, organic and inorganic materials having a particle size less than or equal to 10 microns diameter (10 microns is equal to one hundredth part of a millimetre). Particulates is one of the eight substances for which the government has established an air quality standard as part of

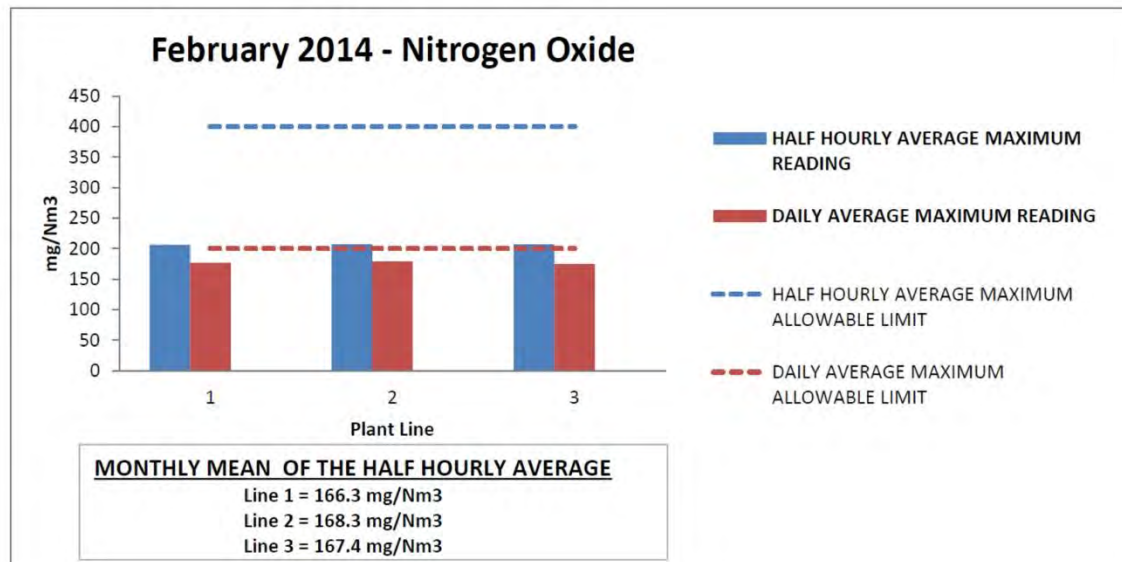

Why do we control and monitor Oxides of Nitrogen (NOx)?


NOx includes various compounds, but is usually used to group two gases; nitrogen dioxide (NO₂) and nitric oxide (NO). These can be formed naturally, but are also formed from man-made processes like fuel combustion or biomass burning. There are a number of health and environmental issues attributed to NOx, including smog, acid rain, and possibly global warming.

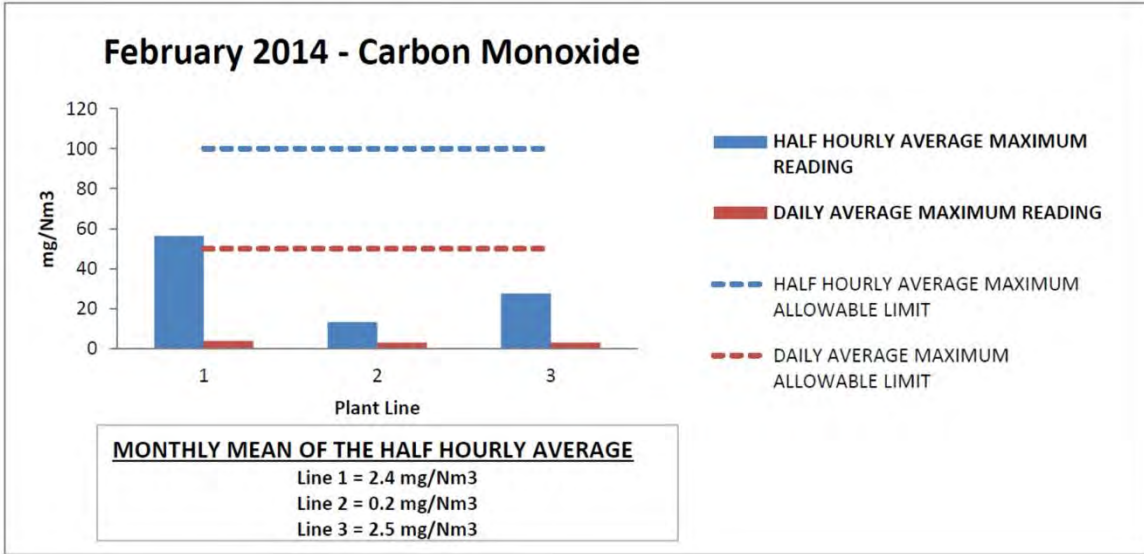

Why do we control and monitor Carbon Monoxide?



Carbon monoxide is both a common naturally occurring chemical and is manufactured by man. It is a colourless, odourless poisonous gas. Carbon monoxide is one of the eight substances for which the government has established an air quality standard as part of its national Air Quality Strategy.

Carbon monoxide can cause harmful health effects by reducing oxygen delivery to the body's organs and tissues.

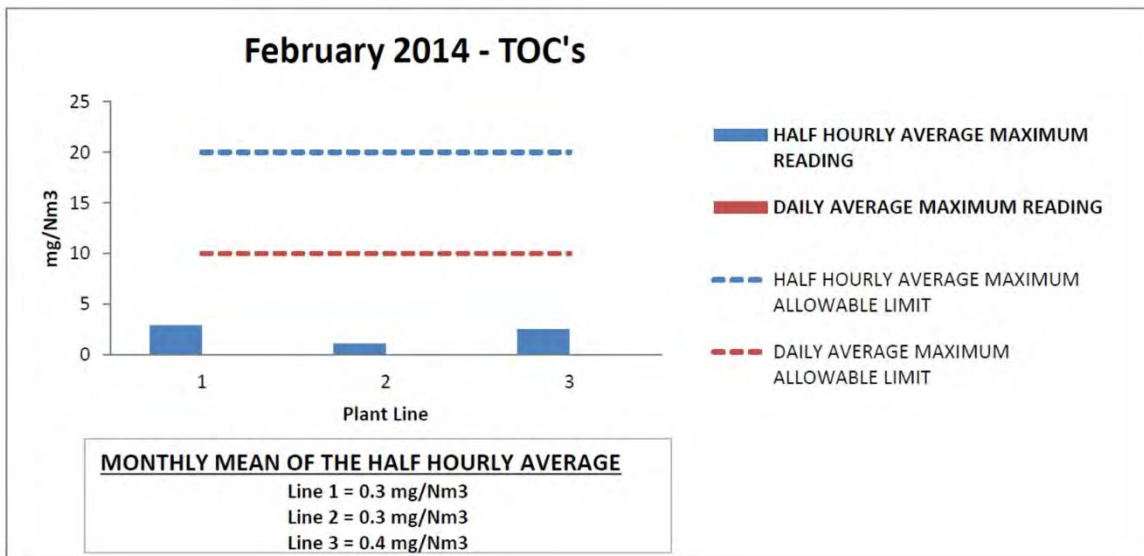


Why do we control and monitor Total Organic Carbon (TOC)?

Total Organic Carbon (TOC) consists of a wide range of organic compounds including Volatile Organic Compounds (VOCs). VOCs are numerous, varied and found everywhere. VOCs are of general concern because of their ability to react with other pollutants (such as nitrogen oxides) in the lower atmosphere to form ozone. High concentrations of ozone at ground level can harm human health, damage crops and affect materials such as rubber. Some VOCs may be directly harmful to human health, contribute to global warming or destroy stratospheric ozone needed to shield the earth's surface from harmful ultra violet radiation.

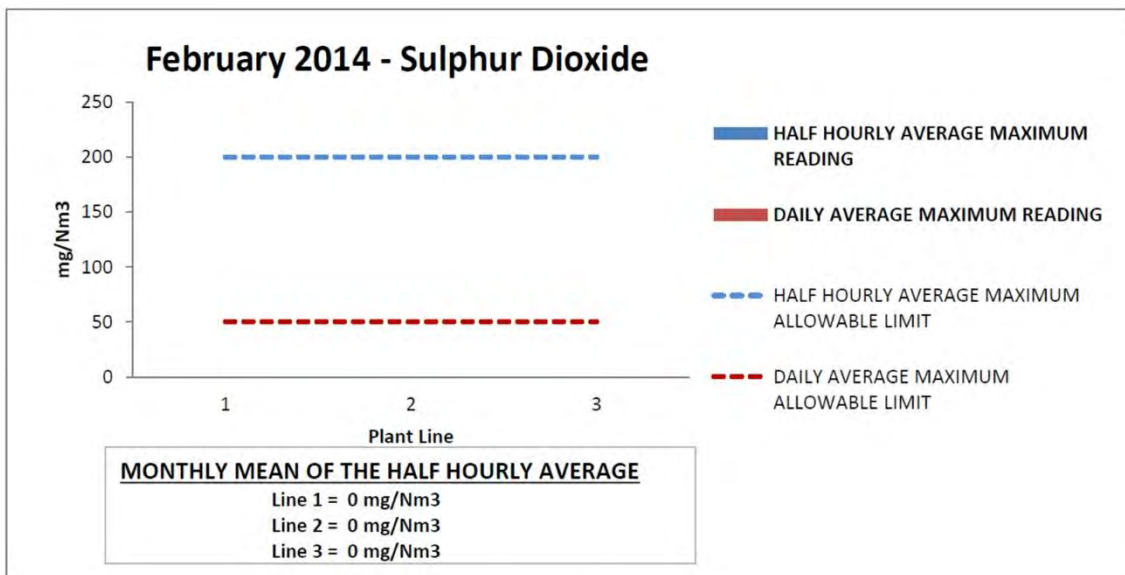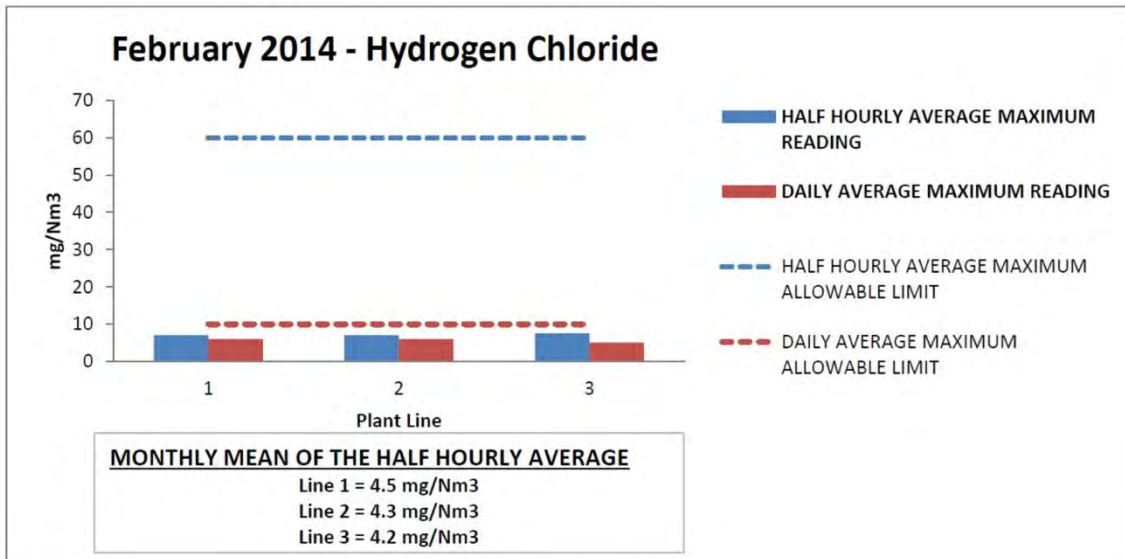

Why do we control and monitor Sulphur Dioxide and Hydrogen Chloride?

Both gases dissolve in water to form strong acids and thus can contribute to the formation of acid rain. Acid rain is environmentally damaging to crops, soils and waters.

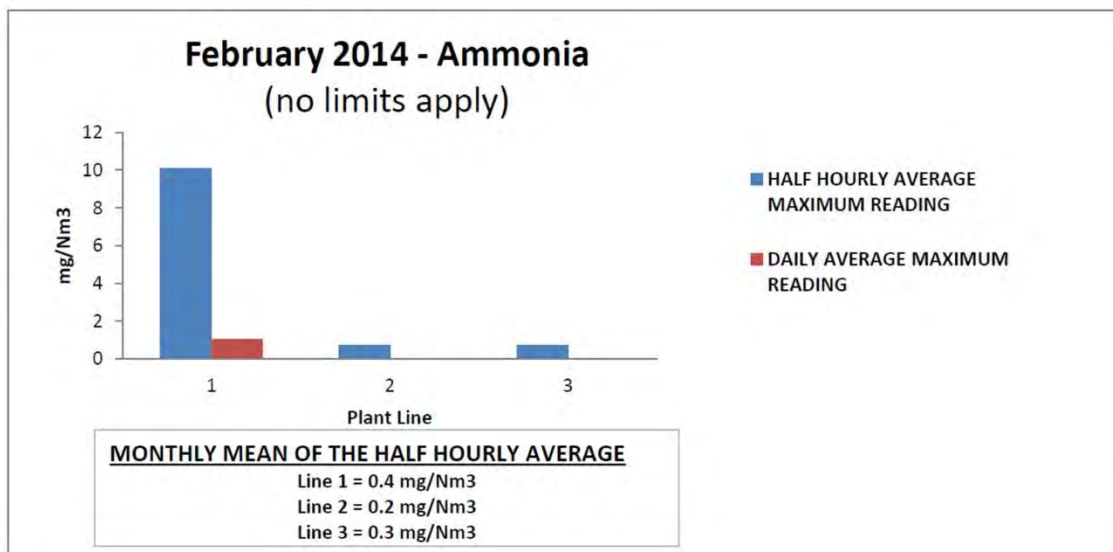

Why do we control and monitor Ammonia?

Although in wide-use in several industries, ammonia is both caustic and hazardous. It is a colourless gas with a characteristic pungent odour.

Ammonia, unlike the other species monitored, is not a product from the incineration of waste but is actually introduced into the furnace. Under the right conditions, ammonia is able to reduce oxides of nitrogen found in the flue gas by the chemical process Selective Non-Catalytic Reduction (SNCR) to nitrogen and water vapour which are both non-hazardous.

Appendix J DETAILED MODELLING PREDICTIONS

To inform a Human Health Risk Assessment, modelling predictions are presented in Table I.1 for the discrete receptors described in Appendix C (particularly sensitive receptors such as schools and childcare centres).

There are too many residential receptors in the suburbs of Minchinbury and Erskine Park to provide individual modelling predictions for each, however modelling predictions for the closest residential receptors are shown in Table I.1 at the discrete locations shown in Figure J-1. Note that the cells highlighted grey represent the sensitive receptors with the highest concentration of those assessed.

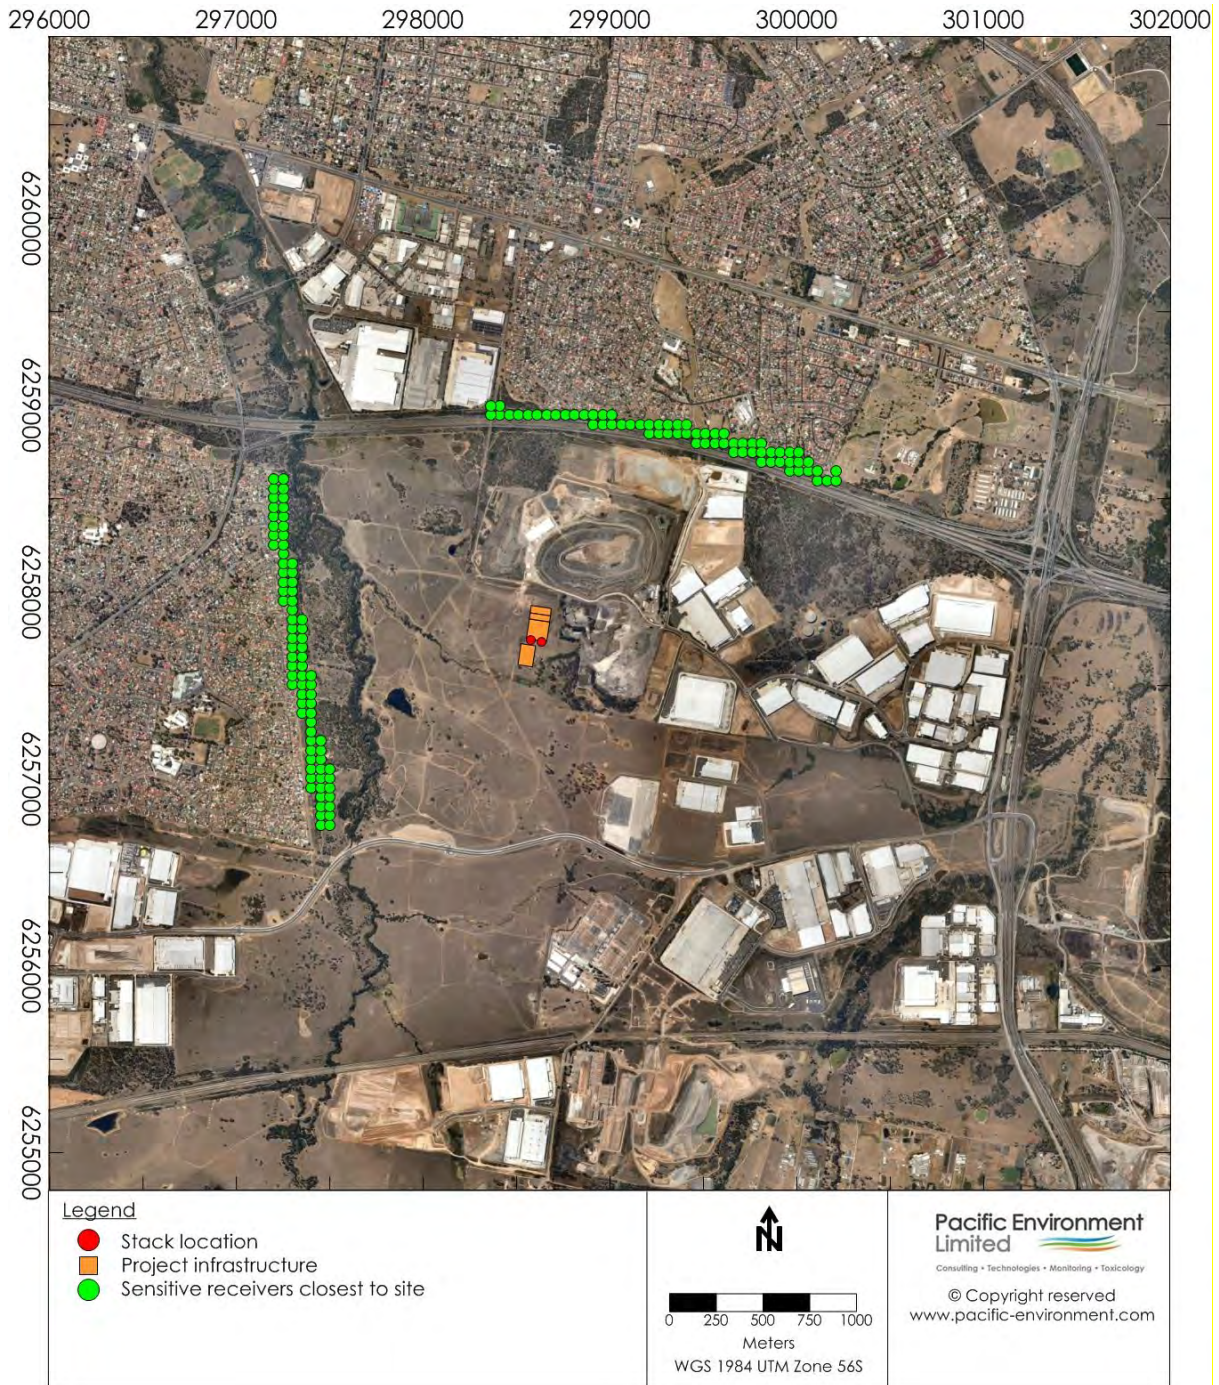


Figure J-1: Receptor locations shown in result tables

J.1.1 Normal Operations

Table J-1: Predicted ground level concentrations at particular sensitive receptors – short term averaging periods

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	10-minute	1 hour	1 hour	1 hour	15-minute	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	
			NO ₂	SO ₂		PM ₁₀ /PM _{2.5}	H ₂ S	CO		HCl	Cd	Hg	Dioxins / Furans	TOC (as benzene)	NH ₃	PAH (as benzo(a) pyrene)	
			µg/m ³	µg/m ³		µg/m ³	µg/m ³	mg/m ³		mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th		100 th	99 th	100 th		100 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th
Maximum (outside site boundary)			5.20E+01	1.10E+01	7.40E+00	2.70E-01	3.60E-01	8.30E-03	6.30E-03	2.50E-03	2.00E-06	8.70E-07	2.20E-12	3.30E-06	4.40E-04	1.10E-07	
James Erskine Primary School	296748	6257187	1.4E+01	2.9E+00	2.0E+00	7.5E-02	3.6E-01	2.2E-03	1.7E-03	6.7E-04	6.6E-07	2.9E-07	7.4E-13	1.1E-06	1.5E-04	3.7E-08	
Eskrine Park High School	296709	6256992	1.4E+01	3.0E+00	2.1E+00	7.6E-02	3.6E-01	2.4E-03	1.8E-03	6.9E-04	6.4E-07	2.8E-07	7.1E-13	1.1E-06	1.4E-04	3.6E-08	
Clairgate Public School	296299	6258187	2.0E+01	4.0E+00	2.8E+00	1.0E-01	3.6E-01	3.2E-03	2.4E-03	9.3E-04	5.6E-07	2.5E-07	6.2E-13	9.3E-07	1.2E-04	3.1E-08	
Minchinbury Public School	299287	6259084	4.6E+01	9.6E+00	6.7E+00	2.5E-01	3.6E-01	7.5E-03	5.7E-03	2.2E-03	1.8E-06	7.8E-07	2.0E-12	2.9E-06	3.9E-04	9.8E-08	
Pinegrove Memorial Park Lawn Cemetery	300567	6258692	4.1E+01	8.4E+00	5.9E+00	2.2E-01	3.6E-01	6.6E-03	5.0E-03	2.0E-03	1.3E-06	5.8E-07	1.5E-12	2.2E-06	2.9E-04	7.3E-08	
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266	2.7E+01	5.6E+00	3.9E+00	1.5E-01	3.6E-01	4.5E-03	3.4E-03	1.3E-03	8.8E-07	3.9E-07	9.8E-13	1.5E-06	2.0E-04	4.9E-08	
Eastern Creek Public School	301201	6259319	3.6E+01	7.3E+00	5.1E+00	1.9E-01	3.6E-01	5.7E-03	4.3E-03	1.7E-03	1.1E-06	4.7E-07	1.2E-12	1.8E-06	2.4E-04	5.9E-08	
St Agnes Catholic High School	300761	6259894	3.1E+01	6.4E+00	4.5E+00	1.7E-01	3.6E-01	5.1E-03	3.9E-03	1.5E-03	1.2E-06	5.3E-07	1.3E-12	2.0E-06	2.6E-04	6.6E-08	
All Areas Family Day Care Pty	299581	6258986	5.1E+01	1.0E+01	7.3E+00	2.7E-01	3.6E-01	8.3E-03	6.3E-03	2.4E-03	1.7E-06	7.4E-07	1.9E-12	2.8E-06	3.7E-04	9.3E-08	
Maria Hawey Child Care Centre	299370	6259272	4.4E+01	9.0E+00	6.3E+00	2.3E-01	3.6E-01	7.1E-03	5.4E-03	2.1E-03	1.7E-06	7.6E-07	1.9E-12	2.8E-06	3.8E-04	9.5E-08	
Jiminey Cricket Long Day Care	298562	6259310	4.7E+01	9.6E+00	6.7E+00	2.5E-01	3.6E-01	7.5E-03	5.7E-03	2.2E-03	1.7E-06	7.6E-07	1.9E-12	2.8E-06	3.8E-04	9.5E-08	
White Bunny Child Care Centre	299792	6259530	4.4E+01	9.2E+00	6.4E+00	2.4E-01	3.6E-01	7.1E-03	5.4E-03	2.1E-03	1.5E-06	6.7E-07	1.7E-12	2.5E-06	3.3E-04	8.3E-08	
LITTLESMARTIES	296419	6258212	2.1E+01	4.3E+00	3.0E+00	1.1E-01	3.6E-01	3.3E-03	2.5E-03	9.9E-04	5.9E-07	2.6E-07	6.6E-13	9.9E-07	1.3E-04	3.3E-08	
Kidz Fun Factory	298128	6259445	4.1E+01	8.4E+00	5.9E+00	2.2E-01	3.6E-01	6.6E-03	5.0E-03	2.0E-03	1.4E-06	6.3E-07	1.6E-12	2.4E-06	3.1E-04	7.9E-08	
Closest receptors to	297450	6256754	1.8E+01	3.6E+00	2.5E+00	9.3E-02	3.6E-01	2.8E-03	2.1E-03	8.4E-04	8.2E-07	3.7E-07	9.1E-13	1.4E-06	1.8E-04	4.6E-08	
	297500	6256754	1.8E+01	3.7E+00	2.6E+00	9.5E-02	3.6E-01	2.9E-03	2.2E-03	8.6E-04	8.5E-07	3.8E-07	9.4E-13	1.4E-06	1.9E-04	4.7E-08	

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	10-minute	1 hour	1 hour	1 hour	15-minute	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	SO ₂		PM ₁₀ /PM _{2.5}	H ₂ S	CO		HCl	Cd	Hg	Dioxins / Furans	TOC (as benzene)	NH ₃	PAH (as benzo(a) pyrene)
			µg/m ³	µg/m ³		µg/m ³	µg/m ³	mg/m ³		mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th		100 th	99 th	100 th		100 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th
Industrial	300786	6255839	3.4E+01	7.0E+00	4.9E+00	1.8E-01	3.6E-01	5.5E-03	4.2E-03	1.6E-03	1.0E-06	4.6E-07	1.1E-12	1.7E-06	2.3E-04	5.7E-08
Industrial	301006	6255854	3.0E+01	6.2E+00	4.3E+00	1.6E-01	3.6E-01	4.9E-03	3.7E-03	1.4E-03	9.1E-07	4.1E-07	1.0E-12	1.5E-06	2.0E-04	5.1E-08
Industrial	298652	6255402	3.7E+01	7.7E+00	5.4E+00	2.0E-01	3.6E-01	6.1E-03	4.6E-03	1.8E-03	1.1E-06	5.1E-07	1.3E-12	1.9E-06	2.5E-04	6.4E-08
Industrial	298508	6255389	3.2E+01	6.7E+00	4.7E+00	1.7E-01	3.6E-01	5.3E-03	4.0E-03	1.6E-03	1.0E-06	4.5E-07	1.1E-12	1.7E-06	2.2E-04	5.6E-08
Industrial	298584	6255037	3.3E+01	6.7E+00	4.7E+00	1.7E-01	3.6E-01	5.3E-03	4.0E-03	1.6E-03	9.7E-07	4.3E-07	1.1E-12	1.6E-06	2.2E-04	5.4E-08
Industrial	296204	6256521	2.0E+01	4.1E+00	2.9E+00	1.1E-01	3.6E-01	3.3E-03	2.5E-03	9.6E-04	4.8E-07	2.1E-07	5.3E-13	8.0E-07	1.1E-04	2.7E-08
Industrial	296614	6256526	1.6E+01	3.1E+00	2.2E+00	8.3E-02	3.6E-01	2.5E-03	1.9E-03	7.5E-04	5.5E-07	2.4E-07	6.1E-13	9.1E-07	1.2E-04	3.0E-08
Industrial	296388	6256355	1.6E+01	3.3E+00	2.3E+00	8.5E-02	3.6E-01	2.6E-03	2.0E-03	7.7E-04	4.9E-07	2.2E-07	5.5E-13	8.2E-07	1.1E-04	2.7E-08
Industrial	296643	6256280	1.2E+01	2.4E+00	1.7E+00	6.3E-02	3.6E-01	1.8E-03	1.4E-03	5.7E-04	5.3E-07	2.3E-07	5.8E-13	8.8E-07	1.2E-04	2.9E-08
Industrial	296700	6256087	1.2E+01	2.4E+00	1.7E+00	6.2E-02	3.6E-01	1.8E-03	1.4E-03	5.6E-04	5.1E-07	2.3E-07	5.7E-13	8.6E-07	1.1E-04	2.9E-08
Industrial	296946	6256040	1.2E+01	2.6E+00	1.8E+00	6.6E-02	3.6E-01	2.0E-03	1.5E-03	5.9E-04	5.5E-07	2.4E-07	6.1E-13	9.1E-07	1.2E-04	3.0E-08
Industrial	296598	6255723	1.1E+01	2.1E+00	1.5E+00	5.7E-02	3.6E-01	1.7E-03	1.3E-03	5.1E-04	4.6E-07	2.0E-07	5.1E-13	7.6E-07	1.0E-04	2.5E-08
Industrial	296410	6255743	1.1E+01	2.3E+00	1.6E+00	5.8E-02	3.6E-01	1.7E-03	1.3E-03	5.2E-04	4.3E-07	1.9E-07	4.8E-13	7.2E-07	9.7E-05	2.4E-08
Industrial	296055	6255881	1.2E+01	2.4E+00	1.7E+00	6.4E-02	3.6E-01	2.0E-03	1.5E-03	5.8E-04	4.1E-07	1.8E-07	4.6E-13	6.9E-07	9.1E-05	2.3E-08
Industrial Facility (Fisher and Paykel)	299251	6258615	4.8E+01	1.0E+01	7.0E+00	2.6E-01	3.6E-01	7.8E-03	5.9E-03	2.3E-03	1.7E-06	7.6E-07	1.9E-12	2.9E-06	3.8E-04	9.5E-08
Commercial Land (Sargents)	298093	6258488	3.2E+01	6.6E+00	4.6E+00	1.7E-01	3.6E-01	5.1E-03	3.9E-03	1.5E-03	1.4E-06	6.3E-07	1.6E-12	2.4E-06	3.1E-04	7.9E-08
Commercial Land (Dept of Planning)	297926	6258109	3.6E+01	7.3E+00	5.1E+00	1.9E-01	3.6E-01	5.7E-03	4.3E-03	1.7E-03	1.5E-06	6.9E-07	1.7E-12	2.6E-06	3.4E-04	8.6E-08
Commercial Land (Dept of Planning)	298154	6257844	4.4E+01	9.0E+00	6.3E+00	2.3E-01	3.6E-01	7.1E-03	5.4E-03	2.1E-03	2.0E-06	8.7E-07	2.2E-12	3.3E-06	4.4E-04	1.1E-07
Commercial Land (Dept of Planning)	298091	6257443	3.4E+01	7.0E+00	4.9E+00	1.8E-01	3.6E-01	5.5E-03	4.2E-03	1.6E-03	1.5E-06	6.6E-07	1.6E-12	2.5E-06	3.3E-04	8.2E-08
Commercial Land (Dept of Planning)	298470	6257372	3.9E+01	8.0E+00	5.6E+00	2.1E-01	3.6E-01	6.3E-03	4.8E-03	1.9E-03	1.7E-06	7.8E-07	1.9E-12	2.9E-06	3.9E-04	9.7E-08
Commercial Land (Dept of Planning)	298175	6257034	2.8E+01	5.7E+00	4.0E+00	1.5E-01	3.6E-01	4.5E-03	3.4E-03	1.3E-03	1.3E-06	5.9E-07	1.5E-12	2.2E-06	2.9E-04	7.4E-08
Commercial Land (Dept of Planning)	298746	6257137	4.3E+01	8.7E+00	6.1E+00	2.3E-01	3.6E-01	6.9E-03	5.2E-03	2.0E-03	2.0E-06	8.7E-07	2.2E-12	3.3E-06	4.3E-04	1.1E-07
Industrial Facility (Hanson)	299072	6257670	4.3E+01	8.9E+00	6.2E+00	2.3E-01	3.6E-01	7.0E-03	5.3E-03	2.1E-03	1.6E-06	7.0E-07	1.7E-12	2.6E-06	3.5E-04	8.7E-08

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	10-minute	1 hour	1 hour	1 hour	15-minute	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}	H ₂ S	CO		HCl	Cd	Hg	Dioxins / Furans	TOC (as benzene)	NH ₃	PAH (as benzo(a) pyrene)
			µg/m ³	µg/m ³		µg/m ³	µg/m ³	mg/m ³		mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th		100 th	99 th	100 th		100 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th
Industrial Facility (Jacfin)	299136	6256900	4.6E+01	9.4E+00	6.6E+00	2.4E-01	3.6E-01	7.4E-03	5.6E-03	2.2E-03	1.9E-06	8.3E-07	2.1E-12	3.1E-06	4.1E-04	1.0E-07

Table J-2: Predicted ground level concentrations at particularly sensitive receptors – longer term averaging periods

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF			
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³			
			100 th	100 th		100 th		100 th	100 th			
Maximum (outside site boundary)			3.20E+00	1.30E+00	4.50E-01	4.70E-02	2.60E-01	7.21E-03	2.60E-01	1.70E-01	1.10E-01	9.30E-02
James Erskine Primary School	296748	6257187	8.70E-01	3.40E-01	1.20E-01	1.20E-02	7.00E-02	4.30E-05	7.00E-02	4.30E-02	2.90E-02	2.30E-02
Eskrine Park High School	296709	6256992	8.10E-01	3.20E-01	1.20E-01	1.20E-02	7.80E-02	3.90E-05	7.80E-02	3.90E-02	2.90E-02	2.30E-02
Clairgate Public School	296299	6258187	8.80E-01	3.30E-01	1.30E-01	1.20E-02	1.30E-01	3.10E-05	1.30E-01	3.10E-02	2.90E-02	2.30E-02
Minchinbury Public School	299287	6259084	1.90E+00	6.80E-01	2.70E-01	2.50E-02	7.60E-02	1.10E-04	7.60E-02	1.10E-01	7.40E-02	6.00E-02
Pinegrove Memorial Park Lawn Cemetery	300567	6258692	9.00E-01	3.60E-01	1.30E-01	1.40E-02	1.50E-01	5.00E-05	1.50E-01	5.00E-02	2.70E-02	2.40E-02
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266	1.50E+00	5.90E-01	2.10E-01	2.20E-02	5.60E-02	6.00E-05	5.60E-02	6.00E-02	5.20E-02	4.30E-02
Eastern Creek Public School	301201	6259319	6.80E-01	2.80E-01	9.70E-02	1.00E-02	6.30E-02	3.60E-05	6.30E-02	3.60E-02	2.00E-02	1.70E-02
St Agnes Catholic High School	300761	6259894	7.90E-01	3.40E-01	1.10E-01	1.30E-02	1.40E-01	3.10E-05	1.40E-01	3.10E-02	2.40E-02	2.20E-02
All Areas Family Day Care Pty	299581	6258986	1.60E+00	6.10E-01	2.30E-01	2.30E-02	1.20E-01	8.00E-05	1.20E-01	8.00E-02	6.50E-02	5.10E-02
Maria Hawey Child Care Centre	299370	6259272	1.70E+00	5.90E-01	2.40E-01	2.20E-02	1.20E-01	9.40E-05	1.20E-01	9.40E-02	6.30E-02	5.20E-02
Jiminey Cricket Long Day Care	298562	6259310	1.70E+00	6.40E-01	2.50E-01	2.40E-02	1.00E-01	6.30E-05	1.00E-01	6.30E-02	5.60E-02	4.20E-02
White Bunny Child Care Centre	299792	6259530	1.30E+00	5.00E-01	1.80E-01	1.90E-02	8.90E-02	7.80E-05	8.90E-02	7.80E-02	6.00E-02	4.30E-02
LITTLES MARTIES	296419	6258212	9.40E-01	3.50E-01	1.30E-01	1.30E-02	9.70E-02	3.30E-05	9.70E-02	3.30E-02	3.10E-02	2.50E-02
Kidz Fun Factory	298128	6259445	1.30E+00	4.60E-01	1.90E-01	1.70E-02	7.50E-02	5.50E-05	7.50E-02	5.50E-02	4.50E-02	3.50E-02
Closest receptors to the west (Erskine Park)	297450	6256754	1.00E+00	4.00E-01	1.50E-01	1.50E-02	7.50E-02	4.30E-05	7.50E-02	4.30E-02	2.80E-02	2.40E-02
	297500	6256754	1.10E+00	4.00E-01	1.50E-01	1.50E-02	7.90E-02	4.30E-05	7.90E-02	4.30E-02	2.90E-02	2.40E-02
	297450	6256804	1.10E+00	4.00E-01	1.50E-01	1.50E-02	7.90E-02	4.50E-05	7.90E-02	4.50E-02	2.90E-02	2.50E-02
	297500	6256804	1.10E+00	4.10E-01	1.50E-01	1.50E-02	8.30E-02	4.50E-05	8.30E-02	4.50E-02	3.00E-02	2.50E-02
	297450	6256854	1.10E+00	4.10E-01	1.50E-01	1.50E-02	8.40E-02	4.80E-05	8.40E-02	4.80E-02	3.10E-02	2.60E-02
	297500	6256854	1.10E+00	4.20E-01	1.60E-01	1.50E-02	8.70E-02	4.80E-05	8.70E-02	4.80E-02	3.10E-02	2.60E-02
	297450	6256904	1.10E+00	4.20E-01	1.60E-01	1.60E-02	8.80E-02	5.10E-05	8.80E-02	5.10E-02	3.30E-02	2.80E-02
297500	6256904	1.10E+00	4.30E-01	1.60E-01	1.60E-02	8.90E-02	5.10E-05	8.90E-02	5.10E-02	3.30E-02	2.80E-02	

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}	CO	HF				
			µg/m ³	µg/m ³		µg/m ³	mg/m ³	µg/m ³				
			100 th	100 th		100 th	100 th	100 th				
Commercial Land (Sargents)	298093	6258488	2.40E+00	1.10E+00	3.40E-01	4.00E-02	2.20E-01	1.50E-04	2.20E-01	1.50E-01	1.10E-01	7.80E-02
Commercial Land (Dept of Planning)	297926	6258109	2.80E+00	1.20E+00	4.10E-01	4.40E-02	2.20E-01	1.30E-04	2.20E-01	1.30E-01	1.10E-01	8.90E-02
Commercial Land (Dept of Planning)	298154	6257844	3.10E+00	1.30E+00	4.50E-01	4.70E-02	2.10E-01	1.30E-04	2.10E-01	1.30E-01	1.10E-01	9.30E-02
Commercial Land (Dept of Planning)	298091	6257443	2.10E+00	8.80E-01	3.10E-01	3.30E-02	2.00E-01	1.00E-04	2.00E-01	1.00E-01	7.40E-02	5.80E-02
Commercial Land (Dept of Planning)	298470	6257372	2.70E+00	1.20E+00	3.90E-01	4.30E-02	1.40E-01	1.20E-04	1.40E-01	1.20E-01	8.90E-02	7.20E-02
Commercial Land (Dept of Planning)	298175	6257034	1.80E+00	7.00E-01	2.60E-01	2.60E-02	2.60E-01	7.40E-05	2.60E-01	7.40E-02	5.10E-02	4.30E-02
Commercial Land (Dept of Planning)	298746	6257137	3.20E+00	1.20E+00	4.50E-01	4.60E-02	1.80E-01	1.70E-04	1.80E-01	1.70E-01	1.10E-01	8.30E-02
Industrial Facility (Hanson)	299072	6257670	2.60E+00	1.00E+00	3.70E-01	3.70E-02	1.80E-01	9.20E-05	1.80E-01	9.20E-02	7.80E-02	6.00E-02
Industrial Facility (Jacfin)	299136	6256900	2.30E+00	7.80E-01	3.30E-01	2.90E-02	2.00E-01	9.90E-05	2.00E-01	9.90E-02	7.60E-02	7.20E-02

J.1.2 Upset Conditions

Table J-3: Predicted ground level concentrations at particular sensitive receptors – short term averaging periods

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	10-minute	1 hour	1 hour	1 hour	15-minute	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	SO ₂		PM ₁₀ /PM _{2.5}	H ₂ S	CO		HCl	Cd	Hg	Dioxins / Furans	TOC (as benzene)	NH ₃	PAH (as benzo(a) pyrene)
			µg/m ³	µg/m ³		µg/m ³	µg/m ³	mg/m ³		mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th		100 th	99 th	100 th		100 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th
Maximum (outside site boundary)			5.2E+02	1.1E+02	7.4E+01	4.1E+01	9.6E+00	8.3E-02	6.3E-02	2.5E-02	2.0E-05	2.8E-06	1.1E-10	3.3E-05	4.4E-03	1.1E-06
James Erskine Primary School	296748	6257187	1.4E+02	2.9E+01	2.0E+01	1.1E+01	3.6E+00	2.3E-02	1.7E-02	6.7E-03	6.6E-06	9.6E-07	3.7E-11	1.1E-05	1.5E-03	3.7E-07
Eskrine Park High School	296709	6256992	1.4E+02	3.0E+01	2.1E+01	1.1E+01	3.4E+00	2.3E-02	1.8E-02	6.9E-03	6.4E-06	9.2E-07	3.6E-11	1.1E-05	1.4E-03	3.6E-07
Clairgate Public School	296299	6258187	2.0E+02	4.0E+01	2.8E+01	1.6E+01	2.9E+00	3.2E-02	2.4E-02	9.3E-03	5.6E-06	8.1E-07	3.1E-11	9.3E-06	1.2E-03	3.1E-07
Minchinbury Public School	299287	6259084	4.6E+02	9.6E+01	6.7E+01	3.7E+01	6.3E+00	7.5E-02	5.7E-02	2.2E-02	1.8E-05	2.5E-06	9.8E-11	2.9E-05	3.9E-03	9.8E-07
Pinegrove Memorial Park Lawn Cemetery	300567	6258692	4.1E+02	8.4E+01	5.9E+01	3.3E+01	3.2E+00	6.6E-02	5.0E-02	2.0E-02	1.3E-05	1.9E-06	7.3E-11	2.2E-05	2.9E-03	7.3E-07
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266	2.7E+02	5.6E+01	3.9E+01	2.2E+01	4.5E+00	4.4E-02	3.4E-02	1.3E-02	8.8E-06	1.3E-06	4.9E-11	1.5E-05	2.0E-03	4.9E-07
Eastern Creek Public School	301201	6259319	3.6E+02	7.3E+01	5.1E+01	2.8E+01	2.3E+00	5.7E-02	4.3E-02	1.7E-02	1.1E-05	1.5E-06	5.9E-11	1.8E-05	2.4E-03	5.9E-07
St Agnes Catholic High School	300761	6259894	3.1E+02	6.5E+01	4.5E+01	2.5E+01	2.7E+00	5.1E-02	3.9E-02	1.5E-02	1.2E-05	1.7E-06	6.6E-11	2.0E-05	2.6E-03	6.6E-07
All Areas Family Day Care Pty	299581	6258986	5.1E+02	1.1E+02	7.3E+01	4.1E+01	5.7E+00	8.3E-02	6.3E-02	2.4E-02	1.7E-05	2.4E-06	9.3E-11	2.8E-05	3.7E-03	9.3E-07
Maria Hawey Child Care Centre	299370	6259272	4.4E+02	9.0E+01	6.3E+01	3.5E+01	5.7E+00	7.1E-02	5.4E-02	2.1E-02	1.7E-05	2.5E-06	9.5E-11	2.8E-05	3.8E-03	9.5E-07
Jiminey Cricket Long Day Care	298562	6259310	4.7E+02	9.7E+01	6.7E+01	3.7E+01	5.0E+00	7.6E-02	5.7E-02	2.2E-02	1.7E-05	2.5E-06	9.5E-11	2.8E-05	3.8E-03	9.5E-07
White Bunny Child Care Centre	299792	6259530	4.4E+02	9.1E+01	6.4E+01	3.5E+01	5.1E+00	7.2E-02	5.4E-02	2.1E-02	1.5E-05	2.2E-06	8.3E-11	2.5E-05	3.3E-03	8.3E-07
LITTLESMAITIES	296419	6258212	2.1E+02	4.2E+01	3.0E+01	1.6E+01	3.1E+00	3.3E-02	2.5E-02	9.9E-03	5.9E-06	8.6E-07	3.3E-11	9.9E-06	1.3E-03	3.3E-07
Kidz Fun Factory	298128	6259445	4.1E+02	8.4E+01	5.9E+01	3.3E+01	4.0E+00	6.6E-02	5.0E-02	2.0E-02	1.4E-05	2.0E-06	7.9E-11	2.4E-05	3.1E-03	7.9E-07
Closest receptors to	297450	6256754	1.8E+02	3.6E+01	2.5E+01	1.4E+01	4.3E+00	2.8E-02	2.1E-02	8.4E-03	8.2E-06	1.2E-06	4.6E-11	1.4E-05	1.8E-03	4.6E-07
	297500	6256754	1.8E+02	3.7E+01	2.6E+01	1.4E+01	4.4E+00	2.9E-02	2.2E-02	8.6E-03	8.5E-06	1.2E-06	4.7E-11	1.4E-05	1.9E-03	4.7E-07

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	10-minute	1 hour	1 hour	1 hour	15-minute	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	SO ₂		PM ₁₀ /PM _{2.5}	H ₂ S	CO		HCl	Cd	Hg	Dioxins / Furans	TOC (as benzene)	NH ₃	PAH (as benzo(a) pyrene)
			µg/m ³	µg/m ³		µg/m ³	µg/m ³	mg/m ³		mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th		100 th	99 th	100 th		100 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th
Industrial	300786	6255839	3.4E+02	7.0E+01	4.9E+01	2.7E+01	2.7E+00	5.5E-02	4.2E-02	1.6E-02	1.0E-05	1.5E-06	5.7E-11	1.7E-05	2.3E-03	5.7E-07
Industrial	301006	6255854	3.0E+02	6.2E+01	4.3E+01	2.4E+01	2.5E+00	4.8E-02	3.7E-02	1.4E-02	9.1E-06	1.3E-06	5.1E-11	1.5E-05	2.0E-03	5.1E-07
Industrial	298652	6255402	3.7E+02	7.7E+01	5.4E+01	3.0E+01	3.3E+00	6.0E-02	4.6E-02	1.8E-02	1.1E-05	1.7E-06	6.4E-11	1.9E-05	2.5E-03	6.4E-07
Industrial	298508	6255389	3.2E+02	6.7E+01	4.7E+01	2.6E+01	3.0E+00	5.2E-02	4.0E-02	1.6E-02	1.0E-05	1.5E-06	5.6E-11	1.7E-05	2.2E-03	5.6E-07
Industrial	298584	6255037	3.3E+02	6.7E+01	4.7E+01	2.6E+01	2.7E+00	5.3E-02	4.0E-02	1.6E-02	9.7E-06	1.4E-06	5.4E-11	1.6E-05	2.2E-03	5.4E-07
Industrial	296204	6256521	2.0E+02	4.1E+01	2.9E+01	1.6E+01	2.6E+00	3.2E-02	2.5E-02	9.6E-03	4.8E-06	6.9E-07	2.7E-11	8.0E-06	1.1E-03	2.7E-07
Industrial	296614	6256526	1.6E+02	3.2E+01	2.2E+01	1.2E+01	2.9E+00	2.5E-02	1.9E-02	7.5E-03	5.5E-06	7.9E-07	3.0E-11	9.1E-06	1.2E-03	3.0E-07
Industrial	296388	6256355	1.6E+02	3.3E+01	2.3E+01	1.3E+01	2.6E+00	2.6E-02	2.0E-02	7.7E-03	4.9E-06	7.1E-07	2.7E-11	8.2E-06	1.1E-03	2.7E-07
Industrial	296643	6256280	1.2E+02	2.4E+01	1.7E+01	9.4E+00	2.8E+00	1.9E-02	1.4E-02	5.7E-03	5.3E-06	7.6E-07	2.9E-11	8.8E-06	1.2E-03	2.9E-07
Industrial	296700	6256087	1.2E+02	2.4E+01	1.7E+01	9.3E+00	2.7E+00	1.9E-02	1.4E-02	5.6E-03	5.1E-06	7.4E-07	2.9E-11	8.6E-06	1.1E-03	2.9E-07
Industrial	296946	6256040	1.2E+02	2.5E+01	1.8E+01	9.8E+00	2.9E+00	2.0E-02	1.5E-02	5.9E-03	5.5E-06	7.9E-07	3.0E-11	9.1E-06	1.2E-03	3.0E-07
Industrial	296598	6255723	1.1E+02	2.2E+01	1.5E+01	8.5E+00	2.4E+00	1.7E-02	1.3E-02	5.1E-03	4.6E-06	6.6E-07	2.5E-11	7.6E-06	1.0E-03	2.5E-07
Industrial	296410	6255743	1.1E+02	2.2E+01	1.6E+01	8.7E+00	2.3E+00	1.8E-02	1.3E-02	5.2E-03	4.3E-06	6.3E-07	2.4E-11	7.2E-06	9.7E-04	2.4E-07
Industrial	296055	6255881	1.2E+02	2.5E+01	1.7E+01	9.7E+00	2.2E+00	2.0E-02	1.5E-02	5.8E-03	4.1E-06	5.9E-07	2.3E-11	6.9E-06	9.1E-04	2.3E-07
Industrial Facility (Fisher and Paykel)	299251	6258615	4.8E+02	9.9E+01	7.0E+01	3.9E+01	7.4E+00	7.8E-02	5.9E-02	2.3E-02	1.7E-05	2.5E-06	9.5E-11	2.9E-05	3.8E-03	9.5E-07
Commercial Land (Sargents)	298093	6258488	3.2E+02	6.6E+01	4.6E+01	2.5E+01	7.4E+00	5.2E-02	3.9E-02	1.5E-02	1.4E-05	2.0E-06	7.9E-11	2.4E-05	3.1E-03	7.9E-07
Commercial Land (Dept of Planning)	297926	6258109	3.6E+02	7.3E+01	5.1E+01	2.8E+01	8.0E+00	5.7E-02	4.3E-02	1.7E-02	1.5E-05	2.2E-06	8.6E-11	2.6E-05	3.4E-03	8.6E-07
Commercial Land (Dept of Planning)	298154	6257844	4.4E+02	9.1E+01	6.3E+01	3.5E+01	8.0E+00	7.1E-02	5.4E-02	2.1E-02	2.0E-05	2.8E-06	1.1E-10	3.3E-05	4.4E-03	1.1E-06
Commercial Land (Dept of Planning)	298091	6257443	3.4E+02	7.0E+01	4.9E+01	2.7E+01	6.8E+00	5.5E-02	4.2E-02	1.6E-02	1.5E-05	2.1E-06	8.2E-11	2.5E-05	3.3E-03	8.2E-07
Commercial Land (Dept of Planning)	298470	6257372	3.9E+02	8.0E+01	5.6E+01	3.1E+01	7.2E+00	6.3E-02	4.8E-02	1.9E-02	1.7E-05	2.5E-06	9.7E-11	2.9E-05	3.9E-03	9.7E-07
Commercial Land (Dept of Planning)	298175	6257034	2.8E+02	5.8E+01	4.0E+01	2.2E+01	6.3E+00	4.5E-02	3.4E-02	1.3E-02	1.3E-05	1.9E-06	7.4E-11	2.2E-05	2.9E-03	7.4E-07
Commercial Land (Dept of Planning)	298746	6257137	4.3E+02	8.8E+01	6.1E+01	3.4E+01	9.6E+00	6.9E-02	5.2E-02	2.0E-02	2.0E-05	2.8E-06	1.1E-10	3.3E-05	4.3E-03	1.1E-06
Industrial Facility (Hanson)	299072	6257670	4.3E+02	8.9E+01	6.2E+01	3.4E+01	7.3E+00	7.0E-02	5.3E-02	2.1E-02	1.6E-05	2.3E-06	8.7E-11	2.6E-05	3.5E-03	8.7E-07

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	10-minute	1 hour	1 hour	1 hour	15-minute	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}	H ₂ S	CO		HCl	Cd	Hg	Dioxins / Furans	TOC (as benzene)	NH ₃	PAH (as benzo(a) pyrene)
			µg/m ³	µg/m ³		µg/m ³	µg/m ³	mg/m ³		mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th		100 th	99 th	100 th		100 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th	99.9 th
Industrial Facility (Jacfin)	299136	6256900	4.6E+02	9.4E+01	6.6E+01	3.7E+01	7.4E+00	7.4E-02	5.6E-02	2.2E-02	1.9E-05	2.7E-06	1.0E-10	3.1E-05	4.1E-03	1.0E-06

Table J-4: Predicted ground level concentrations at particularly sensitive receptors – longer term averaging periods

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day	
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF				
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³				
			100 th	100 th		100 th		100 th	100 th				
Maximum (outside site boundary)			3.16E+01	1.72E+01	4.54E+00	9.58E+00	2.52E+00	7.21E-02	2.55E+00	1.66E+00	1.12E+00	9.27E-01	
James Erskine Primary School	296748	6257187	8.68E+00	4.56E+00	1.25E+00	2.53E+00	6.93E-01	1.08E-02	6.75E-01	4.33E-01	2.88E-01	2.29E-01	
Eskrine Park High School	296709	6256992	8.10E+00	4.76E+00	1.16E+00	2.64E+00	6.46E-01	1.35E-02	7.05E-01	3.90E-01	2.89E-01	2.28E-01	
Clairgate Public School	296299	6258187	8.81E+00	5.29E+00	1.26E+00	2.94E+00	7.03E-01	9.65E-03	7.84E-01	3.08E-01	2.86E-01	2.32E-01	
Minchinbury Public School	299287	6259084	1.87E+01	8.86E+00	2.69E+00	4.92E+00	1.49E+00	3.21E-02	1.31E+00	1.11E+00	7.38E-01	6.05E-01	
Pinegrove Memorial Park Lawn Cemetery	300567	6258692	9.05E+00	5.11E+00	1.30E+00	2.84E+00	7.22E-01	1.26E-02	7.57E-01	4.95E-01	2.72E-01	2.42E-01	
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266	1.47E+01	1.01E+01	2.11E+00	5.61E+00	1.17E+00	2.58E-02	1.50E+00	5.99E-01	5.20E-01	4.31E-01	
Eastern Creek Public School	301201	6259319	6.76E+00	3.79E+00	9.71E-01	2.11E+00	5.39E-01	9.40E-03	5.62E-01	3.57E-01	2.01E-01	1.74E-01	
St Agnes Catholic High School	300761	6259894	7.91E+00	4.28E+00	1.14E+00	2.38E+00	6.31E-01	1.05E-02	6.33E-01	3.11E-01	2.43E-01	2.22E-01	
All Areas Family Day Care Pty	299581	6258986	1.62E+01	9.44E+00	2.33E+00	5.24E+00	1.29E+00	2.88E-02	1.40E+00	7.95E-01	6.51E-01	5.07E-01	
Maria Hawey Child Care Centre	299370	6259272	1.66E+01	8.06E+00	2.39E+00	4.48E+00	1.33E+00	2.64E-02	1.19E+00	9.42E-01	6.27E-01	5.22E-01	
Jiminey Cricket Long Day Care	298562	6259310	1.71E+01	8.17E+00	2.46E+00	4.54E+00	1.36E+00	1.74E-02	1.21E+00	6.34E-01	5.64E-01	4.17E-01	
White Bunny Child Care Centre	299792	6259530	1.28E+01	6.99E+00	1.84E+00	3.89E+00	1.02E+00	1.92E-02	1.04E+00	7.84E-01	6.01E-01	4.33E-01	
LITTLES MARTIES	296419	6258212	9.35E+00	6.00E+00	1.34E+00	3.33E+00	7.46E-01	1.11E-02	8.89E-01	3.25E-01	3.06E-01	2.48E-01	
Kidz Fun Factory	298128	6259445	1.35E+01	6.58E+00	1.94E+00	3.65E+00	1.08E+00	1.47E-02	9.74E-01	5.55E-01	4.50E-01	3.51E-01	
Closest receptors to the west (Erskine Park)	297450	6256754	1.03E+01	5.05E+00	1.48E+00	2.80E+00	8.20E-01	1.54E-02	7.48E-01	4.28E-01	2.82E-01	2.39E-01	
	297500	6256754	1.05E+01	5.09E+00	1.51E+00	2.83E+00	8.41E-01	1.63E-02	7.54E-01	4.32E-01	2.87E-01	2.43E-01	
	297450	6256804	1.05E+01	5.31E+00	1.51E+00	2.95E+00	8.38E-01	1.38E-02	7.87E-01	4.52E-01	2.93E-01	2.49E-01	
	297500	6256804	1.08E+01	5.36E+00	1.55E+00	2.98E+00	8.59E-01	1.59E-02	7.95E-01	4.53E-01	2.98E-01	2.52E-01	
	297450	6256854	1.07E+01	5.59E+00	1.54E+00	3.11E+00	8.56E-01	1.15E-02	8.28E-01	4.80E-01	3.10E-01	2.61E-01	
	297500	6256854	1.10E+01	5.66E+00	1.58E+00	3.14E+00	8.78E-01	1.41E-02	8.38E-01	4.80E-01	3.12E-01	2.63E-01	
	297450	6256904	1.09E+01	5.87E+00	1.57E+00	3.26E+00	8.74E-01	1.25E-02	8.69E-01	5.10E-01	3.33E-01	2.77E-01	
297500	6256904	1.12E+01	5.95E+00	1.61E+00	3.31E+00	8.97E-01	1.16E-02	8.82E-01	5.11E-01	3.32E-01	2.78E-01		

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day	
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF				
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³				
			100 th	100 th		100 th		100 th	100 th				
297400	6256954	1.09E+01	6.04E+00	1.57E+00	3.36E+00	8.70E-01	1.83E-02	8.95E-01	5.31E-01	3.67E-01	2.94E-01		
297450	6256954	1.12E+01	6.14E+00	1.61E+00	3.41E+00	8.92E-01	1.66E-02	9.10E-01	5.38E-01	3.62E-01	2.95E-01		
297500	6256954	1.15E+01	6.26E+00	1.65E+00	3.48E+00	9.17E-01	1.45E-02	9.27E-01	5.43E-01	3.59E-01	2.96E-01		
297400	6257004	1.11E+01	6.28E+00	1.60E+00	3.49E+00	8.87E-01	2.03E-02	9.31E-01	5.46E-01	3.93E-01	3.10E-01		
297450	6257004	1.14E+01	6.42E+00	1.64E+00	3.57E+00	9.12E-01	1.99E-02	9.51E-01	5.61E-01	3.94E-01	3.14E-01		
297500	6257004	1.18E+01	6.58E+00	1.69E+00	3.65E+00	9.40E-01	1.89E-02	9.75E-01	5.75E-01	3.94E-01	3.18E-01		
297400	6257054	1.14E+01	6.51E+00	1.63E+00	3.62E+00	9.06E-01	2.09E-02	9.64E-01	5.54E-01	4.15E-01	3.22E-01		
297450	6257054	1.17E+01	6.69E+00	1.68E+00	3.72E+00	9.32E-01	2.16E-02	9.91E-01	5.76E-01	4.23E-01	3.30E-01		
297500	6257054	1.21E+01	6.88E+00	1.73E+00	3.82E+00	9.62E-01	2.20E-02	1.02E+00	5.98E-01	4.29E-01	3.38E-01		
297400	6257104	1.16E+01	6.72E+00	1.67E+00	3.73E+00	9.26E-01	2.12E-02	9.96E-01	5.61E-01	4.34E-01	3.33E-01		
297450	6257104	1.20E+01	6.94E+00	1.72E+00	3.85E+00	9.54E-01	2.22E-02	1.03E+00	5.85E-01	4.47E-01	3.44E-01		
297400	6257154	1.19E+01	6.89E+00	1.70E+00	3.83E+00	9.46E-01	2.12E-02	1.02E+00	5.72E-01	4.46E-01	3.42E-01		
297450	6257154	1.22E+01	7.14E+00	1.76E+00	3.97E+00	9.76E-01	2.22E-02	1.06E+00	5.92E-01	4.63E-01	3.54E-01		
297400	6257204	1.21E+01	7.02E+00	1.74E+00	3.90E+00	9.66E-01	2.03E-02	1.04E+00	5.86E-01	4.52E-01	3.49E-01		
297450	6257204	1.25E+01	7.30E+00	1.79E+00	4.06E+00	9.97E-01	2.17E-02	1.08E+00	6.08E-01	4.72E-01	3.63E-01		
297400	6257254	1.24E+01	7.10E+00	1.78E+00	3.95E+00	9.87E-01	1.80E-02	1.05E+00	6.10E-01	4.52E-01	3.54E-01		
297400	6257304	1.27E+01	7.15E+00	1.82E+00	3.97E+00	1.01E+00	1.53E-02	1.06E+00	6.36E-01	4.49E-01	3.56E-01		
297350	6257354	1.25E+01	6.81E+00	1.80E+00	3.78E+00	9.99E-01	1.39E-02	1.01E+00	6.34E-01	4.32E-01	3.43E-01		
297400	6257354	1.29E+01	7.15E+00	1.86E+00	3.97E+00	1.03E+00	1.43E-02	1.06E+00	6.56E-01	4.50E-01	3.57E-01		
297350	6257404	1.28E+01	6.76E+00	1.84E+00	3.75E+00	1.02E+00	1.53E-02	1.00E+00	6.45E-01	4.43E-01	3.48E-01		
297400	6257404	1.32E+01	7.10E+00	1.90E+00	3.94E+00	1.05E+00	1.55E-02	1.05E+00	6.69E-01	4.59E-01	3.61E-01		
297350	6257454	1.31E+01	6.86E+00	1.89E+00	3.81E+00	1.05E+00	1.61E-02	1.02E+00	6.55E-01	4.58E-01	3.56E-01		
297400	6257454	1.36E+01	7.13E+00	1.95E+00	3.96E+00	1.08E+00	1.66E-02	1.06E+00	6.79E-01	4.75E-01	3.70E-01		
297300	6257504	1.30E+01	6.74E+00	1.87E+00	3.74E+00	1.04E+00	1.39E-02	9.98E-01	6.45E-01	4.49E-01	3.52E-01		
297350	6257504	1.35E+01	7.03E+00	1.93E+00	3.90E+00	1.07E+00	1.49E-02	1.04E+00	6.69E-01	4.68E-01	3.66E-01		
297400	6257504	1.39E+01	7.32E+00	2.00E+00	4.07E+00	1.11E+00	1.59E-02	1.08E+00	6.94E-01	4.87E-01	3.80E-01		
297300	6257554	1.33E+01	6.83E+00	1.91E+00	3.79E+00	1.06E+00	1.27E-02	1.01E+00	6.66E-01	4.53E-01	3.61E-01		
297350	6257554	1.38E+01	7.12E+00	1.98E+00	3.96E+00	1.10E+00	1.28E-02	1.06E+00	6.89E-01	4.72E-01	3.75E-01		
297400	6257554	1.43E+01	7.45E+00	2.05E+00	4.14E+00	1.14E+00	1.36E-02	1.10E+00	7.16E-01	4.93E-01	3.91E-01		
297300	6257604	1.36E+01	6.87E+00	1.96E+00	3.82E+00	1.09E+00	1.46E-02	1.02E+00	6.83E-01	4.59E-01	3.70E-01		
297350	6257604	1.41E+01	7.18E+00	2.02E+00	3.99E+00	1.12E+00	1.49E-02	1.06E+00	7.08E-01	4.77E-01	3.84E-01		
297300	6257654	1.40E+01	6.88E+00	2.00E+00	3.82E+00	1.11E+00	1.63E-02	1.02E+00	6.83E-01	4.65E-01	3.78E-01		
297350	6257654	1.45E+01	7.19E+00	2.08E+00	3.99E+00	1.15E+00	1.68E-02	1.07E+00	7.11E-01	4.84E-01	3.93E-01		
297300	6257704	1.43E+01	6.84E+00	2.05E+00	3.80E+00	1.14E+00	1.76E-02	1.01E+00	6.68E-01	4.71E-01	3.86E-01		
297350	6257704	1.48E+01	7.15E+00	2.13E+00	3.97E+00	1.18E+00	1.82E-02	1.06E+00	6.96E-01	4.91E-01	4.02E-01		
297300	6257754	1.46E+01	6.85E+00	2.10E+00	3.81E+00	1.17E+00	1.81E-02	1.02E+00	6.54E-01	4.78E-01	3.95E-01		
297350	6257754	1.52E+01	7.06E+00	2.18E+00	3.92E+00	1.21E+00	1.87E-02	1.05E+00	6.81E-01	4.98E-01	4.12E-01		
297300	6257804	1.49E+01	7.14E+00	2.15E+00	3.97E+00	1.19E+00	1.76E-02	1.06E+00	6.45E-01	4.85E-01	4.06E-01		
297350	6257804	1.55E+01	7.38E+00	2.23E+00	4.10E+00	1.24E+00	1.82E-02	1.09E+00	6.70E-01	5.06E-01	4.23E-01		
297300	6257854	1.53E+01	7.37E+00	2.19E+00	4.09E+00	1.22E+00	1.64E-02	1.09E+00	6.31E-01	4.94E-01	4.16E-01		
297350	6257854	1.59E+01	7.63E+00	2.28E+00	4.24E+00	1.27E+00	1.69E-02	1.13E+00	6.56E-01	5.16E-01	4.35E-01		

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day	
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF				
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³				
			100 th	100 th		100 th		100 th	100 th				
	297300	6257904	1.55E+01	7.53E+00	2.23E+00	4.18E+00	1.24E+00	1.46E-02	1.11E+00	6.19E-01	5.05E-01	4.26E-01	
	297250	6257954	1.52E+01	7.34E+00	2.18E+00	4.08E+00	1.21E+00	1.32E-02	1.09E+00	6.04E-01	4.97E-01	4.16E-01	
	297300	6257954	1.58E+01	7.74E+00	2.27E+00	4.30E+00	1.26E+00	1.40E-02	1.15E+00	6.33E-01	5.20E-01	4.36E-01	
	297250	6258004	1.54E+01	8.04E+00	2.21E+00	4.47E+00	1.23E+00	1.35E-02	1.19E+00	6.06E-01	5.11E-01	4.25E-01	
	297300	6258004	1.60E+01	8.47E+00	2.30E+00	4.71E+00	1.28E+00	1.45E-02	1.25E+00	6.35E-01	5.36E-01	4.46E-01	
	297250	6258054	1.55E+01	8.83E+00	2.23E+00	4.91E+00	1.24E+00	1.69E-02	1.31E+00	6.05E-01	5.24E-01	4.34E-01	
	297300	6258054	1.62E+01	9.27E+00	2.33E+00	5.15E+00	1.29E+00	1.84E-02	1.37E+00	6.35E-01	5.50E-01	4.55E-01	
	297250	6258104	1.57E+01	9.51E+00	2.25E+00	5.28E+00	1.25E+00	2.07E-02	1.41E+00	6.07E-01	5.35E-01	4.42E-01	
	297300	6258104	1.63E+01	9.92E+00	2.34E+00	5.51E+00	1.30E+00	2.24E-02	1.47E+00	6.41E-01	5.61E-01	4.65E-01	
	297250	6258154	1.58E+01	1.00E+01	2.26E+00	5.57E+00	1.26E+00	2.42E-02	1.49E+00	6.20E-01	5.44E-01	4.51E-01	
	297300	6258154	1.64E+01	1.04E+01	2.36E+00	5.78E+00	1.31E+00	2.57E-02	1.54E+00	6.58E-01	5.71E-01	4.74E-01	
	297250	6258204	1.58E+01	1.04E+01	2.27E+00	5.77E+00	1.26E+00	2.65E-02	1.54E+00	6.43E-01	5.56E-01	4.62E-01	
	297200	6258254	1.52E+01	1.03E+01	2.19E+00	5.70E+00	1.21E+00	2.63E-02	1.52E+00	6.27E-01	5.41E-01	4.48E-01	
	297250	6258254	1.58E+01	1.05E+01	2.27E+00	5.85E+00	1.26E+00	2.71E-02	1.56E+00	6.65E-01	5.71E-01	4.72E-01	
	297200	6258304	1.52E+01	1.02E+01	2.18E+00	5.68E+00	1.21E+00	2.60E-02	1.52E+00	6.40E-01	5.54E-01	4.56E-01	
	297250	6258304	1.57E+01	1.04E+01	2.26E+00	5.78E+00	1.26E+00	2.64E-02	1.54E+00	6.74E-01	5.84E-01	4.79E-01	
	297200	6258354	1.51E+01	1.00E+01	2.16E+00	5.57E+00	1.20E+00	2.48E-02	1.49E+00	6.42E-01	5.65E-01	4.60E-01	
	297250	6258354	1.56E+01	1.01E+01	2.24E+00	5.63E+00	1.25E+00	2.48E-02	1.50E+00	6.70E-01	5.93E-01	4.81E-01	
	297200	6258404	1.49E+01	9.69E+00	2.14E+00	5.38E+00	1.19E+00	2.32E-02	1.44E+00	6.32E-01	5.69E-01	4.59E-01	
	297250	6258404	1.55E+01	9.72E+00	2.22E+00	5.40E+00	1.23E+00	2.49E-02	1.44E+00	6.63E-01	5.94E-01	4.78E-01	
	297200	6258454	1.48E+01	9.27E+00	2.12E+00	5.15E+00	1.18E+00	2.39E-02	1.37E+00	6.34E-01	5.66E-01	4.55E-01	
	297250	6258454	1.53E+01	9.23E+00	2.19E+00	5.13E+00	1.22E+00	2.51E-02	1.37E+00	6.63E-01	5.85E-01	4.72E-01	
	297200	6258504	1.46E+01	8.78E+00	2.10E+00	4.88E+00	1.17E+00	2.36E-02	1.30E+00	6.34E-01	5.54E-01	4.47E-01	
	297250	6258504	1.51E+01	8.70E+00	2.17E+00	4.83E+00	1.20E+00	2.42E-02	1.29E+00	6.60E-01	5.68E-01	4.61E-01	
	297200	6258554	1.44E+01	8.30E+00	2.07E+00	4.61E+00	1.15E+00	2.28E-02	1.23E+00	6.31E-01	5.37E-01	4.38E-01	
	297250	6258554	1.49E+01	8.15E+00	2.13E+00	4.53E+00	1.19E+00	2.28E-02	1.21E+00	6.52E-01	5.45E-01	4.49E-01	
	297200	6258604	1.42E+01	7.80E+00	2.05E+00	4.34E+00	1.14E+00	2.15E-02	1.16E+00	6.24E-01	5.15E-01	4.27E-01	
	297250	6258604	1.46E+01	7.59E+00	2.10E+00	4.22E+00	1.17E+00	2.12E-02	1.12E+00	6.46E-01	5.20E-01	4.36E-01	
Closest receptors to the north (Minchinbury)	299461.5	6258797	1.82E+01	1.05E+01	2.61E+00	5.82E+00	1.45E+00	3.67E-02	1.55E+00	9.18E-01	7.03E-01	5.60E-01	
	299511.5	6258797	1.75E+01	1.00E+01	2.52E+00	5.57E+00	1.40E+00	3.67E-02	1.49E+00	8.77E-01	6.31E-01	5.24E-01	
	299561.5	6258797	1.69E+01	9.53E+00	2.43E+00	5.29E+00	1.35E+00	3.60E-02	1.41E+00	8.36E-01	5.78E-01	4.96E-01	
	299611.5	6258797	1.64E+01	9.01E+00	2.35E+00	5.01E+00	1.31E+00	3.44E-02	1.34E+00	7.96E-01	5.39E-01	4.74E-01	
	299661.5	6258797	1.58E+01	8.54E+00	2.26E+00	4.74E+00	1.26E+00	3.20E-02	1.26E+00	7.52E-01	5.04E-01	4.51E-01	
	299711.5	6258797	1.52E+01	8.36E+00	2.18E+00	4.65E+00	1.21E+00	2.92E-02	1.24E+00	7.15E-01	4.73E-01	4.31E-01	
	299761.5	6258797	1.46E+01	8.30E+00	2.10E+00	4.61E+00	1.16E+00	2.64E-02	1.23E+00	6.84E-01	4.46E-01	4.12E-01	
	299811.5	6258797	1.41E+01	8.18E+00	2.02E+00	4.54E+00	1.12E+00	2.36E-02	1.21E+00	6.74E-01	4.22E-01	3.96E-01	
	299211.5	6258847	2.11E+01	9.77E+00	3.03E+00	5.43E+00	1.68E+00	3.53E-02	1.45E+00	1.26E+00	8.93E-01	7.04E-01	
	299261.5	6258847	2.05E+01	9.99E+00	2.94E+00	5.55E+00	1.63E+00	3.11E-02	1.48E+00	1.23E+00	9.15E-01	6.92E-01	
	299311.5	6258847	1.99E+01	1.04E+01	2.86E+00	5.76E+00	1.59E+00	3.03E-02	1.54E+00	1.16E+00	9.10E-01	6.72E-01	
	299361.5	6258847	1.93E+01	1.06E+01	2.77E+00	5.87E+00	1.54E+00	2.90E-02	1.57E+00	1.04E+00	8.79E-01	6.45E-01	
	299411.5	6258847	1.87E+01	1.06E+01	2.68E+00	5.87E+00	1.49E+00	3.19E-02	1.56E+00	9.08E-01	8.15E-01	6.08E-01	

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day	
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF				
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³				
			100 th	100 th		100 th		100 th	100 th				
299461.5	6258847	1.79E+01	1.03E+01	2.57E+00	5.72E+00	1.43E+00	3.35E-02	1.52E+00	8.84E-01	7.20E-01	5.59E-01		
299511.5	6258847	1.73E+01	9.96E+00	2.48E+00	5.54E+00	1.38E+00	3.42E-02	1.48E+00	8.55E-01	6.46E-01	5.23E-01		
299561.5	6258847	1.67E+01	9.59E+00	2.40E+00	5.33E+00	1.34E+00	3.43E-02	1.42E+00	8.25E-01	5.91E-01	4.96E-01		
299611.5	6258847	1.62E+01	9.13E+00	2.33E+00	5.07E+00	1.29E+00	3.36E-02	1.35E+00	7.90E-01	5.48E-01	4.73E-01		
298911.5	6258897	2.35E+01	1.56E+01	3.37E+00	8.67E+00	1.87E+00	2.84E-02	2.31E+00	1.00E+00	7.56E-01	5.74E-01		
298961.5	6258897	2.32E+01	1.43E+01	3.33E+00	7.96E+00	1.85E+00	2.82E-02	2.12E+00	1.05E+00	7.60E-01	5.99E-01		
299011.5	6258897	2.29E+01	1.33E+01	3.28E+00	7.41E+00	1.82E+00	3.10E-02	1.98E+00	1.17E+00	7.53E-01	6.27E-01		
299061.5	6258897	2.24E+01	1.26E+01	3.21E+00	6.99E+00	1.79E+00	3.28E-02	1.86E+00	1.25E+00	7.38E-01	6.52E-01		
299111.5	6258897	2.18E+01	1.16E+01	3.14E+00	6.45E+00	1.74E+00	3.31E-02	1.72E+00	1.24E+00	7.53E-01	6.73E-01		
299161.5	6258897	2.13E+01	1.05E+01	3.05E+00	5.84E+00	1.70E+00	3.51E-02	1.56E+00	1.27E+00	8.12E-01	6.87E-01		
299211.5	6258897	2.07E+01	9.57E+00	2.97E+00	5.32E+00	1.65E+00	3.61E-02	1.42E+00	1.26E+00	8.54E-01	6.87E-01		
299261.5	6258897	2.01E+01	9.40E+00	2.89E+00	5.22E+00	1.60E+00	3.18E-02	1.39E+00	1.21E+00	8.79E-01	6.77E-01		
299311.5	6258897	1.96E+01	9.87E+00	2.81E+00	5.48E+00	1.56E+00	3.04E-02	1.46E+00	1.17E+00	8.86E-01	6.61E-01		
299361.5	6258897	1.90E+01	1.02E+01	2.73E+00	5.64E+00	1.52E+00	2.79E-02	1.50E+00	1.09E+00	8.75E-01	6.42E-01		
299411.5	6258897	1.84E+01	1.02E+01	2.65E+00	5.69E+00	1.47E+00	2.81E-02	1.52E+00	9.60E-01	8.27E-01	6.09E-01		
298411.5	6258947	2.03E+01	1.09E+01	2.91E+00	6.05E+00	1.62E+00	2.29E-02	1.61E+00	8.29E-01	7.10E-01	5.29E-01		
298461.5	6258947	2.08E+01	1.11E+01	2.98E+00	6.15E+00	1.66E+00	2.27E-02	1.64E+00	8.33E-01	7.25E-01	5.35E-01		
298511.5	6258947	2.12E+01	1.11E+01	3.05E+00	6.15E+00	1.70E+00	2.34E-02	1.64E+00	8.25E-01	7.30E-01	5.37E-01		
298561.5	6258947	2.17E+01	1.09E+01	3.11E+00	6.03E+00	1.73E+00	2.38E-02	1.61E+00	8.13E-01	7.27E-01	5.38E-01		
298611.5	6258947	2.19E+01	1.14E+01	3.15E+00	6.34E+00	1.75E+00	2.36E-02	1.69E+00	7.91E-01	7.13E-01	5.35E-01		
298661.5	6258947	2.22E+01	1.30E+01	3.19E+00	7.21E+00	1.77E+00	2.55E-02	1.92E+00	7.76E-01	6.96E-01	5.34E-01		
298711.5	6258947	2.24E+01	1.43E+01	3.22E+00	7.95E+00	1.79E+00	2.75E-02	2.12E+00	8.27E-01	6.85E-01	5.35E-01		
298761.5	6258947	2.27E+01	1.54E+01	3.25E+00	8.55E+00	1.81E+00	2.90E-02	2.28E+00	8.69E-01	6.92E-01	5.38E-01		
298811.5	6258947	2.28E+01	1.60E+01	3.28E+00	8.87E+00	1.82E+00	2.95E-02	2.37E+00	8.99E-01	7.02E-01	5.41E-01		
298861.5	6258947	2.29E+01	1.60E+01	3.28E+00	8.88E+00	1.82E+00	2.91E-02	2.37E+00	9.28E-01	7.16E-01	5.45E-01		
298911.5	6258947	2.27E+01	1.53E+01	3.26E+00	8.53E+00	1.81E+00	2.76E-02	2.27E+00	9.55E-01	7.24E-01	5.50E-01		
298961.5	6258947	2.25E+01	1.43E+01	3.24E+00	7.94E+00	1.80E+00	2.70E-02	2.12E+00	9.95E-01	7.30E-01	5.72E-01		
299011.5	6258947	2.23E+01	1.30E+01	3.20E+00	7.23E+00	1.78E+00	2.92E-02	1.93E+00	1.10E+00	7.31E-01	5.99E-01		
298411.5	6258997	1.96E+01	1.04E+01	2.81E+00	5.77E+00	1.56E+00	2.17E-02	1.54E+00	7.96E-01	6.83E-01	5.08E-01		
300111.5	6258597	1.16E+01	6.45E+00	1.66E+00	3.58E+00	9.24E-01	1.59E-02	9.55E-01	6.44E-01	3.44E-01	3.07E-01		
300161.5	6258597	1.13E+01	6.31E+00	1.62E+00	3.51E+00	8.98E-01	1.55E-02	9.36E-01	6.24E-01	3.36E-01	3.00E-01		
300211.5	6258597	1.09E+01	6.17E+00	1.57E+00	3.43E+00	8.73E-01	1.51E-02	9.14E-01	6.06E-01	3.29E-01	2.93E-01		
299961.5	6258647	1.27E+01	7.21E+00	1.83E+00	4.01E+00	1.02E+00	1.83E-02	1.07E+00	7.22E-01	3.90E-01	3.36E-01		
300011.5	6258647	1.23E+01	6.86E+00	1.77E+00	3.81E+00	9.82E-01	1.76E-02	1.02E+00	6.98E-01	3.75E-01	3.21E-01		
300061.5	6258647	1.19E+01	6.51E+00	1.71E+00	3.62E+00	9.50E-01	1.68E-02	9.65E-01	6.72E-01	3.60E-01	3.11E-01		
300111.5	6258647	1.15E+01	6.31E+00	1.66E+00	3.51E+00	9.20E-01	1.61E-02	9.35E-01	6.48E-01	3.47E-01	3.04E-01		
300211.5	6258647	1.09E+01	6.09E+00	1.56E+00	3.38E+00	8.69E-01	1.49E-02	9.02E-01	6.04E-01	3.23E-01	2.90E-01		
299811.5	6258697	1.42E+01	8.30E+00	2.03E+00	4.61E+00	1.13E+00	2.14E-02	1.23E+00	7.49E-01	4.27E-01	3.92E-01		
299861.5	6258697	1.36E+01	8.02E+00	1.96E+00	4.46E+00	1.09E+00	2.00E-02	1.19E+00	7.45E-01	4.17E-01	3.75E-01		
299911.5	6258697	1.32E+01	7.72E+00	1.89E+00	4.29E+00	1.05E+00	1.89E-02	1.14E+00	7.36E-01	4.05E-01	3.59E-01		
299961.5	6258697	1.27E+01	7.40E+00	1.82E+00	4.11E+00	1.01E+00	1.81E-02	1.10E+00	7.21E-01	3.92E-01	3.44E-01		

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF			
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³			
			100 th	100 th		100 th		100 th	100 th			
	300011.5	6258697	1.23E+01	7.08E+00	1.76E+00	3.93E+00	9.80E-01	1.73E-02	1.05E+00	7.01E-01	3.79E-01	3.28E-01
	300061.5	6258697	1.19E+01	6.75E+00	1.71E+00	3.75E+00	9.48E-01	1.67E-02	1.00E+00	6.78E-01	3.65E-01	3.14E-01
	299661.5	6258747	1.58E+01	8.67E+00	2.27E+00	4.82E+00	1.26E+00	3.12E-02	1.28E+00	7.54E-01	4.94E-01	4.49E-01
	299711.5	6258747	1.52E+01	8.60E+00	2.18E+00	4.78E+00	1.21E+00	2.80E-02	1.27E+00	7.20E-01	4.65E-01	4.29E-01
	299761.5	6258747	1.46E+01	8.46E+00	2.10E+00	4.70E+00	1.17E+00	2.49E-02	1.25E+00	7.07E-01	4.38E-01	4.11E-01
	299811.5	6258747	1.41E+01	8.28E+00	2.02E+00	4.60E+00	1.12E+00	2.19E-02	1.23E+00	7.13E-01	4.19E-01	3.95E-01
	299861.5	6258747	1.36E+01	8.05E+00	1.95E+00	4.47E+00	1.09E+00	2.04E-02	1.19E+00	7.16E-01	4.11E-01	3.79E-01
	299911.5	6258747	1.31E+01	7.80E+00	1.88E+00	4.33E+00	1.05E+00	1.91E-02	1.16E+00	7.16E-01	4.02E-01	3.65E-01
	299961.5	6258747	1.27E+01	7.52E+00	1.82E+00	4.18E+00	1.01E+00	1.84E-02	1.11E+00	7.11E-01	3.93E-01	3.51E-01
	300011.5	6258747	1.23E+01	7.23E+00	1.76E+00	4.02E+00	9.78E-01	1.77E-02	1.07E+00	6.97E-01	3.81E-01	3.35E-01
	298361.5	6258947	1.97E+01	1.06E+01	2.83E+00	5.87E+00	1.57E+00	2.27E-02	1.57E+00	8.16E-01	6.89E-01	5.20E-01
	298361.5	6258997	1.91E+01	1.01E+01	2.74E+00	5.61E+00	1.52E+00	2.15E-02	1.50E+00	7.85E-01	6.64E-01	5.00E-01
Industrial	297743	6259085	1.40E+01	7.23E+00	2.02E+00	4.01E+00	1.12E+00	2.13E-02	1.07E+00	6.98E-01	5.83E-01	4.33E-01
Industrial	298017	6259102	1.54E+01	7.25E+00	2.22E+00	4.03E+00	1.23E+00	1.59E-02	1.07E+00	5.79E-01	5.57E-01	4.36E-01
Industrial	298262	6259157	1.66E+01	8.50E+00	2.38E+00	4.72E+00	1.32E+00	1.79E-02	1.26E+00	6.86E-01	5.69E-01	4.35E-01
Industrial	298362	6259444	1.48E+01	7.19E+00	2.12E+00	4.00E+00	1.18E+00	1.49E-02	1.07E+00	5.94E-01	5.07E-01	3.76E-01
Industrial	298106	6259473	1.32E+01	6.39E+00	1.90E+00	3.55E+00	1.05E+00	1.45E-02	9.47E-01	5.42E-01	4.39E-01	3.44E-01
Industrial	297650	6259598	1.07E+01	5.41E+00	1.53E+00	3.01E+00	8.51E-01	1.24E-02	8.02E-01	3.73E-01	3.77E-01	3.01E-01
Industrial	297391	6259845	9.08E+00	4.76E+00	1.30E+00	2.64E+00	7.24E-01	1.08E-02	7.05E-01	3.09E-01	3.13E-01	2.50E-01
Industrial	297425	6259607	1.00E+01	5.17E+00	1.44E+00	2.87E+00	7.98E-01	1.31E-02	7.66E-01	4.02E-01	3.63E-01	2.83E-01
Industrial	297528	6259706	9.91E+00	5.18E+00	1.42E+00	2.88E+00	7.91E-01	1.19E-02	7.68E-01	3.39E-01	3.50E-01	2.79E-01
Industrial	297827	6259711	1.08E+01	4.69E+00	1.55E+00	2.61E+00	8.60E-01	1.18E-02	6.95E-01	4.01E-01	3.50E-01	2.85E-01
Industrial	297923	6259624	1.15E+01	5.18E+00	1.66E+00	2.88E+00	9.20E-01	1.27E-02	7.67E-01	4.46E-01	3.75E-01	3.03E-01
Industrial	298057	6259589	1.23E+01	5.81E+00	1.76E+00	3.23E+00	9.81E-01	1.36E-02	8.61E-01	5.03E-01	4.04E-01	3.19E-01
Industrial	298165	6259576	1.29E+01	6.23E+00	1.85E+00	3.46E+00	1.03E+00	1.40E-02	9.23E-01	5.28E-01	4.32E-01	3.33E-01
Industrial	298169	6259723	1.21E+01	5.77E+00	1.74E+00	3.21E+00	9.67E-01	1.32E-02	8.55E-01	4.95E-01	4.08E-01	3.13E-01
Industrial	297988	6259754	1.12E+01	5.11E+00	1.61E+00	2.84E+00	8.93E-01	1.25E-02	7.57E-01	4.55E-01	3.63E-01	2.90E-01
Industrial	297855	6259871	1.03E+01	4.50E+00	1.47E+00	2.50E+00	8.18E-01	1.15E-02	6.66E-01	3.97E-01	3.26E-01	2.66E-01
Industrial	298473	6259809	1.29E+01	5.98E+00	1.86E+00	3.32E+00	1.03E+00	1.32E-02	8.86E-01	4.95E-01	4.33E-01	3.18E-01
Industrial	298254	6259912	1.15E+01	5.38E+00	1.65E+00	2.99E+00	9.18E-01	1.22E-02	7.97E-01	4.67E-01	3.92E-01	2.93E-01
Industrial	297964	6259979	1.02E+01	4.56E+00	1.47E+00	2.53E+00	8.16E-01	1.16E-02	6.76E-01	4.19E-01	3.31E-01	2.63E-01
Industrial	297807	6260039	9.53E+00	4.22E+00	1.37E+00	2.34E+00	7.60E-01	1.08E-02	6.25E-01	3.69E-01	3.00E-01	2.45E-01
Industrial	299645	6258440	1.61E+01	9.14E+00	2.32E+00	5.08E+00	1.29E+00	2.43E-02	1.35E+00	8.98E-01	4.85E-01	4.24E-01
Industrial	299645	6258037	1.61E+01	8.06E+00	2.31E+00	4.48E+00	1.28E+00	2.55E-02	1.19E+00	7.44E-01	4.76E-01	4.35E-01
Industrial	299709	6257886	1.56E+01	1.08E+01	2.24E+00	5.99E+00	1.25E+00	2.72E-02	1.60E+00	6.07E-01	5.00E-01	4.24E-01
Industrial	299541	6257851	1.79E+01	1.22E+01	2.56E+00	6.75E+00	1.42E+00	3.28E-02	1.80E+00	6.49E-01	5.54E-01	4.66E-01
Industrial	299441	6258055	1.89E+01	9.84E+00	2.72E+00	5.46E+00	1.51E+00	2.30E-02	1.46E+00	8.24E-01	5.26E-01	4.73E-01
Industrial	299490	6257405	2.08E+01	1.46E+01	2.98E+00	8.09E+00	1.66E+00	3.50E-02	2.16E+00	8.74E-01	7.67E-01	6.76E-01
Industrial	299906	6257425	1.49E+01	1.06E+01	2.14E+00	5.86E+00	1.19E+00	2.12E-02	1.56E+00	6.24E-01	5.57E-01	4.68E-01
Industrial	300157	6257390	1.26E+01	9.00E+00	1.82E+00	5.00E+00	1.01E+00	1.65E-02	1.33E+00	4.97E-01	4.54E-01	3.88E-01
Industrial	300263	6257339	1.19E+01	8.26E+00	1.71E+00	4.59E+00	9.51E-01	1.56E-02	1.22E+00	4.80E-01	4.29E-01	3.69E-01

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day
			NO ₂	SO ₂		PM ₁₀ /PM _{2.5}		CO	HF			
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³			
			100 th	100 th		100 th		100 th	100 th			
Industrial	300447	6257583	1.02E+01	7.57E+00	1.47E+00	4.20E+00	8.18E-01	1.35E-02	1.12E+00	3.54E-01	3.38E-01	2.91E-01
Industrial	300228	6257651	1.15E+01	8.62E+00	1.65E+00	4.79E+00	9.19E-01	1.58E-02	1.28E+00	4.08E-01	3.80E-01	3.24E-01
Industrial	300560	6257928	9.28E+00	5.94E+00	1.33E+00	3.30E+00	7.41E-01	1.18E-02	8.81E-01	3.32E-01	2.84E-01	2.55E-01
Industrial	300633	6257735	9.14E+00	6.14E+00	1.31E+00	3.41E+00	7.29E-01	1.17E-02	9.09E-01	3.15E-01	2.91E-01	2.53E-01
Industrial	300948	6257833	7.93E+00	4.70E+00	1.14E+00	2.61E+00	6.33E-01	9.54E-03	6.96E-01	2.68E-01	2.45E-01	2.19E-01
Industrial	300802	6257591	8.59E+00	5.98E+00	1.23E+00	3.32E+00	6.85E-01	1.04E-02	8.85E-01	2.91E-01	2.74E-01	2.40E-01
Industrial	300633	6257403	9.52E+00	6.83E+00	1.37E+00	3.79E+00	7.59E-01	1.18E-02	1.01E+00	3.33E-01	3.18E-01	2.78E-01
Industrial	300755	6257374	8.87E+00	6.30E+00	1.27E+00	3.50E+00	7.08E-01	1.07E-02	9.33E-01	3.16E-01	2.97E-01	2.61E-01
Industrial	301037	6257567	7.76E+00	5.23E+00	1.12E+00	2.90E+00	6.20E-01	9.01E-03	7.74E-01	2.58E-01	2.45E-01	2.17E-01
Industrial	301057	6257410	7.78E+00	5.34E+00	1.12E+00	2.97E+00	6.21E-01	9.02E-03	7.91E-01	2.53E-01	2.49E-01	2.22E-01
Industrial	301003	6257186	8.10E+00	5.36E+00	1.16E+00	2.98E+00	6.46E-01	8.82E-03	7.94E-01	3.03E-01	2.78E-01	2.45E-01
Industrial	300950	6257066	8.40E+00	5.20E+00	1.21E+00	2.89E+00	6.70E-01	1.01E-02	7.70E-01	3.42E-01	2.94E-01	2.62E-01
Industrial	300910	6256975	8.55E+00	4.95E+00	1.23E+00	2.75E+00	6.82E-01	1.07E-02	7.33E-01	3.15E-01	2.87E-01	2.66E-01
Industrial	300682	6257126	9.56E+00	5.96E+00	1.37E+00	3.31E+00	7.63E-01	1.22E-02	8.83E-01	3.91E-01	3.38E-01	3.01E-01
Industrial	300691	6257026	9.50E+00	5.51E+00	1.36E+00	3.06E+00	7.58E-01	1.25E-02	8.16E-01	3.42E-01	3.18E-01	2.98E-01
Industrial	300831	6257241	8.73E+00	5.91E+00	1.25E+00	3.28E+00	6.97E-01	9.78E-03	8.75E-01	3.25E-01	3.01E-01	2.64E-01
Industrial	300436	6257299	1.07E+01	7.36E+00	1.54E+00	4.09E+00	8.55E-01	1.35E-02	1.09E+00	4.27E-01	3.83E-01	3.32E-01
Industrial	299601	6257064	1.84E+01	1.16E+01	2.64E+00	6.47E+00	1.47E+00	5.10E-02	1.73E+00	1.43E+00	8.47E-01	7.08E-01
Industrial	299490	6256891	1.87E+01	1.11E+01	2.68E+00	6.15E+00	1.49E+00	5.54E-02	1.64E+00	1.57E+00	8.64E-01	7.70E-01
Industrial	299689	6256705	1.57E+01	9.91E+00	2.25E+00	5.51E+00	1.25E+00	4.77E-02	1.47E+00	1.28E+00	7.06E-01	6.38E-01
Industrial	299501	6256224	1.47E+01	7.26E+00	2.12E+00	4.03E+00	1.18E+00	3.05E-02	1.08E+00	6.10E-01	5.15E-01	4.70E-01
Industrial	300008	6256426	1.23E+01	8.02E+00	1.77E+00	4.46E+00	9.85E-01	3.86E-02	1.19E+00	9.50E-01	5.44E-01	4.95E-01
Industrial	300219	6256526	1.14E+01	5.79E+00	1.64E+00	3.21E+00	9.12E-01	3.16E-02	8.57E-01	8.22E-01	5.28E-01	4.42E-01
Industrial	300529	6256577	1.00E+01	5.22E+00	1.44E+00	2.90E+00	7.99E-01	2.16E-02	7.73E-01	6.32E-01	3.79E-01	3.39E-01
Industrial	300899	6256202	8.12E+00	4.05E+00	1.17E+00	2.25E+00	6.48E-01	1.84E-02	5.99E-01	5.42E-01	3.21E-01	2.81E-01
Industrial	300786	6255839	8.12E+00	4.81E+00	1.17E+00	2.67E+00	6.48E-01	1.70E-02	7.12E-01	4.86E-01	3.35E-01	3.01E-01
Industrial	301006	6255854	7.56E+00	3.82E+00	1.09E+00	2.12E+00	6.03E-01	2.10E-02	5.67E-01	4.36E-01	3.33E-01	2.81E-01
Industrial	298652	6255402	1.04E+01	5.11E+00	1.50E+00	2.84E+00	8.33E-01	2.74E-02	7.57E-01	4.70E-01	3.53E-01	2.93E-01
Industrial	298508	6255389	9.83E+00	4.49E+00	1.41E+00	2.50E+00	7.84E-01	1.80E-02	6.66E-01	4.27E-01	3.31E-01	2.65E-01
Industrial	298584	6255037	8.87E+00	4.25E+00	1.27E+00	2.36E+00	7.08E-01	2.17E-02	6.30E-01	3.95E-01	3.01E-01	2.45E-01
Industrial	296204	6256521	6.07E+00	3.89E+00	8.71E-01	2.16E+00	4.84E-01	1.19E-02	5.77E-01	2.86E-01	2.18E-01	1.67E-01
Industrial	296614	6256526	6.90E+00	4.10E+00	9.92E-01	2.28E+00	5.51E-01	1.44E-02	6.07E-01	3.28E-01	2.40E-01	1.89E-01
Industrial	296388	6256355	6.21E+00	3.69E+00	8.91E-01	2.05E+00	4.95E-01	1.38E-02	5.46E-01	2.98E-01	2.15E-01	1.70E-01
Industrial	296643	6256280	6.59E+00	3.42E+00	9.46E-01	1.90E+00	5.26E-01	7.31E-03	5.07E-01	2.88E-01	1.85E-01	1.55E-01
Industrial	296700	6256087	6.39E+00	3.18E+00	9.18E-01	1.77E+00	5.10E-01	1.19E-02	4.71E-01	2.48E-01	1.81E-01	1.48E-01
Industrial	296946	6256040	6.79E+00	3.36E+00	9.75E-01	1.86E+00	5.42E-01	7.50E-03	4.97E-01	2.56E-01	1.93E-01	1.58E-01
Industrial	296598	6255723	5.68E+00	2.84E+00	8.15E-01	1.58E+00	4.53E-01	6.58E-03	4.21E-01	2.11E-01	1.63E-01	1.33E-01
Industrial	296410	6255743	5.44E+00	2.73E+00	7.81E-01	1.52E+00	4.34E-01	1.09E-02	4.05E-01	2.05E-01	1.56E-01	1.27E-01
Industrial	296055	6255881	5.13E+00	2.67E+00	7.37E-01	1.48E+00	4.09E-01	5.77E-03	3.95E-01	2.22E-01	1.46E-01	1.20E-01
Industrial Facility (Fisher and Paykel)	299251	6258615	2.19E+01	1.22E+01	3.15E+00	6.78E+00	1.75E+00	4.15E-02	1.81E+00	1.07E+00	9.02E-01	6.94E-01

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	24 hour	Annual	8 hour	24 hour	7 day	30 day	90 day
			NO ₂	SO ₂		PM ₁₀ / PM _{2.5}		CO	HF			
			µg/m ³	µg/m ³		µg/m ³		mg/m ³	µg/m ³			
			100 th	100 th		100 th		100 th	100 th			
Commercial Land (Sargents)	298093	6258488	2.38E+01	1.24E+01	3.42E+00	6.86E+00	1.90E+00	3.39E-02	1.83E+00	1.48E+00	1.12E+00	7.84E-01
Commercial Land (Dept of Planning)	297926	6258109	2.84E+01	1.46E+01	4.07E+00	8.10E+00	2.26E+00	3.47E-02	2.16E+00	1.35E+00	1.09E+00	8.90E-01
Commercial Land (Dept of Planning)	298154	6257844	3.14E+01	1.50E+01	4.50E+00	8.34E+00	2.50E+00	3.32E-02	2.22E+00	1.26E+00	1.11E+00	9.27E-01
Commercial Land (Dept of Planning)	298091	6257443	2.15E+01	1.39E+01	3.09E+00	7.73E+00	1.71E+00	2.54E-02	2.06E+00	1.02E+00	7.43E-01	5.78E-01
Commercial Land (Dept of Planning)	298470	6257372	2.72E+01	1.37E+01	3.90E+00	7.63E+00	2.17E+00	3.07E-02	2.04E+00	1.22E+00	8.88E-01	7.17E-01
Commercial Land (Dept of Planning)	298175	6257034	1.81E+01	9.15E+00	2.61E+00	5.09E+00	1.45E+00	1.93E-02	1.36E+00	7.36E-01	5.08E-01	4.30E-01
Commercial Land (Dept of Planning)	298746	6257137	3.16E+01	1.72E+01	4.54E+00	9.58E+00	2.52E+00	7.21E-02	2.55E+00	1.66E+00	1.09E+00	8.31E-01
Industrial Facility (Hanson)	299072	6257670	2.58E+01	1.22E+01	3.70E+00	6.77E+00	2.06E+00	2.83E-02	1.81E+00	9.18E-01	7.82E-01	5.98E-01
Industrial Facility (Jacfin)	299136	6256900	2.33E+01	1.23E+01	3.34E+00	6.85E+00	1.86E+00	4.91E-02	1.83E+00	9.92E-01	7.59E-01	7.23E-01

J.1.3 POEO Emission Limits

Table J-5: Predicted ground level concentrations at particular sensitive receptors – short term averaging periods

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	PM ₁₀	H ₂ S	CO	Cd	Hg	Dioxins / Furans	TOC (as benzene)
			µg/m ³	µg/m ³	µg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th	99 th	100 th	99.9 th	99.9 th	99.9 th	99.9 th
Maximum (outside site boundary)			1.4E+02	1.4E+01	9.6E-01	3.4E-02	4.4E-05	4.4E-05	2.2E-11	8.7E-03
James Erskine Primary School	296748	6257187	3.7E+01	3.7E+00	3.6E-01	9.3E-03	1.5E-05	1.5E-05	7.4E-12	2.9E-03
Eskrine Park High School	296709	6256992	3.8E+01	3.8E+00	3.4E-01	9.5E-03	1.4E-05	1.4E-05	7.1E-12	2.8E-03
Clairgate Public School	296299	6258187	5.2E+01	5.2E+00	2.9E-01	1.3E-02	1.2E-05	1.2E-05	6.2E-12	2.5E-03
Minchinbury Public School	299287	6259084	1.2E+02	1.2E+01	6.3E-01	3.1E-02	3.9E-05	3.9E-05	2.0E-11	7.8E-03
Pinegrove Memorial Park Lawn Cemetery	300567	6258692	1.1E+02	1.1E+01	3.2E-01	2.7E-02	2.9E-05	2.9E-05	1.5E-11	5.8E-03
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266	7.3E+01	7.3E+00	4.5E-01	1.8E-02	2.0E-05	2.0E-05	9.8E-12	3.9E-03
Eastern Creek Public School	301201	6259319	9.5E+01	9.5E+00	2.3E-01	2.4E-02	2.4E-05	2.4E-05	1.2E-11	4.7E-03
St Agnes Catholic High School	300761	6259894	8.4E+01	8.4E+00	2.7E-01	2.1E-02	2.6E-05	2.6E-05	1.3E-11	5.3E-03
All Areas Family Day Care Pty	299581	6258986	1.4E+02	1.4E+01	5.7E-01	3.4E-02	3.7E-05	3.7E-05	1.9E-11	7.4E-03
Maria Hawey Child Care Centre	299370	6259272	1.2E+02	1.2E+01	5.7E-01	2.9E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
Jiminey Cricket Long Day Care	298562	6259310	1.2E+02	1.2E+01	5.0E-01	3.1E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
White Bunny Child Care Centre	299792	6259530	1.2E+02	1.2E+01	5.1E-01	3.0E-02	3.3E-05	3.3E-05	1.7E-11	6.7E-03
LITTLES MARTIES	296419	6258212	5.5E+01	5.5E+00	3.1E-01	1.4E-02	1.3E-05	1.3E-05	6.6E-12	2.6E-03
Kidz Fun Factory	298128	6259445	1.1E+02	1.1E+01	4.0E-01	2.7E-02	3.1E-05	3.1E-05	1.6E-11	6.3E-03
Closest receptors to the west (Erskine Park)	297450	6256754	4.7E+01	4.7E+00	4.3E-01	1.2E-02	1.8E-05	1.8E-05	9.1E-12	3.7E-03
	297500	6256754	4.8E+01	4.8E+00	4.4E-01	1.2E-02	1.9E-05	1.9E-05	9.4E-12	3.8E-03
	297450	6256804	4.7E+01	4.7E+00	4.4E-01	1.2E-02	1.9E-05	1.9E-05	9.4E-12	3.8E-03
	297500	6256804	4.8E+01	4.8E+00	4.4E-01	1.2E-02	1.9E-05	1.9E-05	9.7E-12	3.9E-03
	297450	6256854	4.8E+01	4.8E+00	4.5E-01	1.2E-02	1.9E-05	1.9E-05	9.5E-12	3.8E-03
	297500	6256854	4.9E+01	4.9E+00	4.6E-01	1.2E-02	2.0E-05	2.0E-05	9.8E-12	3.9E-03
	297450	6256904	4.9E+01	4.9E+00	4.6E-01	1.2E-02	1.9E-05	1.9E-05	9.7E-12	3.9E-03
	297500	6256904	5.0E+01	5.0E+00	4.7E-01	1.3E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
	297400	6256954	4.9E+01	4.9E+00	4.6E-01	1.2E-02	1.9E-05	1.9E-05	9.7E-12	3.9E-03
	297450	6256954	5.0E+01	5.0E+00	4.7E-01	1.2E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
	297500	6256954	5.1E+01	5.1E+00	4.8E-01	1.3E-02	2.0E-05	2.0E-05	1.0E-11	4.1E-03
	297400	6257004	4.9E+01	4.9E+00	4.7E-01	1.2E-02	2.0E-05	2.0E-05	9.8E-12	3.9E-03
	297450	6257004	5.1E+01	5.1E+00	4.8E-01	1.3E-02	2.0E-05	2.0E-05	1.0E-11	4.0E-03
	297500	6257004	5.2E+01	5.2E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03
	297400	6257054	5.0E+01	5.0E+00	4.8E-01	1.3E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
	297450	6257054	5.2E+01	5.2E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03
	297500	6257054	5.3E+01	5.3E+00	5.0E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03
	297400	6257104	5.1E+01	5.1E+00	4.9E-01	1.3E-02	2.0E-05	2.0E-05	1.0E-11	4.1E-03
	297450	6257104	5.3E+01	5.3E+00	5.0E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03
	297400	6257154	5.2E+01	5.2E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03
	297450	6257154	5.3E+01	5.3E+00	5.1E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03
	297400	6257204	5.2E+01	5.2E+00	5.0E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	PM ₁₀	H ₂ S	CO	Cd	Hg	Dioxins / Furans	TOC (as benzene)
			µg/m ³	µg/m ³	µg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th	99 th	100 th	99.9 th	99.9 th	99.9 th	99.9 th
297450	6257204	5.4E+01	5.4E+00	5.1E-01	1.4E-02	2.1E-05	2.1E-05	1.1E-11	4.3E-03	
297400	6257254	5.3E+01	5.3E+00	5.0E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297400	6257304	5.4E+01	5.4E+00	5.1E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.3E-03	
297350	6257354	5.2E+01	5.2E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	
297400	6257354	5.4E+01	5.4E+00	5.1E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297350	6257404	5.3E+01	5.3E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	
297400	6257404	5.5E+01	5.5E+00	5.1E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297350	6257454	5.3E+01	5.3E+00	5.0E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297400	6257454	5.5E+01	5.5E+00	5.2E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.4E-03	
297300	6257504	5.2E+01	5.2E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03	
297350	6257504	5.4E+01	5.4E+00	5.1E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.3E-03	
297400	6257504	5.6E+01	5.6E+00	5.2E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.4E-03	
297300	6257554	5.2E+01	5.2E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03	
297350	6257554	5.4E+01	5.4E+00	5.1E-01	1.3E-02	2.1E-05	2.1E-05	1.1E-11	4.3E-03	
297400	6257554	5.6E+01	5.6E+00	5.2E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.4E-03	
297300	6257604	5.3E+01	5.3E+00	4.9E-01	1.3E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	
297350	6257604	5.5E+01	5.5E+00	5.1E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297300	6257654	5.5E+01	5.5E+00	4.9E-01	1.4E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	
297350	6257654	5.7E+01	5.7E+00	5.1E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297300	6257704	5.6E+01	5.6E+00	4.9E-01	1.4E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	
297350	6257704	5.8E+01	5.8E+00	5.1E-01	1.5E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297300	6257754	5.6E+01	5.6E+00	5.0E-01	1.4E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	
297350	6257754	5.8E+01	5.8E+00	5.1E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297300	6257804	5.5E+01	5.5E+00	5.0E-01	1.4E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297350	6257804	5.8E+01	5.8E+00	5.2E-01	1.4E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297300	6257854	5.7E+01	5.7E+00	5.0E-01	1.4E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297350	6257854	6.0E+01	6.0E+00	5.1E-01	1.5E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297300	6257904	6.0E+01	6.0E+00	4.9E-01	1.5E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297250	6257954	6.3E+01	6.3E+00	4.8E-01	1.6E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03	
297300	6257954	6.4E+01	6.4E+00	5.0E-01	1.6E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03	
297250	6258004	6.6E+01	6.6E+00	4.8E-01	1.6E-02	2.0E-05	2.0E-05	1.0E-11	4.1E-03	
297300	6258004	6.7E+01	6.7E+00	5.0E-01	1.7E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297250	6258054	6.9E+01	6.9E+00	4.8E-01	1.7E-02	2.0E-05	2.0E-05	1.0E-11	4.0E-03	
297300	6258054	7.0E+01	7.0E+00	5.0E-01	1.7E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297250	6258104	7.1E+01	7.1E+00	4.8E-01	1.8E-02	2.0E-05	2.0E-05	1.0E-11	4.1E-03	
297300	6258104	7.2E+01	7.2E+00	5.0E-01	1.8E-02	2.1E-05	2.1E-05	1.1E-11	4.2E-03	
297250	6258154	7.3E+01	7.3E+00	4.8E-01	1.8E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03	
297300	6258154	7.4E+01	7.4E+00	4.9E-01	1.8E-02	2.1E-05	2.1E-05	1.1E-11	4.3E-03	
297250	6258204	7.4E+01	7.4E+00	4.8E-01	1.9E-02	2.1E-05	2.1E-05	1.1E-11	4.3E-03	
297200	6258254	7.4E+01	7.4E+00	4.6E-01	1.8E-02	2.0E-05	2.0E-05	1.0E-11	4.0E-03	
297250	6258254	7.5E+01	7.5E+00	4.7E-01	1.9E-02	2.1E-05	2.1E-05	1.0E-11	4.2E-03	

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	PM ₁₀	H ₂ S	CO	Cd	Hg	Dioxins / Furans	TOC (as benzene)
			µg/m ³	µg/m ³	µg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th	99 th	100 th	99.9 th	99.9 th	99.9 th	99.9 th
	297200	6258304	7.4E+01	7.4E+00	4.6E-01	1.8E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
	297250	6258304	7.5E+01	7.5E+00	4.7E-01	1.9E-02	2.1E-05	2.1E-05	1.0E-11	4.1E-03
	297200	6258354	7.3E+01	7.3E+00	4.5E-01	1.8E-02	2.0E-05	2.0E-05	9.8E-12	3.9E-03
	297250	6258354	7.4E+01	7.4E+00	4.6E-01	1.9E-02	2.0E-05	2.0E-05	1.0E-11	4.1E-03
	297200	6258404	7.3E+01	7.3E+00	4.4E-01	1.8E-02	1.9E-05	1.9E-05	9.7E-12	3.9E-03
	297250	6258404	7.3E+01	7.3E+00	4.6E-01	1.8E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
	297200	6258454	7.1E+01	7.1E+00	4.4E-01	1.8E-02	1.9E-05	1.9E-05	9.5E-12	3.8E-03
	297250	6258454	7.2E+01	7.2E+00	4.5E-01	1.8E-02	2.0E-05	2.0E-05	9.8E-12	3.9E-03
	297200	6258504	7.0E+01	7.0E+00	4.3E-01	1.8E-02	1.9E-05	1.9E-05	9.3E-12	3.7E-03
	297250	6258504	7.0E+01	7.0E+00	4.4E-01	1.8E-02	1.9E-05	1.9E-05	9.5E-12	3.8E-03
	297200	6258554	6.9E+01	6.9E+00	4.3E-01	1.7E-02	1.8E-05	1.8E-05	9.1E-12	3.7E-03
	297250	6258554	6.8E+01	6.8E+00	4.4E-01	1.7E-02	1.9E-05	1.9E-05	9.7E-12	3.9E-03
	297200	6258604	6.7E+01	6.7E+00	4.2E-01	1.7E-02	1.8E-05	1.8E-05	9.1E-12	3.7E-03
	297250	6258604	6.6E+01	6.6E+00	4.3E-01	1.7E-02	1.9E-05	1.9E-05	9.3E-12	3.7E-03
Closest receptors to the north (Minchinbury)	299461.5	6258797	1.4E+02	1.4E+01	6.3E-01	3.4E-02	3.8E-05	3.8E-05	1.9E-11	7.5E-03
	299511.5	6258797	1.3E+02	1.3E+01	6.0E-01	3.3E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	299561.5	6258797	1.3E+02	1.3E+01	5.9E-01	3.3E-02	3.7E-05	3.7E-05	1.8E-11	7.4E-03
	299611.5	6258797	1.3E+02	1.3E+01	5.8E-01	3.2E-02	3.8E-05	3.8E-05	1.9E-11	7.5E-03
	299661.5	6258797	1.2E+02	1.2E+01	5.5E-01	3.1E-02	3.7E-05	3.7E-05	1.8E-11	7.4E-03
	299711.5	6258797	1.2E+02	1.2E+01	5.2E-01	3.0E-02	3.6E-05	3.6E-05	1.8E-11	7.3E-03
	299761.5	6258797	1.1E+02	1.1E+01	5.0E-01	2.8E-02	3.7E-05	3.7E-05	1.8E-11	7.4E-03
	299811.5	6258797	1.2E+02	1.2E+01	4.9E-01	2.9E-02	3.7E-05	3.7E-05	1.9E-11	7.5E-03
	299211.5	6258847	1.2E+02	1.2E+01	7.2E-01	3.1E-02	4.0E-05	4.0E-05	2.0E-11	7.9E-03
	299261.5	6258847	1.3E+02	1.3E+01	7.0E-01	3.2E-02	4.0E-05	4.0E-05	2.0E-11	7.9E-03
	299311.5	6258847	1.3E+02	1.3E+01	7.1E-01	3.3E-02	3.8E-05	3.8E-05	1.9E-11	7.5E-03
	299361.5	6258847	1.4E+02	1.4E+01	6.9E-01	3.4E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	299411.5	6258847	1.4E+02	1.4E+01	6.6E-01	3.4E-02	3.8E-05	3.8E-05	1.9E-11	7.7E-03
	299461.5	6258847	1.4E+02	1.4E+01	6.1E-01	3.4E-02	3.9E-05	3.9E-05	1.9E-11	7.7E-03
	299511.5	6258847	1.3E+02	1.3E+01	5.9E-01	3.4E-02	3.6E-05	3.6E-05	1.8E-11	7.3E-03
	299561.5	6258847	1.3E+02	1.3E+01	5.8E-01	3.3E-02	3.7E-05	3.7E-05	1.9E-11	7.5E-03
	299611.5	6258847	1.3E+02	1.3E+01	5.7E-01	3.3E-02	3.6E-05	3.6E-05	1.8E-11	7.3E-03
	298911.5	6258897	1.3E+02	1.3E+01	6.9E-01	3.2E-02	3.9E-05	3.9E-05	1.9E-11	7.8E-03
	298961.5	6258897	1.3E+02	1.3E+01	7.0E-01	3.3E-02	3.9E-05	3.9E-05	1.9E-11	7.8E-03
	299011.5	6258897	1.3E+02	1.3E+01	7.0E-01	3.4E-02	3.9E-05	3.9E-05	1.9E-11	7.7E-03
	299061.5	6258897	1.3E+02	1.3E+01	6.8E-01	3.4E-02	4.1E-05	4.1E-05	2.0E-11	8.1E-03
	299111.5	6258897	1.3E+02	1.3E+01	6.9E-01	3.3E-02	4.1E-05	4.1E-05	2.0E-11	8.1E-03
	299161.5	6258897	1.3E+02	1.3E+01	6.9E-01	3.2E-02	4.0E-05	4.0E-05	2.0E-11	8.0E-03
	299211.5	6258897	1.3E+02	1.3E+01	6.9E-01	3.1E-02	4.0E-05	4.0E-05	2.0E-11	8.0E-03
	299261.5	6258897	1.2E+02	1.2E+01	7.0E-01	3.1E-02	4.0E-05	4.0E-05	2.0E-11	8.0E-03
	299311.5	6258897	1.3E+02	1.3E+01	6.9E-01	3.3E-02	3.9E-05	3.9E-05	2.0E-11	7.8E-03
299361.5	6258897	1.3E+02	1.3E+01	6.8E-01	3.4E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03	

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	PM ₁₀	H ₂ S	CO	Cd	Hg	Dioxins / Furans	TOC (as benzene)
			µg/m ³	µg/m ³	µg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th	99 th	100 th	99.9 th	99.9 th	99.9 th	99.9 th
	299411.5	6258897	1.4E+02	1.4E+01	6.5E-01	3.4E-02	3.7E-05	3.7E-05	1.9E-11	7.5E-03
	298411.5	6258947	1.3E+02	1.3E+01	6.1E-01	3.2E-02	3.9E-05	3.9E-05	1.9E-11	7.7E-03
	298461.5	6258947	1.3E+02	1.3E+01	6.2E-01	3.3E-02	3.9E-05	3.9E-05	2.0E-11	7.9E-03
	298511.5	6258947	1.3E+02	1.3E+01	6.2E-01	3.3E-02	3.9E-05	3.9E-05	2.0E-11	7.8E-03
	298561.5	6258947	1.3E+02	1.3E+01	6.4E-01	3.3E-02	4.1E-05	4.1E-05	2.0E-11	8.2E-03
	298611.5	6258947	1.3E+02	1.3E+01	6.3E-01	3.2E-02	4.1E-05	4.1E-05	2.1E-11	8.2E-03
	298661.5	6258947	1.2E+02	1.2E+01	6.4E-01	3.0E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	298711.5	6258947	1.2E+02	1.2E+01	6.4E-01	3.0E-02	3.9E-05	3.9E-05	1.9E-11	7.8E-03
	298761.5	6258947	1.2E+02	1.2E+01	6.6E-01	3.1E-02	4.1E-05	4.1E-05	2.1E-11	8.2E-03
	298811.5	6258947	1.2E+02	1.2E+01	6.6E-01	3.1E-02	4.1E-05	4.1E-05	2.0E-11	8.1E-03
	298861.5	6258947	1.2E+02	1.2E+01	6.6E-01	3.1E-02	4.1E-05	4.1E-05	2.0E-11	8.1E-03
	298911.5	6258947	1.3E+02	1.3E+01	6.7E-01	3.2E-02	3.9E-05	3.9E-05	1.9E-11	7.8E-03
	298961.5	6258947	1.3E+02	1.3E+01	6.8E-01	3.3E-02	3.9E-05	3.9E-05	1.9E-11	7.8E-03
	299011.5	6258947	1.3E+02	1.3E+01	6.8E-01	3.4E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	298411.5	6258997	1.3E+02	1.3E+01	5.9E-01	3.2E-02	3.8E-05	3.8E-05	1.9E-11	7.7E-03
	300111.5	6258597	1.3E+02	1.3E+01	4.1E-01	3.2E-02	3.1E-05	3.1E-05	1.6E-11	6.3E-03
	300161.5	6258597	1.3E+02	1.3E+01	4.0E-01	3.2E-02	3.0E-05	3.0E-05	1.5E-11	6.0E-03
	300211.5	6258597	1.2E+02	1.2E+01	3.9E-01	3.1E-02	2.9E-05	2.9E-05	1.5E-11	5.9E-03
	299961.5	6258647	1.3E+02	1.3E+01	4.4E-01	3.3E-02	3.2E-05	3.2E-05	1.6E-11	6.5E-03
	300011.5	6258647	1.3E+02	1.3E+01	4.2E-01	3.3E-02	3.3E-05	3.3E-05	1.6E-11	6.5E-03
	300061.5	6258647	1.3E+02	1.3E+01	4.1E-01	3.3E-02	3.3E-05	3.3E-05	1.7E-11	6.6E-03
	300111.5	6258647	1.3E+02	1.3E+01	4.0E-01	3.3E-02	3.3E-05	3.3E-05	1.6E-11	6.5E-03
	300211.5	6258647	1.3E+02	1.3E+01	3.8E-01	3.2E-02	3.0E-05	3.0E-05	1.5E-11	6.0E-03
	299811.5	6258697	1.3E+02	1.3E+01	5.0E-01	3.1E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	299861.5	6258697	1.3E+02	1.3E+01	4.9E-01	3.2E-02	3.6E-05	3.6E-05	1.8E-11	7.1E-03
	299911.5	6258697	1.3E+02	1.3E+01	4.7E-01	3.2E-02	3.4E-05	3.4E-05	1.7E-11	6.9E-03
	299961.5	6258697	1.3E+02	1.3E+01	4.5E-01	3.3E-02	3.3E-05	3.3E-05	1.7E-11	6.7E-03
	300011.5	6258697	1.3E+02	1.3E+01	4.2E-01	3.3E-02	3.2E-05	3.2E-05	1.6E-11	6.5E-03
	300061.5	6258697	1.3E+02	1.3E+01	4.1E-01	3.3E-02	3.1E-05	3.1E-05	1.6E-11	6.3E-03
	299661.5	6258747	1.2E+02	1.2E+01	5.4E-01	3.0E-02	3.7E-05	3.7E-05	1.9E-11	7.4E-03
	299711.5	6258747	1.2E+02	1.2E+01	5.2E-01	2.9E-02	3.8E-05	3.8E-05	1.9E-11	7.5E-03
	299761.5	6258747	1.2E+02	1.2E+01	5.1E-01	2.9E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	299811.5	6258747	1.2E+02	1.2E+01	5.1E-01	3.0E-02	3.9E-05	3.9E-05	1.9E-11	7.7E-03
	299861.5	6258747	1.2E+02	1.2E+01	4.9E-01	3.1E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
	299911.5	6258747	1.3E+02	1.3E+01	4.7E-01	3.2E-02	3.6E-05	3.6E-05	1.8E-11	7.2E-03
	299961.5	6258747	1.3E+02	1.3E+01	4.6E-01	3.2E-02	3.4E-05	3.4E-05	1.7E-11	6.8E-03
	300011.5	6258747	1.3E+02	1.3E+01	4.4E-01	3.2E-02	3.3E-05	3.3E-05	1.7E-11	6.6E-03
	298361.5	6258947	1.2E+02	1.2E+01	5.9E-01	3.1E-02	3.6E-05	3.6E-05	1.8E-11	7.2E-03
	298361.5	6258997	1.2E+02	1.2E+01	5.7E-01	3.1E-02	3.6E-05	3.6E-05	1.8E-11	7.2E-03
Industrial	297743	6259085	6.5E+01	6.5E+00	4.3E-01	1.6E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
Industrial	298017	6259102	1.0E+02	1.0E+01	4.7E-01	2.5E-02	2.5E-05	2.5E-05	1.2E-11	4.9E-03

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	PM ₁₀	H ₂ S	CO	Cd	Hg	Dioxins / Furans	TOC (as benzene)
			µg/m ³	µg/m ³	µg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th	99 th	100 th	99.9 th	99.9 th	99.9 th	99.9 th
Industrial	298262	6259157	1.2E+02	1.2E+01	4.9E-01	3.0E-02	3.2E-05	3.2E-05	1.6E-11	6.5E-03
Industrial	298362	6259444	1.2E+02	1.2E+01	4.5E-01	3.0E-02	3.6E-05	3.6E-05	1.8E-11	7.3E-03
Industrial	298106	6259473	1.1E+02	1.1E+01	3.9E-01	2.7E-02	3.1E-05	3.1E-05	1.5E-11	6.2E-03
Industrial	297650	6259598	7.3E+01	7.3E+00	3.3E-01	1.8E-02	1.8E-05	1.8E-05	8.8E-12	3.5E-03
Industrial	297391	6259845	5.8E+01	5.8E+00	2.9E-01	1.4E-02	1.5E-05	1.5E-05	7.6E-12	3.0E-03
Industrial	297425	6259607	5.4E+01	5.4E+00	3.1E-01	1.4E-02	1.7E-05	1.7E-05	8.5E-12	3.4E-03
Industrial	297528	6259706	6.6E+01	6.6E+00	3.1E-01	1.6E-02	1.6E-05	1.6E-05	7.9E-12	3.1E-03
Industrial	297827	6259711	8.9E+01	8.9E+00	3.3E-01	2.2E-02	2.2E-05	2.2E-05	1.1E-11	4.4E-03
Industrial	297923	6259624	9.5E+01	9.5E+00	3.5E-01	2.4E-02	2.5E-05	2.5E-05	1.2E-11	5.0E-03
Industrial	298057	6259589	1.0E+02	1.0E+01	3.6E-01	2.6E-02	3.0E-05	3.0E-05	1.5E-11	5.9E-03
Industrial	298165	6259576	1.1E+02	1.1E+01	3.8E-01	2.7E-02	3.3E-05	3.3E-05	1.6E-11	6.6E-03
Industrial	298169	6259723	1.0E+02	1.0E+01	3.6E-01	2.6E-02	3.3E-05	3.3E-05	1.7E-11	6.6E-03
Industrial	297988	6259754	9.7E+01	9.7E+00	3.3E-01	2.4E-02	2.7E-05	2.7E-05	1.4E-11	5.5E-03
Industrial	297855	6259871	9.0E+01	9.0E+00	3.1E-01	2.2E-02	2.3E-05	2.3E-05	1.2E-11	4.7E-03
Industrial	298473	6259809	1.1E+02	1.1E+01	3.8E-01	2.8E-02	3.4E-05	3.4E-05	1.7E-11	6.8E-03
Industrial	298254	6259912	1.0E+02	1.0E+01	3.5E-01	2.6E-02	3.3E-05	3.3E-05	1.7E-11	6.7E-03
Industrial	297964	6259979	9.3E+01	9.3E+00	3.1E-01	2.3E-02	2.7E-05	2.7E-05	1.3E-11	5.3E-03
Industrial	297807	6260039	8.6E+01	8.6E+00	2.9E-01	2.1E-02	2.2E-05	2.2E-05	1.1E-11	4.5E-03
Industrial	299645	6258440	1.3E+02	1.3E+01	5.5E-01	3.2E-02	3.4E-05	3.4E-05	1.7E-11	6.9E-03
Industrial	299645	6258037	9.7E+01	9.7E+00	6.0E-01	2.4E-02	3.2E-05	3.2E-05	1.6E-11	6.5E-03
Industrial	299709	6257886	9.9E+01	9.9E+00	5.9E-01	2.5E-02	3.2E-05	3.2E-05	1.6E-11	6.4E-03
Industrial	299541	6257851	9.9E+01	9.9E+00	6.7E-01	2.5E-02	3.6E-05	3.6E-05	1.8E-11	7.2E-03
Industrial	299441	6258055	1.0E+02	1.0E+01	6.8E-01	2.5E-02	3.5E-05	3.5E-05	1.7E-11	7.0E-03
Industrial	299490	6257405	1.1E+02	1.1E+01	7.6E-01	2.8E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
Industrial	299906	6257425	9.8E+01	9.8E+00	5.2E-01	2.5E-02	2.8E-05	2.8E-05	1.4E-11	5.6E-03
Industrial	300157	6257390	8.9E+01	8.9E+00	4.4E-01	2.2E-02	2.4E-05	2.4E-05	1.2E-11	4.7E-03
Industrial	300263	6257339	8.7E+01	8.7E+00	4.1E-01	2.2E-02	2.2E-05	2.2E-05	1.1E-11	4.5E-03
Industrial	300447	6257583	6.5E+01	6.5E+00	3.8E-01	1.6E-02	2.0E-05	2.0E-05	9.9E-12	4.0E-03
Industrial	300228	6257651	7.1E+01	7.1E+00	4.3E-01	1.8E-02	2.2E-05	2.2E-05	1.1E-11	4.5E-03
Industrial	300560	6257928	9.1E+01	9.1E+00	3.6E-01	2.3E-02	1.8E-05	1.8E-05	9.0E-12	3.6E-03
Industrial	300633	6257735	7.5E+01	7.5E+00	3.5E-01	1.9E-02	1.8E-05	1.8E-05	9.0E-12	3.6E-03
Industrial	300948	6257833	7.6E+01	7.6E+00	3.0E-01	1.9E-02	1.5E-05	1.5E-05	7.5E-12	3.0E-03
Industrial	300802	6257591	5.9E+01	5.9E+00	3.2E-01	1.5E-02	1.6E-05	1.6E-05	8.0E-12	3.2E-03
Industrial	300633	6257403	7.0E+01	7.0E+00	3.4E-01	1.8E-02	1.8E-05	1.8E-05	9.1E-12	3.7E-03
Industrial	300755	6257374	6.8E+01	6.8E+00	3.2E-01	1.7E-02	1.7E-05	1.7E-05	8.4E-12	3.4E-03
Industrial	301037	6257567	5.5E+01	5.5E+00	2.9E-01	1.4E-02	1.4E-05	1.4E-05	7.0E-12	2.8E-03
Industrial	301057	6257410	6.2E+01	6.2E+00	2.8E-01	1.6E-02	1.4E-05	1.4E-05	7.2E-12	2.9E-03
Industrial	301003	6257186	7.3E+01	7.3E+00	2.9E-01	1.8E-02	1.5E-05	1.5E-05	7.4E-12	2.9E-03
Industrial	300950	6257066	7.7E+01	7.7E+00	2.9E-01	1.9E-02	1.5E-05	1.5E-05	7.6E-12	3.0E-03
Industrial	300910	6256975	7.9E+01	7.9E+00	2.9E-01	2.0E-02	1.6E-05	1.6E-05	8.0E-12	3.2E-03
Industrial	300682	6257126	7.8E+01	7.8E+00	3.3E-01	2.0E-02	1.7E-05	1.7E-05	8.5E-12	3.4E-03

Sensitive Receptor	Easting (m)	Northing (m)	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour	1 hour
			NO ₂	PM ₁₀	H ₂ S	CO	Cd	Hg	Dioxins / Furans	TOC (as benzene)
			µg/m ³	µg/m ³	µg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³	mg/m ³
			100 th	100 th	99 th	100 th	99.9 th	99.9 th	99.9 th	99.9 th
Industrial	300691	6257026	7.9E+01	7.9E+00	3.2E-01	2.0E-02	1.8E-05	1.8E-05	8.9E-12	3.6E-03
Industrial	300831	6257241	7.2E+01	7.2E+00	3.1E-01	1.8E-02	1.6E-05	1.6E-05	8.0E-12	3.2E-03
Industrial	300436	6257299	8.2E+01	8.2E+00	3.7E-01	2.1E-02	2.0E-05	2.0E-05	1.0E-11	4.0E-03
Industrial	299601	6257064	9.9E+01	9.9E+00	7.1E-01	2.5E-02	3.3E-05	3.3E-05	1.7E-11	6.6E-03
Industrial	299490	6256891	1.2E+02	1.2E+01	7.5E-01	3.0E-02	3.6E-05	3.6E-05	1.8E-11	7.3E-03
Industrial	299689	6256705	1.1E+02	1.1E+01	6.3E-01	2.8E-02	3.7E-05	3.7E-05	1.9E-11	7.5E-03
Industrial	299501	6256224	1.2E+02	1.2E+01	5.5E-01	3.0E-02	3.9E-05	3.9E-05	2.0E-11	7.8E-03
Industrial	300008	6256426	1.1E+02	1.1E+01	4.6E-01	2.8E-02	3.3E-05	3.3E-05	1.6E-11	6.6E-03
Industrial	300219	6256526	9.4E+01	9.4E+00	4.0E-01	2.4E-02	2.7E-05	2.7E-05	1.4E-11	5.4E-03
Industrial	300529	6256577	7.8E+01	7.8E+00	3.3E-01	1.9E-02	2.4E-05	2.4E-05	1.2E-11	4.8E-03
Industrial	300899	6256202	7.1E+01	7.1E+00	2.6E-01	1.8E-02	2.2E-05	2.2E-05	1.1E-11	4.4E-03
Industrial	300786	6255839	9.1E+01	9.1E+00	2.7E-01	2.3E-02	2.3E-05	2.3E-05	1.1E-11	4.6E-03
Industrial	301006	6255854	8.0E+01	8.0E+00	2.5E-01	2.0E-02	2.0E-05	2.0E-05	1.0E-11	4.1E-03
Industrial	298652	6255402	9.9E+01	9.9E+00	3.3E-01	2.5E-02	2.5E-05	2.5E-05	1.3E-11	5.1E-03
Industrial	298508	6255389	8.6E+01	8.6E+00	3.0E-01	2.2E-02	2.2E-05	2.2E-05	1.1E-11	4.5E-03
Industrial	298584	6255037	8.7E+01	8.7E+00	2.7E-01	2.2E-02	2.2E-05	2.2E-05	1.1E-11	4.3E-03
Industrial	296204	6256521	5.3E+01	5.3E+00	2.6E-01	1.3E-02	1.1E-05	1.1E-05	5.3E-12	2.1E-03
Industrial	296614	6256526	4.1E+01	4.1E+00	2.9E-01	1.0E-02	1.2E-05	1.2E-05	6.1E-12	2.4E-03
Industrial	296388	6256355	4.3E+01	4.3E+00	2.6E-01	1.1E-02	1.1E-05	1.1E-05	5.5E-12	2.2E-03
Industrial	296643	6256280	3.1E+01	3.1E+00	2.8E-01	7.9E-03	1.2E-05	1.2E-05	5.8E-12	2.3E-03
Industrial	296700	6256087	3.1E+01	3.1E+00	2.7E-01	7.7E-03	1.1E-05	1.1E-05	5.7E-12	2.3E-03
Industrial	296946	6256040	3.3E+01	3.3E+00	2.9E-01	8.2E-03	1.2E-05	1.2E-05	6.1E-12	2.4E-03
Industrial	296598	6255723	2.8E+01	2.8E+00	2.4E-01	7.1E-03	1.0E-05	1.0E-05	5.1E-12	2.0E-03
Industrial	296410	6255743	2.9E+01	2.9E+00	2.3E-01	7.2E-03	9.7E-06	9.7E-06	4.8E-12	1.9E-03
Industrial	296055	6255881	3.2E+01	3.2E+00	2.2E-01	8.1E-03	9.1E-06	9.1E-06	4.6E-12	1.8E-03
Industrial Facility (Fisher and Paykel)	299251	6258615	1.3E+02	1.3E+01	7.4E-01	3.2E-02	3.8E-05	3.8E-05	1.9E-11	7.6E-03
Commercial Land (Sargents)	298093	6258488	8.5E+01	8.5E+00	7.4E-01	2.1E-02	3.1E-05	3.1E-05	1.6E-11	6.3E-03
Commercial Land (Dept of Planning)	297926	6258109	9.5E+01	9.5E+00	8.0E-01	2.4E-02	3.4E-05	3.4E-05	1.7E-11	6.9E-03
Commercial Land (Dept of Planning)	298154	6257844	1.2E+02	1.2E+01	8.0E-01	2.9E-02	4.4E-05	4.4E-05	2.2E-11	8.7E-03
Commercial Land (Dept of Planning)	298091	6257443	9.0E+01	9.0E+00	6.8E-01	2.3E-02	3.3E-05	3.3E-05	1.6E-11	6.6E-03
Commercial Land (Dept of Planning)	298470	6257372	1.0E+02	1.0E+01	7.2E-01	2.6E-02	3.9E-05	3.9E-05	1.9E-11	7.8E-03
Commercial Land (Dept of Planning)	298175	6257034	7.5E+01	7.5E+00	6.3E-01	1.9E-02	2.9E-05	2.9E-05	1.5E-11	5.9E-03
Commercial Land (Dept of Planning)	298746	6257137	1.1E+02	1.1E+01	9.6E-01	2.8E-02	4.3E-05	4.3E-05	2.2E-11	8.7E-03
Industrial Facility (Hanson)	299072	6257670	1.1E+02	1.1E+01	7.3E-01	2.9E-02	3.5E-05	3.5E-05	1.7E-11	7.0E-03
Industrial Facility (Jacfin)	299136	6256900	1.2E+02	1.2E+01	7.4E-01	3.0E-02	4.1E-05	4.1E-05	2.1E-11	8.3E-03

Table J-6: Predicted ground level concentrations at particularly sensitive receptors – longer term averaging periods

Sensitive Receptor	Easting (m)	Northing (m)	Annual	24 hour	Annual	8 hour
			NO ₂	PM ₁₀		CO
			µg/m ³	µg/m ³		mg/m ³
			100 th	100 th		100 th
Maximum (outside site boundary)			8.4E+00	3.2E+00	8.4E-01	3.9E-02
James Erskine Primary School	296748	6257187	2.3E+00	8.4E-01	2.3E-01	5.9E-03
Eskrine Park High School	296709	6256992	2.2E+00	8.8E-01	2.2E-01	7.3E-03
Clairgate Public School	296299	6258187	2.3E+00	9.8E-01	2.3E-01	5.2E-03
Minchinbury Public School	299287	6259084	5.0E+00	1.6E+00	5.0E-01	1.7E-02
Pinegrove Memorial Park Lawn Cemetery	300567	6258692	2.4E+00	9.5E-01	2.4E-01	6.9E-03
Sunny Patch Preparation School & Long Day Care Centre	297153	6258266	3.9E+00	1.9E+00	3.9E-01	1.4E-02
Eastern Creek Public School	301201	6259319	1.8E+00	7.0E-01	1.8E-01	5.1E-03
St Agnes Catholic High School	300761	6259894	2.1E+00	7.9E-01	2.1E-01	5.7E-03
All Areas Family Day Care Pty	299581	6258986	4.3E+00	1.7E+00	4.3E-01	1.6E-02
Maria Hawey Child Care Centre	299370	6259272	4.4E+00	1.5E+00	4.4E-01	1.4E-02
Jiminey Cricket Long Day Care	298562	6259310	4.5E+00	1.5E+00	4.5E-01	9.5E-03
White Bunny Child Care Centre	299792	6259530	3.4E+00	1.3E+00	3.4E-01	1.0E-02
LITTLES MARTIES	296419	6258212	2.5E+00	1.1E+00	2.5E-01	6.0E-03
Kidz Fun Factory	298128	6259445	3.6E+00	1.2E+00	3.6E-01	8.0E-03
Closest receptors to the west (Erskine Park)	297450	6256754	2.7E+00	9.3E-01	2.7E-01	8.4E-03
	297500	6256754	2.8E+00	9.4E-01	2.8E-01	8.9E-03
	297450	6256804	2.8E+00	9.8E-01	2.8E-01	7.5E-03
	297500	6256804	2.9E+00	9.9E-01	2.9E-01	8.6E-03
	297450	6256854	2.9E+00	1.0E+00	2.9E-01	6.2E-03
	297500	6256854	2.9E+00	1.0E+00	2.9E-01	7.6E-03
	297450	6256904	2.9E+00	1.1E+00	2.9E-01	6.8E-03
	297500	6256904	3.0E+00	1.1E+00	3.0E-01	6.3E-03
	297400	6256954	2.9E+00	1.1E+00	2.9E-01	1.0E-02
	297450	6256954	3.0E+00	1.1E+00	3.0E-01	9.0E-03
	297500	6256954	3.1E+00	1.2E+00	3.1E-01	7.9E-03
	297400	6257004	3.0E+00	1.2E+00	3.0E-01	1.1E-02
	297450	6257004	3.0E+00	1.2E+00	3.0E-01	1.1E-02
	297500	6257004	3.1E+00	1.2E+00	3.1E-01	1.0E-02
	297400	6257054	3.0E+00	1.2E+00	3.0E-01	1.1E-02
	297450	6257054	3.1E+00	1.2E+00	3.1E-01	1.2E-02
	297500	6257054	3.2E+00	1.3E+00	3.2E-01	1.2E-02
	297400	6257104	3.1E+00	1.2E+00	3.1E-01	1.2E-02
	297450	6257104	3.2E+00	1.3E+00	3.2E-01	1.2E-02
	297400	6257154	3.2E+00	1.3E+00	3.2E-01	1.2E-02
297450	6257154	3.3E+00	1.3E+00	3.3E-01	1.2E-02	

297400	6257204	3.2E+00	1.3E+00	3.2E-01	1.1E-02
297450	6257204	3.3E+00	1.4E+00	3.3E-01	1.2E-02
297400	6257254	3.3E+00	1.3E+00	3.3E-01	9.8E-03
297400	6257304	3.4E+00	1.3E+00	3.4E-01	8.3E-03
297350	6257354	3.3E+00	1.3E+00	3.3E-01	7.5E-03
297400	6257354	3.4E+00	1.3E+00	3.4E-01	7.8E-03
297350	6257404	3.4E+00	1.3E+00	3.4E-01	8.3E-03
297400	6257404	3.5E+00	1.3E+00	3.5E-01	8.4E-03
297350	6257454	3.5E+00	1.3E+00	3.5E-01	8.7E-03
297400	6257454	3.6E+00	1.3E+00	3.6E-01	9.0E-03
297300	6257504	3.5E+00	1.2E+00	3.5E-01	7.6E-03
297350	6257504	3.6E+00	1.3E+00	3.6E-01	8.1E-03
297400	6257504	3.7E+00	1.4E+00	3.7E-01	8.6E-03
297300	6257554	3.5E+00	1.3E+00	3.5E-01	6.9E-03
297350	6257554	3.7E+00	1.3E+00	3.7E-01	7.0E-03
297400	6257554	3.8E+00	1.4E+00	3.8E-01	7.4E-03
297300	6257604	3.6E+00	1.3E+00	3.6E-01	8.0E-03
297350	6257604	3.7E+00	1.3E+00	3.7E-01	8.1E-03
297300	6257654	3.7E+00	1.3E+00	3.7E-01	8.9E-03
297350	6257654	3.8E+00	1.3E+00	3.8E-01	9.1E-03
297300	6257704	3.8E+00	1.3E+00	3.8E-01	9.5E-03
297350	6257704	3.9E+00	1.3E+00	3.9E-01	9.9E-03
297300	6257754	3.9E+00	1.3E+00	3.9E-01	9.8E-03
297350	6257754	4.0E+00	1.3E+00	4.0E-01	1.0E-02
297300	6257804	4.0E+00	1.3E+00	4.0E-01	9.6E-03
297350	6257804	4.1E+00	1.4E+00	4.1E-01	9.9E-03
297300	6257854	4.1E+00	1.4E+00	4.1E-01	8.9E-03
297350	6257854	4.2E+00	1.4E+00	4.2E-01	9.2E-03
297300	6257904	4.1E+00	1.4E+00	4.1E-01	8.0E-03
297250	6257954	4.0E+00	1.4E+00	4.0E-01	7.2E-03
297300	6257954	4.2E+00	1.4E+00	4.2E-01	7.6E-03
297250	6258004	4.1E+00	1.5E+00	4.1E-01	7.3E-03
297300	6258004	4.3E+00	1.6E+00	4.3E-01	7.9E-03
297250	6258054	4.1E+00	1.6E+00	4.1E-01	9.2E-03
297300	6258054	4.3E+00	1.7E+00	4.3E-01	1.0E-02
297250	6258104	4.2E+00	1.8E+00	4.2E-01	1.1E-02
297300	6258104	4.3E+00	1.8E+00	4.3E-01	1.2E-02
297250	6258154	4.2E+00	1.9E+00	4.2E-01	1.3E-02
297300	6258154	4.4E+00	1.9E+00	4.4E-01	1.4E-02
297250	6258204	4.2E+00	1.9E+00	4.2E-01	1.4E-02
297200	6258254	4.0E+00	1.9E+00	4.0E-01	1.4E-02
297250	6258254	4.2E+00	1.9E+00	4.2E-01	1.5E-02
297200	6258304	4.0E+00	1.9E+00	4.0E-01	1.4E-02
297250	6258304	4.2E+00	1.9E+00	4.2E-01	1.4E-02
297200	6258354	4.0E+00	1.9E+00	4.0E-01	1.3E-02
297250	6258354	4.2E+00	1.9E+00	4.2E-01	1.3E-02
297200	6258404	4.0E+00	1.8E+00	4.0E-01	1.3E-02

	297250	6258404	4.1E+00	1.8E+00	4.1E-01	1.4E-02
	297200	6258454	3.9E+00	1.7E+00	3.9E-01	1.3E-02
	297250	6258454	4.1E+00	1.7E+00	4.1E-01	1.4E-02
	297200	6258504	3.9E+00	1.6E+00	3.9E-01	1.3E-02
	297250	6258504	4.0E+00	1.6E+00	4.0E-01	1.3E-02
	297200	6258554	3.8E+00	1.5E+00	3.8E-01	1.2E-02
	297250	6258554	4.0E+00	1.5E+00	4.0E-01	1.2E-02
	297200	6258604	3.8E+00	1.4E+00	3.8E-01	1.2E-02
	297250	6258604	3.9E+00	1.4E+00	3.9E-01	1.1E-02
Closest receptors to the north (Minchinbury)	299461.5	6258797	4.8E+00	1.9E+00	4.8E-01	2.0E-02
	299511.5	6258797	4.7E+00	1.9E+00	4.7E-01	2.0E-02
	299561.5	6258797	4.5E+00	1.8E+00	4.5E-01	2.0E-02
	299611.5	6258797	4.4E+00	1.7E+00	4.4E-01	1.9E-02
	299661.5	6258797	4.2E+00	1.6E+00	4.2E-01	1.7E-02
	299711.5	6258797	4.0E+00	1.5E+00	4.0E-01	1.6E-02
	299761.5	6258797	3.9E+00	1.5E+00	3.9E-01	1.4E-02
	299811.5	6258797	3.7E+00	1.5E+00	3.7E-01	1.3E-02
	299211.5	6258847	5.6E+00	1.8E+00	5.6E-01	1.9E-02
	299261.5	6258847	5.4E+00	1.8E+00	5.4E-01	1.7E-02
	299311.5	6258847	5.3E+00	1.9E+00	5.3E-01	1.6E-02
	299361.5	6258847	5.1E+00	2.0E+00	5.1E-01	1.6E-02
	299411.5	6258847	5.0E+00	2.0E+00	5.0E-01	1.7E-02
	299461.5	6258847	4.8E+00	1.9E+00	4.8E-01	1.8E-02
	299511.5	6258847	4.6E+00	1.8E+00	4.6E-01	1.9E-02
	299561.5	6258847	4.5E+00	1.8E+00	4.5E-01	1.9E-02
	299611.5	6258847	4.3E+00	1.7E+00	4.3E-01	1.8E-02
	298911.5	6258897	6.2E+00	2.9E+00	6.2E-01	1.5E-02
	298961.5	6258897	6.2E+00	2.7E+00	6.2E-01	1.5E-02
	299011.5	6258897	6.1E+00	2.5E+00	6.1E-01	1.7E-02
	299061.5	6258897	6.0E+00	2.3E+00	6.0E-01	1.8E-02
	299111.5	6258897	5.8E+00	2.1E+00	5.8E-01	1.8E-02
	299161.5	6258897	5.7E+00	1.9E+00	5.7E-01	1.9E-02
	299211.5	6258897	5.5E+00	1.8E+00	5.5E-01	2.0E-02
	299261.5	6258897	5.3E+00	1.7E+00	5.3E-01	1.7E-02
	299311.5	6258897	5.2E+00	1.8E+00	5.2E-01	1.7E-02
	299361.5	6258897	5.1E+00	1.9E+00	5.1E-01	1.5E-02
	299411.5	6258897	4.9E+00	1.9E+00	4.9E-01	1.5E-02
	298411.5	6258947	5.4E+00	2.0E+00	5.4E-01	1.2E-02
	298461.5	6258947	5.5E+00	2.1E+00	5.5E-01	1.2E-02
	298511.5	6258947	5.7E+00	2.0E+00	5.7E-01	1.3E-02
	298561.5	6258947	5.8E+00	2.0E+00	5.8E-01	1.3E-02
	298611.5	6258947	5.8E+00	2.1E+00	5.8E-01	1.3E-02
	298661.5	6258947	5.9E+00	2.4E+00	5.9E-01	1.4E-02
298711.5	6258947	6.0E+00	2.7E+00	6.0E-01	1.5E-02	
298761.5	6258947	6.0E+00	2.8E+00	6.0E-01	1.6E-02	
298811.5	6258947	6.1E+00	3.0E+00	6.1E-01	1.6E-02	
298861.5	6258947	6.1E+00	3.0E+00	6.1E-01	1.6E-02	

	298911.5	6258947	6.0E+00	2.8E+00	6.0E-01	1.5E-02
	298961.5	6258947	6.0E+00	2.6E+00	6.0E-01	1.5E-02
	299011.5	6258947	5.9E+00	2.4E+00	5.9E-01	1.6E-02
	298411.5	6258997	5.2E+00	1.9E+00	5.2E-01	1.2E-02
	300111.5	6258597	3.1E+00	1.2E+00	3.1E-01	8.7E-03
	300161.5	6258597	3.0E+00	1.2E+00	3.0E-01	8.4E-03
	300211.5	6258597	2.9E+00	1.1E+00	2.9E-01	8.2E-03
	299961.5	6258647	3.4E+00	1.3E+00	3.4E-01	9.9E-03
	300011.5	6258647	3.3E+00	1.3E+00	3.3E-01	9.5E-03
	300061.5	6258647	3.2E+00	1.2E+00	3.2E-01	9.1E-03
	300111.5	6258647	3.1E+00	1.2E+00	3.1E-01	8.7E-03
	300211.5	6258647	2.9E+00	1.1E+00	2.9E-01	8.1E-03
	299811.5	6258697	3.8E+00	1.5E+00	3.8E-01	1.2E-02
	299861.5	6258697	3.6E+00	1.5E+00	3.6E-01	1.1E-02
	299911.5	6258697	3.5E+00	1.4E+00	3.5E-01	1.0E-02
	299961.5	6258697	3.4E+00	1.4E+00	3.4E-01	9.9E-03
	300011.5	6258697	3.3E+00	1.3E+00	3.3E-01	9.4E-03
	300061.5	6258697	3.2E+00	1.3E+00	3.2E-01	9.1E-03
	299661.5	6258747	4.2E+00	1.6E+00	4.2E-01	1.7E-02
	299711.5	6258747	4.0E+00	1.6E+00	4.0E-01	1.5E-02
	299761.5	6258747	3.9E+00	1.6E+00	3.9E-01	1.4E-02
	299811.5	6258747	3.7E+00	1.5E+00	3.7E-01	1.2E-02
	299861.5	6258747	3.6E+00	1.5E+00	3.6E-01	1.1E-02
	299911.5	6258747	3.5E+00	1.4E+00	3.5E-01	1.0E-02
	299961.5	6258747	3.4E+00	1.4E+00	3.4E-01	1.0E-02
	300011.5	6258747	3.3E+00	1.3E+00	3.3E-01	9.6E-03
	298361.5	6258947	5.2E+00	2.0E+00	5.2E-01	1.2E-02
	298361.5	6258997	5.1E+00	1.9E+00	5.1E-01	1.2E-02
Industrial	297743	6259085	3.7E+00	1.3E+00	3.7E-01	1.2E-02
Industrial	298017	6259102	4.1E+00	1.3E+00	4.1E-01	8.6E-03
Industrial	298262	6259157	4.4E+00	1.6E+00	4.4E-01	9.7E-03
Industrial	298362	6259444	3.9E+00	1.3E+00	3.9E-01	8.1E-03
Industrial	298106	6259473	3.5E+00	1.2E+00	3.5E-01	7.9E-03
Industrial	297650	6259598	2.8E+00	1.0E+00	2.8E-01	6.7E-03
Industrial	297391	6259845	2.4E+00	8.8E-01	2.4E-01	5.9E-03
Industrial	297425	6259607	2.7E+00	9.6E-01	2.7E-01	7.1E-03
Industrial	297528	6259706	2.6E+00	9.6E-01	2.6E-01	6.5E-03
Industrial	297827	6259711	2.9E+00	8.7E-01	2.9E-01	6.4E-03
Industrial	297923	6259624	3.1E+00	9.6E-01	3.1E-01	6.9E-03
Industrial	298057	6259589	3.3E+00	1.1E+00	3.3E-01	7.4E-03
Industrial	298165	6259576	3.4E+00	1.2E+00	3.4E-01	7.6E-03
Industrial	298169	6259723	3.2E+00	1.1E+00	3.2E-01	7.2E-03
Industrial	297988	6259754	3.0E+00	9.5E-01	3.0E-01	6.8E-03
Industrial	297855	6259871	2.7E+00	8.3E-01	2.7E-01	6.2E-03
Industrial	298473	6259809	3.4E+00	1.1E+00	3.4E-01	7.2E-03
Industrial	298254	6259912	3.1E+00	1.0E+00	3.1E-01	6.6E-03
Industrial	297964	6259979	2.7E+00	8.4E-01	2.7E-01	6.3E-03

Industrial	297807	6260039	2.5E+00	7.8E-01	2.5E-01	5.8E-03
Industrial	299645	6258440	4.3E+00	1.7E+00	4.3E-01	1.3E-02
Industrial	299645	6258037	4.3E+00	1.5E+00	4.3E-01	1.4E-02
Industrial	299709	6257886	4.2E+00	2.0E+00	4.2E-01	1.5E-02
Industrial	299541	6257851	4.7E+00	2.3E+00	4.7E-01	1.8E-02
Industrial	299441	6258055	5.0E+00	1.8E+00	5.0E-01	1.3E-02
Industrial	299490	6257405	5.5E+00	2.7E+00	5.5E-01	1.9E-02
Industrial	299906	6257425	4.0E+00	2.0E+00	4.0E-01	1.2E-02
Industrial	300157	6257390	3.4E+00	1.7E+00	3.4E-01	9.0E-03
Industrial	300263	6257339	3.2E+00	1.5E+00	3.2E-01	8.5E-03
Industrial	300447	6257583	2.7E+00	1.4E+00	2.7E-01	7.3E-03
Industrial	300228	6257651	3.1E+00	1.6E+00	3.1E-01	8.6E-03
Industrial	300560	6257928	2.5E+00	1.1E+00	2.5E-01	6.4E-03
Industrial	300633	6257735	2.4E+00	1.1E+00	2.4E-01	6.4E-03
Industrial	300948	6257833	2.1E+00	8.7E-01	2.1E-01	5.2E-03
Industrial	300802	6257591	2.3E+00	1.1E+00	2.3E-01	5.7E-03
Industrial	300633	6257403	2.5E+00	1.3E+00	2.5E-01	6.4E-03
Industrial	300755	6257374	2.4E+00	1.2E+00	2.4E-01	5.8E-03
Industrial	301037	6257567	2.1E+00	9.7E-01	2.1E-01	4.9E-03
Industrial	301057	6257410	2.1E+00	9.9E-01	2.1E-01	4.9E-03
Industrial	301003	6257186	2.2E+00	9.9E-01	2.2E-01	4.8E-03
Industrial	300950	6257066	2.2E+00	9.6E-01	2.2E-01	5.5E-03
Industrial	300910	6256975	2.3E+00	9.2E-01	2.3E-01	5.8E-03
Industrial	300682	6257126	2.5E+00	1.1E+00	2.5E-01	6.6E-03
Industrial	300691	6257026	2.5E+00	1.0E+00	2.5E-01	6.8E-03
Industrial	300831	6257241	2.3E+00	1.1E+00	2.3E-01	5.3E-03
Industrial	300436	6257299	2.8E+00	1.4E+00	2.8E-01	7.3E-03
Industrial	299601	6257064	4.9E+00	2.2E+00	4.9E-01	2.8E-02
Industrial	299490	6256891	5.0E+00	2.1E+00	5.0E-01	3.0E-02
Industrial	299689	6256705	4.2E+00	1.8E+00	4.2E-01	2.6E-02
Industrial	299501	6256224	3.9E+00	1.3E+00	3.9E-01	1.7E-02
Industrial	300008	6256426	3.3E+00	1.5E+00	3.3E-01	2.1E-02
Industrial	300219	6256526	3.0E+00	1.1E+00	3.0E-01	1.7E-02
Industrial	300529	6256577	2.7E+00	9.7E-01	2.7E-01	1.2E-02
Industrial	300899	6256202	2.2E+00	7.5E-01	2.2E-01	1.0E-02
Industrial	300786	6255839	2.2E+00	8.9E-01	2.2E-01	9.2E-03
Industrial	301006	6255854	2.0E+00	7.1E-01	2.0E-01	1.1E-02
Industrial	298652	6255402	2.8E+00	9.5E-01	2.8E-01	1.5E-02
Industrial	298508	6255389	2.6E+00	8.3E-01	2.6E-01	9.8E-03
Industrial	298584	6255037	2.4E+00	7.9E-01	2.4E-01	1.2E-02
Industrial	296204	6256521	1.6E+00	7.2E-01	1.6E-01	6.5E-03
Industrial	296614	6256526	1.8E+00	7.6E-01	1.8E-01	7.8E-03
Industrial	296388	6256355	1.7E+00	6.8E-01	1.7E-01	7.5E-03
Industrial	296643	6256280	1.8E+00	6.3E-01	1.8E-01	4.0E-03
Industrial	296700	6256087	1.7E+00	5.9E-01	1.7E-01	6.5E-03
Industrial	296946	6256040	1.8E+00	6.2E-01	1.8E-01	4.1E-03
Industrial	296598	6255723	1.5E+00	5.3E-01	1.5E-01	3.6E-03

Industrial	296410	6255743	1.4E+00	5.1E-01	1.4E-01	5.9E-03
Industrial	296055	6255881	1.4E+00	4.9E-01	1.4E-01	3.1E-03
Industrial Facility (Fisher and Paykel)	299251	6258615	5.8E+00	2.3E+00	5.8E-01	2.3E-02
Commercial Land (Sargents)	298093	6258488	6.3E+00	2.3E+00	6.3E-01	1.8E-02
Commercial Land (Dept of Planning)	297926	6258109	7.5E+00	2.7E+00	7.5E-01	1.9E-02
Commercial Land (Dept of Planning)	298154	6257844	8.3E+00	2.8E+00	8.3E-01	1.8E-02
Commercial Land (Dept of Planning)	298091	6257443	5.7E+00	2.6E+00	5.7E-01	1.4E-02
Commercial Land (Dept of Planning)	298470	6257372	7.2E+00	2.5E+00	7.2E-01	1.7E-02
Commercial Land (Dept of Planning)	298175	6257034	4.8E+00	1.7E+00	4.8E-01	1.1E-02
Commercial Land (Dept of Planning)	298746	6257137	8.4E+00	3.2E+00	8.4E-01	3.9E-02
Industrial Facility (Hanson)	299072	6257670	6.9E+00	2.3E+00	6.9E-01	1.5E-02
Industrial Facility (Jacfin)	299136	6256900	6.2E+00	2.3E+00	6.2E-01	2.7E-02

